

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P909467

Luminaire Tested: DFN2DIP-SQ4F0-080D060US840-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P909467
REPORT IS A COMBINATION OF REPORTS P901584 AND P898471
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-080D060US840-RLLONL
Description: 4 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 12865.7 lumens
Efficiency: N/A
Efficacy: 110.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 116.6
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9954
Total Harmonic Distortion (THDi): 0.076
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P909467

CATALOG NUMBER: DFN2DIP-SQ4F0-080D060US840-RLLONL

Luminous Intensity Polar Plot

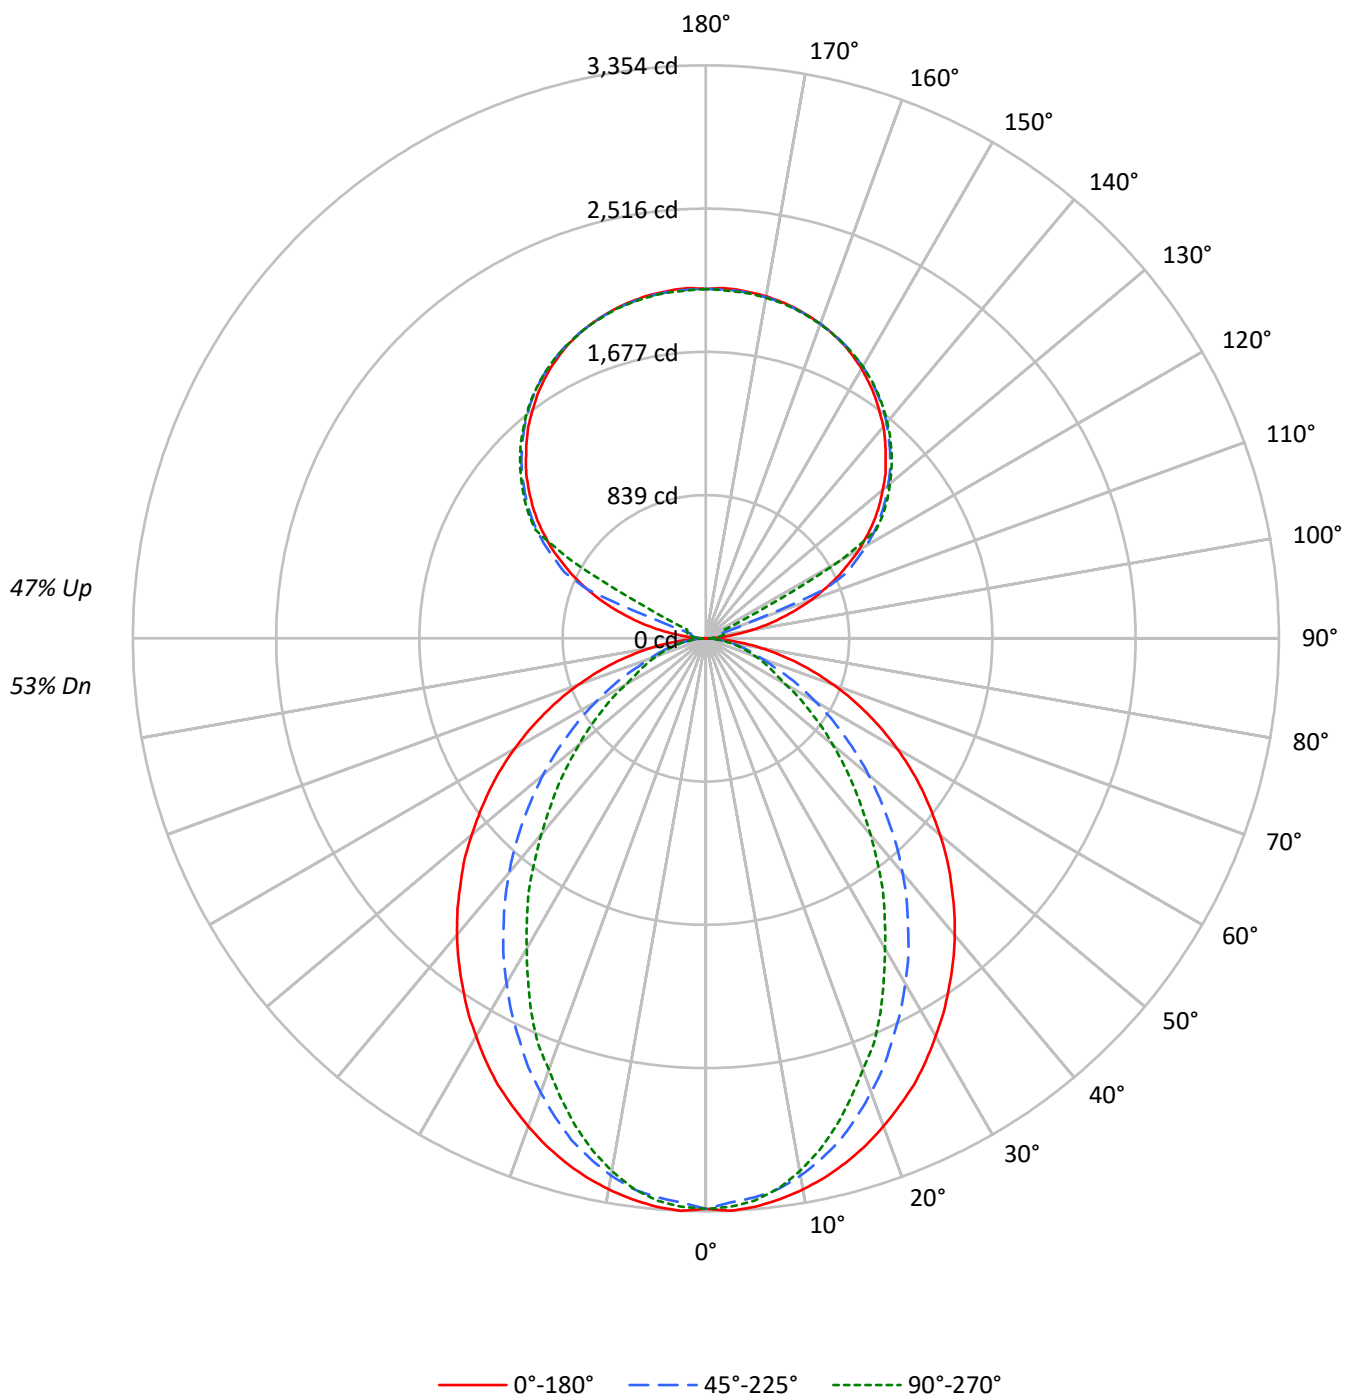

TEST NUMBER: P909467

CATALOG NUMBER: DFN2DIP-SQ4F0-080D060US840-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	85	85	85	72	72	72	59	59	59
1	99	95	91	88	92	88	85	82	76	73	71	64	62	61	53	52	51
2	91	83	78	73	84	78	73	68	67	63	60	57	54	52	47	45	44
3	83	74	67	61	77	69	63	58	59	55	51	51	47	44	42	40	38
4	76	66	58	52	70	61	55	49	53	48	44	45	42	38	38	35	33
5	70	59	51	45	65	55	48	43	48	42	38	41	37	34	35	32	29
6	65	53	45	39	60	50	43	37	43	38	34	37	33	30	32	28	26
7	60	48	40	35	56	45	38	33	39	34	30	34	30	26	29	26	23
8	56	44	36	31	52	41	34	29	36	31	27	31	27	24	27	24	21
9	52	40	33	28	48	38	31	26	33	28	24	29	25	22	25	22	19
10	49	37	30	25	45	35	28	24	31	25	22	27	23	20	23	20	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2343	2343	2343
5°	2347	2306	2321
10°	2323	2261	2246
15°	2291	2187	2130
20°	2249	2085	1987
25°	2206	1969	1849
30°	2147	1851	1674
35°	2090	1724	1521
40°	2032	1593	1344
45°	1965	1447	1184
50°	1895	1300	1028
55°	1822	1142	878
60°	1738	978	723
65°	1641	810	651
70°	1524	654	591
75°	1376	578	539
80°	1162	486	469
85°	810	327	358

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1965 cd/sqm

TEST NUMBER: P909467

CATALOG NUMBER: DFN2DIP-SQ4F0-080D060US840-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	312.9	2.4
10°-20°	859.1	6.7
20°-30°	1206.1	9.4
30°-40°	1314.7	10.2
40°-50°	1208.4	9.4
50°-60°	949.0	7.4
60°-70°	617.7	4.8
70°-80°	318.0	2.5
80°-90°	84.8	0.7
90°-100°	67.4	0.5
100°-110°	251.4	2.0
110°-120°	666.7	5.2
120°-130°	1105.7	8.6
130°-140°	1174.5	9.1
140°-150°	1091.6	8.5
150°-160°	877.6	6.8
160°-170°	565.5	4.4
170°-180°	194.6	1.5
0°-30°	2378.1	18.5
0°-40°	3692.9	28.7
0°-60°	5850.2	45.5
0°-90°	6870.7	53.4
90°-120°	985.5	7.7
90°-150°	4357.2	33.9
90°-180°	5995.0	46.6
0°-180°	12865.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3339	3339	3339	3339	3339	
5°	3339	3324	3284	3312	3303	317
15°	3176	3142	3040	2982	2952	895
25°	2883	2786	2587	2463	2417	1326
35°	2484	2330	2064	1874	1807	1555
45°	2031	1828	1511	1296	1224	1568
55°	1544	1308	982	801	744	1380
65°	1043	798	526	423	414	1034
75°	556	344	242	221	218	588
85°	130	66	57	57	57	149
90°	1	18	30	37	40	12
95°	96	47	58	65	64	114
105°	450	494	90	106	112	481
115°	851	876	913	228	121	838
125°	1203	1222	1250	1261	1265	1073
135°	1489	1512	1526	1540	1537	1150
145°	1727	1725	1750	1761	1753	1080
155°	1901	1888	1906	1915	1903	876
165°	2004	1995	1999	2009	1999	566
175°	2049	2039	2042	2052	2038	195
180°	2045	2045	2045	2045	2045	

TEST NUMBER: P909467

CATALOG NUMBER: DFN2DIP-SQ4F0-080D060US840-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3339.0	3339.0	3339.0	3339.0	3339.0
2.5°	3354.1	3339.0	3305.7	3336.1	3330.0
5°	3339.0	3324.0	3284.5	3311.8	3302.8
7.5°	3311.8	3293.8	3251.5	3263.4	3248.2
10°	3275.5	3254.4	3194.1	3184.8	3166.8
12.5°	3230.4	3203.1	3121.3	3103.3	3070.0
15°	3175.8	3142.5	3039.9	2982.5	2952.3
17.5°	3112.3	3063.9	2937.0	2870.6	2822.2
20°	3039.9	2979.3	2828.3	2753.0	2686.2
22.5°	2961.3	2891.7	2716.4	2613.8	2568.6
25°	2882.8	2786.0	2586.6	2462.9	2417.3
27.5°	2789.1	2686.2	2465.7	2323.7	2254.1
30°	2689.5	2574.3	2332.7	2178.8	2097.0
32.5°	2592.6	2453.6	2206.1	2024.6	1948.9
35°	2484.0	2329.8	2064.0	1873.6	1806.9
37.5°	2378.1	2211.8	1931.0	1722.2	1646.9
40°	2266.3	2085.2	1791.8	1577.3	1498.7
42.5°	2151.5	1958.2	1652.9	1429.3	1353.8
45°	2030.6	1828.1	1511.0	1296.2	1223.8
47.5°	1915.9	1701.4	1375.0	1160.2	1093.9
50°	1788.9	1574.5	1242.0	1033.3	970.1
52.5°	1664.9	1438.1	1115.0	915.6	858.3
55°	1544.0	1308.4	982.0	800.8	743.5
57.5°	1420.3	1178.5	864.3	695.1	646.6
60°	1293.2	1051.6	740.2	586.3	538.0
62.5°	1169.5	927.8	634.5	489.6	465.5
65°	1042.6	797.6	525.7	423.2	413.8
67.5°	921.7	676.8	423.2	371.5	362.6
70°	794.8	559.2	350.4	320.2	308.1
72.5°	673.9	450.1	293.1	269.0	262.9
75°	555.9	344.4	241.8	220.6	217.7
77.5°	438.3	244.6	190.5	178.2	172.2
80°	329.2	175.4	144.9	133.0	133.0
82.5°	229.5	118.0	99.7	93.6	93.6
85°	129.9	66.3	57.4	57.4	57.4
87.5°	48.4	24.0	24.0	21.2	21.2
90°	1.4	17.8	29.5	37.1	39.9
92.5°	37.1	31.1	35.4	38.5	39.9
95°	96.1	47.3	57.7	65.2	63.6
97.5°	173.1	51.8	75.3	80.0	81.4
100°	262.0	59.2	84.3	96.1	99.1
102.5°	359.5	356.7	87.4	103.5	108.1
105°	449.8	494.2	90.3	106.4	112.5
107.5°	554.9	591.8	93.3	109.5	115.4
110°	655.6	686.5	259.0	111.1	116.8

TEST NUMBER: P909467

CATALOG NUMBER: DFN2DIP-SQ4F0-080D060US840-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	750.2	776.8	751.6	113.8	118.5
115°	850.8	876.0	913.0	227.9	121.4
117.5°	938.1	967.7	992.9	781.2	393.5
120°	1035.8	1057.9	1084.7	1102.4	902.6
122.5°	1118.5	1142.3	1171.9	1180.7	1182.4
125°	1203.0	1222.2	1250.3	1260.7	1265.1
127.5°	1279.9	1300.6	1322.9	1337.7	1339.1
130°	1352.4	1376.1	1392.3	1408.7	1407.2
132.5°	1426.4	1445.7	1461.9	1475.2	1473.8
135°	1488.6	1512.4	1525.5	1540.4	1537.4
137.5°	1553.6	1571.4	1586.3	1601.0	1596.7
140°	1617.2	1629.2	1645.4	1658.7	1651.3
142.5°	1670.6	1681.0	1700.2	1711.9	1704.6
145°	1726.9	1725.3	1750.4	1760.8	1753.4
147.5°	1775.5	1771.1	1796.2	1803.6	1797.9
150°	1823.0	1812.6	1836.3	1845.1	1837.8
152.5°	1862.9	1851.1	1873.2	1882.2	1871.8
155°	1901.4	1888.1	1905.9	1914.7	1902.9
157.5°	1932.5	1920.7	1934.0	1944.4	1932.5
160°	1959.1	1950.2	1959.1	1967.9	1957.6
162.5°	1982.7	1973.9	1981.3	1991.7	1978.3
165°	2003.5	1994.7	1999.0	2009.4	1999.0
167.5°	2019.7	2010.8	2015.4	2025.8	2012.4
170°	2033.2	2024.2	2027.2	2037.5	2024.2
172.5°	2041.9	2033.2	2036.1	2046.5	2033.2
175°	2049.3	2038.9	2041.9	2052.2	2037.5
177.5°	2052.2	2041.9	2043.5	2053.9	2040.5
180°	2044.9	2044.9	2044.9	2044.9	2044.9

TEST NUMBER: P909467

CATALOG NUMBER: DFN2DIP-SQ4F0-080D060US840-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.43	11.29	11.36	12.24	13.46	6.39	7.25	7.33	8.20	9.42
	3H	12.11	12.88	13.06	13.84	15.09	7.58	8.35	8.53	9.31	10.55
	4H	12.73	13.45	13.69	14.41	15.67	8.03	8.76	9.00	9.72	10.98
	6H	13.15	13.82	14.13	14.79	16.06	8.36	9.03	9.33	9.99	11.26
	8H	13.28	13.92	14.26	14.90	16.17	8.45	9.08	9.43	10.07	11.33
	12H	13.35	13.95	14.33	14.93	16.22	8.49	9.10	9.48	10.07	11.37
4H	2H	10.45	11.18	11.42	12.14	13.40	6.99	7.72	7.96	8.68	9.94
	3H	12.29	12.89	13.26	13.88	15.15	8.35	8.95	9.32	9.94	11.21
	4H	12.99	13.54	13.97	14.52	15.82	8.90	9.45	9.88	10.43	11.73
	6H	13.51	13.98	14.50	14.99	16.28	9.32	9.79	10.31	10.80	12.09
	8H	13.68	14.13	14.68	15.13	16.43	9.45	9.89	10.44	10.89	12.20
	12H	13.78	14.18	14.80	15.20	16.51	9.51	9.91	10.53	10.93	12.24
8H	4H	12.96	13.40	13.95	14.40	15.71	9.18	9.62	10.18	10.62	11.93
	6H	13.53	13.89	14.55	14.93	16.24	9.70	10.07	10.72	11.11	12.41
	8H	13.75	14.07	14.78	15.10	16.42	9.89	10.21	10.92	11.24	12.57
	12H	13.89	14.17	14.92	15.20	16.57	10.01	10.30	11.05	11.32	12.69
12H	4H	12.91	13.31	13.92	14.32	15.64	9.19	9.59	10.20	10.60	11.92
	6H	13.50	13.82	14.53	14.85	16.18	9.75	10.07	10.78	11.10	12.43
	8H	13.73	14.01	14.76	15.03	16.40	9.96	10.25	11.00	11.27	12.64

END OF REPORT