

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P909469

Luminaire Tested: DFN2DIP-SQ4F0-080D070US840-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P909469
REPORT IS A COMBINATION OF REPORTS P901601 AND P898471
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-080D070US840-FLLONL
Description: 4 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 14996.6 lumens
Efficiency: N/A
Efficacy: 121.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 123.6
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9954
Total Harmonic Distortion (THDi): 0.076
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P909469

CATALOG NUMBER: DFN2DIP-SQ4F0-080D070US840-FLLONL

Luminous Intensity Polar Plot

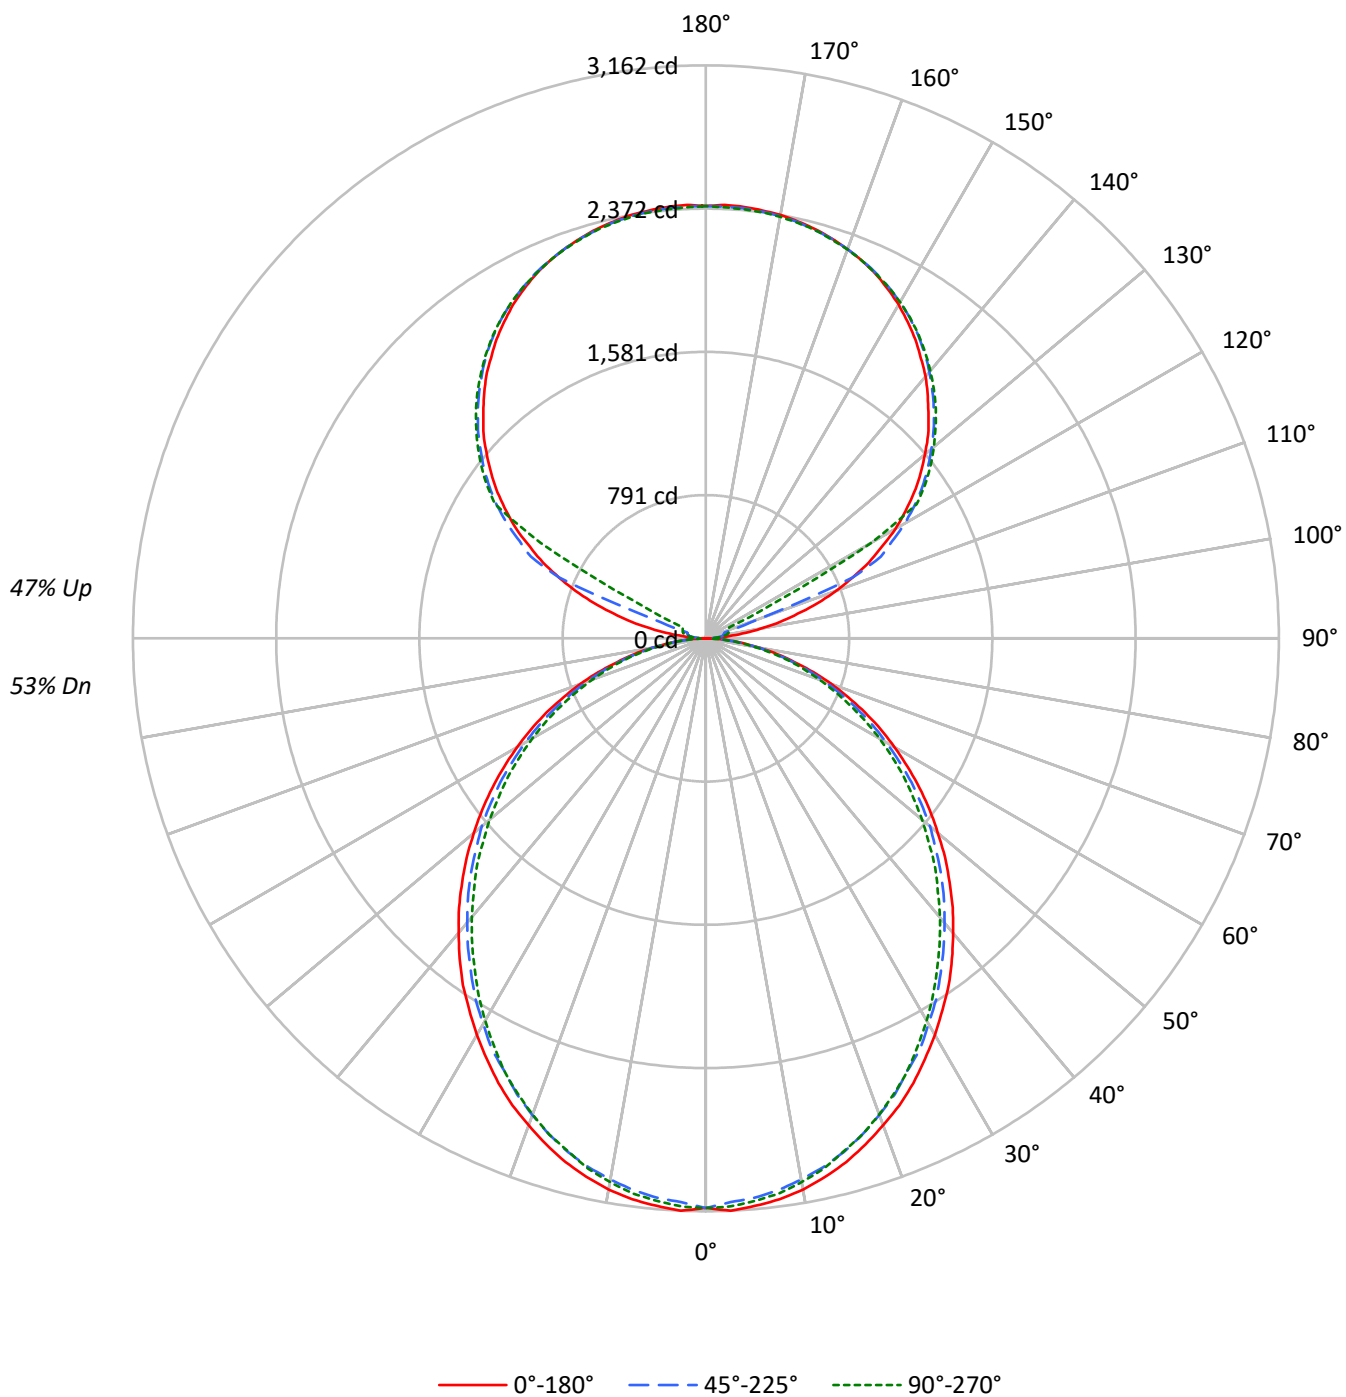

TEST NUMBER: P909469

CATALOG NUMBER: DFN2DIP-SQ4F0-080D070US840-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	108	108	108	108	100	100	100	100	85	85	85		72	72	72		59
1	99	94	90	87	91	87	84	81	75	72	70		63	61	60		52
2	90	82	76	71	83	76	71	66	65	61	58		55	52	50		46
3	82	72	65	59	76	67	61	56	58	53	49		49	45	42		41
4	75	64	56	50	69	60	53	47	51	46	42		44	40	36		37
5	69	57	49	43	63	53	46	41	46	40	36		39	35	31		33
6	63	51	43	37	59	48	41	35	41	36	31		35	31	28		30
7	59	46	38	33	54	43	36	31	38	32	28		32	28	24		27
8	54	42	34	29	50	39	32	27	34	29	25		30	25	22		25
9	51	38	31	26	47	36	29	25	31	26	22		27	23	20		23
10	47	35	28	23	44	33	26	22	29	24	20		25	21	18		21

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2206	2206	2206
5°	2209	2176	2190
10°	2191	2147	2161
15°	2159	2112	2116
20°	2115	2063	2069
25°	2072	2005	2015
30°	2018	1951	1945
35°	1966	1887	1872
40°	1903	1822	1803
45°	1840	1757	1732
50°	1771	1689	1649
55°	1698	1611	1573
60°	1617	1517	1487
65°	1528	1421	1385
70°	1414	1303	1275
75°	1257	1163	1175
80°	1068	983	981
85°	772	673	659

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1840 cd/sqm

TEST NUMBER: P909469

CATALOG NUMBER: DFN2DIP-SQ4F0-080D070US840-FLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	295.9	2.0
10°-20°	832.5	5.6
20°-30°	1223.4	8.2
30°-40°	1420.9	9.5
40°-50°	1419.1	9.5
50°-60°	1237.5	8.3
60°-70°	914.7	6.1
70°-80°	517.6	3.5
80°-90°	140.8	0.9
90°-100°	78.7	0.5
100°-110°	293.3	2.0
110°-120°	777.8	5.2
120°-130°	1290.0	8.6
130°-140°	1370.3	9.1
140°-150°	1273.5	8.5
150°-160°	1023.9	6.8
160°-170°	659.7	4.4
170°-180°	227.1	1.5
0°-30°	2351.8	15.7
0°-40°	3772.7	25.2
0°-60°	6429.3	42.9
0°-90°	8002.4	53.4
90°-120°	1149.7	7.7
90°-150°	5083.5	33.9
90°-180°	6994.0	46.6
0°-180°	14996.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3144	3144	3144	3144	3144	
5°	3144	3132	3098	3122	3117	298
15°	2992	2975	2935	2947	2932	843
25°	2708	2684	2633	2639	2633	1246
35°	2337	2306	2258	2240	2225	1459
45°	1902	1880	1835	1802	1790	1467
55°	1439	1421	1384	1348	1333	1287
65°	970	952	922	895	880	959
75°	508	502	487	469	475	542
85°	124	121	118	109	106	138
90°	2	21	34	43	47	14
95°	112	55	67	76	74	133
105°	525	577	105	124	131	561
115°	993	1022	1065	266	142	977
125°	1403	1426	1459	1471	1476	1252
135°	1737	1764	1780	1797	1794	1342
145°	2015	2013	2042	2054	2046	1260
155°	2218	2203	2224	2234	2220	1022
165°	2337	2327	2332	2344	2332	660
175°	2391	2379	2382	2394	2377	228
180°	2386	2386	2386	2386	2386	

TEST NUMBER: P909469

CATALOG NUMBER: DFN2DIP-SQ4F0-080D070US840-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3143.5	3143.5	3143.5	3143.5	3143.5
2.5°	3161.8	3146.7	3113.4	3143.5	3137.8
5°	3143.5	3131.7	3098.4	3122.4	3116.6
7.5°	3122.4	3104.4	3071.1	3095.4	3089.4
10°	3089.4	3068.2	3031.9	3056.0	3047.1
12.5°	3043.8	3025.9	2989.6	3004.7	2998.6
15°	2992.5	2974.6	2935.1	2947.3	2932.2
17.5°	2929.0	2911.0	2871.6	2886.7	2871.6
20°	2859.4	2841.5	2799.1	2808.1	2796.2
22.5°	2790.2	2762.9	2723.4	2723.4	2717.3
25°	2708.4	2684.3	2633.0	2638.8	2633.0
27.5°	2617.6	2596.5	2557.3	2548.3	2533.2
30°	2527.2	2502.7	2457.6	2448.6	2436.4
32.5°	2430.3	2412.4	2363.9	2345.6	2333.5
35°	2336.6	2306.5	2258.1	2239.8	2224.7
37.5°	2230.8	2203.5	2155.2	2133.9	2118.9
40°	2122.1	2097.7	2049.3	2022.4	2010.1
42.5°	2016.3	1991.9	1943.8	1913.3	1895.4
45°	1901.5	1880.3	1834.7	1801.7	1789.6
47.5°	1789.6	1768.4	1719.9	1686.6	1668.6
50°	1671.5	1656.5	1614.1	1571.8	1556.7
52.5°	1556.7	1535.5	1496.4	1463.1	1441.9
55°	1439.0	1420.7	1384.5	1348.3	1333.1
57.5°	1321.0	1306.0	1266.5	1230.2	1218.0
60°	1203.0	1191.1	1148.7	1115.4	1106.4
62.5°	1088.1	1067.0	1036.8	1006.7	994.5
65°	970.5	952.2	922.0	894.7	879.7
67.5°	849.5	834.1	807.2	786.1	773.9
70°	737.6	725.4	698.2	677.0	665.1
72.5°	622.8	610.7	595.5	574.4	565.4
75°	507.7	501.9	486.6	468.6	474.6
77.5°	405.1	392.8	386.8	377.8	368.8
80°	302.5	299.2	293.2	284.2	278.0
82.5°	205.6	205.6	202.7	190.5	190.5
85°	123.8	120.9	118.1	108.8	105.8
87.5°	54.5	48.5	42.3	33.3	30.2
90°	1.6	20.7	34.4	43.2	46.6
92.5°	43.2	36.3	41.4	44.9	46.6
95°	112.1	55.1	67.3	76.0	74.2
97.5°	201.9	60.5	88.0	93.3	94.9
100°	305.7	69.1	98.4	112.1	115.6
102.5°	419.4	416.2	101.9	120.8	126.0
105°	524.8	576.6	105.3	124.2	131.2
107.5°	647.3	690.4	108.9	127.7	134.7
110°	764.9	800.9	302.2	129.6	136.3



TEST NUMBER: P909469

CATALOG NUMBER: DFN2DIP-SQ4F0-080D070US840-FLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	875.4	906.3	877.0	132.8	138.1
115°	992.6	1021.9	1065.1	265.9	141.7
117.5°	1094.5	1128.9	1158.4	911.4	459.2
120°	1208.4	1234.3	1265.5	1286.2	1053.1
122.5°	1304.9	1332.6	1367.4	1377.6	1379.4
125°	1403.4	1425.9	1458.8	1470.9	1475.9
127.5°	1493.2	1517.3	1543.4	1560.6	1562.3
130°	1577.8	1605.5	1624.4	1643.5	1641.8
132.5°	1664.2	1686.7	1705.6	1721.1	1719.5
135°	1736.7	1764.3	1779.8	1797.2	1793.7
137.5°	1812.5	1833.3	1850.7	1867.9	1862.8
140°	1886.7	1900.7	1919.6	1935.1	1926.5
142.5°	1949.0	1961.2	1983.5	1997.2	1988.6
145°	2014.7	2012.9	2042.2	2054.3	2045.7
147.5°	2071.4	2066.4	2095.7	2104.3	2097.5
150°	2126.8	2114.8	2142.4	2152.6	2144.0
152.5°	2173.3	2159.6	2185.5	2195.9	2183.8
155°	2218.3	2202.8	2223.5	2233.8	2220.1
157.5°	2254.5	2240.8	2256.3	2268.5	2254.5
160°	2285.7	2275.2	2285.7	2295.9	2283.8
162.5°	2313.2	2302.9	2311.5	2323.6	2308.0
165°	2337.3	2327.1	2332.2	2344.3	2332.2
167.5°	2356.4	2345.9	2351.3	2363.4	2347.8
170°	2372.0	2361.6	2365.0	2377.1	2361.6
172.5°	2382.3	2372.0	2375.5	2387.5	2372.0
175°	2390.9	2378.7	2382.3	2394.3	2377.1
177.5°	2394.3	2382.3	2384.1	2396.2	2380.6
180°	2385.7	2385.7	2385.7	2385.7	2385.7

TEST NUMBER: P909469

CATALOG NUMBER: DFN2DIP-SQ4F0-080D070US840-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.34	11.23	11.27	12.18	13.40	9.89	10.79	10.82	11.73	12.95
	3H	12.01	12.81	12.94	13.76	15.01	11.52	12.32	12.45	13.27	14.52
	4H	12.60	13.35	13.55	14.31	15.57	12.10	12.86	13.06	13.82	15.07
	6H	13.00	13.70	13.97	14.67	15.93	12.50	13.20	13.47	14.16	15.43
	8H	13.11	13.77	14.08	14.76	16.02	12.61	13.27	13.58	14.25	15.52
	12H	13.16	13.79	14.14	14.77	16.06	12.65	13.28	13.63	14.26	15.55
4H	2H	10.80	11.56	11.76	12.52	13.78	10.45	11.21	11.41	12.17	13.42
	3H	12.68	13.31	13.65	14.30	15.57	12.27	12.90	13.24	13.89	15.16
	4H	13.40	13.97	14.37	14.96	16.25	12.97	13.55	13.95	14.53	15.83
	6H	13.92	14.42	14.91	15.42	16.71	13.49	13.98	14.48	14.99	16.28
	8H	14.07	14.54	15.06	15.54	16.84	13.63	14.10	14.62	15.10	16.40
	12H	14.15	14.57	15.16	15.58	16.89	13.70	14.12	14.71	15.13	16.44
8H	4H	13.60	14.06	14.59	15.06	16.37	13.22	13.68	14.21	14.68	15.99
	6H	14.23	14.62	15.25	15.66	16.96	13.85	14.23	14.87	15.28	16.58
	8H	14.46	14.80	15.48	15.82	17.15	14.06	14.40	15.09	15.43	16.75
	12H	14.59	14.89	15.62	15.91	17.28	14.18	14.48	15.21	15.50	16.87
12H	4H	13.58	14.00	14.59	15.02	16.33	13.22	13.64	14.23	14.65	15.96
	6H	14.26	14.60	15.29	15.63	16.95	13.89	14.23	14.92	15.26	16.58
	8H	14.51	14.81	15.54	15.83	17.20	14.13	14.43	15.16	15.45	16.82

END OF REPORT