

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P909483

Luminaire Tested: DFN2DIP-SQ4F0-080D100US840-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P909483
REPORT IS A COMBINATION OF REPORTS P901656 AND P898471
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-080D100US840-RLLONL
Description: 4 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 16864.8 lumens
Efficiency: N/A
Efficacy: 115.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 146.1
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9954
Total Harmonic Distortion (THDi): 0.076
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P909483

CATALOG NUMBER: DFN2DIP-SQ4F0-080D100US840-RLLONL

Luminous Intensity Polar Plot

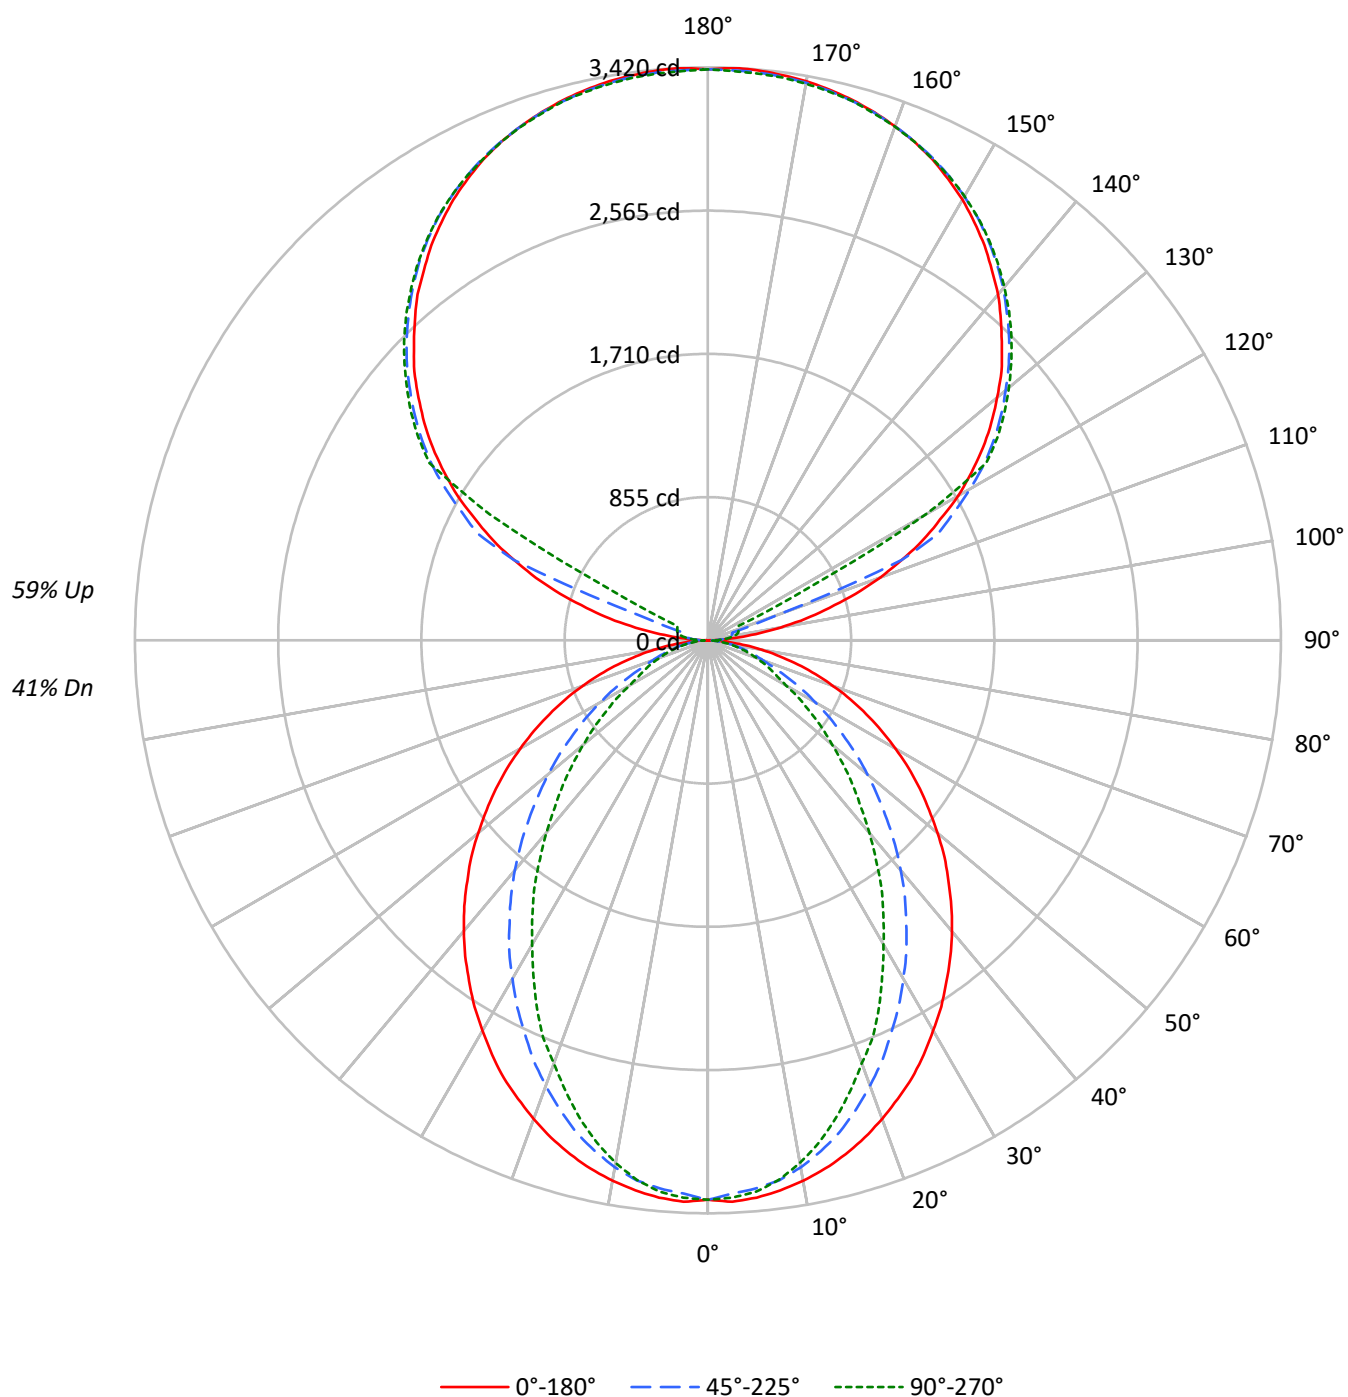

TEST NUMBER: P909483

CATALOG NUMBER: DFN2DIP-SQ4F0-080D100US840-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	96	96	96	96	78	78	78	62	62	62	48	48	48
1	96	92	88	85	87	84	81	78	69	67	65	55	54	53	43	42	41
2	88	81	75	70	80	74	69	65	61	57	54	49	47	44	38	36	35
3	80	71	64	59	73	65	59	54	54	50	46	44	41	38	34	32	30
4	74	63	56	50	67	58	52	46	48	43	40	39	36	33	31	28	26
5	68	57	49	43	62	52	45	40	43	38	34	35	32	29	28	25	23
6	62	51	43	37	57	47	40	35	39	34	30	32	28	25	25	23	21
7	58	46	38	33	53	42	36	31	36	30	27	29	25	23	23	21	19
8	54	42	34	29	49	39	32	27	33	27	24	27	23	20	21	19	17
9	50	38	31	26	46	35	29	24	30	25	21	25	21	18	20	17	15
10	47	35	28	23	43	32	26	22	28	23	19	23	19	17	18	16	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2343	2343	2343
5°	2347	2306	2321
10°	2323	2261	2246
15°	2291	2187	2130
20°	2249	2085	1987
25°	2206	1969	1849
30°	2147	1851	1674
35°	2090	1724	1521
40°	2032	1593	1344
45°	1965	1447	1184
50°	1895	1300	1028
55°	1822	1142	878
60°	1738	978	723
65°	1641	810	651
70°	1524	654	591
75°	1376	578	539
80°	1162	486	469
85°	810	327	358

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1965 cd/sqm

TEST NUMBER: P909483

CATALOG NUMBER: DFN2DIP-SQ4F0-080D100US840-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	312.9	1.9
10°-20°	859.1	5.1
20°-30°	1206.1	7.2
30°-40°	1314.7	7.8
40°-50°	1208.4	7.2
50°-60°	949.0	5.6
60°-70°	617.7	3.7
70°-80°	318.0	1.9
80°-90°	87.2	0.5
90°-100°	112.4	0.7
100°-110°	418.9	2.5
110°-120°	1111.1	6.6
120°-130°	1842.9	10.9
130°-140°	1957.5	11.6
140°-150°	1819.3	10.8
150°-160°	1462.7	8.7
160°-170°	942.5	5.6
170°-180°	324.4	1.9
0°-30°	2378.1	14.1
0°-40°	3692.9	21.9
0°-60°	5850.2	34.7
0°-90°	6873.1	40.8
90°-120°	1642.4	9.7
90°-150°	7262.1	43.1
90°-180°	9992.0	59.2
0°-180°	16864.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3339	3339	3339	3339	3339	
5°	3339	3324	3284	3312	3303	317
15°	3176	3142	3040	2982	2952	895
25°	2883	2786	2587	2463	2417	1326
35°	2484	2330	2064	1874	1807	1555
45°	2031	1828	1511	1296	1224	1568
55°	1544	1308	982	801	744	1380
65°	1043	798	526	423	414	1034
75°	556	344	242	221	218	588
85°	130	66	57	57	57	149
90°	2	30	49	62	66	16
95°	160	79	96	109	106	190
105°	750	824	151	177	187	801
115°	1418	1460	1522	380	202	1396
125°	2005	2037	2084	2101	2108	1788
135°	2481	2520	2542	2567	2562	1916
145°	2878	2876	2917	2935	2922	1800
155°	3169	3147	3176	3191	3172	1460
165°	3339	3324	3332	3349	3332	943
175°	3416	3398	3403	3420	3396	325
180°	3408	3408	3408	3408	3408	

TEST NUMBER: P909483

CATALOG NUMBER: DFN2DIP-SQ4F0-080D100US840-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3339.0	3339.0	3339.0	3339.0	3339.0
2.5°	3354.1	3339.0	3305.7	3336.1	3330.0
5°	3339.0	3324.0	3284.5	3311.8	3302.8
7.5°	3311.8	3293.8	3251.5	3263.4	3248.2
10°	3275.5	3254.4	3194.1	3184.8	3166.8
12.5°	3230.4	3203.1	3121.3	3103.3	3070.0
15°	3175.8	3142.5	3039.9	2982.5	2952.3
17.5°	3112.3	3063.9	2937.0	2870.6	2822.2
20°	3039.9	2979.3	2828.3	2753.0	2686.2
22.5°	2961.3	2891.7	2716.4	2613.8	2568.6
25°	2882.8	2786.0	2586.6	2462.9	2417.3
27.5°	2789.1	2686.2	2465.7	2323.7	2254.1
30°	2689.5	2574.3	2332.7	2178.8	2097.0
32.5°	2592.6	2453.6	2206.1	2024.6	1948.9
35°	2484.0	2329.8	2064.0	1873.6	1806.9
37.5°	2378.1	2211.8	1931.0	1722.2	1646.9
40°	2266.3	2085.2	1791.8	1577.3	1498.7
42.5°	2151.5	1958.2	1652.9	1429.3	1353.8
45°	2030.6	1828.1	1511.0	1296.2	1223.8
47.5°	1915.9	1701.4	1375.0	1160.2	1093.9
50°	1788.9	1574.5	1242.0	1033.3	970.1
52.5°	1664.9	1438.1	1115.0	915.6	858.3
55°	1544.0	1308.4	982.0	800.8	743.5
57.5°	1420.3	1178.5	864.3	695.1	646.6
60°	1293.2	1051.6	740.2	586.3	538.0
62.5°	1169.5	927.8	634.5	489.6	465.5
65°	1042.6	797.6	525.7	423.2	413.8
67.5°	921.7	676.8	423.2	371.5	362.6
70°	794.8	559.2	350.4	320.2	308.1
72.5°	673.9	450.1	293.1	269.0	262.9
75°	555.9	344.4	241.8	220.6	217.7
77.5°	438.3	244.6	190.5	178.2	172.2
80°	329.2	175.4	144.9	133.0	133.0
82.5°	229.5	118.0	99.7	93.6	93.6
85°	129.9	66.3	57.4	57.4	57.4
87.5°	48.4	24.0	24.0	21.2	21.2
90°	2.3	29.6	49.2	61.8	66.4
92.5°	61.8	51.8	59.2	64.1	66.4
95°	160.2	78.8	96.0	108.7	106.0
97.5°	288.4	86.3	125.6	133.2	135.6
100°	436.7	98.7	140.6	160.2	165.2
102.5°	599.2	594.5	145.5	172.5	180.1
105°	749.7	823.7	150.6	177.4	187.4
107.5°	924.8	986.3	155.5	182.5	192.4
110°	1092.6	1144.2	431.6	185.1	194.7

TEST NUMBER: P909483

CATALOG NUMBER: DFN2DIP-SQ4F0-080D100US840-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1250.4	1294.6	1252.8	189.8	197.4
115°	1418.0	1459.9	1521.7	379.8	202.4
117.5°	1563.5	1612.8	1654.9	1302.0	656.0
120°	1726.4	1763.2	1807.8	1837.3	1504.4
122.5°	1864.3	1903.8	1953.3	1967.9	1970.6
125°	2004.9	2037.1	2084.0	2101.2	2108.5
127.5°	2133.1	2167.7	2204.8	2229.5	2231.8
130°	2254.0	2293.6	2320.6	2347.7	2345.4
132.5°	2377.3	2409.5	2436.5	2458.7	2456.4
135°	2481.0	2520.5	2542.5	2567.4	2562.4
137.5°	2589.4	2619.0	2643.8	2668.5	2661.1
140°	2695.3	2715.3	2742.2	2764.5	2752.2
142.5°	2784.4	2801.7	2833.6	2853.2	2841.0
145°	2878.1	2875.5	2917.4	2934.7	2922.3
147.5°	2959.2	2951.9	2993.7	3006.1	2996.5
150°	3038.3	3021.0	3060.6	3075.2	3062.9
152.5°	3104.7	3085.1	3122.1	3136.9	3119.7
155°	3169.0	3146.9	3176.5	3191.2	3171.6
157.5°	3220.8	3201.2	3223.4	3240.7	3220.8
160°	3265.3	3250.4	3265.3	3279.9	3262.7
162.5°	3304.5	3289.8	3302.2	3319.4	3297.2
165°	3339.0	3324.4	3331.7	3349.0	3331.7
167.5°	3366.3	3351.3	3359.0	3376.3	3354.0
170°	3388.5	3373.7	3378.6	3395.9	3373.7
172.5°	3403.1	3388.5	3393.6	3410.8	3388.5
175°	3415.5	3398.2	3403.1	3420.5	3395.9
177.5°	3420.5	3403.1	3405.9	3423.1	3400.8
180°	3408.2	3408.2	3408.2	3408.2	3408.2

TEST NUMBER: P909483

CATALOG NUMBER: DFN2DIP-SQ4F0-080D100US840-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.19	9.95	10.23	10.99	12.39	5.15	5.91	6.19	6.95	8.35
	3H	10.87	11.55	11.91	12.59	14.01	6.33	7.01	7.38	8.06	9.48
	4H	11.47	12.12	12.53	13.17	14.60	6.78	7.42	7.84	8.48	9.90
	6H	11.90	12.49	12.97	13.54	14.98	7.10	7.69	8.17	8.75	10.18
	8H	12.02	12.59	13.10	13.66	15.09	7.19	7.75	8.26	8.82	10.26
	12H	12.08	12.62	13.16	13.68	15.14	7.23	7.76	8.31	8.83	10.29
4H	2H	9.20	9.84	10.27	10.89	12.32	5.74	6.38	6.81	7.43	8.86
	3H	11.03	11.56	12.10	12.64	14.08	7.08	7.62	8.16	8.70	10.14
	4H	11.72	12.21	12.80	13.28	14.74	7.63	8.12	8.71	9.19	10.65
	6H	12.23	12.65	13.32	13.75	15.20	8.05	8.47	9.13	9.56	11.01
	8H	12.41	12.80	13.50	13.89	15.36	8.17	8.57	9.26	9.65	11.12
	12H	12.51	12.86	13.61	13.96	15.43	8.24	8.59	9.34	9.69	11.16
8H	4H	11.68	12.07	12.77	13.16	14.63	7.91	8.30	9.00	9.38	10.86
	6H	12.25	12.57	13.36	13.70	15.17	8.42	8.75	9.53	9.88	11.34
	8H	12.47	12.75	13.59	13.86	15.35	8.62	8.90	9.73	10.01	11.50
	12H	12.61	12.86	13.73	13.96	15.49	8.73	8.98	9.85	10.09	11.61
12H	4H	11.63	11.99	12.74	13.08	14.56	7.91	8.26	9.01	9.36	10.84
	6H	12.23	12.51	13.34	13.62	15.11	8.47	8.76	9.59	9.87	11.35
	8H	12.45	12.70	13.57	13.80	15.33	8.68	8.93	9.80	10.04	11.56

END OF REPORT