

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P909488

Luminaire Tested: DFN2DIP-SQ4F0-080D120US840-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P909488
REPORT IS A COMBINATION OF REPORTS P900171 AND P896915
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-080D120US840-FLLFLL
Description: 4 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 18722.9 lumens
Efficiency: N/A
Efficacy: 115.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 161.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9954
Total Harmonic Distortion (THDi): 0.076
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P909488

CATALOG NUMBER: DFN2DIP-SQ4F0-080D120US840-FLLFLL

Luminous Intensity Polar Plot

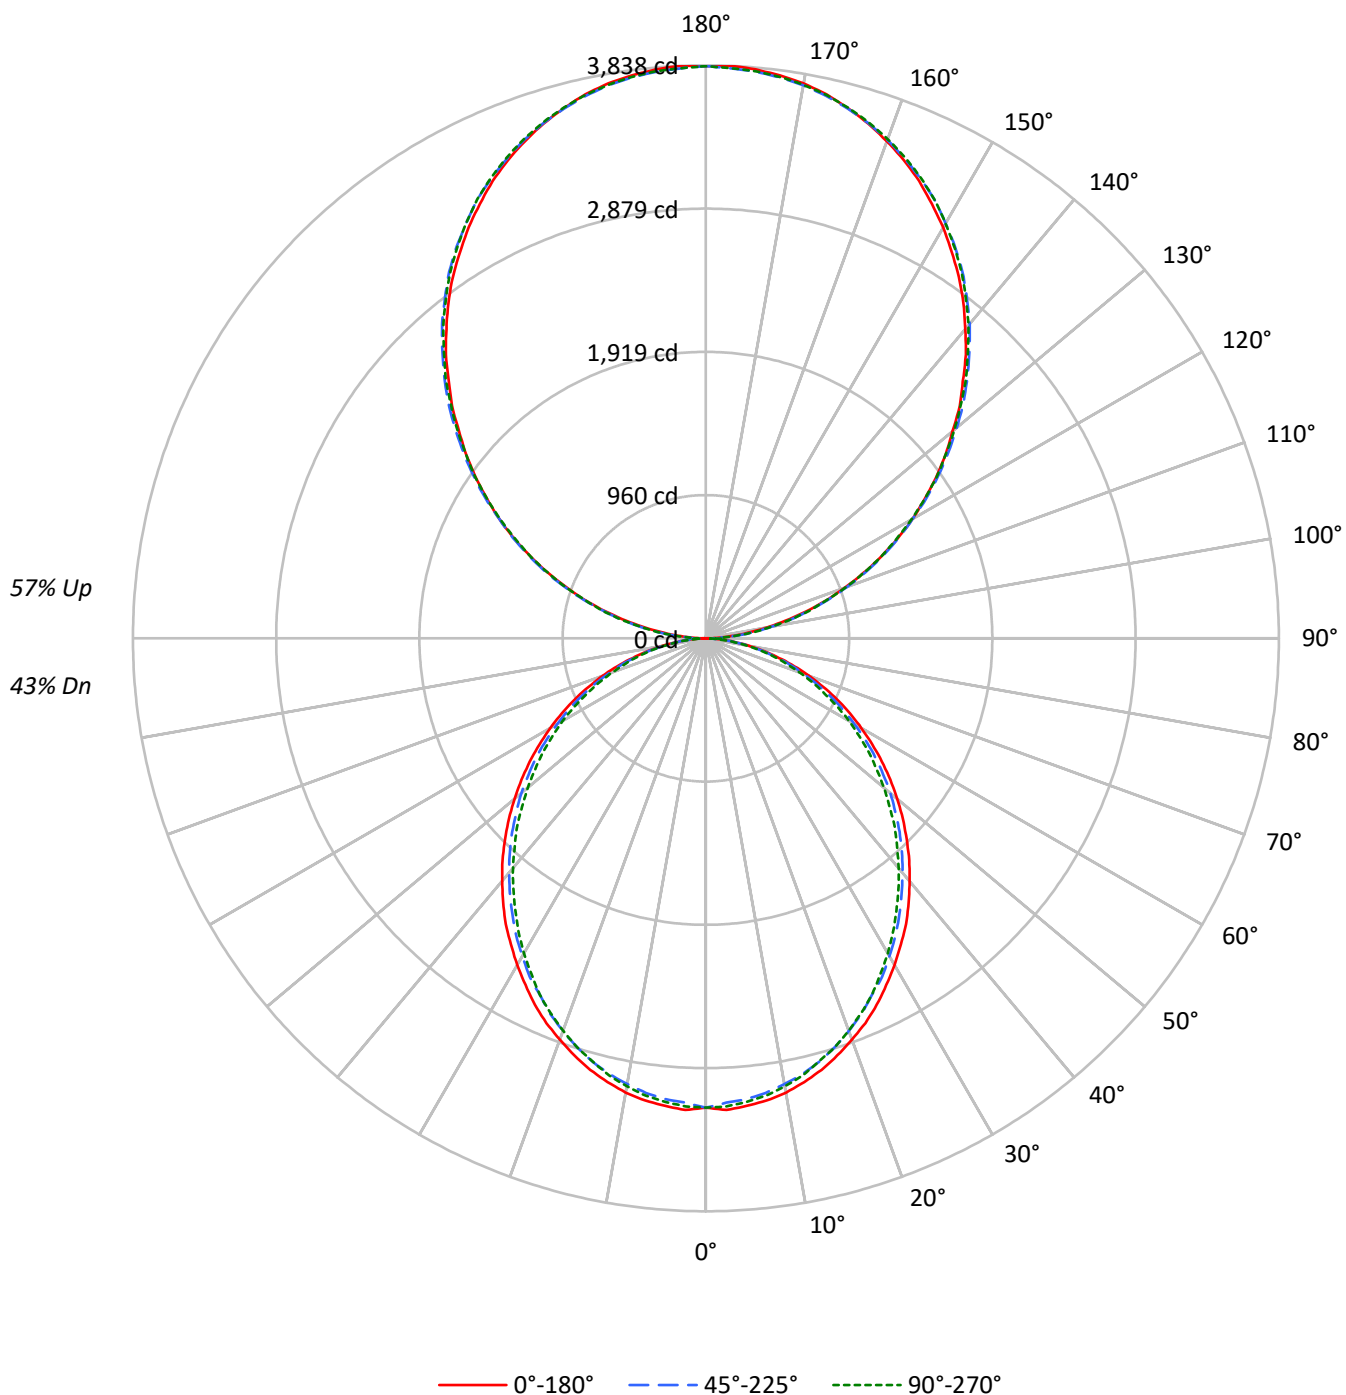

TEST NUMBER: P909488

CATALOG NUMBER: DFN2DIP-SQ4F0-080D120US840-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	96	96	96	96	79	79	79	64	64	64	49	49	49
1	96	92	88	85	88	84	81	78	69	67	65	56	54	53	44	43	42
2	88	80	74	69	80	73	68	64	61	57	54	49	47	44	38	37	35
3	80	70	63	57	73	65	58	53	54	49	45	44	40	37	34	32	30
4	73	62	55	49	66	57	50	45	48	43	39	39	35	32	30	28	26
5	67	56	47	42	61	51	44	39	43	37	33	35	31	28	27	25	22
6	62	50	42	36	56	46	39	34	38	33	29	31	27	24	25	22	20
7	57	45	37	31	52	41	34	29	35	29	25	29	24	21	23	20	18
8	53	41	33	28	48	38	31	26	32	26	23	26	22	19	21	18	16
9	49	37	30	25	45	34	28	23	29	24	20	24	20	17	19	16	14
10	46	34	27	22	42	31	25	21	27	22	18	22	18	15	18	15	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2206	2206	2206
5°	2209	2176	2190
10°	2191	2147	2161
15°	2159	2112	2116
20°	2115	2063	2069
25°	2072	2005	2015
30°	2018	1951	1945
35°	1966	1887	1872
40°	1903	1822	1803
45°	1840	1757	1732
50°	1771	1689	1649
55°	1698	1611	1573
60°	1617	1517	1487
65°	1528	1421	1385
70°	1414	1303	1275
75°	1257	1163	1175
80°	1068	983	981
85°	772	673	659

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 3018 cd/sqm

TEST NUMBER: P909488

CATALOG NUMBER: DFN2DIP-SQ4F0-080D120US840-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	295.9	1.6
10°-20°	832.5	4.4
20°-30°	1223.4	6.5
30°-40°	1420.9	7.6
40°-50°	1419.1	7.6
50°-60°	1237.5	6.6
60°-70°	914.7	4.9
70°-80°	517.6	2.8
80°-90°	147.5	0.8
90°-100°	237.2	1.3
100°-110°	753.5	4.0
110°-120°	1289.5	6.9
120°-130°	1696.0	9.1
130°-140°	1903.6	10.2
140°-150°	1866.7	10.0
150°-160°	1565.9	8.4
160°-170°	1038.5	5.5
170°-180°	363.0	1.9
0°-30°	2351.8	12.6
0°-40°	3772.7	20.1
0°-60°	6429.3	34.3
0°-90°	8009.0	42.8
90°-120°	2280.2	12.2
90°-150°	7746.5	41.4
90°-180°	10714.0	57.2
0°-180°	18722.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3144	3144	3144	3144	3144	
5°	3144	3132	3098	3122	3117	298
15°	2992	2975	2935	2947	2932	843
25°	2708	2684	2633	2639	2633	1246
35°	2337	2306	2258	2240	2225	1459
45°	1902	1880	1835	1802	1790	1467
55°	1439	1421	1384	1348	1333	1287
65°	970	952	922	895	880	959
75°	508	502	487	469	475	542
85°	124	121	118	109	106	138
90°	3	42	113	106	110	18
95°	169	201	207	207	201	188
105°	696	705	712	718	718	734
115°	1294	1313	1307	1303	1294	1280
125°	1882	1911	1902	1892	1888	1682
135°	2434	2470	2477	2474	2465	1882
145°	2956	2979	2997	3001	2988	1847
155°	3380	3389	3399	3416	3405	1556
165°	3677	3673	3673	3696	3680	1037
175°	3826	3816	3810	3832	3813	363
180°	3832	3832	3832	3832	3832	

TEST NUMBER: P909488

CATALOG NUMBER: DFN2DIP-SQ4F0-080D120US840-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3143.5	3143.5	3143.5	3143.5	3143.5
2.5°	3161.8	3146.7	3113.4	3143.5	3137.8
5°	3143.5	3131.7	3098.4	3122.4	3116.6
7.5°	3122.4	3104.4	3071.1	3095.4	3089.4
10°	3089.4	3068.2	3031.9	3056.0	3047.1
12.5°	3043.8	3025.9	2989.6	3004.7	2998.6
15°	2992.5	2974.6	2935.1	2947.3	2932.2
17.5°	2929.0	2911.0	2871.6	2886.7	2871.6
20°	2859.4	2841.5	2799.1	2808.1	2796.2
22.5°	2790.2	2762.9	2723.4	2723.4	2717.3
25°	2708.4	2684.3	2633.0	2638.8	2633.0
27.5°	2617.6	2596.5	2557.3	2548.3	2533.2
30°	2527.2	2502.7	2457.6	2448.6	2436.4
32.5°	2430.3	2412.4	2363.9	2345.6	2333.5
35°	2336.6	2306.5	2258.1	2239.8	2224.7
37.5°	2230.8	2203.5	2155.2	2133.9	2118.9
40°	2122.1	2097.7	2049.3	2022.4	2010.1
42.5°	2016.3	1991.9	1943.8	1913.3	1895.4
45°	1901.5	1880.3	1834.7	1801.7	1789.6
47.5°	1789.6	1768.4	1719.9	1686.6	1668.6
50°	1671.5	1656.5	1614.1	1571.8	1556.7
52.5°	1556.7	1535.5	1496.4	1463.1	1441.9
55°	1439.0	1420.7	1384.5	1348.3	1333.1
57.5°	1321.0	1306.0	1266.5	1230.2	1218.0
60°	1203.0	1191.1	1148.7	1115.4	1106.4
62.5°	1088.1	1067.0	1036.8	1006.7	994.5
65°	970.5	952.2	922.0	894.7	879.7
67.5°	849.5	834.1	807.2	786.1	773.9
70°	737.6	725.4	698.2	677.0	665.1
72.5°	622.8	610.7	595.5	574.4	565.4
75°	507.7	501.9	486.6	468.6	474.6
77.5°	405.1	392.8	386.8	377.8	368.8
80°	302.5	299.2	293.2	284.2	278.0
82.5°	205.6	205.6	202.7	190.5	190.5
85°	123.8	120.9	118.1	108.8	105.8
87.5°	54.5	48.5	42.3	33.3	30.2
90°	3.4	41.6	113.2	106.3	109.8
92.5°	71.6	97.0	100.5	104.0	104.0
95°	168.6	201.1	206.8	206.8	201.1
97.5°	280.7	310.8	323.6	323.6	323.6
100°	410.2	436.8	446.0	446.0	442.5
102.5°	546.5	566.1	578.9	582.4	578.9
105°	695.6	704.8	711.8	717.5	717.5
107.5°	843.4	857.4	857.4	859.6	843.4
110°	986.7	1005.2	1005.2	1005.2	996.0

TEST NUMBER: P909488

CATALOG NUMBER: DFN2DIP-SQ4F0-080D120US840-FLLFL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1141.6	1161.2	1157.7	1148.5	1141.6
115°	1294.0	1312.6	1306.8	1303.3	1294.0
117.5°	1445.4	1470.9	1454.7	1445.4	1436.2
120°	1598.0	1623.4	1598.0	1598.0	1587.6
122.5°	1736.7	1769.0	1752.8	1743.5	1736.7
125°	1882.2	1911.1	1901.9	1891.5	1887.9
127.5°	2024.4	2060.1	2047.4	2033.6	2024.4
130°	2157.2	2198.8	2193.0	2186.1	2173.3
132.5°	2306.2	2338.6	2340.9	2324.7	2315.5
135°	2434.5	2470.3	2477.3	2473.8	2464.6
137.5°	2577.8	2606.7	2612.4	2610.1	2596.3
140°	2703.7	2732.6	2748.8	2748.8	2736.0
142.5°	2833.2	2862.1	2871.2	2874.7	2862.1
145°	2955.6	2978.7	2997.2	3000.7	2988.0
147.5°	3065.3	3094.2	3108.2	3113.9	3101.2
150°	3178.7	3198.2	3211.0	3221.4	3211.0
152.5°	3279.1	3298.7	3315.0	3327.7	3315.0
155°	3379.6	3388.9	3399.3	3415.5	3405.1
157.5°	3466.4	3473.2	3479.0	3502.1	3486.0
160°	3543.7	3550.7	3554.1	3573.8	3559.9
162.5°	3615.3	3615.3	3618.9	3640.8	3624.6
165°	3676.6	3673.2	3673.2	3696.2	3680.1
167.5°	3732.1	3721.7	3721.7	3744.8	3728.6
170°	3773.7	3764.4	3760.9	3784.1	3764.4
172.5°	3802.5	3793.3	3789.8	3812.9	3793.3
175°	3825.7	3816.4	3809.5	3832.5	3812.9
177.5°	3838.4	3829.1	3822.1	3841.8	3822.1
180°	3832.5	3832.5	3832.5	3832.5	3832.5

TEST NUMBER: P909488

CATALOG NUMBER: DFN2DIP-SQ4F0-080D120US840-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.32	10.12	10.34	11.15	12.52	8.88	9.68	9.90	10.71	12.08
	3H	10.98	11.70	12.01	12.74	14.13	10.49	11.21	11.52	12.25	13.64
	4H	11.57	12.25	12.61	13.29	14.69	11.08	11.76	12.12	12.79	14.19
	6H	11.97	12.60	13.02	13.64	15.05	11.47	12.10	12.52	13.14	14.55
	8H	12.08	12.67	13.13	13.73	15.14	11.57	12.17	12.63	13.23	14.63
	12H	12.13	12.69	13.18	13.74	15.17	11.62	12.18	12.67	13.23	14.66
4H	2H	9.78	10.46	10.82	11.50	12.89	9.42	10.10	10.47	11.14	12.54
	3H	11.64	12.21	12.70	13.28	14.69	11.24	11.80	12.29	12.87	14.28
	4H	12.36	12.88	13.42	13.93	15.37	11.93	12.45	12.99	13.51	14.94
	6H	12.87	13.32	13.94	14.40	15.83	12.44	12.89	13.51	13.97	15.40
	8H	13.02	13.44	14.10	14.51	15.96	12.59	13.00	13.66	14.08	15.52
	12H	13.10	13.47	14.19	14.56	16.01	12.65	13.03	13.74	14.11	15.56
8H	4H	12.55	12.97	13.62	14.04	15.48	12.17	12.59	13.24	13.66	15.11
	6H	13.18	13.53	14.28	14.64	16.08	12.80	13.15	13.89	14.26	15.70
	8H	13.41	13.71	14.51	14.81	16.27	13.01	13.32	14.11	14.41	15.87
	12H	13.54	13.81	14.64	14.90	16.40	13.13	13.39	14.23	14.49	15.99
12H	4H	12.53	12.91	13.62	14.00	15.45	12.17	12.54	13.25	13.63	15.08
	6H	13.21	13.52	14.31	14.61	16.07	12.84	13.15	13.94	14.24	15.70
	8H	13.46	13.72	14.56	14.81	16.31	13.08	13.34	14.18	14.43	15.93