

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P909604

Luminaire Tested: DFN2DIP-SQ4F0-110D160US840-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P909604
REPORT IS A COMBINATION OF REPORTS P900213 AND P896915
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-110D160US840-FLLFLL
Description: 4 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 25298.1 lumens
Efficiency: N/A
Efficacy: 111.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 227.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9951
Total Harmonic Distortion (THDi): 0.07
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P909604

CATALOG NUMBER: DFN2DIP-SQ4F0-110D160US840-FLLFLL

Luminous Intensity Polar Plot

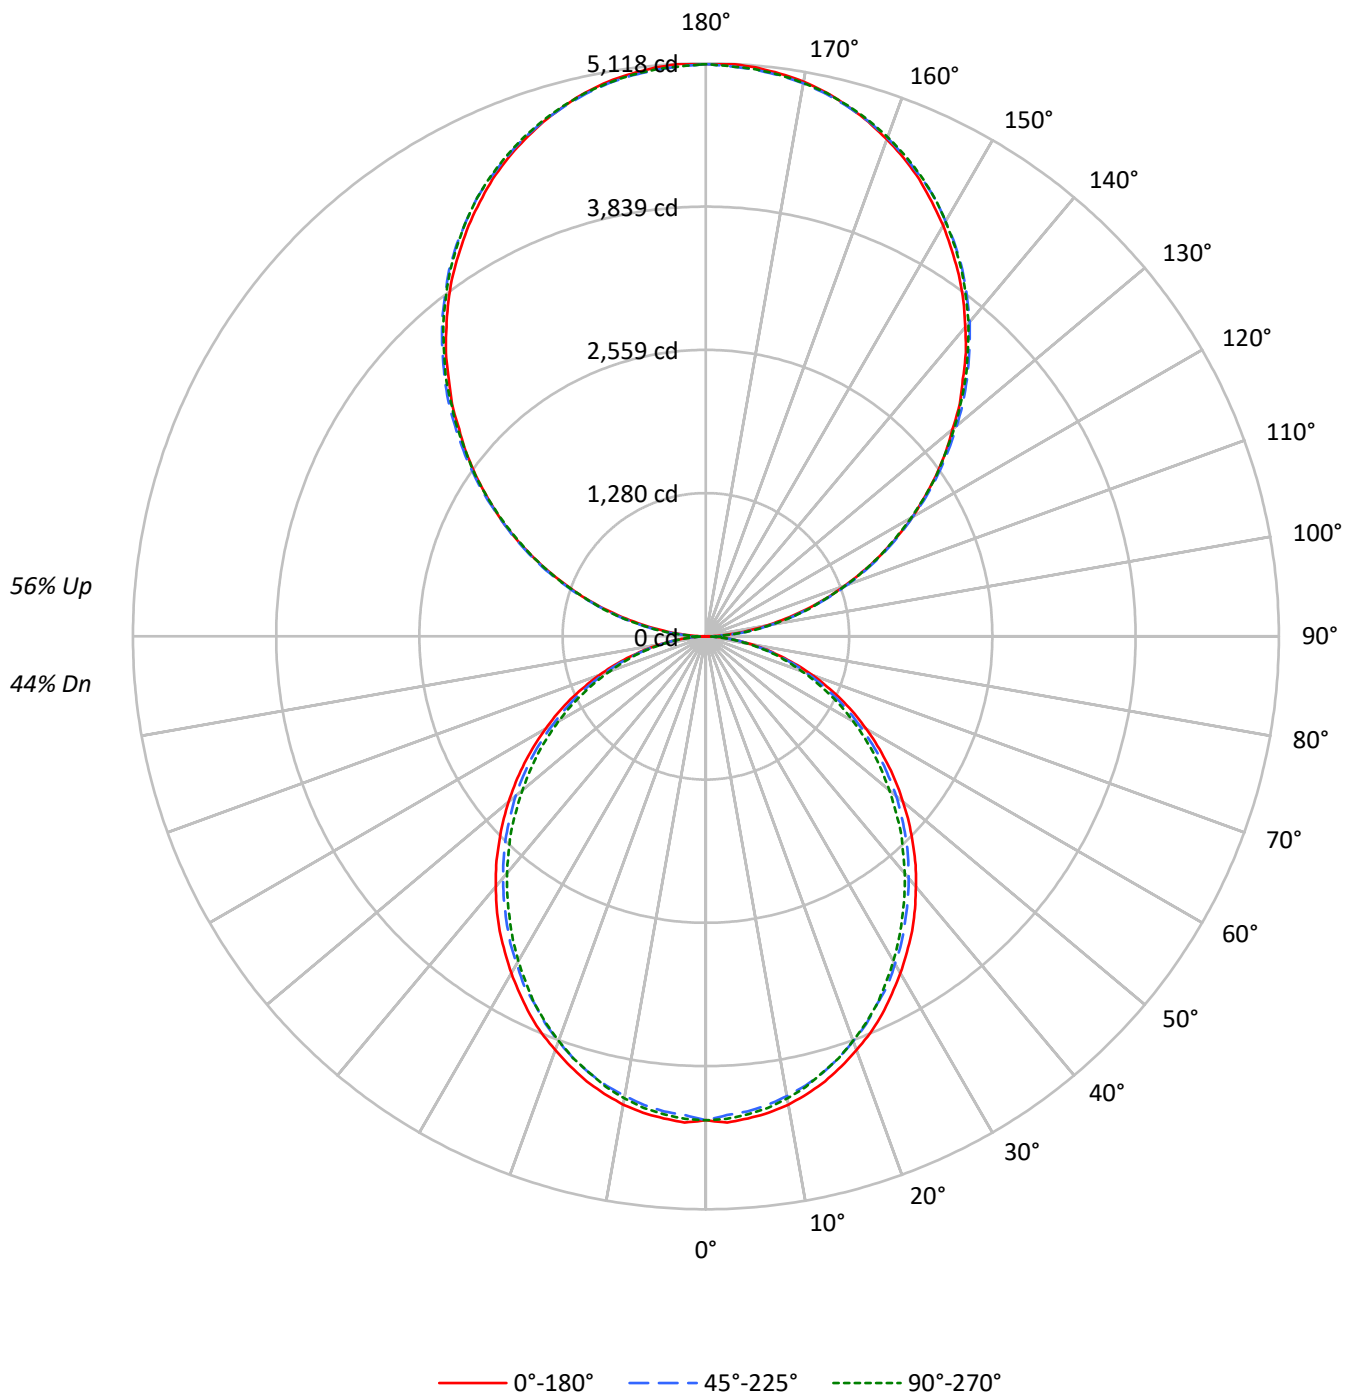

TEST NUMBER: P909604

CATALOG NUMBER: DFN2DIP-SQ4F0-110D160US840-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	97	97	97	97	80	80	80	64	64	64	50	50	50
1	96	92	88	85	88	84	81	78	70	68	65	57	55	54	44	43	42
2	88	80	74	69	80	74	68	64	61	57	54	50	47	45	39	37	36
3	80	71	63	58	73	65	59	53	54	49	46	44	41	38	35	32	30
4	73	62	55	49	67	57	51	45	48	43	39	39	35	32	31	28	26
5	67	56	48	42	61	51	44	39	43	37	33	35	31	28	28	25	23
6	62	50	42	36	56	46	39	34	39	33	29	32	28	25	25	22	20
7	57	45	37	32	52	42	35	30	35	30	26	29	25	22	23	20	18
8	53	41	33	28	48	38	31	26	32	27	23	26	22	19	21	18	16
9	49	37	30	25	45	34	28	23	29	24	20	24	20	17	20	17	14
10	46	34	27	22	42	32	25	21	27	22	18	22	18	16	18	15	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3033	3033	3033
5°	3038	2991	3012
10°	3013	2952	2972
15°	2969	2904	2909
20°	2909	2837	2845
25°	2849	2757	2770
30°	2774	2682	2675
35°	2704	2594	2574
40°	2617	2505	2479
45°	2530	2416	2381
50°	2435	2323	2268
55°	2335	2215	2164
60°	2223	2086	2045
65°	2100	1954	1904
70°	1944	1792	1753
75°	1728	1598	1616
80°	1468	1352	1349
85°	1061	925	907

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 4021 cd/sqm

TEST NUMBER: P909604

CATALOG NUMBER: DFN2DIP-SQ4F0-110D160US840-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	406.8	1.6
10°-20°	1144.7	4.5
20°-30°	1682.2	6.6
30°-40°	1953.7	7.7
40°-50°	1951.3	7.7
50°-60°	1701.5	6.7
60°-70°	1257.8	5.0
70°-80°	711.6	2.8
80°-90°	202.3	0.8
90°-100°	316.2	1.3
100°-110°	1004.8	4.0
110°-120°	1719.5	6.8
120°-130°	2261.4	8.9
130°-140°	2538.3	10.0
140°-150°	2489.1	9.8
150°-160°	2088.0	8.3
160°-170°	1384.7	5.5
170°-180°	484.0	1.9
0°-30°	3233.7	12.8
0°-40°	5187.4	20.5
0°-60°	8840.2	34.9
0°-90°	11012.0	43.5
90°-120°	3040.5	12.0
90°-150°	10329.4	40.8
90°-180°	14286.0	56.5
0°-180°	25298.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4322	4322	4322	4322	4322	
5°	4322	4306	4260	4293	4285	410
15°	4115	4090	4036	4052	4032	1159
25°	3724	3691	3620	3628	3620	1714
35°	3213	3172	3105	3080	3059	2006
45°	2614	2585	2523	2477	2461	2018
55°	1979	1954	1904	1854	1833	1769
65°	1334	1309	1268	1230	1210	1319
75°	698	690	669	644	653	745
85°	170	166	162	150	146	190
90°	5	55	151	142	146	25
95°	225	268	276	276	268	250
105°	928	940	949	957	957	979
115°	1726	1750	1742	1738	1726	1707
125°	2510	2548	2536	2522	2518	2243
135°	3246	3294	3303	3299	3286	2509
145°	3941	3972	3996	4001	3984	2462
155°	4506	4519	4533	4554	4540	2074
165°	4902	4898	4898	4929	4907	1383
175°	5101	5089	5080	5110	5084	485
180°	5110	5110	5110	5110	5110	

TEST NUMBER: P909604

CATALOG NUMBER: DFN2DIP-SQ4F0-110D160US840-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4322.4	4322.4	4322.4	4322.4	4322.4
2.5°	4347.5	4326.8	4280.9	4322.4	4314.4
5°	4322.4	4306.1	4260.2	4293.2	4285.4
7.5°	4293.2	4268.6	4222.8	4256.3	4247.9
10°	4247.9	4218.7	4168.9	4201.9	4189.6
12.5°	4185.3	4160.5	4110.8	4131.5	4123.1
15°	4114.7	4090.0	4035.7	4052.5	4031.8
17.5°	4027.3	4002.7	3948.5	3969.2	3948.5
20°	3931.7	3907.0	3848.8	3861.1	3844.9
22.5°	3836.5	3798.9	3744.7	3744.7	3736.3
25°	3724.0	3691.0	3620.4	3628.3	3620.4
27.5°	3599.2	3570.1	3516.3	3503.9	3483.2
30°	3474.8	3441.3	3379.1	3366.8	3350.0
32.5°	3341.6	3317.0	3250.4	3225.2	3208.4
35°	3212.9	3171.5	3104.8	3079.7	3059.0
37.5°	3067.4	3029.9	2963.3	2934.2	2913.5
40°	2917.9	2884.4	2817.8	2780.8	2764.0
42.5°	2772.4	2738.9	2672.7	2630.8	2606.2
45°	2614.5	2585.4	2522.7	2477.4	2460.6
47.5°	2460.6	2431.6	2364.9	2319.1	2294.3
50°	2298.4	2277.7	2219.4	2161.2	2140.5
52.5°	2140.5	2111.3	2057.6	2011.7	1982.6
55°	1978.6	1953.5	1903.7	1853.8	1833.1
57.5°	1816.3	1795.6	1741.4	1691.5	1674.8
60°	1654.1	1637.8	1579.5	1533.7	1521.4
62.5°	1496.2	1467.1	1425.6	1384.2	1367.5
65°	1334.3	1309.2	1267.8	1230.3	1209.6
67.5°	1168.1	1147.0	1109.9	1080.9	1064.1
70°	1014.2	997.4	960.0	930.9	914.5
72.5°	856.4	839.6	818.9	789.8	777.4
75°	698.0	690.1	668.9	644.3	652.7
77.5°	556.9	540.2	531.8	519.5	507.2
80°	415.9	411.4	403.0	390.7	382.3
82.5°	282.7	282.7	278.7	262.0	262.0
85°	170.3	166.2	162.3	149.5	145.5
87.5°	74.9	66.6	58.2	45.8	41.4
90°	4.6	55.4	151.0	141.8	146.3
92.5°	95.5	129.5	134.0	138.7	138.7
95°	224.9	268.1	275.8	275.8	268.1
97.5°	374.4	414.4	431.4	431.4	431.4
100°	546.9	582.4	594.7	594.7	590.1
102.5°	728.7	755.0	771.8	776.5	771.8
105°	927.5	939.8	949.1	956.7	956.7
107.5°	1124.7	1143.2	1143.2	1146.3	1124.7
110°	1315.8	1340.4	1340.4	1340.4	1328.1

TEST NUMBER: P909604

CATALOG NUMBER: DFN2DIP-SQ4F0-110D160US840-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1522.2	1548.4	1543.8	1531.5	1522.2
115°	1725.6	1750.2	1742.5	1737.9	1725.6
117.5°	1927.4	1961.3	1939.7	1927.4	1915.1
120°	2130.8	2164.6	2130.8	2130.8	2116.9
122.5°	2315.6	2358.8	2337.2	2324.9	2315.6
125°	2509.8	2548.3	2536.0	2522.1	2517.5
127.5°	2699.3	2747.0	2730.1	2711.6	2699.3
130°	2876.5	2931.9	2924.3	2915.0	2898.0
132.5°	3075.2	3118.4	3121.4	3099.9	3087.6
135°	3246.2	3294.0	3303.3	3298.6	3286.3
137.5°	3437.3	3475.8	3483.5	3480.4	3461.9
140°	3605.2	3643.7	3665.3	3665.3	3648.3
142.5°	3777.8	3816.3	3828.6	3833.2	3816.3
145°	3941.1	3971.9	3996.5	4001.2	3984.2
147.5°	4087.4	4126.0	4144.5	4152.2	4135.2
150°	4238.4	4264.7	4281.6	4295.5	4281.6
152.5°	4372.5	4398.7	4420.3	4437.1	4420.3
155°	4506.5	4518.8	4532.7	4554.3	4540.5
157.5°	4622.1	4631.3	4639.0	4669.8	4648.3
160°	4725.3	4734.6	4739.2	4765.4	4746.9
162.5°	4820.8	4820.8	4825.4	4854.7	4833.1
165°	4902.5	4897.8	4897.8	4928.6	4907.1
167.5°	4976.4	4962.6	4962.6	4993.4	4971.8
170°	5031.9	5019.5	5015.0	5045.8	5019.5
172.5°	5070.4	5058.1	5053.5	5084.3	5058.1
175°	5101.2	5088.9	5079.6	5110.5	5084.3
177.5°	5118.2	5105.9	5096.6	5122.8	5096.6
180°	5110.5	5110.5	5110.5	5110.5	5110.5

TEST NUMBER: P909604

CATALOG NUMBER: DFN2DIP-SQ4F0-110D160US840-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.51	11.31	11.52	12.33	13.70	10.06	10.87	11.07	11.89	13.25
	3H	12.17	12.89	13.19	13.92	15.30	11.68	12.40	12.70	13.43	14.81
	4H	12.76	13.44	13.79	14.47	15.86	12.26	12.95	13.30	13.98	15.37
	6H	13.16	13.79	14.20	14.82	16.22	12.66	13.29	13.70	14.32	15.72
	8H	13.26	13.86	14.31	14.92	16.31	12.76	13.36	13.81	14.41	15.81
	12H	13.31	13.88	14.36	14.93	16.35	12.80	13.37	13.85	14.42	15.84
4H	2H	10.96	11.65	12.00	12.68	14.07	10.61	11.29	11.65	12.32	13.71
	3H	12.83	13.40	13.88	14.46	15.86	12.42	12.99	13.47	14.05	15.45
	4H	13.54	14.07	14.60	15.12	16.54	13.12	13.64	14.17	14.70	16.12
	6H	14.06	14.51	15.12	15.59	17.00	13.63	14.08	14.69	15.15	16.57
	8H	14.21	14.63	15.28	15.70	17.13	13.77	14.19	14.84	15.26	16.70
	12H	14.28	14.66	15.37	15.74	17.18	13.83	14.21	14.92	15.30	16.74
8H	4H	13.74	14.16	14.80	15.22	16.66	13.36	13.78	14.42	14.85	16.28
	6H	14.37	14.72	15.46	15.83	17.26	13.99	14.33	15.07	15.44	16.87
	8H	14.59	14.90	15.69	15.99	17.44	14.20	14.51	15.30	15.60	17.05
	12H	14.73	14.99	15.82	16.08	17.57	14.31	14.58	15.41	15.67	17.16
12H	4H	13.72	14.10	14.80	15.18	16.62	13.35	13.73	14.43	14.81	16.25
	6H	14.40	14.71	15.49	15.80	17.25	14.03	14.33	15.12	15.43	16.88
	8H	14.64	14.91	15.74	16.00	17.49	14.26	14.53	15.36	15.62	17.11

END OF REPORT