

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P912135

Luminaire Tested: DFN2DIP-SQ4F0-060D090US850-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P912135
REPORT IS A COMBINATION OF REPORTS P901634 AND P898471
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-060D090US850-RLLONL
Description: 4 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 15537.1 lumens
Efficiency: N/A
Efficacy: 133.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 116.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.946
Total Harmonic Distortion (THDi): 0.132
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P912135

CATALOG NUMBER: DFN2DIP-SQ4F0-060D090US850-RLLONL

Luminous Intensity Polar Plot

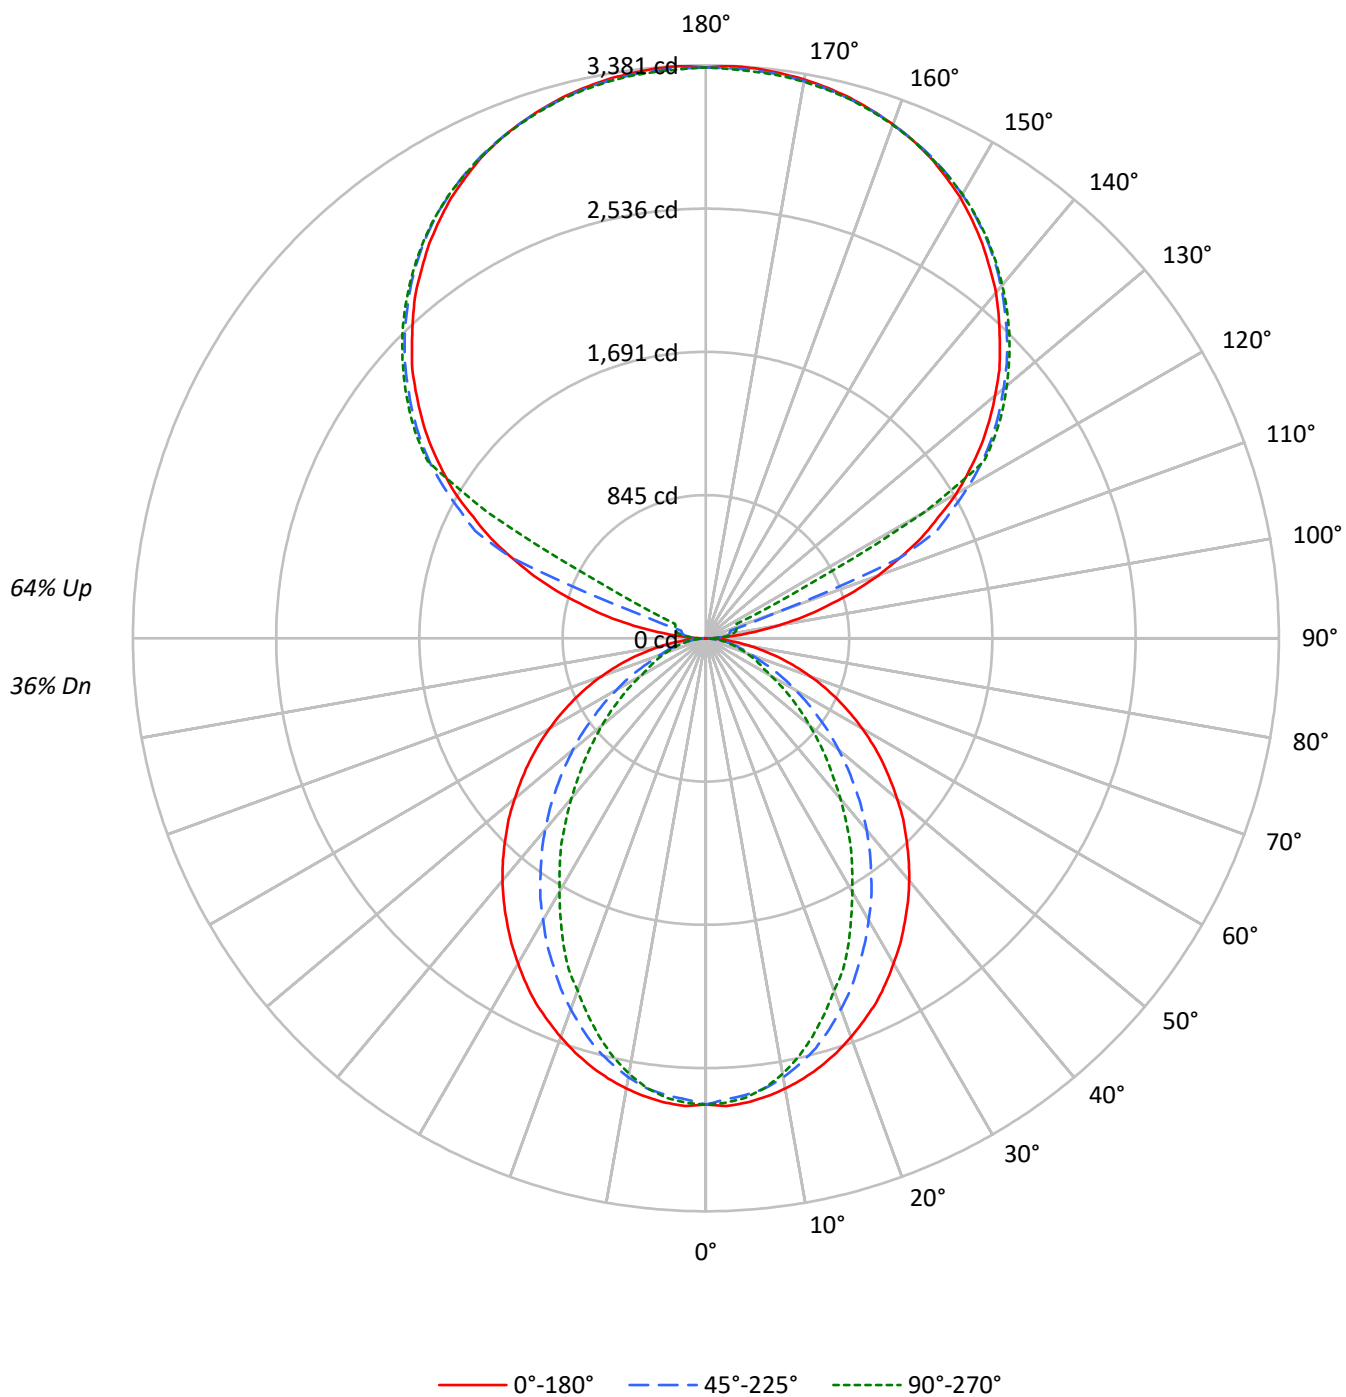

TEST NUMBER: P912135

CATALOG NUMBER: DFN2DIP-SQ4F0-060D090US850-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	104	104	104	104	94	94	94	94	76	76	76	59	59	59	44	44	44
1	95	91	87	84	86	83	80	77	67	65	63	52	51	50	39	38	38
2	87	80	74	69	78	73	68	63	59	56	53	46	44	42	35	33	32
3	79	70	63	58	72	64	58	53	52	48	45	41	38	36	31	29	28
4	73	63	55	49	66	57	51	46	47	42	38	37	34	31	28	26	24
5	67	56	48	42	60	51	44	39	42	37	33	33	30	27	25	23	21
6	62	50	42	37	56	46	39	34	38	33	29	30	27	24	23	21	19
7	57	45	38	32	52	41	35	30	34	29	26	28	24	21	21	19	17
8	53	41	34	29	48	38	31	27	31	26	23	25	22	19	20	17	15
9	49	37	30	25	45	34	28	24	29	24	20	23	20	17	18	16	14
10	46	34	27	23	42	32	25	21	26	22	18	22	18	15	17	14	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1930	1930	1930
5°	1933	1899	1912
10°	1914	1863	1850
15°	1887	1801	1754
20°	1852	1717	1637
25°	1817	1622	1523
30°	1769	1525	1379
35°	1722	1420	1252
40°	1674	1312	1107
45°	1618	1192	975
50°	1561	1071	846
55°	1501	941	723
60°	1432	805	595
65°	1352	667	537
70°	1255	539	486
75°	1133	476	444
80°	957	400	387
85°	666	269	294

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1806 cd/sqm

TEST NUMBER: P912135

CATALOG NUMBER: DFN2DIP-SQ4F0-060D090US850-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	257.7	1.7
10°-20°	707.6	4.6
20°-30°	993.4	6.4
30°-40°	1082.8	7.0
40°-50°	995.2	6.4
50°-60°	781.6	5.0
60°-70°	508.8	3.3
70°-80°	261.9	1.7
80°-90°	72.8	0.5
90°-100°	111.1	0.7
100°-110°	414.0	2.7
110°-120°	1098.2	7.1
120°-130°	1821.4	11.7
130°-140°	1934.7	12.5
140°-150°	1798.1	11.6
150°-160°	1445.6	9.3
160°-170°	931.5	6.0
170°-180°	320.6	2.1
0°-30°	1958.7	12.6
0°-40°	3041.5	19.6
0°-60°	4818.4	31.0
0°-90°	5661.8	36.4
90°-120°	1623.3	10.4
90°-150°	7177.5	46.2
90°-180°	9875.0	63.6
0°-180°	15537.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2750	2750	2750	2750	2750	
5°	2750	2738	2705	2728	2720	261
15°	2616	2588	2504	2456	2432	737
25°	2374	2295	2130	2028	1991	1092
35°	2046	1919	1700	1543	1488	1281
45°	1672	1506	1244	1068	1008	1292
55°	1272	1078	809	660	612	1136
65°	859	657	433	349	341	851
75°	458	284	199	182	179	484
85°	107	55	47	47	47	123
90°	2	29	49	61	66	14
95°	158	78	95	107	105	188
105°	741	814	149	175	185	792
115°	1401	1443	1504	375	200	1380
125°	1982	2013	2060	2077	2084	1767
135°	2452	2491	2513	2538	2533	1894
145°	2845	2842	2883	2900	2888	1779
155°	3132	3110	3140	3154	3135	1443
165°	3300	3286	3293	3310	3293	932
175°	3376	3359	3364	3381	3356	321
180°	3368	3368	3368	3368	3368	

TEST NUMBER: P912135

CATALOG NUMBER: DFN2DIP-SQ4F0-060D090US850-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2750.1	2750.1	2750.1	2750.1	2750.1
2.5°	2762.5	2750.1	2722.6	2747.7	2742.7
5°	2750.1	2737.7	2705.2	2727.7	2720.3
7.5°	2727.7	2712.8	2678.0	2687.8	2675.4
10°	2697.8	2680.3	2630.8	2623.1	2608.3
12.5°	2660.6	2638.1	2570.8	2556.0	2528.5
15°	2615.7	2588.2	2503.7	2456.4	2431.6
17.5°	2563.5	2523.5	2419.0	2364.3	2324.5
20°	2503.7	2453.8	2329.5	2267.4	2212.5
22.5°	2439.0	2381.7	2237.3	2152.8	2115.5
25°	2374.4	2294.6	2130.4	2028.5	1991.0
27.5°	2297.3	2212.5	2030.8	1913.8	1856.6
30°	2215.1	2120.3	1921.2	1794.5	1727.2
32.5°	2135.4	2020.8	1817.0	1667.5	1605.2
35°	2045.9	1918.9	1700.0	1543.1	1488.2
37.5°	1958.7	1821.6	1590.4	1418.5	1356.4
40°	1866.6	1717.4	1475.7	1299.1	1234.4
42.5°	1772.1	1612.8	1361.4	1177.1	1115.1
45°	1672.5	1505.6	1244.5	1067.5	1007.9
47.5°	1578.0	1401.3	1132.5	955.6	901.0
50°	1473.4	1296.8	1022.9	851.0	799.0
52.5°	1371.2	1184.5	918.4	754.1	706.9
55°	1271.7	1077.6	808.8	659.6	612.3
57.5°	1169.8	970.6	711.9	572.5	532.5
60°	1065.2	866.1	609.7	483.0	443.0
62.5°	963.3	764.2	522.6	403.2	383.4
65°	858.7	657.0	433.1	348.6	340.9
67.5°	759.1	557.4	348.6	306.1	298.7
70°	654.5	460.5	288.6	263.8	253.7
72.5°	555.1	370.7	241.3	221.6	216.5
75°	457.9	283.6	199.1	181.7	179.3
77.5°	361.0	201.5	156.8	146.8	141.8
80°	271.2	144.4	119.3	109.6	109.6
82.5°	189.1	97.1	82.1	77.1	77.1
85°	106.9	54.7	47.2	47.2	47.2
87.5°	39.9	19.9	19.9	17.4	17.4
90°	2.3	29.3	48.6	61.1	65.7
92.5°	61.1	51.2	58.4	63.4	65.7
95°	158.4	77.9	94.9	107.4	104.8
97.5°	285.1	85.4	124.2	131.6	134.0
100°	431.5	97.6	139.0	158.4	163.2
102.5°	592.2	587.5	143.8	170.5	178.0
105°	740.9	814.2	148.7	175.4	185.2
107.5°	914.0	974.8	153.7	180.3	190.2
110°	1079.8	1130.8	426.6	182.9	192.5

TEST NUMBER: P912135

CATALOG NUMBER: DFN2DIP-SQ4F0-060D090US850-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1235.9	1279.6	1238.2	187.5	195.1
115°	1401.4	1442.8	1503.9	375.4	200.0
117.5°	1545.3	1594.0	1635.6	1286.9	648.3
120°	1706.2	1742.7	1786.7	1815.9	1486.8
122.5°	1842.6	1881.6	1930.5	1945.0	1947.6
125°	1981.5	2013.3	2059.6	2076.7	2083.9
127.5°	2108.2	2142.4	2179.2	2203.5	2205.8
130°	2227.8	2266.9	2293.5	2320.4	2318.1
132.5°	2349.6	2381.5	2408.1	2430.2	2427.8
135°	2452.1	2491.1	2512.9	2537.5	2532.6
137.5°	2559.2	2588.4	2613.0	2637.3	2630.1
140°	2663.9	2683.7	2710.3	2732.2	2720.2
142.5°	2752.0	2769.1	2800.6	2820.0	2807.9
145°	2844.6	2841.9	2883.4	2900.5	2888.3
147.5°	2924.8	2917.6	2958.9	2971.1	2961.5
150°	3003.0	2985.9	3024.9	3039.3	3027.2
152.5°	3068.6	3049.2	3085.7	3100.4	3083.4
155°	3132.0	3110.3	3139.5	3154.0	3134.6
157.5°	3183.3	3163.9	3185.8	3202.9	3183.3
160°	3227.2	3212.4	3227.2	3241.7	3224.6
162.5°	3266.0	3251.5	3263.7	3280.8	3258.8
165°	3300.2	3285.6	3293.0	3310.0	3293.0
167.5°	3327.1	3312.4	3319.8	3336.9	3314.9
170°	3349.1	3334.3	3339.2	3356.3	3334.3
172.5°	3363.6	3349.1	3353.9	3371.0	3349.1
175°	3375.7	3358.6	3363.6	3380.6	3356.3
177.5°	3380.6	3363.6	3366.1	3383.2	3361.3
180°	3368.5	3368.5	3368.5	3368.5	3368.5

TEST NUMBER: P912135

CATALOG NUMBER: DFN2DIP-SQ4F0-060D090US850-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.03	8.76	9.10	9.83	11.28	3.99	4.72	5.06	5.79	7.24
	3H	9.70	10.36	10.78	11.43	12.91	5.17	5.82	6.25	6.90	8.37
	4H	10.31	10.93	11.40	12.01	13.49	5.62	6.24	6.71	7.32	8.79
	6H	10.73	11.30	11.83	12.38	13.87	5.93	6.50	7.03	7.59	9.08
	8H	10.86	11.40	11.96	12.49	13.98	6.02	6.56	7.13	7.66	9.15
	12H	10.92	11.43	12.02	12.52	14.03	6.06	6.58	7.17	7.67	9.18
4H	2H	8.03	8.65	9.13	9.73	11.21	4.57	5.19	5.67	6.27	7.75
	3H	9.86	10.37	10.96	11.48	12.97	5.92	6.43	7.02	7.54	9.03
	4H	10.55	11.02	11.66	12.12	13.63	6.46	6.93	7.57	8.03	9.54
	6H	11.06	11.47	12.18	12.59	14.09	6.88	7.28	7.99	8.40	9.91
	8H	11.24	11.62	12.36	12.73	14.25	7.00	7.38	8.12	8.49	10.01
	12H	11.33	11.68	12.47	12.80	14.32	7.06	7.41	8.20	8.53	10.06
8H	4H	10.51	10.89	11.63	12.00	13.52	6.74	7.11	7.85	8.23	9.75
	6H	11.08	11.39	12.22	12.54	14.06	7.25	7.56	8.39	8.72	10.24
	8H	11.30	11.57	12.44	12.70	14.24	7.44	7.72	8.59	8.85	10.39
	12H	11.44	11.67	12.58	12.80	14.38	7.56	7.80	8.71	8.93	10.50
12H	4H	10.46	10.80	11.59	11.92	13.45	6.74	7.08	7.87	8.20	9.73
	6H	11.05	11.33	12.20	12.46	14.00	7.30	7.58	8.45	8.71	10.25
	8H	11.27	11.51	12.42	12.64	14.22	7.51	7.75	8.66	8.88	10.45

END OF REPORT