

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P912244

Luminaire Tested: DFN2DIP-SQ4F0-090D100US850-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P912244
REPORT IS A COMBINATION OF REPORTS P900137 AND P896915
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-090D100US850-FLLFLL
Description: 4 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 19695.9 lumens
Efficiency: N/A
Efficacy: 125.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 157.4
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.983
Total Harmonic Distortion (THDi): 0.073
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P912244

CATALOG NUMBER: DFN2DIP-SQ4F0-090D100US850-FLLFLL

Luminous Intensity Polar Plot

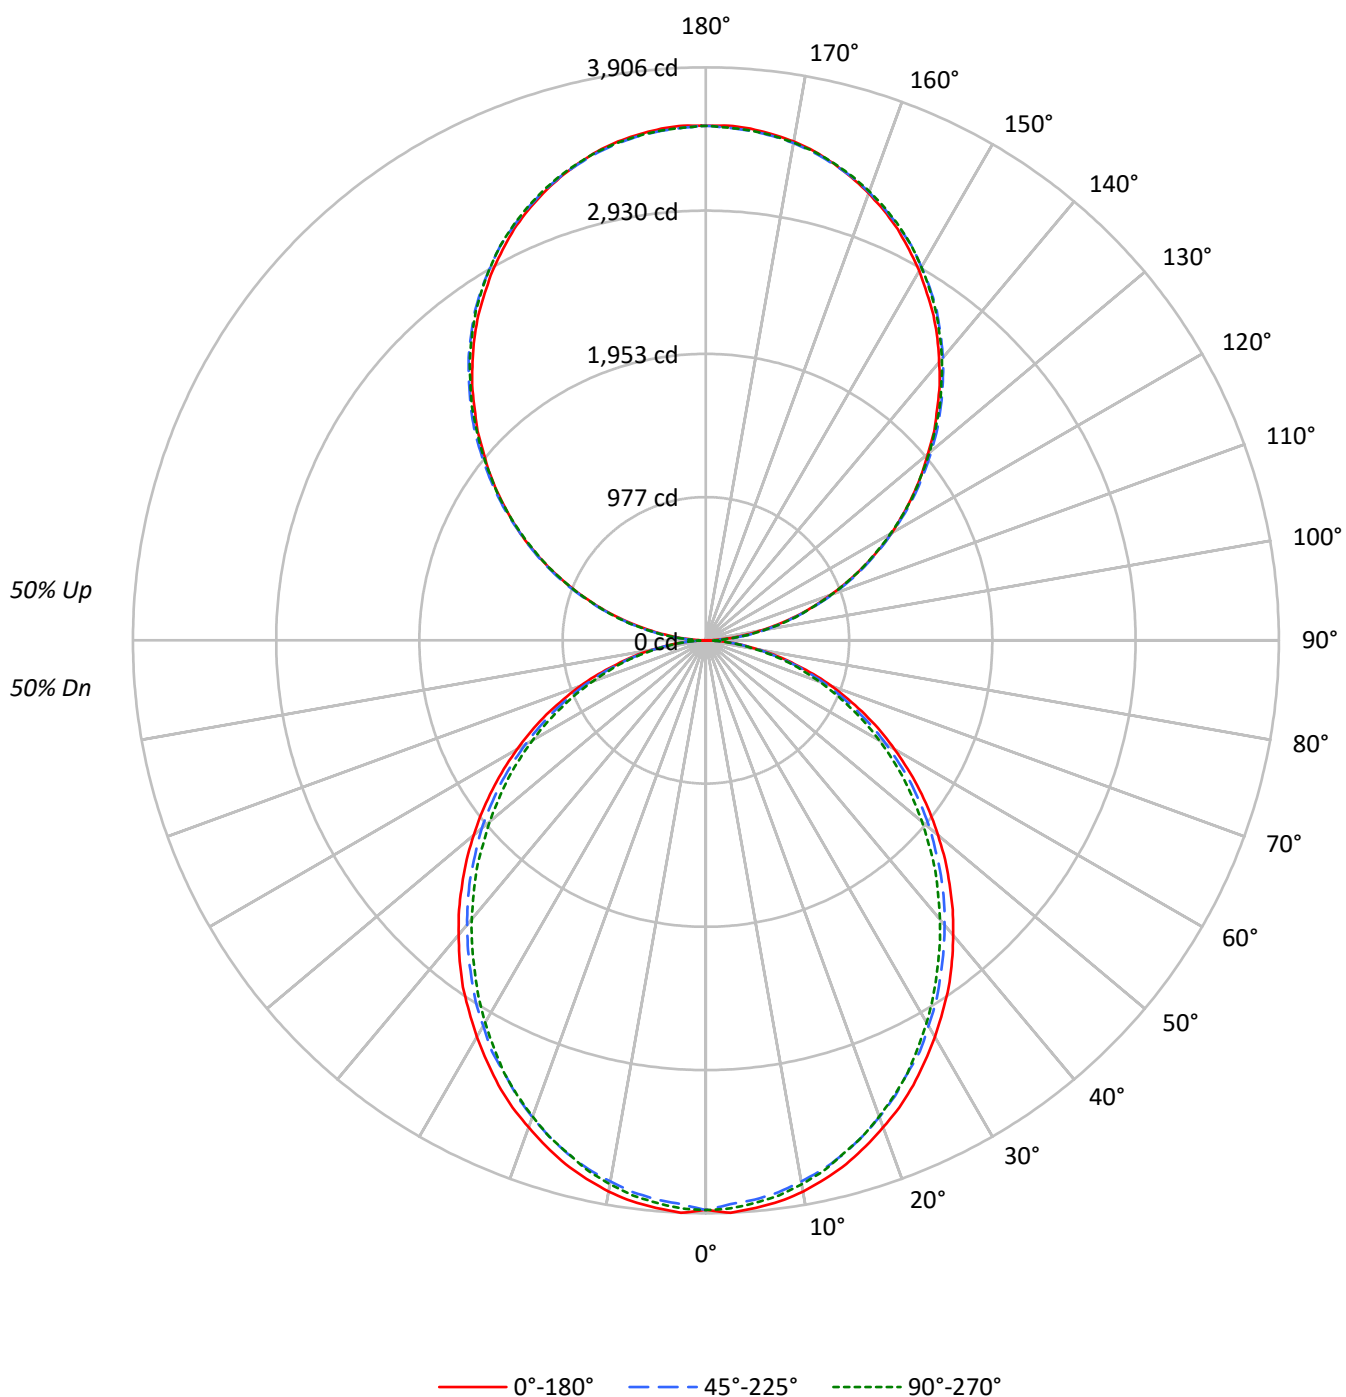

TEST NUMBER: P912244

CATALOG NUMBER: DFN2DIP-SQ4F0-090D100US850-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	69	69	69	56	56	56
1	98	93	90	86	90	86	83	80	73	71	69	61	59	58	50	49	48
2	89	82	76	70	82	76	70	66	64	60	57	54	51	48	44	42	40
3	81	72	64	59	75	67	60	55	57	52	48	47	44	41	39	36	34
4	74	64	56	50	68	59	52	47	50	45	41	42	38	35	35	32	29
5	68	57	48	42	63	53	45	40	45	39	35	38	34	30	31	28	26
6	63	51	43	37	58	47	40	35	41	35	31	34	30	27	28	25	23
7	58	46	38	32	54	43	36	31	37	31	27	31	27	23	26	23	20
8	54	42	34	29	50	39	32	27	34	28	24	29	24	21	24	20	18
9	50	38	31	25	46	36	29	24	31	25	21	26	22	19	22	19	16
10	47	35	28	23	43	33	26	22	28	23	19	24	20	17	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2725	2725	2725
5°	2729	2688	2706
10°	2707	2652	2670
15°	2667	2609	2614
20°	2614	2549	2556
25°	2560	2477	2489
30°	2493	2410	2403
35°	2429	2331	2313
40°	2351	2251	2227
45°	2273	2171	2139
50°	2188	2087	2037
55°	2098	1990	1944
60°	1997	1874	1837
65°	1887	1755	1711
70°	1747	1610	1575
75°	1553	1436	1451
80°	1319	1214	1213
85°	953	831	815

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2762 cd/sqm

TEST NUMBER: P912244

CATALOG NUMBER: DFN2DIP-SQ4F0-090D100US850-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	365.5	1.9
10°-20°	1028.5	5.2
20°-30°	1511.4	7.7
30°-40°	1755.4	8.9
40°-50°	1753.3	8.9
50°-60°	1528.8	7.8
60°-70°	1130.1	5.7
70°-80°	639.4	3.2
80°-90°	178.7	0.9
90°-100°	217.0	1.1
100°-110°	689.6	3.5
110°-120°	1180.1	6.0
120°-130°	1552.0	7.9
130°-140°	1742.1	8.8
140°-150°	1708.3	8.7
150°-160°	1433.0	7.3
160°-170°	950.4	4.8
170°-180°	332.2	1.7
0°-30°	2905.4	14.8
0°-40°	4660.9	23.7
0°-60°	7942.9	40.3
0°-90°	9891.2	50.2
90°-120°	2086.7	10.6
90°-150°	7089.1	36.0
90°-180°	9805.0	49.8
0°-180°	19695.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3884	3884	3884	3884	3884	
5°	3884	3869	3828	3858	3850	369
15°	3697	3675	3626	3641	3622	1041
25°	3346	3316	3253	3260	3253	1540
35°	2887	2850	2790	2767	2748	1803
45°	2349	2323	2267	2226	2211	1813
55°	1778	1755	1710	1666	1647	1589
65°	1199	1176	1139	1106	1087	1185
75°	627	620	601	579	586	670
85°	153	149	146	134	131	171
90°	3	38	104	97	100	19
95°	154	184	189	189	184	172
105°	637	645	651	657	657	672
115°	1184	1201	1196	1193	1184	1171
125°	1722	1749	1740	1731	1728	1539
135°	2228	2261	2267	2264	2255	1722
145°	2705	2726	2743	2746	2734	1690
155°	3093	3101	3111	3126	3116	1424
165°	3365	3361	3361	3383	3368	949
175°	3501	3493	3486	3507	3489	333
180°	3507	3507	3507	3507	3507	

TEST NUMBER: P912244

CATALOG NUMBER: DFN2DIP-SQ4F0-090D100US850-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3883.6	3883.6	3883.6	3883.6	3883.6
2.5°	3906.2	3887.6	3846.5	3883.6	3876.5
5°	3883.6	3869.0	3827.8	3857.5	3850.3
7.5°	3857.5	3835.4	3794.1	3824.3	3816.7
10°	3816.7	3790.6	3745.8	3775.5	3764.4
12.5°	3760.4	3738.2	3693.5	3712.0	3704.6
15°	3697.1	3674.9	3626.1	3641.2	3622.5
17.5°	3618.6	3596.4	3547.7	3566.3	3547.7
20°	3532.6	3510.4	3458.1	3469.2	3454.5
22.5°	3447.0	3413.4	3364.6	3364.6	3357.1
25°	3346.0	3316.2	3252.9	3260.0	3252.9
27.5°	3233.8	3207.7	3159.4	3148.3	3129.7
30°	3122.2	3092.0	3036.1	3025.0	3010.0
32.5°	3002.5	2980.3	2920.4	2897.9	2882.8
35°	2886.8	2849.6	2789.7	2767.2	2748.5
37.5°	2756.1	2722.4	2662.5	2636.4	2617.8
40°	2621.7	2591.6	2531.7	2498.5	2483.5
42.5°	2490.9	2460.9	2401.4	2363.8	2341.7
45°	2349.1	2323.0	2266.7	2225.9	2210.9
47.5°	2210.9	2184.7	2124.8	2083.7	2061.5
50°	2065.1	2046.4	1994.1	1941.9	1923.2
52.5°	1923.2	1897.1	1848.7	1807.6	1781.4
55°	1777.8	1755.2	1710.4	1665.7	1647.1
57.5°	1632.0	1613.4	1564.7	1519.9	1504.8
60°	1486.2	1471.5	1419.2	1378.0	1367.0
62.5°	1344.3	1318.2	1280.9	1243.7	1228.7
65°	1198.9	1176.3	1139.1	1105.5	1086.8
67.5°	1049.6	1030.6	997.2	971.2	956.1
70°	911.3	896.2	862.6	836.4	821.8
72.5°	769.4	754.3	735.7	709.6	698.6
75°	627.3	620.0	601.1	578.9	586.4
77.5°	500.4	485.4	477.9	466.8	455.7
80°	373.6	369.6	362.1	351.0	343.6
82.5°	254.0	254.0	250.4	235.3	235.3
85°	152.9	149.4	145.8	134.3	130.8
87.5°	67.3	59.8	52.3	41.3	37.3
90°	3.2	38.0	103.6	97.3	100.5
92.5°	65.5	88.8	92.0	95.2	95.2
95°	154.4	184.0	189.3	189.3	184.0
97.5°	257.0	284.5	296.1	296.1	296.1
100°	375.4	399.7	408.1	408.1	405.0
102.5°	500.2	518.1	529.8	532.9	529.8
105°	636.6	645.0	651.3	656.6	656.6
107.5°	771.9	784.6	784.6	786.7	771.9
110°	903.1	919.9	919.9	919.9	911.5

TEST NUMBER: P912244

CATALOG NUMBER: DFN2DIP-SQ4F0-090D100US850-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1044.7	1062.6	1059.5	1051.0	1044.7
115°	1184.3	1201.2	1195.9	1192.7	1184.3
117.5°	1322.8	1346.1	1331.2	1322.8	1314.3
120°	1462.3	1485.6	1462.3	1462.3	1452.9
122.5°	1589.2	1618.8	1604.1	1595.6	1589.2
125°	1722.5	1748.9	1740.5	1730.9	1727.8
127.5°	1852.6	1885.3	1873.7	1861.0	1852.6
130°	1974.1	2012.2	2007.0	2000.5	1989.0
132.5°	2110.5	2140.1	2142.3	2127.5	2119.0
135°	2227.9	2260.7	2267.0	2263.9	2255.4
137.5°	2359.1	2385.5	2390.8	2388.7	2375.9
140°	2474.3	2500.7	2515.5	2515.5	2503.9
142.5°	2592.7	2619.1	2627.6	2630.8	2619.1
145°	2704.7	2725.9	2742.9	2746.0	2734.4
147.5°	2805.2	2831.7	2844.4	2849.7	2838.0
150°	2908.9	2926.9	2938.5	2947.9	2938.5
152.5°	3000.8	3018.8	3033.7	3045.3	3033.7
155°	3092.9	3101.3	3110.9	3125.6	3116.1
157.5°	3172.2	3178.5	3183.8	3204.9	3190.1
160°	3243.0	3249.4	3252.5	3270.4	3257.8
162.5°	3308.6	3308.6	3311.7	3331.8	3317.0
165°	3364.6	3361.4	3361.4	3382.6	3367.8
167.5°	3415.4	3405.8	3405.8	3427.0	3412.2
170°	3453.4	3445.0	3441.8	3463.0	3445.0
172.5°	3479.8	3471.4	3468.2	3489.4	3471.4
175°	3501.0	3492.6	3486.3	3507.3	3489.4
177.5°	3512.6	3504.2	3497.8	3515.8	3497.8
180°	3507.3	3507.3	3507.3	3507.3	3507.3

TEST NUMBER: P912244

CATALOG NUMBER: DFN2DIP-SQ4F0-090D100US850-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.79	11.65	11.74	12.62	13.89	10.34	11.21	11.30	12.18	13.44
	3H	12.45	13.23	13.42	14.21	15.50	11.96	12.74	12.93	13.72	15.01
	4H	13.04	13.77	14.02	14.76	16.06	12.55	13.28	13.53	14.26	15.56
	6H	13.45	14.12	14.44	15.11	16.42	12.95	13.62	13.94	14.61	15.92
	8H	13.55	14.20	14.55	15.20	16.51	13.05	13.69	14.05	14.70	16.01
	12H	13.60	14.21	14.60	15.21	16.55	13.09	13.70	14.10	14.70	16.04
4H	2H	11.25	11.98	12.23	12.97	14.26	10.89	11.63	11.88	12.61	13.91
	3H	13.12	13.73	14.11	14.74	16.06	12.71	13.32	13.71	14.34	15.65
	4H	13.84	14.40	14.84	15.40	16.74	13.41	13.97	14.42	14.98	16.31
	6H	14.36	14.84	15.37	15.87	17.20	13.92	14.41	14.94	15.44	16.77
	8H	14.51	14.96	15.52	15.98	17.33	14.07	14.52	15.09	15.54	16.89
	12H	14.58	14.99	15.62	16.03	17.38	14.13	14.54	15.17	15.58	16.93
8H	4H	14.03	14.48	15.05	15.51	16.85	13.66	14.11	14.67	15.13	16.48
	6H	14.67	15.04	15.71	16.11	17.45	14.29	14.66	15.33	15.72	17.07
	8H	14.89	15.22	15.94	16.27	17.64	14.50	14.83	15.55	15.88	17.24
	12H	15.03	15.32	16.08	16.36	17.77	14.62	14.91	15.67	15.95	17.36
12H	4H	14.02	14.43	15.05	15.46	16.82	13.65	14.06	14.69	15.10	16.45
	6H	14.70	15.03	15.75	16.08	17.44	14.33	14.66	15.38	15.71	17.07
	8H	14.95	15.23	16.00	16.28	17.69	14.57	14.85	15.62	15.90	17.31

END OF REPORT