

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P912258

Luminaire Tested: DFN2DIP-SQ4F0-090D140US850-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P912258
REPORT IS A COMBINATION OF REPORTS P900192 AND P896915
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-090D140US850-RLLFLL
Description: 4 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 22224.4 lumens
Efficiency: N/A
Efficacy: 117.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 188.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.983
Total Harmonic Distortion (THDi): 0.073
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P912258

CATALOG NUMBER: DFN2DIP-SQ4F0-090D140US850-RLLFLL

Luminous Intensity Polar Plot

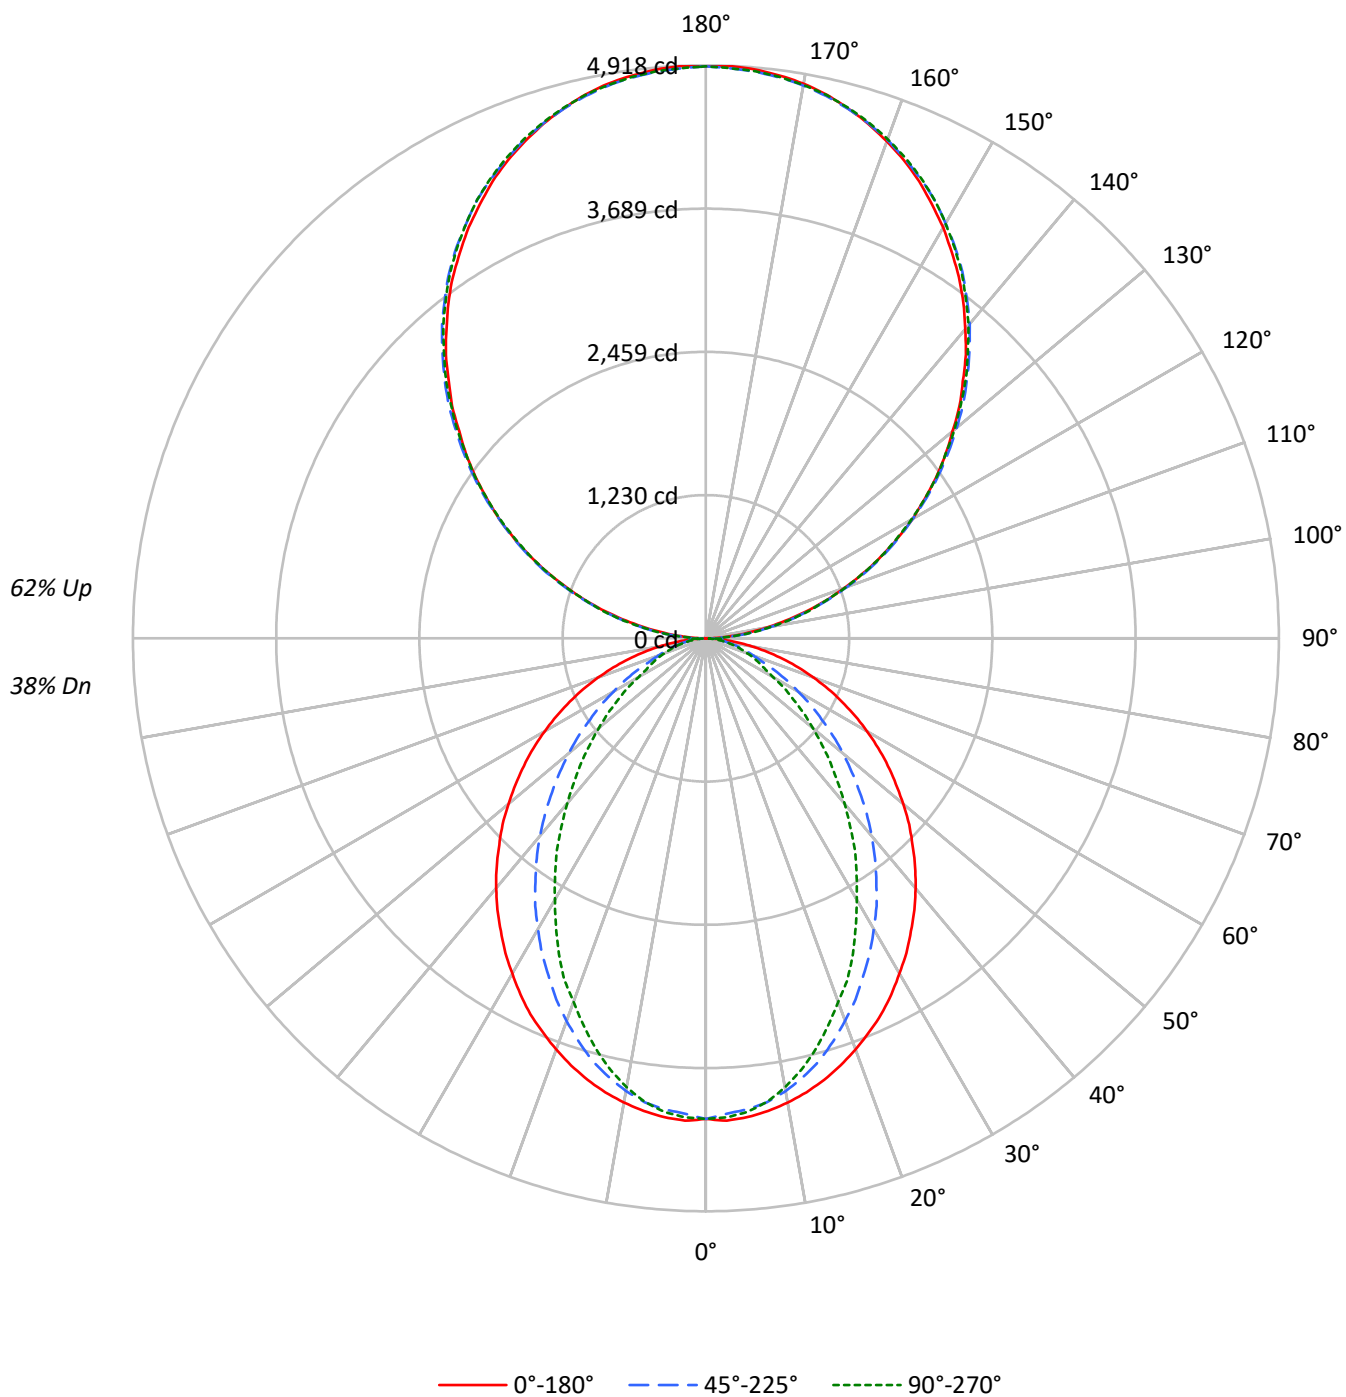

TEST NUMBER: P912258

CATALOG NUMBER: DFN2DIP-SQ4F0-090D140US850-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	104	104	104	104	95	95	95	95	77	77	77	60	60	60	45	45	45
1	96	91	88	84	87	83	80	77	68	66	64	54	52	51	41	40	39
2	87	80	74	69	79	73	68	64	60	56	53	48	45	43	36	35	33
3	80	71	64	58	72	65	59	54	53	49	45	42	39	37	32	30	29
4	73	63	55	50	66	57	51	46	47	43	39	38	35	32	29	27	25
5	67	56	48	43	61	51	45	40	42	37	34	34	31	28	26	24	22
6	62	50	43	37	56	46	39	34	38	33	29	31	27	24	24	22	20
7	57	46	38	33	52	42	35	30	35	30	26	28	25	22	22	20	18
8	53	41	34	29	48	38	31	27	32	27	23	26	22	19	20	18	16
9	50	38	31	26	45	35	28	24	29	24	21	24	20	18	19	16	14
10	46	35	28	23	42	32	26	22	27	22	19	22	18	16	18	15	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2894	2894	2894
5°	2899	2849	2868
10°	2870	2794	2775
15°	2831	2702	2632
20°	2779	2575	2455
25°	2725	2433	2285
30°	2653	2287	2069
35°	2583	2130	1879
40°	2511	1968	1661
45°	2428	1788	1463
50°	2341	1606	1270
55°	2251	1411	1084
60°	2147	1208	893
65°	2027	1001	805
70°	1882	808	730
75°	1700	714	666
80°	1436	600	580
85°	1000	404	442

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 3864 cd/sqm

TEST NUMBER: P912258

CATALOG NUMBER: DFN2DIP-SQ4F0-090D140US850-RLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	386.6	1.7
10°-20°	1061.3	4.8
20°-30°	1490.1	6.7
30°-40°	1624.3	7.3
40°-50°	1492.9	6.7
50°-60°	1172.4	5.3
60°-70°	763.1	3.4
70°-80°	392.8	1.8
80°-90°	114.3	0.5
90°-100°	303.8	1.4
100°-110°	965.4	4.3
110°-120°	1652.1	7.4
120°-130°	2172.8	9.8
130°-140°	2438.9	11.0
140°-150°	2391.6	10.8
150°-160°	2006.2	9.0
160°-170°	1330.5	6.0
170°-180°	465.0	2.1
0°-30°	2938.0	13.2
0°-40°	4562.3	20.5
0°-60°	7227.6	32.5
0°-90°	8497.8	38.2
90°-120°	2921.4	13.1
90°-150°	9924.8	44.7
90°-180°	13727.0	61.8
0°-180°	22224.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4125	4125	4125	4125	4125	
5°	4125	4106	4058	4091	4080	391
15°	3924	3882	3756	3685	3648	1106
25°	3562	3442	3196	3043	2986	1638
35°	3069	2878	2550	2315	2232	1921
45°	2509	2258	1867	1601	1512	1937
55°	1908	1616	1213	989	918	1705
65°	1288	986	650	523	511	1277
75°	687	425	299	272	269	726
85°	160	82	71	71	71	184
90°	4	53	145	136	141	22
95°	216	258	265	265	258	241
105°	891	903	912	919	919	940
115°	1658	1682	1674	1670	1658	1640
125°	2412	2448	2437	2423	2419	2155
135°	3119	3165	3174	3169	3158	2411
145°	3787	3816	3840	3844	3828	2366
155°	4330	4342	4355	4376	4363	1993
165°	4710	4706	4706	4736	4715	1329
175°	4901	4890	4881	4910	4885	466
180°	4910	4910	4910	4910	4910	

TEST NUMBER: P912258

CATALOG NUMBER: DFN2DIP-SQ4F0-090D140US850-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4125.1	4125.1	4125.1	4125.1	4125.1
2.5°	4143.8	4125.1	4083.9	4121.6	4114.1
5°	4125.1	4106.5	4057.8	4091.4	4080.3
7.5°	4091.4	4069.3	4017.0	4031.7	4013.0
10°	4046.7	4020.6	3946.2	3934.6	3912.4
12.5°	3990.8	3957.2	3856.2	3834.0	3792.8
15°	3923.5	3882.4	3755.6	3684.7	3647.5
17.5°	3845.1	3785.3	3628.4	3546.5	3486.7
20°	3755.6	3680.8	3494.1	3401.1	3318.7
22.5°	3658.6	3572.6	3355.9	3229.2	3173.4
25°	3561.6	3441.9	3195.6	3042.7	2986.4
27.5°	3445.9	3318.7	3046.2	2870.8	2784.8
30°	3322.7	3180.5	2881.8	2691.8	2590.7
32.5°	3203.0	3031.1	2725.4	2501.2	2407.7
35°	3068.8	2878.3	2549.9	2314.7	2232.3
37.5°	2938.1	2732.6	2385.6	2127.7	2034.7
40°	2799.9	2576.1	2213.7	1948.7	1851.7
42.5°	2658.1	2419.3	2042.1	1765.7	1672.6
45°	2508.8	2258.5	1866.7	1601.3	1511.8
47.5°	2366.9	2102.0	1698.8	1433.4	1351.4
50°	2210.1	1945.1	1534.4	1276.6	1198.5
52.5°	2056.9	1776.8	1377.6	1131.2	1060.3
55°	1907.5	1616.4	1213.1	989.4	918.5
57.5°	1754.7	1456.0	1067.9	858.7	798.9
60°	1597.7	1299.1	914.6	724.4	664.6
62.5°	1444.9	1146.3	783.8	604.8	575.1
65°	1288.0	985.5	649.5	522.8	511.4
67.5°	1138.7	836.1	522.8	459.0	447.9
70°	981.9	690.8	433.0	395.7	380.6
72.5°	832.5	556.1	362.0	332.3	324.8
75°	686.8	425.4	298.7	272.5	268.9
77.5°	541.4	302.2	235.2	220.2	212.7
80°	406.8	216.7	179.0	164.4	164.4
82.5°	283.6	145.7	123.2	115.7	115.7
85°	160.4	82.0	70.9	70.9	70.9
87.5°	59.8	29.7	29.7	26.2	26.2
90°	4.4	53.3	145.1	136.2	140.6
92.5°	91.8	124.3	128.8	133.2	133.2
95°	216.1	257.6	264.9	264.9	257.6
97.5°	359.8	398.2	414.5	414.5	414.5
100°	525.6	559.6	571.4	571.4	566.9
102.5°	700.2	725.4	741.7	746.1	741.7
105°	891.2	903.1	911.9	919.3	919.3
107.5°	1080.6	1098.5	1098.5	1101.3	1080.6
110°	1264.3	1287.9	1287.9	1287.9	1276.0

TEST NUMBER: P912258

CATALOG NUMBER: DFN2DIP-SQ4F0-090D140US850-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1462.5	1487.7	1483.3	1471.4	1462.5
115°	1658.0	1681.7	1674.3	1669.8	1658.0
117.5°	1851.9	1884.5	1863.8	1851.9	1840.1
120°	2047.3	2079.9	2047.3	2047.3	2034.0
122.5°	2225.0	2266.4	2245.7	2233.9	2225.0
125°	2411.5	2448.5	2436.6	2423.3	2418.8
127.5°	2593.5	2639.4	2623.1	2605.4	2593.5
130°	2763.7	2817.1	2809.7	2800.8	2784.5
132.5°	2954.7	2996.2	2999.2	2978.4	2966.6
135°	3119.1	3165.0	3173.8	3169.4	3157.5
137.5°	3302.6	3339.6	3347.1	3344.1	3326.3
140°	3464.0	3501.0	3521.7	3521.7	3505.4
142.5°	3629.8	3666.8	3678.7	3683.1	3666.8
145°	3786.7	3816.3	3840.0	3844.5	3828.2
147.5°	3927.3	3964.3	3982.1	3989.5	3973.2
150°	4072.4	4097.5	4113.8	4127.1	4113.8
152.5°	4201.2	4226.4	4247.1	4263.3	4247.1
155°	4330.0	4341.8	4355.2	4375.9	4362.6
157.5°	4441.0	4449.9	4457.3	4486.9	4466.2
160°	4540.2	4549.1	4553.6	4578.7	4560.9
162.5°	4632.0	4632.0	4636.4	4664.6	4643.8
165°	4710.5	4706.0	4706.0	4735.7	4714.9
167.5°	4781.5	4768.1	4768.1	4797.8	4777.0
170°	4834.8	4822.9	4818.5	4848.1	4822.9
172.5°	4871.8	4860.0	4855.5	4885.1	4860.0
175°	4901.4	4889.6	4880.7	4910.3	4885.1
177.5°	4917.6	4905.9	4897.0	4922.1	4897.0
180°	4910.3	4910.3	4910.3	4910.3	4910.3

TEST NUMBER: P912258

CATALOG NUMBER: DFN2DIP-SQ4F0-090D140US850-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.64	10.39	10.70	11.44	12.87	5.60	6.35	6.66	7.40	8.84
	3H	11.32	11.98	12.38	13.05	14.50	6.79	7.45	7.85	8.52	9.97
	4H	11.92	12.55	13.00	13.62	15.08	7.23	7.86	8.31	8.93	10.39
	6H	12.35	12.92	13.43	14.00	15.47	7.55	8.13	8.64	9.20	10.67
	8H	12.47	13.02	13.56	14.11	15.57	7.64	8.19	8.73	9.28	10.74
	12H	12.53	13.06	13.63	14.14	15.62	7.68	8.20	8.77	9.28	10.77
4H	2H	9.65	10.28	10.74	11.35	12.80	6.19	6.82	7.28	7.89	9.34
	3H	11.48	12.00	12.57	13.09	14.56	7.53	8.06	8.62	9.15	10.62
	4H	12.17	12.65	13.26	13.73	15.22	8.08	8.56	9.17	9.64	11.13
	6H	12.68	13.09	13.79	14.20	15.69	8.49	8.90	9.60	10.01	11.50
	8H	12.86	13.24	13.96	14.34	15.84	8.62	9.01	9.73	10.11	11.61
	12H	12.95	13.30	14.07	14.41	15.92	8.68	9.03	9.80	10.14	11.65
8H	4H	12.13	12.51	13.23	13.61	15.11	8.35	8.74	9.46	9.84	11.34
	6H	12.70	13.01	13.82	14.16	15.65	8.87	9.19	10.00	10.33	11.83
	8H	12.92	13.19	14.05	14.32	15.83	9.06	9.34	10.20	10.46	11.98
	12H	13.05	13.30	14.19	14.42	15.97	9.18	9.42	10.31	10.54	12.10
12H	4H	12.08	12.42	13.20	13.54	15.04	8.36	8.70	9.48	9.82	11.32
	6H	12.67	12.95	13.80	14.07	15.59	8.92	9.20	10.05	10.32	11.84
	8H	12.89	13.14	14.03	14.26	15.81	9.13	9.37	10.26	10.49	12.05

END OF REPORT