

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P912282

Luminaire Tested: DFN2DIP-SQ4F0-100D100US850-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P912282
REPORT IS A COMBINATION OF REPORTS P900140 AND P896915
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-100D100US850-RLFL
Description: 4 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 19241.1 lumens
Efficiency: N/A
Efficacy: 114.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 167.4
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9968
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P912282

CATALOG NUMBER: DFN2DIP-SQ4F0-100D100US850-RLLFLL

Luminous Intensity Polar Plot

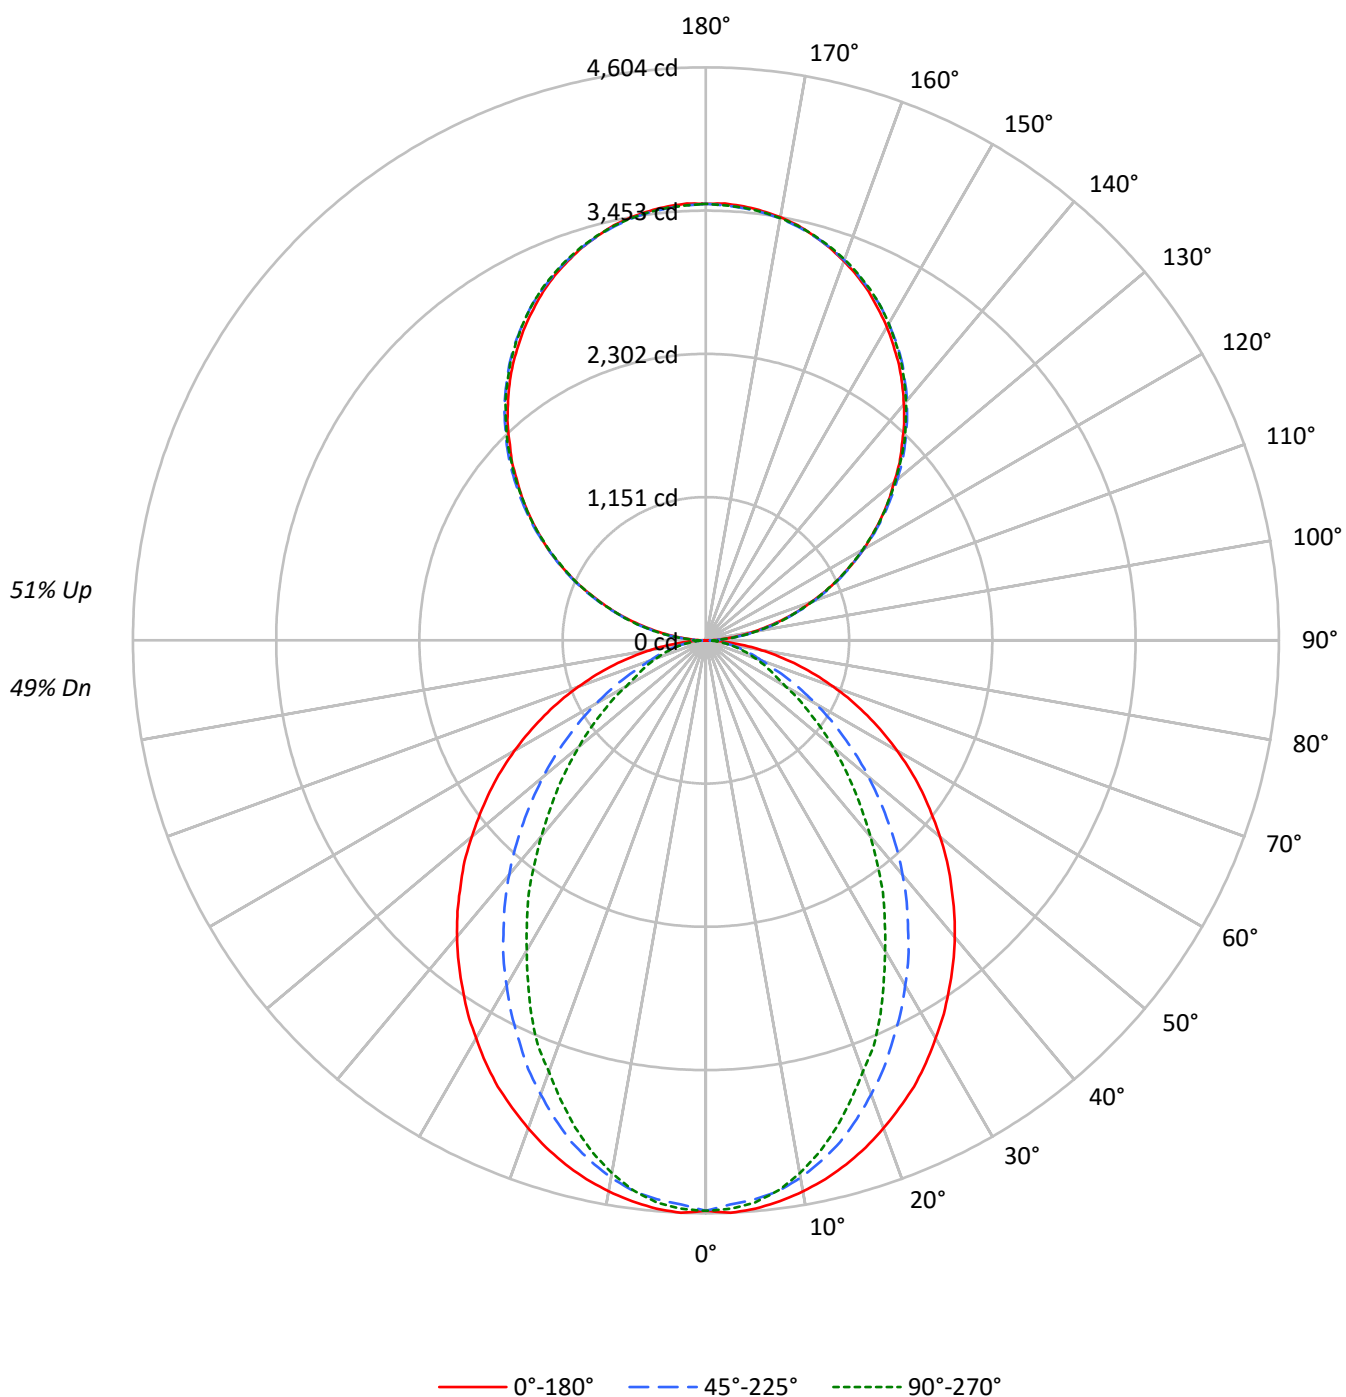

TEST NUMBER: P912282

CATALOG NUMBER: DFN2DIP-SQ4F0-100D100US850-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	68	68	68	55	55	55
1	98	94	90	87	90	87	84	81	73	71	69	61	59	58	50	49	48
2	90	83	77	72	82	76	71	67	65	61	58	54	51	49	44	42	41
3	82	73	66	60	75	68	61	57	58	53	49	48	45	42	40	37	35
4	75	65	57	51	69	60	54	48	51	46	42	43	40	36	36	33	31
5	69	58	50	44	64	54	47	42	46	41	37	39	35	32	32	29	27
6	64	52	44	39	59	49	42	37	42	36	32	35	31	28	30	26	24
7	59	47	40	34	55	44	37	32	38	33	29	32	28	25	27	24	22
8	55	43	36	30	51	40	33	29	35	29	26	30	26	23	25	22	20
9	51	39	32	27	47	37	30	26	32	27	23	27	23	20	23	20	18
10	48	36	29	24	44	34	28	23	30	24	21	25	21	19	22	18	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3216	3216	3216
5°	3221	3166	3186
10°	3189	3104	3084
15°	3145	3002	2924
20°	3087	2861	2728
25°	3028	2703	2539
30°	2948	2541	2298
35°	2869	2367	2087
40°	2790	2187	1845
45°	2697	1987	1625
50°	2602	1784	1411
55°	2502	1568	1204
60°	2386	1342	992
65°	2253	1112	894
70°	2091	898	811
75°	1889	793	740
80°	1595	667	645
85°	1111	448	490

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2762 cd/sqm

TEST NUMBER: P912282

CATALOG NUMBER: DFN2DIP-SQ4F0-100D100US850-RLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	429.6	2.2
10°-20°	1179.3	6.1
20°-30°	1655.6	8.6
30°-40°	1804.7	9.4
40°-50°	1658.8	8.6
50°-60°	1302.7	6.8
60°-70°	847.9	4.4
70°-80°	436.5	2.3
80°-90°	121.4	0.6
90°-100°	217.0	1.1
100°-110°	689.6	3.6
110°-120°	1180.1	6.1
120°-130°	1552.0	8.1
130°-140°	1742.1	9.1
140°-150°	1708.3	8.9
150°-160°	1433.0	7.4
160°-170°	950.4	4.9
170°-180°	332.2	1.7
0°-30°	3264.5	17.0
0°-40°	5069.2	26.3
0°-60°	8030.6	41.7
0°-90°	9436.4	49.0
90°-120°	2086.7	10.8
90°-150°	7089.1	36.8
90°-180°	9805.0	51.0
0°-180°	19241.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4584	4584	4584	4584	4584	
5°	4584	4563	4509	4546	4534	435
15°	4360	4314	4173	4094	4053	1228
25°	3957	3824	3551	3381	3318	1820
35°	3410	3198	2833	2572	2480	2134
45°	2788	2509	2074	1779	1680	2153
55°	2119	1796	1348	1099	1020	1894
65°	1431	1095	722	581	568	1419
75°	763	473	332	303	299	807
85°	178	91	79	79	79	205
90°	3	38	104	97	100	19
95°	154	184	189	189	184	172
105°	637	645	651	657	657	672
115°	1184	1201	1196	1193	1184	1171
125°	1722	1749	1740	1731	1728	1539
135°	2228	2261	2267	2264	2255	1722
145°	2705	2726	2743	2746	2734	1690
155°	3093	3101	3111	3126	3116	1424
165°	3365	3361	3361	3383	3368	949
175°	3501	3493	3486	3507	3489	333
180°	3507	3507	3507	3507	3507	

TEST NUMBER: P912282

CATALOG NUMBER: DFN2DIP-SQ4F0-100D100US850-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4583.5	4583.5	4583.5	4583.5	4583.5
2.5°	4604.1	4583.5	4537.7	4579.5	4571.2
5°	4583.5	4562.8	4508.6	4546.1	4533.7
7.5°	4546.1	4521.4	4463.3	4479.6	4459.0
10°	4496.3	4467.3	4384.5	4371.8	4347.2
12.5°	4434.3	4396.9	4284.6	4260.0	4214.2
15°	4359.5	4313.7	4172.8	4094.1	4052.7
17.5°	4272.3	4205.9	4031.7	3940.5	3874.1
20°	4172.8	4089.7	3882.4	3779.0	3687.4
22.5°	4065.0	3969.6	3728.8	3588.1	3526.0
25°	3957.2	3824.4	3550.6	3380.7	3318.2
27.5°	3828.7	3687.4	3384.7	3189.7	3094.2
30°	3691.9	3533.8	3202.0	2990.9	2878.6
32.5°	3559.0	3367.9	3028.2	2779.2	2675.2
35°	3409.7	3198.1	2833.3	2571.9	2480.3
37.5°	3264.6	3036.1	2650.6	2364.2	2260.7
40°	3111.0	2862.3	2459.7	2165.2	2057.4
42.5°	2953.4	2688.0	2269.1	1961.9	1858.5
45°	2787.5	2509.3	2074.2	1779.3	1679.8
47.5°	2630.0	2335.6	1887.5	1592.6	1501.6
50°	2455.7	2161.2	1704.9	1418.4	1331.7
52.5°	2285.3	1974.2	1530.6	1256.8	1178.1
55°	2119.4	1796.0	1348.0	1099.4	1020.5
57.5°	1949.6	1617.7	1186.5	954.1	887.6
60°	1775.3	1443.5	1016.2	804.9	738.5
62.5°	1605.4	1273.6	870.9	672.1	639.0
65°	1431.2	1094.9	721.7	580.9	568.1
67.5°	1265.3	929.0	580.9	510.0	497.7
70°	1090.9	767.5	481.0	439.6	423.0
72.5°	925.0	617.8	402.2	369.2	360.9
75°	763.1	472.7	331.8	302.8	298.8
77.5°	601.6	335.8	261.4	244.6	236.3
80°	451.9	240.8	199.0	182.7	182.7
82.5°	315.1	161.9	136.9	128.5	128.5
85°	178.2	91.0	78.7	78.7	78.7
87.5°	66.4	33.0	33.0	29.1	29.1
90°	3.2	38.0	103.6	97.3	100.5
92.5°	65.5	88.8	92.0	95.2	95.2
95°	154.4	184.0	189.3	189.3	184.0
97.5°	257.0	284.5	296.1	296.1	296.1
100°	375.4	399.7	408.1	408.1	405.0
102.5°	500.2	518.1	529.8	532.9	529.8
105°	636.6	645.0	651.3	656.6	656.6
107.5°	771.9	784.6	784.6	786.7	771.9
110°	903.1	919.9	919.9	919.9	911.5

TEST NUMBER: P912282

CATALOG NUMBER: DFN2DIP-SQ4F0-100D100US850-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1044.7	1062.6	1059.5	1051.0	1044.7
115°	1184.3	1201.2	1195.9	1192.7	1184.3
117.5°	1322.8	1346.1	1331.2	1322.8	1314.3
120°	1462.3	1485.6	1462.3	1462.3	1452.9
122.5°	1589.2	1618.8	1604.1	1595.6	1589.2
125°	1722.5	1748.9	1740.5	1730.9	1727.8
127.5°	1852.6	1885.3	1873.7	1861.0	1852.6
130°	1974.1	2012.2	2007.0	2000.5	1989.0
132.5°	2110.5	2140.1	2142.3	2127.5	2119.0
135°	2227.9	2260.7	2267.0	2263.9	2255.4
137.5°	2359.1	2385.5	2390.8	2388.7	2375.9
140°	2474.3	2500.7	2515.5	2515.5	2503.9
142.5°	2592.7	2619.1	2627.6	2630.8	2619.1
145°	2704.7	2725.9	2742.9	2746.0	2734.4
147.5°	2805.2	2831.7	2844.4	2849.7	2838.0
150°	2908.9	2926.9	2938.5	2947.9	2938.5
152.5°	3000.8	3018.8	3033.7	3045.3	3033.7
155°	3092.9	3101.3	3110.9	3125.6	3116.1
157.5°	3172.2	3178.5	3183.8	3204.9	3190.1
160°	3243.0	3249.4	3252.5	3270.4	3257.8
162.5°	3308.6	3308.6	3311.7	3331.8	3317.0
165°	3364.6	3361.4	3361.4	3382.6	3367.8
167.5°	3415.4	3405.8	3405.8	3427.0	3412.2
170°	3453.4	3445.0	3441.8	3463.0	3445.0
172.5°	3479.8	3471.4	3468.2	3489.4	3471.4
175°	3501.0	3492.6	3486.3	3507.3	3489.4
177.5°	3512.6	3504.2	3497.8	3515.8	3497.8
180°	3507.3	3507.3	3507.3	3507.3	3507.3

TEST NUMBER: P912282

CATALOG NUMBER: DFN2DIP-SQ4F0-100D100US850-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.13	11.95	12.10	12.93	14.22	7.09	7.91	8.06	8.89	10.18
	3H	12.81	13.54	13.79	14.53	15.84	8.28	9.01	9.26	10.00	11.31
	4H	13.42	14.11	14.42	15.11	16.43	8.73	9.42	9.72	10.42	11.73
	6H	13.84	14.48	14.85	15.48	16.81	9.05	9.69	10.05	10.69	12.02
	8H	13.97	14.58	14.98	15.60	16.92	9.14	9.75	10.15	10.76	12.09
	12H	14.04	14.61	15.05	15.62	16.97	9.18	9.76	10.20	10.77	12.12
4H	2H	11.14	11.84	12.15	12.83	14.15	7.68	8.38	8.69	9.37	10.69
	3H	12.98	13.55	13.99	14.58	15.91	9.03	9.61	10.05	10.64	11.97
	4H	13.67	14.20	14.69	15.22	16.57	9.58	10.11	10.60	11.13	12.48
	6H	14.19	14.64	15.22	15.68	17.04	10.00	10.46	11.03	11.50	12.85
	8H	14.37	14.79	15.40	15.82	17.19	10.13	10.56	11.16	11.59	12.95
	12H	14.47	14.85	15.51	15.90	17.27	10.20	10.58	11.24	11.63	13.00
8H	4H	13.64	14.06	14.67	15.09	16.46	9.86	10.29	10.90	11.32	12.69
	6H	14.21	14.56	15.26	15.63	17.00	10.38	10.73	11.44	11.81	13.17
	8H	14.43	14.74	15.49	15.80	17.18	10.58	10.88	11.64	11.94	13.33
	12H	14.57	14.84	15.64	15.89	17.32	10.70	10.97	11.76	12.02	13.44
12H	4H	13.59	13.97	14.64	15.02	16.39	9.87	10.25	10.92	11.30	12.67
	6H	14.19	14.49	15.25	15.55	16.93	10.43	10.74	11.50	11.80	13.18
	8H	14.41	14.68	15.47	15.73	17.16	10.65	10.92	11.71	11.97	13.40

END OF REPORT