

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P912287

Luminaire Tested: DFN2DIP-SQ4F0-100D110US850-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P912287
REPORT IS A COMBINATION OF REPORTS P901678 AND P898471
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-100D110US850-RLLONL
Description: 4 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 21503.5 lumens
Efficiency: N/A
Efficacy: 122.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 175.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9968
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P912287

CATALOG NUMBER: DFN2DIP-SQ4F0-100D110US850-RLLONL

Luminous Intensity Polar Plot

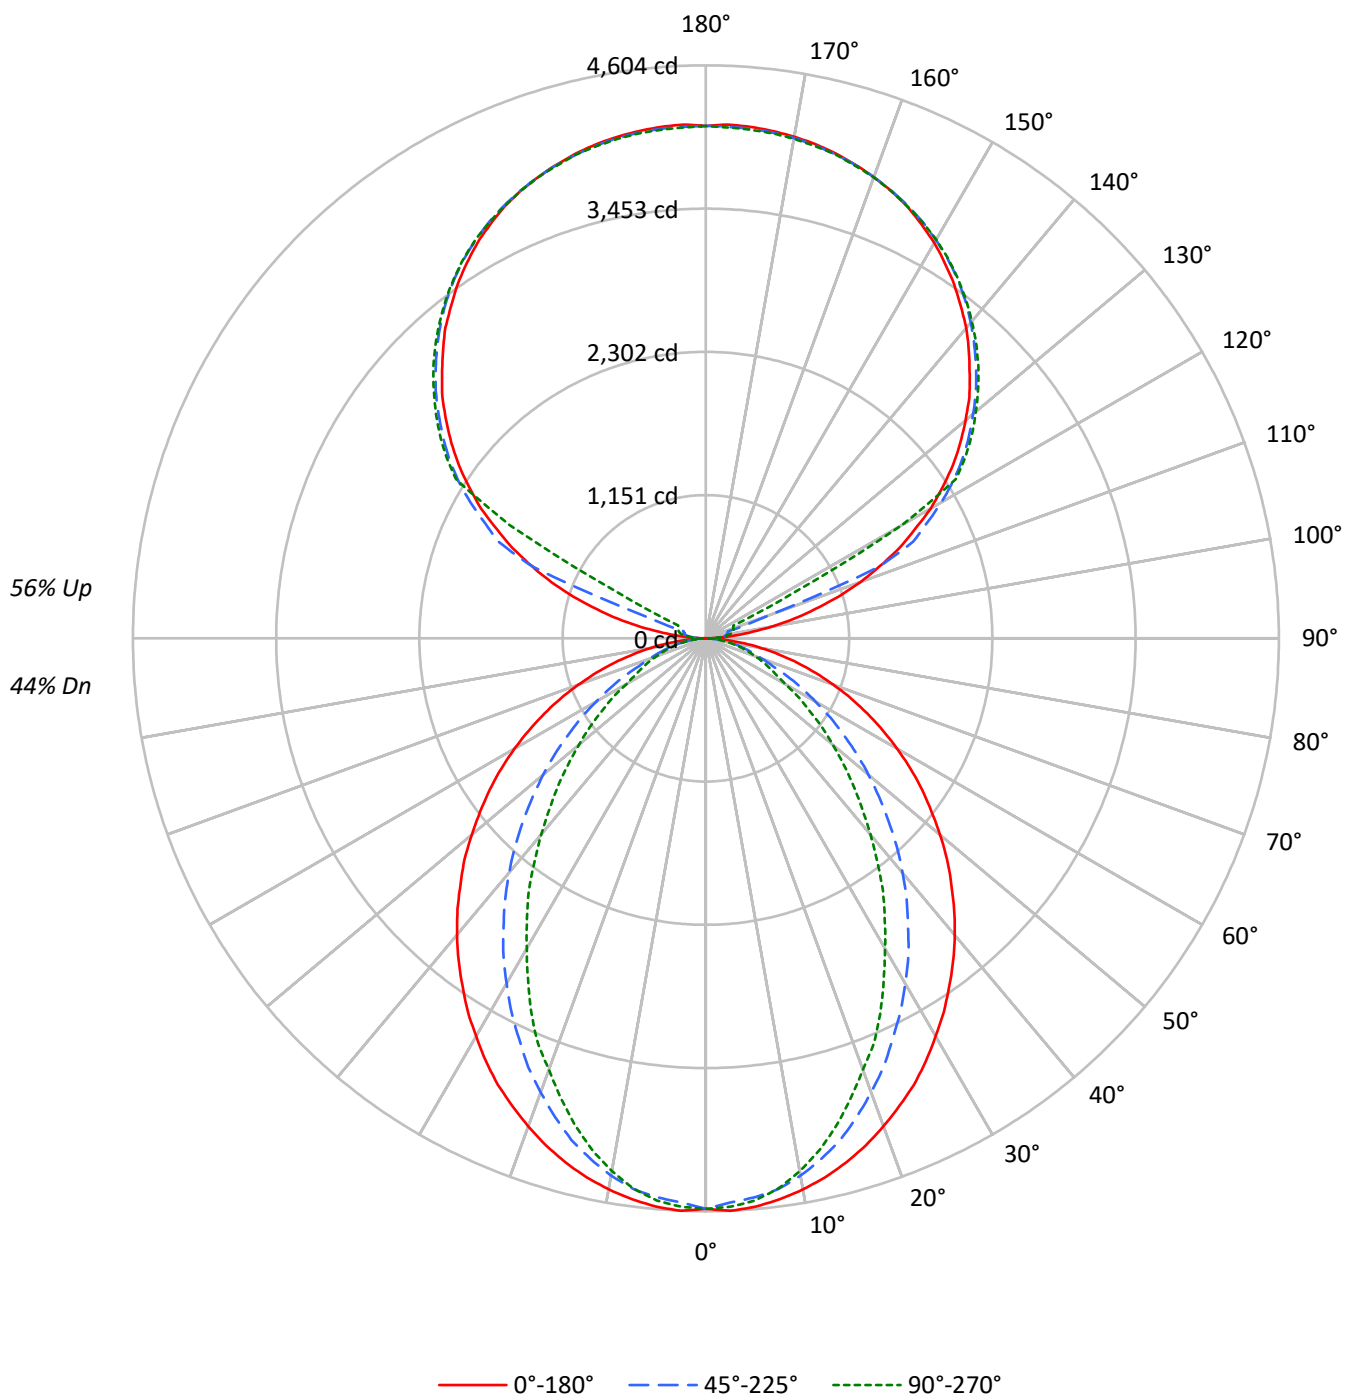

TEST NUMBER: P912287

CATALOG NUMBER: DFN2DIP-SQ4F0-100D110US850-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	97	97	97	97	80	80	80	65	65	65	50	50	50
1	97	93	89	86	89	85	82	79	71	68	66	57	56	55	45	44	43
2	89	81	76	71	81	75	70	66	62	59	56	51	48	46	40	39	37
3	81	72	65	59	74	66	60	55	55	51	47	45	42	40	36	34	32
4	74	64	56	51	68	59	52	47	49	45	41	41	37	34	33	30	28
5	68	57	49	44	62	53	46	41	44	39	35	37	33	30	30	27	25
6	63	51	44	38	58	47	41	36	40	35	31	33	29	26	27	24	22
7	58	46	39	33	53	43	36	31	37	31	27	30	26	24	25	22	20
8	54	42	35	30	50	39	33	28	33	28	24	28	24	21	23	20	18
9	50	39	31	26	46	36	29	25	31	26	22	26	22	19	21	18	16
10	47	35	28	24	43	33	27	22	28	23	20	24	20	17	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3216	3216	3216
5°	3221	3166	3186
10°	3189	3104	3084
15°	3145	3002	2924
20°	3087	2861	2728
25°	3028	2703	2539
30°	2948	2541	2298
35°	2869	2367	2087
40°	2790	2187	1845
45°	2697	1987	1625
50°	2602	1784	1411
55°	2502	1568	1204
60°	2386	1342	992
65°	2253	1112	894
70°	2091	898	811
75°	1889	793	740
80°	1595	667	645
85°	1111	448	490

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2697 cd/sqm

TEST NUMBER: P912287

CATALOG NUMBER: DFN2DIP-SQ4F0-100D110US850-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	429.6	2.0
10°-20°	1179.3	5.5
20°-30°	1655.6	7.7
30°-40°	1804.7	8.4
40°-50°	1658.8	7.7
50°-60°	1302.7	6.1
60°-70°	847.9	3.9
70°-80°	436.5	2.0
80°-90°	118.7	0.6
90°-100°	135.7	0.6
100°-110°	506.1	2.4
110°-120°	1342.2	6.2
120°-130°	2226.1	10.4
130°-140°	2364.7	11.0
140°-150°	2197.7	10.2
150°-160°	1766.9	8.2
160°-170°	1138.5	5.3
170°-180°	391.9	1.8
0°-30°	3264.5	15.2
0°-40°	5069.2	23.6
0°-60°	8030.6	37.3
0°-90°	9433.7	43.9
90°-120°	1984.0	9.2
90°-150°	8772.5	40.8
90°-180°	12070.0	56.1
0°-180°	21503.5	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4584	4584	4584	4584	4584	
5°	4584	4563	4509	4546	4534	435
15°	4360	4314	4173	4094	4053	1228
25°	3957	3824	3551	3381	3318	1820
35°	3410	3198	2833	2572	2480	2134
45°	2788	2509	2074	1779	1680	2153
55°	2119	1796	1348	1099	1020	1894
65°	1431	1095	722	581	568	1419
75°	763	473	332	303	299	807
85°	178	91	79	79	79	205
90°	3	36	59	75	80	20
95°	194	95	116	131	128	229
105°	906	995	182	214	226	968
115°	1713	1763	1838	459	244	1686
125°	2422	2461	2517	2538	2547	2160
135°	2997	3045	3071	3101	3095	2315
145°	3477	3474	3524	3545	3530	2174
155°	3828	3801	3837	3855	3831	1764
165°	4034	4016	4025	4046	4025	1140
175°	4126	4105	4111	4132	4102	393
180°	4117	4117	4117	4117	4117	

TEST NUMBER: P912287

CATALOG NUMBER: DFN2DIP-SQ4F0-100D110US850-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4583.5	4583.5	4583.5	4583.5	4583.5
2.5°	4604.1	4583.5	4537.7	4579.5	4571.2
5°	4583.5	4562.8	4508.6	4546.1	4533.7
7.5°	4546.1	4521.4	4463.3	4479.6	4459.0
10°	4496.3	4467.3	4384.5	4371.8	4347.2
12.5°	4434.3	4396.9	4284.6	4260.0	4214.2
15°	4359.5	4313.7	4172.8	4094.1	4052.7
17.5°	4272.3	4205.9	4031.7	3940.5	3874.1
20°	4172.8	4089.7	3882.4	3779.0	3687.4
22.5°	4065.0	3969.6	3728.8	3588.1	3526.0
25°	3957.2	3824.4	3550.6	3380.7	3318.2
27.5°	3828.7	3687.4	3384.7	3189.7	3094.2
30°	3691.9	3533.8	3202.0	2990.9	2878.6
32.5°	3559.0	3367.9	3028.2	2779.2	2675.2
35°	3409.7	3198.1	2833.3	2571.9	2480.3
37.5°	3264.6	3036.1	2650.6	2364.2	2260.7
40°	3111.0	2862.3	2459.7	2165.2	2057.4
42.5°	2953.4	2688.0	2269.1	1961.9	1858.5
45°	2787.5	2509.3	2074.2	1779.3	1679.8
47.5°	2630.0	2335.6	1887.5	1592.6	1501.6
50°	2455.7	2161.2	1704.9	1418.4	1331.7
52.5°	2285.3	1974.2	1530.6	1256.8	1178.1
55°	2119.4	1796.0	1348.0	1099.4	1020.5
57.5°	1949.6	1617.7	1186.5	954.1	887.6
60°	1775.3	1443.5	1016.2	804.9	738.5
62.5°	1605.4	1273.6	870.9	672.1	639.0
65°	1431.2	1094.9	721.7	580.9	568.1
67.5°	1265.3	929.0	580.9	510.0	497.7
70°	1090.9	767.5	481.0	439.6	423.0
72.5°	925.0	617.8	402.2	369.2	360.9
75°	763.1	472.7	331.8	302.8	298.8
77.5°	601.6	335.8	261.4	244.6	236.3
80°	451.9	240.8	199.0	182.7	182.7
82.5°	315.1	161.9	136.9	128.5	128.5
85°	178.2	91.0	78.7	78.7	78.7
87.5°	66.4	33.0	33.0	29.1	29.1
90°	2.9	35.7	59.4	74.6	80.3
92.5°	74.6	62.7	71.4	77.5	80.3
95°	193.5	95.2	116.0	131.2	128.1
97.5°	348.4	104.4	151.7	160.9	163.8
100°	527.4	119.2	169.8	193.5	199.5
102.5°	723.7	718.1	175.8	208.4	217.6
105°	905.6	995.1	181.9	214.4	226.5
107.5°	1117.2	1191.4	187.9	220.4	232.4
110°	1319.8	1382.1	521.5	223.6	235.2

TEST NUMBER: P912287

CATALOG NUMBER: DFN2DIP-SQ4F0-100D110US850-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1510.6	1563.9	1513.3	229.2	238.4
115°	1712.9	1763.4	1838.2	458.8	244.4
117.5°	1888.7	1948.2	1999.1	1572.8	792.4
120°	2085.4	2129.9	2183.7	2219.4	1817.2
122.5°	2252.0	2299.7	2359.5	2377.3	2380.5
125°	2421.8	2460.8	2517.3	2538.2	2547.0
127.5°	2576.8	2618.5	2663.4	2693.1	2696.0
130°	2722.8	2770.6	2803.1	2836.0	2833.3
132.5°	2871.8	2910.7	2943.3	2970.1	2967.4
135°	2997.1	3044.8	3071.3	3101.4	3095.3
137.5°	3127.9	3163.6	3193.7	3223.4	3214.5
140°	3256.0	3280.0	3312.6	3339.4	3324.6
142.5°	3363.5	3384.3	3422.9	3446.7	3431.8
145°	3476.7	3473.5	3524.1	3545.0	3530.2
147.5°	3574.8	3565.9	3616.4	3631.3	3619.7
150°	3670.2	3649.4	3697.1	3714.8	3700.0
152.5°	3750.5	3726.8	3771.4	3789.5	3768.6
155°	3828.0	3801.4	3837.1	3854.9	3831.2
157.5°	3890.6	3866.9	3893.8	3914.7	3890.6
160°	3944.4	3926.3	3944.4	3962.0	3941.2
162.5°	3991.7	3974.1	3989.0	4009.8	3983.0
165°	4033.5	4015.8	4024.7	4045.5	4024.7
167.5°	4066.4	4048.4	4057.6	4078.5	4051.6
170°	4093.3	4075.2	4081.2	4102.2	4075.2
172.5°	4111.0	4093.3	4099.3	4120.2	4093.3
175°	4125.8	4105.0	4111.0	4131.9	4102.2
177.5°	4131.9	4111.0	4114.2	4135.0	4108.2
180°	4117.1	4117.1	4117.1	4117.1	4117.1

TEST NUMBER: P912287

CATALOG NUMBER: DFN2DIP-SQ4F0-100D110US850-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.62	11.40	11.63	12.42	13.78	6.58	7.36	7.59	8.38	9.74
	3H	12.30	13.00	13.32	14.02	15.40	7.76	8.46	8.79	9.49	10.87
	4H	12.91	13.57	13.94	14.60	15.99	8.21	8.87	9.25	9.91	11.29
	6H	13.33	13.94	14.38	14.97	16.37	8.53	9.14	9.58	10.18	11.57
	8H	13.46	14.03	14.51	15.09	16.48	8.62	9.20	9.67	10.25	11.65
	12H	13.52	14.07	14.57	15.11	16.53	8.66	9.21	9.72	10.26	11.68
4H	2H	10.63	11.29	11.67	12.32	13.71	7.17	7.83	8.21	8.86	10.25
	3H	12.46	13.01	13.51	14.07	15.47	8.52	9.07	9.57	10.13	11.53
	4H	13.15	13.66	14.21	14.71	16.13	9.06	9.57	10.12	10.62	12.04
	6H	13.67	14.10	14.74	15.18	16.59	9.48	9.91	10.55	10.99	12.40
	8H	13.85	14.25	14.91	15.32	16.75	9.61	10.01	10.68	11.08	12.51
	12H	13.94	14.31	15.03	15.39	16.82	9.67	10.04	10.76	11.12	12.55
8H	4H	13.12	13.52	14.19	14.59	16.02	9.34	9.75	10.41	10.81	12.24
	6H	13.69	14.02	14.78	15.13	16.56	9.86	10.19	10.95	11.30	12.73
	8H	13.91	14.20	15.00	15.29	16.74	10.05	10.35	11.15	11.44	12.89
	12H	14.05	14.30	15.15	15.39	16.88	10.17	10.43	11.27	11.51	13.00
12H	4H	13.07	13.43	14.15	14.51	15.95	9.35	9.71	10.43	10.79	12.23
	6H	13.66	13.95	14.76	15.05	16.49	9.91	10.20	11.01	11.30	12.74
	8H	13.88	14.14	14.98	15.23	16.72	10.12	10.38	11.22	11.46	12.95

END OF REPORT