

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P912325

Luminaire Tested: DFN2DIP-SQ4F0-110D120US850-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P912325
REPORT IS A COMBINATION OF REPORTS P901697 AND P898471
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-110D120US850-FLLONL
Description: 4 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 25251.9 lumens
Efficiency: N/A
Efficacy: 129.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 195.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9951
Total Harmonic Distortion (THDi): 0.07
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P912325

CATALOG NUMBER: DFN2DIP-SQ4F0-110D120US850-FLLONL

Luminous Intensity Polar Plot

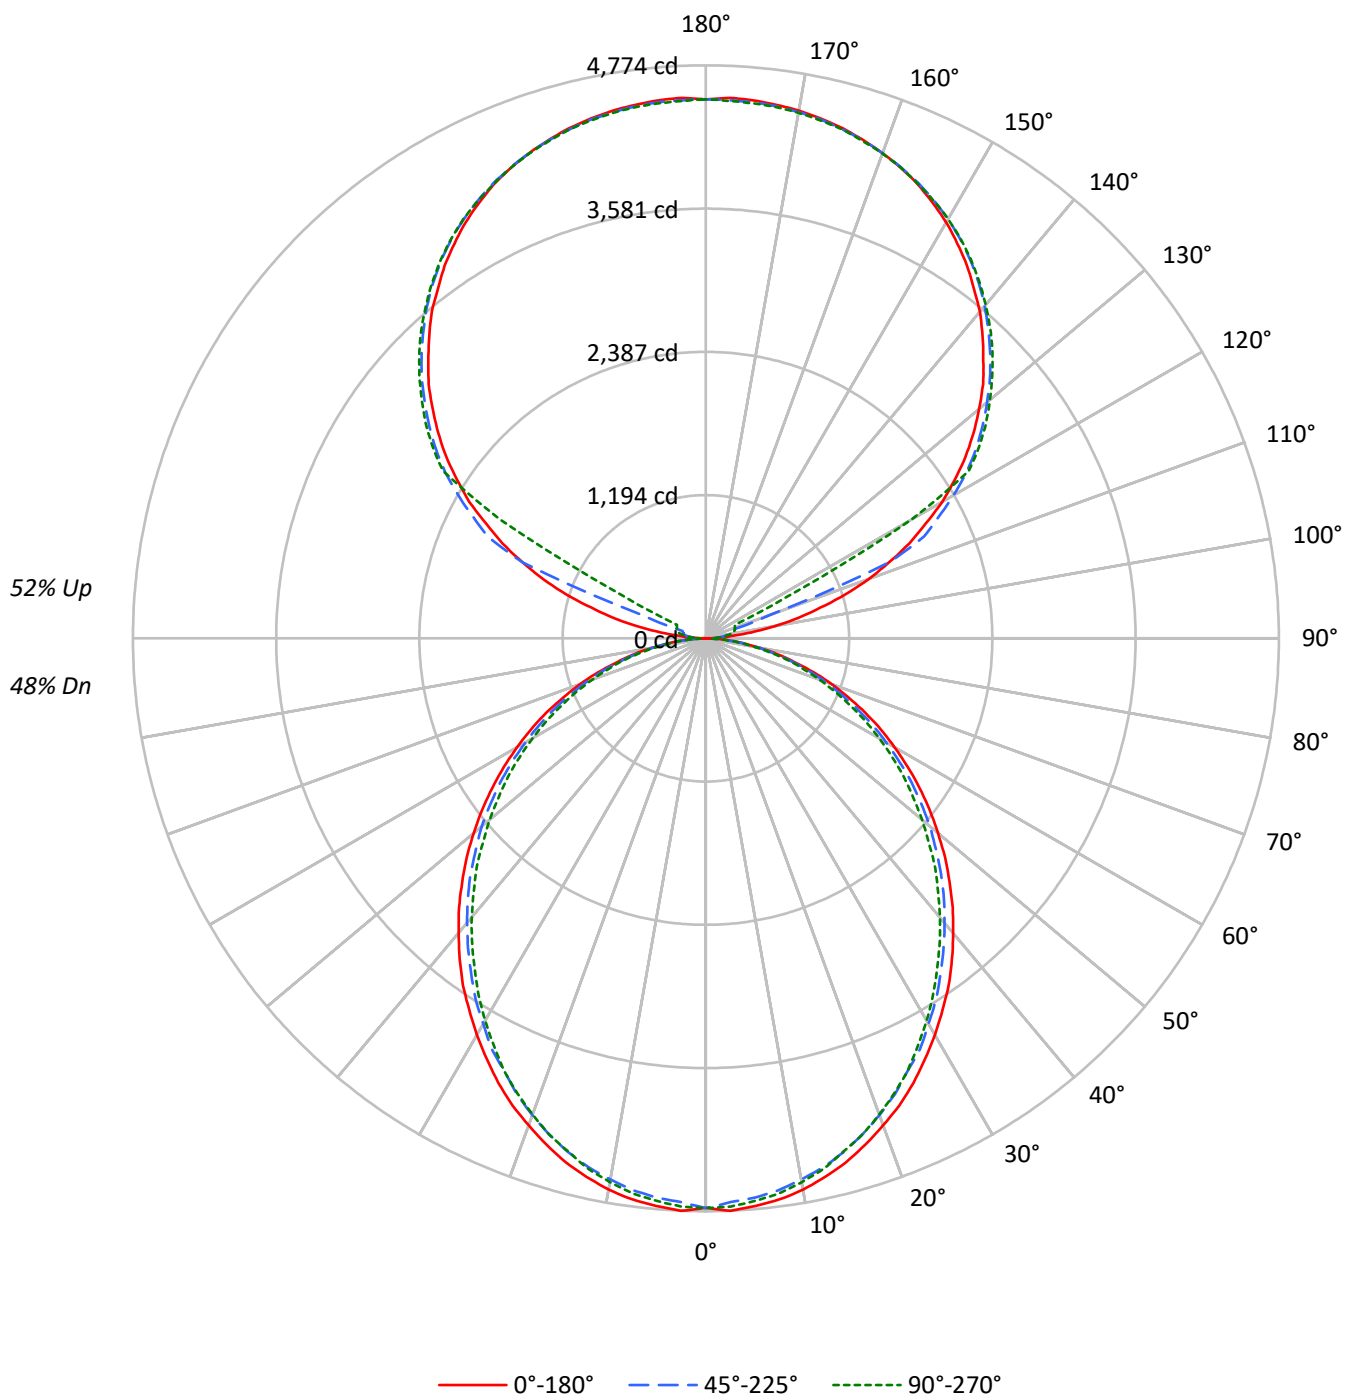

TEST NUMBER: P912325

CATALOG NUMBER: DFN2DIP-SQ4F0-110D120US850-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	98	98	98	98	82	82	82	68	68	68	54	54	54
1	97	93	89	86	89	86	82	79	72	70	67	59	58	56	48	47	46
2	89	81	75	70	81	75	70	65	63	59	56	52	49	47	42	40	39
3	81	71	64	58	74	66	60	54	56	51	47	46	43	40	37	35	33
4	74	63	55	49	68	58	51	46	49	44	40	41	37	34	33	31	28
5	68	56	48	42	62	52	45	40	44	39	34	37	33	30	30	27	25
6	62	50	42	37	57	47	40	34	40	34	30	33	29	26	27	24	22
7	58	46	38	32	53	42	35	30	36	31	26	30	26	23	25	22	19
8	54	41	34	28	49	38	32	27	33	27	24	28	23	20	23	20	17
9	50	38	30	25	46	35	28	24	30	25	21	26	21	18	21	18	16
10	47	35	27	23	43	32	26	21	28	23	19	24	19	17	20	16	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3331	3331	3331
5°	3336	3285	3307
10°	3309	3241	3263
15°	3260	3189	3194
20°	3194	3115	3124
25°	3129	3027	3042
30°	3047	2945	2937
35°	2969	2849	2827
40°	2873	2751	2722
45°	2778	2653	2615
50°	2674	2551	2490
55°	2565	2432	2376
60°	2441	2291	2245
65°	2307	2145	2091
70°	2135	1968	1925
75°	1897	1755	1774
80°	1612	1484	1482
85°	1165	1016	996

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2778 cd/sqm

TEST NUMBER: P912325

CATALOG NUMBER: DFN2DIP-SQ4F0-110D120US850-FLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	446.8	1.8
10°-20°	1257.0	5.0
20°-30°	1847.3	7.3
30°-40°	2145.5	8.5
40°-50°	2142.9	8.5
50°-60°	1868.5	7.4
60°-70°	1381.3	5.5
70°-80°	781.5	3.1
80°-90°	214.2	0.8
90°-100°	148.1	0.6
100°-110°	552.1	2.2
110°-120°	1464.2	5.8
120°-130°	2428.5	9.6
130°-140°	2579.6	10.2
140°-150°	2397.5	9.5
150°-160°	1927.5	7.6
160°-170°	1242.0	4.9
170°-180°	427.5	1.7
0°-30°	3551.1	14.1
0°-40°	5696.6	22.6
0°-60°	9708.0	38.4
0°-90°	12084.9	47.9
90°-120°	2164.4	8.6
90°-150°	9570.0	37.9
90°-180°	13167.0	52.1
0°-180°	25251.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4747	4747	4747	4747	4747	
5°	4747	4729	4678	4715	4706	451
15°	4519	4491	4432	4450	4428	1273
25°	4090	4053	3976	3984	3976	1882
35°	3528	3483	3410	3382	3359	2203
45°	2871	2839	2770	2721	2702	2216
55°	2173	2145	2091	2036	2013	1943
65°	1465	1438	1392	1351	1328	1449
75°	766	758	735	708	717	818
85°	187	182	178	164	160	209
90°	3	39	65	81	88	23
95°	211	104	126	143	140	250
105°	988	1086	198	234	247	1056
115°	1869	1924	2005	500	267	1840
125°	2642	2684	2746	2769	2779	2356
135°	3269	3322	3350	3383	3377	2526
145°	3793	3789	3844	3867	3851	2372
155°	4176	4147	4186	4205	4180	1924
165°	4400	4381	4390	4413	4390	1243
175°	4501	4478	4485	4508	4475	428
180°	4491	4491	4491	4491	4491	

TEST NUMBER: P912325

CATALOG NUMBER: DFN2DIP-SQ4F0-110D120US850-FLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4746.7	4746.7	4746.7	4746.7	4746.7
2.5°	4774.2	4751.5	4701.2	4746.7	4738.0
5°	4746.7	4728.8	4678.4	4714.7	4706.0
7.5°	4714.7	4687.6	4637.3	4674.1	4664.9
10°	4664.9	4632.8	4578.2	4614.4	4600.9
12.5°	4596.1	4569.0	4514.3	4537.0	4527.8
15°	4518.6	4491.4	4431.9	4450.3	4427.6
17.5°	4422.7	4395.6	4336.1	4358.8	4336.1
20°	4317.7	4290.5	4226.6	4240.2	4222.3
22.5°	4213.1	4171.8	4112.3	4112.3	4103.1
25°	4089.5	4053.3	3975.8	3984.5	3975.8
27.5°	3952.5	3920.5	3861.4	3847.9	3825.2
30°	3816.0	3779.1	3710.8	3697.3	3678.9
32.5°	3669.7	3642.6	3569.4	3541.8	3523.4
35°	3528.3	3482.8	3409.6	3382.0	3359.3
37.5°	3368.5	3327.3	3254.2	3222.2	3199.5
40°	3204.3	3167.5	3094.4	3053.7	3035.3
42.5°	3044.5	3007.7	2935.1	2889.1	2862.0
45°	2871.2	2839.2	2770.4	2720.6	2702.2
47.5°	2702.2	2670.3	2597.1	2546.7	2519.5
50°	2524.0	2501.2	2437.2	2373.4	2350.6
52.5°	2350.6	2318.6	2259.6	2209.1	2177.2
55°	2172.9	2145.2	2090.6	2035.8	2013.1
57.5°	1994.6	1971.9	1912.4	1857.6	1839.2
60°	1816.4	1798.6	1734.6	1684.2	1670.7
62.5°	1643.1	1611.2	1565.6	1520.1	1501.7
65°	1465.3	1437.7	1392.2	1351.1	1328.4
67.5°	1282.8	1259.6	1218.9	1187.0	1168.6
70°	1113.8	1095.4	1054.2	1022.3	1004.3
72.5°	940.4	922.0	899.3	867.3	853.7
75°	766.5	757.9	734.6	707.5	716.7
77.5°	611.6	593.2	584.0	570.5	556.9
80°	456.7	451.8	442.6	429.1	419.9
82.5°	310.4	310.4	306.1	287.7	287.7
85°	187.0	182.5	178.2	164.1	159.8
87.5°	82.3	73.1	63.9	50.3	45.5
90°	3.1	38.9	64.9	81.4	87.6
92.5°	81.4	68.3	78.0	84.5	87.6
95°	211.0	103.8	126.5	143.2	139.7
97.5°	380.2	113.9	165.6	175.6	178.7
100°	575.3	130.1	185.2	211.0	217.7
102.5°	789.6	783.4	191.7	227.3	237.3
105°	987.9	1085.6	198.4	233.9	247.0
107.5°	1218.7	1299.7	204.9	240.4	253.5
110°	1439.8	1507.8	568.8	243.9	256.6

TEST NUMBER: P912325

CATALOG NUMBER: DFN2DIP-SQ4F0-110D120US850-FLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1647.9	1706.1	1651.0	250.1	260.1
115°	1868.6	1923.8	2005.2	500.5	266.7
117.5°	2060.4	2125.3	2180.8	1715.7	864.5
120°	2275.0	2323.6	2382.2	2421.3	1982.4
122.5°	2456.8	2508.9	2574.1	2593.4	2596.8
125°	2642.0	2684.4	2746.2	2769.0	2778.6
127.5°	2811.0	2856.6	2905.6	2938.0	2941.1
130°	2970.3	3022.5	3058.0	3093.9	3090.8
132.5°	3132.8	3175.3	3210.8	3240.2	3237.1
135°	3269.4	3321.6	3350.5	3383.3	3376.8
137.5°	3412.3	3451.2	3484.0	3516.4	3506.8
140°	3552.0	3578.2	3613.7	3643.1	3626.9
142.5°	3669.2	3692.1	3734.1	3760.0	3743.8
145°	3792.8	3789.3	3844.5	3867.3	3851.0
147.5°	3899.7	3890.0	3945.3	3961.5	3948.7
150°	4003.8	3981.1	4033.2	4052.5	4036.3
152.5°	4091.4	4065.6	4114.3	4133.9	4111.2
155°	4175.9	4147.0	4186.0	4205.3	4179.5
157.5°	4244.3	4218.4	4247.8	4270.5	4244.3
160°	4302.9	4283.3	4302.9	4322.2	4299.5
162.5°	4354.7	4335.4	4351.6	4374.3	4345.1
165°	4400.2	4380.9	4390.5	4413.4	4390.5
167.5°	4436.1	4416.4	4426.5	4449.2	4419.9
170°	4465.4	4445.8	4452.3	4475.0	4445.8
172.5°	4484.7	4465.4	4472.0	4494.8	4465.4
175°	4500.9	4478.1	4484.7	4507.5	4475.0
177.5°	4507.5	4484.7	4488.2	4511.0	4481.7
180°	4491.3	4491.3	4491.3	4491.3	4491.3

TEST NUMBER: P912325

CATALOG NUMBER: DFN2DIP-SQ4F0-110D120US850-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.26	12.11	12.24	13.09	14.40	10.82	11.66	11.79	12.65	13.95
	3H	12.93	13.68	13.91	14.68	16.00	12.44	13.19	13.42	14.19	15.51
	4H	13.52	14.23	14.52	15.23	16.56	13.02	13.74	14.02	14.74	16.07
	6H	13.92	14.58	14.93	15.58	16.93	13.42	14.08	14.43	15.08	16.43
	8H	14.02	14.65	15.04	15.67	17.01	13.52	14.15	14.54	15.17	16.51
	12H	14.07	14.67	15.10	15.69	17.05	13.56	14.16	14.59	15.18	16.54
4H	2H	11.72	12.44	12.73	13.44	14.77	11.37	12.08	12.37	13.08	14.42
	3H	13.59	14.19	14.61	15.22	16.56	13.18	13.78	14.20	14.81	16.16
	4H	14.31	14.85	15.33	15.88	17.24	13.88	14.43	14.91	15.45	16.82
	6H	14.83	15.30	15.86	16.34	17.71	14.39	14.86	15.43	15.91	17.27
	8H	14.98	15.42	16.01	16.46	17.84	14.54	14.98	15.57	16.02	17.40
	12H	15.05	15.45	16.10	16.50	17.89	14.60	15.00	15.66	16.05	17.44
8H	4H	14.50	14.94	15.54	15.98	17.36	14.13	14.57	15.16	15.61	16.98
	6H	15.14	15.50	16.20	16.58	17.96	14.76	15.12	15.81	16.20	17.58
	8H	15.36	15.68	16.43	16.75	18.14	14.97	15.29	16.04	16.35	17.75
	12H	15.50	15.78	16.57	16.84	18.28	15.09	15.37	16.15	16.43	17.86
12H	4H	14.49	14.89	15.54	15.94	17.32	14.12	14.52	15.17	15.57	16.96
	6H	15.17	15.49	16.23	16.55	17.95	14.80	15.12	15.86	16.18	17.58
	8H	15.41	15.69	16.48	16.75	18.19	15.03	15.31	16.10	16.37	17.81