

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P912411

Luminaire Tested: DFN2DIP-SQ4F0-160D060US850-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P912411
REPORT IS A COMBINATION OF REPORTS P901596 AND P898471
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-160D060US850-RLLONL
Description: 4 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 21669.9 lumens
Efficiency: N/A
Efficacy: 102.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 211.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P912411

CATALOG NUMBER: DFN2DIP-SQ4F0-160D060US850-RLLONL

Luminous Intensity Polar Plot

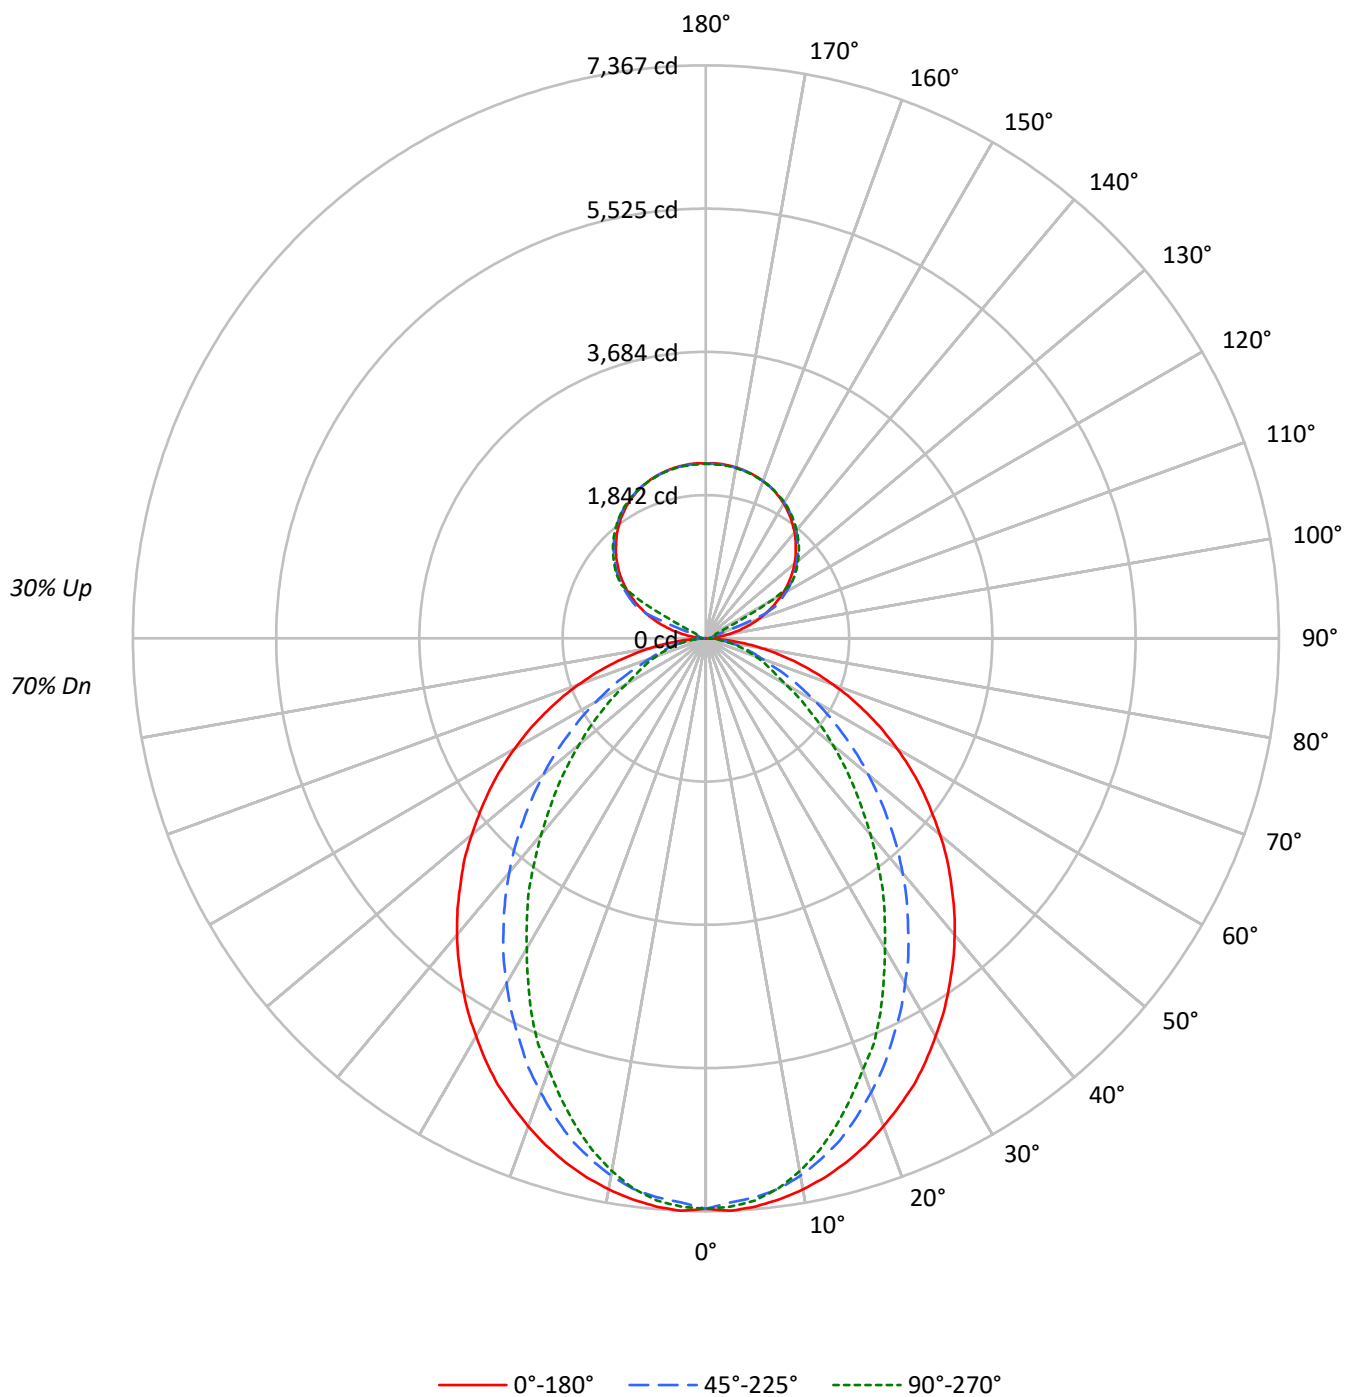

TEST NUMBER: P912411

CATALOG NUMBER: DFN2DIP-SQ4F0-160D060US850-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	112	112	112	112	106	106	106	106	94	94	94	84	84	84	74	74	74
1	103	99	95	92	97	93	90	87	84	81	79	75	73	71	67	65	64
2	94	87	81	76	89	83	77	73	74	70	67	67	63	61	59	57	55
3	86	77	70	64	82	73	67	62	66	61	57	59	55	52	53	50	48
4	79	69	61	55	75	65	58	53	59	54	49	53	49	45	48	45	42
5	73	62	54	48	69	59	52	46	53	47	43	48	44	40	44	40	37
6	68	56	48	42	64	53	46	41	49	42	38	44	39	35	40	36	33
7	63	51	43	37	60	49	41	36	44	38	34	40	35	32	37	32	29
8	59	46	39	33	56	44	37	32	41	35	30	37	32	28	34	30	27
9	55	43	35	30	52	41	34	29	37	32	27	34	29	26	31	27	24
10	51	39	32	27	49	38	31	26	35	29	25	32	27	24	29	25	22

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	5146	5146	5146
5°	5154	5065	5098
10°	5103	4967	4934
15°	5033	4804	4678
20°	4940	4578	4365
25°	4844	4325	4062
30°	4716	4066	3678
35°	4591	3787	3340
40°	4464	3499	2952
45°	4316	3178	2601
50°	4162	2855	2257
55°	4003	2509	1927
60°	3817	2147	1588
65°	3605	1780	1431
70°	3346	1436	1297
75°	3022	1268	1183
80°	2553	1068	1031
85°	1777	719	786

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 4316 cd/sqm

TEST NUMBER: P912411

CATALOG NUMBER: DFN2DIP-SQ4F0-160D060US850-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	687.3	3.2
10°-20°	1886.8	8.7
20°-30°	2649.0	12.2
30°-40°	2887.6	13.3
40°-50°	2654.0	12.2
50°-60°	2084.3	9.6
60°-70°	1356.7	6.3
70°-80°	698.4	3.2
80°-90°	182.3	0.8
90°-100°	74.1	0.3
100°-110°	276.0	1.3
110°-120°	732.1	3.4
120°-130°	1214.2	5.6
130°-140°	1289.8	6.0
140°-150°	1198.7	5.5
150°-160°	963.8	4.4
160°-170°	621.0	2.9
170°-180°	213.7	1.0
0°-30°	5223.1	24.1
0°-40°	8110.7	37.4
0°-60°	12849.0	59.3
0°-90°	15086.4	69.6
90°-120°	1082.2	5.0
90°-150°	4785.0	22.1
90°-180°	6583.0	30.4
0°-180°	21669.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	7334	7334	7334	7334	7334	
5°	7334	7300	7214	7274	7254	695
15°	6975	6902	6677	6550	6484	1966
25°	6332	6119	5681	5409	5309	2912
35°	5456	5117	4533	4115	3969	3415
45°	4460	4015	3319	2847	2688	3444
55°	3391	2874	2157	1759	1633	3030
65°	2290	1752	1155	930	909	2270
75°	1221	756	531	484	478	1291
85°	285	146	126	126	126	327
90°	2	20	32	41	44	21
95°	106	52	63	72	70	125
105°	494	543	99	117	124	528
115°	934	962	1003	250	133	920
125°	1321	1342	1373	1384	1389	1178
135°	1635	1661	1675	1692	1688	1263
145°	1896	1895	1922	1934	1926	1186
155°	2088	2074	2093	2103	2090	962
165°	2200	2190	2195	2207	2195	622
175°	2250	2239	2242	2254	2238	214
180°	2246	2246	2246	2246	2246	

TEST NUMBER: P912411

CATALOG NUMBER: DFN2DIP-SQ4F0-160D060US850-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	7333.6	7333.6	7333.6	7333.6	7333.6
2.5°	7366.6	7333.6	7260.3	7327.3	7313.9
5°	7333.6	7300.4	7213.8	7273.7	7254.0
7.5°	7273.7	7234.2	7141.3	7167.4	7134.3
10°	7194.2	7147.7	7015.3	6994.9	6955.4
12.5°	7094.8	7035.1	6855.5	6816.0	6742.8
15°	6975.2	6902.0	6676.6	6550.5	6484.3
17.5°	6835.8	6729.4	6450.6	6304.8	6198.5
20°	6676.6	6543.5	6211.8	6046.4	5900.0
22.5°	6504.1	6351.2	5966.1	5740.8	5641.5
25°	6331.6	6118.9	5681.0	5409.1	5309.2
27.5°	6126.0	5900.0	5415.5	5103.6	4950.8
30°	5907.0	5654.2	5123.2	4785.3	4605.8
32.5°	5694.4	5388.7	4845.1	4446.6	4280.4
35°	5455.6	5116.9	4533.3	4114.9	3968.6
37.5°	5223.3	4857.9	4241.0	3782.6	3617.1
40°	4977.5	4579.7	3935.4	3464.3	3291.8
42.5°	4725.4	4300.8	3630.5	3139.0	2973.6
45°	4460.0	4015.0	3318.6	2846.8	2687.7
47.5°	4207.9	3736.9	3020.0	2548.3	2402.5
50°	3929.1	3458.0	2727.8	2269.5	2130.7
52.5°	3656.6	3158.8	2449.0	2011.1	1885.0
55°	3391.1	2873.5	2156.8	1758.9	1632.9
57.5°	3119.3	2588.4	1898.4	1526.5	1420.2
60°	2840.5	2309.6	1625.8	1287.9	1181.5
62.5°	2568.7	2037.8	1393.5	1075.2	1022.4
65°	2289.9	1751.9	1154.8	929.5	909.0
67.5°	2024.4	1486.4	929.5	816.1	796.4
70°	1745.6	1228.0	769.6	703.4	676.7
72.5°	1480.1	988.6	643.6	590.8	577.3
75°	1221.0	756.2	530.9	484.4	478.1
77.5°	962.5	537.2	418.2	391.5	378.2
80°	723.2	385.2	318.3	292.2	292.2
82.5°	504.2	259.2	219.0	205.6	205.6
85°	285.1	145.7	126.1	126.1	126.1
87.5°	106.4	52.8	52.8	46.5	46.5
90°	1.6	19.5	32.4	40.7	43.8
92.5°	40.7	34.2	38.9	42.3	43.8
95°	105.6	51.9	63.3	71.6	69.9
97.5°	190.1	56.9	82.7	87.8	89.4
100°	287.7	65.0	92.6	105.6	108.8
102.5°	394.8	391.7	95.9	113.7	118.7
105°	493.9	542.7	99.1	116.9	123.5
107.5°	609.4	649.9	102.5	120.2	126.8
110°	720.0	753.9	284.5	122.0	128.3



TEST NUMBER: P912411

CATALOG NUMBER: DFN2DIP-SQ4F0-160D060US850-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	823.9	853.0	825.4	125.0	130.1
115°	934.3	961.9	1002.6	250.3	133.3
117.5°	1030.2	1062.6	1090.4	857.9	432.2
120°	1137.5	1161.8	1191.2	1210.6	991.2
122.5°	1228.3	1254.4	1287.0	1296.6	1298.4
125°	1321.0	1342.2	1373.1	1384.5	1389.2
127.5°	1405.5	1428.3	1452.8	1469.0	1470.5
130°	1485.2	1511.2	1529.0	1546.9	1545.4
132.5°	1566.5	1587.6	1605.4	1620.0	1618.5
135°	1634.8	1660.8	1675.3	1691.7	1688.3
137.5°	1706.1	1725.6	1742.0	1758.2	1753.4
140°	1776.0	1789.1	1806.9	1821.5	1813.4
142.5°	1834.6	1846.0	1867.1	1880.0	1871.9
145°	1896.4	1894.6	1922.2	1933.7	1925.6
147.5°	1949.8	1945.0	1972.6	1980.7	1974.4
150°	2002.0	1990.5	2016.6	2026.3	2018.2
152.5°	2045.8	2032.8	2057.1	2067.0	2055.5
155°	2088.0	2073.5	2093.0	2102.7	2089.7
157.5°	2122.2	2109.2	2123.8	2135.3	2122.2
160°	2151.5	2141.6	2151.5	2161.1	2149.8
162.5°	2177.3	2167.7	2175.7	2187.2	2172.5
165°	2200.1	2190.5	2195.3	2206.7	2195.3
167.5°	2218.0	2208.2	2213.2	2224.7	2209.9
170°	2232.7	2222.9	2226.2	2237.5	2222.9
172.5°	2242.4	2232.7	2236.0	2247.4	2232.7
175°	2250.5	2239.1	2242.4	2253.7	2237.5
177.5°	2253.7	2242.4	2244.1	2255.5	2240.8
180°	2245.6	2245.6	2245.6	2245.6	2245.6

TEST NUMBER: P912411

CATALOG NUMBER: DFN2DIP-SQ4F0-160D060US850-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	14.51	15.54	15.29	16.33	17.29	10.47	11.50	11.25	12.29	13.25
	3H	16.21	17.12	17.00	17.93	18.92	11.68	12.59	12.47	13.39	14.39
	4H	16.83	17.69	17.64	18.50	19.51	12.14	13.00	12.94	13.81	14.81
	6H	17.27	18.06	18.08	18.88	19.90	12.47	13.26	13.29	14.08	15.10
	8H	17.40	18.15	18.23	18.99	20.01	12.57	13.32	13.39	14.16	15.18
	12H	17.47	18.19	18.30	19.02	20.06	12.62	13.33	13.45	14.16	15.21
4H	2H	14.56	15.42	15.37	16.23	17.23	11.10	11.96	11.91	12.77	13.77
	3H	16.41	17.12	17.23	17.97	18.99	12.46	13.18	13.29	14.02	15.04
	4H	17.11	17.76	17.95	18.60	19.65	13.02	13.67	13.86	14.51	15.56
	6H	17.64	18.20	18.49	19.07	20.12	13.45	14.01	14.30	14.88	15.93
	8H	17.82	18.34	18.68	19.21	20.27	13.58	14.11	14.44	14.97	16.03
	12H	17.93	18.40	18.80	19.28	20.35	13.66	14.13	14.53	15.01	16.08
8H	4H	17.09	17.61	17.95	18.48	19.54	13.32	13.84	14.17	14.70	15.77
	6H	17.67	18.10	18.55	19.01	20.07	13.84	14.28	14.73	15.18	16.25
	8H	17.89	18.27	18.78	19.17	20.26	14.04	14.42	14.93	15.32	16.40
	12H	18.04	18.38	18.94	19.27	20.40	14.16	14.50	15.06	15.39	16.53
12H	4H	17.05	17.52	17.93	18.41	19.48	13.33	13.80	14.21	14.68	15.75
	6H	17.65	18.03	18.54	18.93	20.01	13.89	14.28	14.79	15.18	16.26
	8H	17.88	18.22	18.77	19.11	20.24	14.11	14.45	15.01	15.34	16.48

END OF REPORT