

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P912436

Luminaire Tested: DFN2DIP-SQ4F0-160D140US850-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P912436
REPORT IS A COMBINATION OF REPORTS P900201 AND P896915
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-160D140US850-FLLFLL
Description: 4 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 31307.0 lumens
Efficiency: N/A
Efficacy: 114.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 272.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P912436

CATALOG NUMBER: DFN2DIP-SQ4F0-160D140US850-FLLFLL

Luminous Intensity Polar Plot

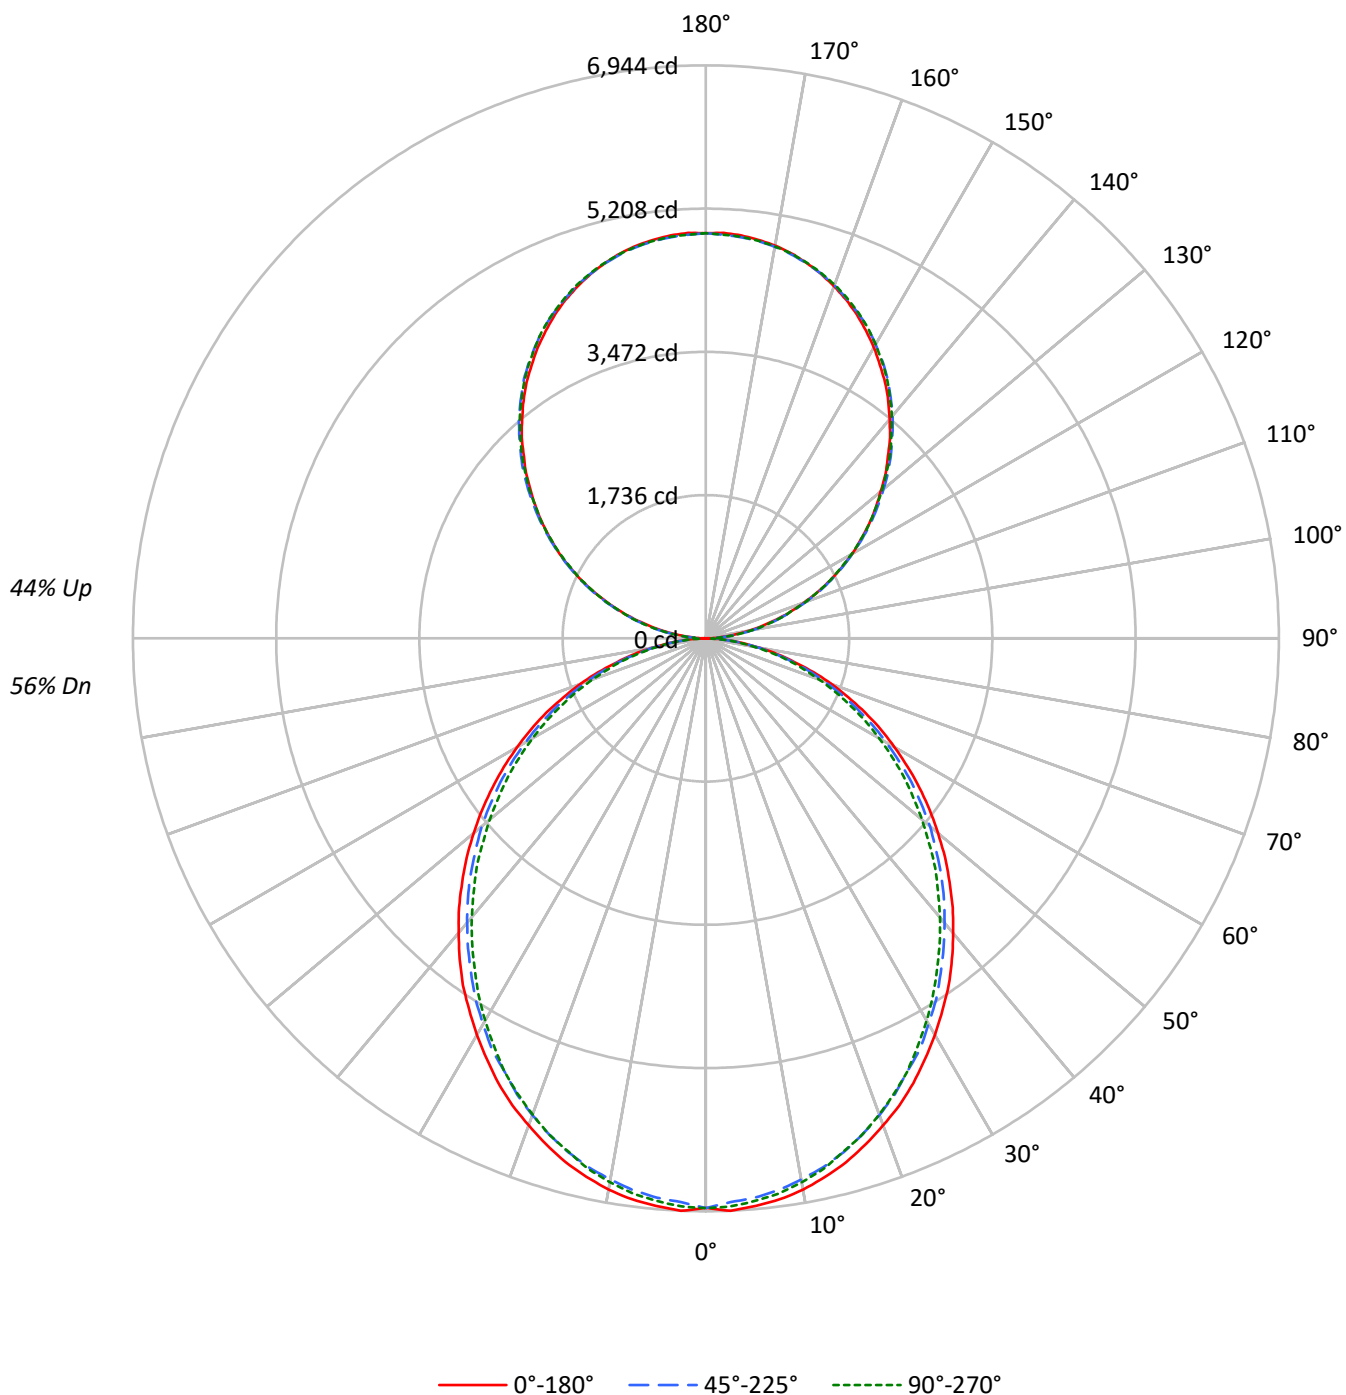

TEST NUMBER: P912436

CATALOG NUMBER: DFN2DIP-SQ4F0-160D140US850-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	109	109	109	109	101	101	101	101	87	87	87	74	74	74	62	62	62
1	99	95	91	87	92	88	85	82	76	74	71	65	63	61	55	53	52
2	90	83	77	71	84	77	72	67	67	63	59	57	54	51	48	46	44
3	82	73	65	59	76	68	61	56	59	54	50	50	47	43	43	40	37
4	75	64	56	50	70	60	53	48	52	47	42	45	41	37	38	35	32
5	69	57	49	43	64	54	46	41	47	41	37	40	36	32	34	31	28
6	64	52	43	38	59	48	41	36	42	36	32	37	32	28	31	28	25
7	59	47	39	33	55	44	37	31	38	32	28	33	29	25	28	25	22
8	55	42	35	29	51	40	33	28	35	29	25	30	26	22	26	23	20
9	51	39	31	26	47	36	30	25	32	26	23	28	23	20	24	21	18
10	48	36	28	23	44	34	27	22	30	24	20	26	21	18	22	19	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	4845	4845	4845
5°	4852	4778	4811
10°	4813	4715	4747
15°	4742	4638	4646
20°	4646	4531	4544
25°	4551	4403	4425
30°	4432	4284	4273
35°	4319	4143	4112
40°	4180	4002	3959
45°	4041	3859	3803
50°	3889	3710	3622
55°	3730	3538	3456
60°	3551	3332	3266
65°	3355	3120	3041
70°	3106	2862	2801
75°	2760	2553	2580
80°	2344	2159	2156
85°	1695	1477	1448

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 4041 cd/sqm

TEST NUMBER: P912436

CATALOG NUMBER: DFN2DIP-SQ4F0-160D140US850-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	649.8	2.1
10°-20°	1828.4	5.8
20°-30°	2687.0	8.6
30°-40°	3120.8	10.0
40°-50°	3116.9	10.0
50°-60°	2717.8	8.7
60°-70°	2009.1	6.4
70°-80°	1136.7	3.6
80°-90°	314.0	1.0
90°-100°	303.8	1.0
100°-110°	965.4	3.1
110°-120°	1652.1	5.3
120°-130°	2172.8	6.9
130°-140°	2438.9	7.8
140°-150°	2391.6	7.6
150°-160°	2006.2	6.4
160°-170°	1330.5	4.2
170°-180°	465.0	1.5
0°-30°	5165.2	16.5
0°-40°	8286.0	26.5
0°-60°	14120.7	45.1
0°-90°	17580.5	56.2
90°-120°	2921.4	9.3
90°-150°	9924.8	31.7
90°-180°	13727.0	43.8
0°-180°	31307.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	6904	6904	6904	6904	6904	
5°	6904	6878	6805	6858	6845	655
15°	6572	6533	6446	6473	6440	1851
25°	5948	5896	5783	5796	5783	2737
35°	5132	5066	4959	4919	4886	3205
45°	4176	4130	4030	3957	3930	3223
55°	3160	3120	3041	2961	2928	2826
65°	2131	2091	2025	1965	1932	2107
75°	1115	1102	1068	1029	1042	1190
85°	272	266	259	239	232	303
90°	4	53	145	136	141	30
95°	216	258	265	265	258	241
105°	891	903	912	919	919	940
115°	1658	1682	1674	1670	1658	1640
125°	2412	2448	2437	2423	2419	2155
135°	3119	3165	3174	3169	3158	2411
145°	3787	3816	3840	3844	3828	2366
155°	4330	4342	4355	4376	4363	1993
165°	4710	4706	4706	4736	4715	1329
175°	4901	4890	4881	4910	4885	466
180°	4910	4910	4910	4910	4910	

TEST NUMBER: P912436

CATALOG NUMBER: DFN2DIP-SQ4F0-160D140US850-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	6904.3	6904.3	6904.3	6904.3	6904.3
2.5°	6944.4	6911.3	6838.1	6904.3	6891.5
5°	6904.3	6878.2	6804.9	6857.8	6845.1
7.5°	6857.8	6818.4	6745.0	6798.6	6785.2
10°	6785.2	6738.7	6659.2	6712.0	6692.3
12.5°	6685.3	6645.8	6566.2	6599.3	6585.9
15°	6572.5	6533.1	6446.4	6473.2	6440.1
17.5°	6433.1	6393.6	6307.0	6340.0	6307.0
20°	6280.2	6240.8	6147.7	6167.5	6141.4
22.5°	6128.1	6068.2	5981.5	5981.5	5968.2
25°	5948.5	5895.7	5782.9	5795.6	5782.9
27.5°	5749.1	5702.6	5616.6	5597.0	5563.9
30°	5550.4	5497.0	5397.6	5377.9	5351.1
32.5°	5337.7	5298.4	5191.9	5151.7	5125.0
35°	5132.1	5065.9	4959.4	4919.3	4886.3
37.5°	4899.7	4839.8	4733.4	4686.9	4653.8
40°	4660.8	4607.3	4501.0	4441.8	4415.0
42.5°	4428.5	4374.9	4269.2	4202.3	4162.9
45°	4176.3	4129.7	4029.8	3957.1	3930.4
47.5°	3930.4	3883.9	3777.6	3704.3	3664.9
50°	3671.2	3638.1	3545.1	3452.1	3419.0
52.5°	3419.0	3372.6	3286.6	3213.3	3166.9
55°	3160.5	3120.4	3040.8	2961.1	2928.1
57.5°	2901.4	2868.2	2781.6	2702.0	2675.2
60°	2642.1	2616.0	2523.1	2449.8	2430.0
62.5°	2389.9	2343.4	2277.2	2211.0	2184.3
65°	2131.4	2091.2	2025.0	1965.3	1932.1
67.5°	1865.9	1832.1	1773.0	1726.4	1699.7
70°	1620.0	1593.3	1533.4	1486.9	1460.9
72.5°	1367.8	1341.1	1308.1	1261.5	1241.9
75°	1115.0	1102.3	1068.5	1029.0	1042.5
77.5°	889.6	862.9	849.5	829.8	810.0
80°	664.2	657.2	643.8	624.0	610.7
82.5°	451.5	451.5	445.2	418.4	418.4
85°	271.9	265.5	259.2	238.8	232.4
87.5°	119.8	106.4	92.9	73.3	66.2
90°	4.4	53.3	145.1	136.2	140.6
92.5°	91.8	124.3	128.8	133.2	133.2
95°	216.1	257.6	264.9	264.9	257.6
97.5°	359.8	398.2	414.5	414.5	414.5
100°	525.6	559.6	571.4	571.4	566.9
102.5°	700.2	725.4	741.7	746.1	741.7
105°	891.2	903.1	911.9	919.3	919.3
107.5°	1080.6	1098.5	1098.5	1101.3	1080.6
110°	1264.3	1287.9	1287.9	1287.9	1276.0

TEST NUMBER: P912436

CATALOG NUMBER: DFN2DIP-SQ4F0-160D140US850-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1462.5	1487.7	1483.3	1471.4	1462.5
115°	1658.0	1681.7	1674.3	1669.8	1658.0
117.5°	1851.9	1884.5	1863.8	1851.9	1840.1
120°	2047.3	2079.9	2047.3	2047.3	2034.0
122.5°	2225.0	2266.4	2245.7	2233.9	2225.0
125°	2411.5	2448.5	2436.6	2423.3	2418.8
127.5°	2593.5	2639.4	2623.1	2605.4	2593.5
130°	2763.7	2817.1	2809.7	2800.8	2784.5
132.5°	2954.7	2996.2	2999.2	2978.4	2966.6
135°	3119.1	3165.0	3173.8	3169.4	3157.5
137.5°	3302.6	3339.6	3347.1	3344.1	3326.3
140°	3464.0	3501.0	3521.7	3521.7	3505.4
142.5°	3629.8	3666.8	3678.7	3683.1	3666.8
145°	3786.7	3816.3	3840.0	3844.5	3828.2
147.5°	3927.3	3964.3	3982.1	3989.5	3973.2
150°	4072.4	4097.5	4113.8	4127.1	4113.8
152.5°	4201.2	4226.4	4247.1	4263.3	4247.1
155°	4330.0	4341.8	4355.2	4375.9	4362.6
157.5°	4441.0	4449.9	4457.3	4486.9	4466.2
160°	4540.2	4549.1	4553.6	4578.7	4560.9
162.5°	4632.0	4632.0	4636.4	4664.6	4643.8
165°	4710.5	4706.0	4706.0	4735.7	4714.9
167.5°	4781.5	4768.1	4768.1	4797.8	4777.0
170°	4834.8	4822.9	4818.5	4848.1	4822.9
172.5°	4871.8	4860.0	4855.5	4885.1	4860.0
175°	4901.4	4889.6	4880.7	4910.3	4885.1
177.5°	4917.6	4905.9	4897.0	4922.1	4897.0
180°	4910.3	4910.3	4910.3	4910.3	4910.3

TEST NUMBER: P912436

CATALOG NUMBER: DFN2DIP-SQ4F0-160D140US850-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.32	14.23	14.22	15.16	16.34	12.87	13.79	13.77	14.71	15.89
	3H	14.98	15.81	15.90	16.74	17.95	14.49	15.32	15.41	16.25	17.46
	4H	15.58	16.36	16.51	17.29	18.51	15.08	15.86	16.01	16.80	18.01
	6H	15.98	16.70	16.92	17.65	18.87	15.48	16.20	16.42	17.15	18.37
	8H	16.09	16.78	17.04	17.74	18.96	15.59	16.28	16.54	17.24	18.46
	12H	16.14	16.80	17.10	17.75	19.00	15.63	16.29	16.59	17.24	18.49
4H	2H	13.78	14.56	14.72	15.50	16.72	13.43	14.21	14.36	15.15	16.36
	3H	15.66	16.31	16.60	17.28	18.51	15.25	15.90	16.20	16.87	18.10
	4H	16.38	16.97	17.33	17.94	19.19	15.96	16.55	16.91	17.51	18.77
	6H	16.90	17.42	17.87	18.40	19.65	16.47	16.98	17.44	17.97	19.22
	8H	17.06	17.54	18.03	18.51	19.78	16.62	17.10	17.59	18.08	19.34
	12H	17.13	17.57	18.12	18.56	19.83	16.68	17.12	17.67	18.11	19.38
8H	4H	16.58	17.06	17.55	18.04	19.31	16.20	16.68	17.17	17.66	18.93
	6H	17.22	17.62	18.22	18.64	19.90	16.84	17.23	17.83	18.25	19.52
	8H	17.44	17.79	18.45	18.80	20.09	17.05	17.40	18.06	18.41	19.69
	12H	17.58	17.89	18.59	18.89	20.22	17.17	17.48	18.18	18.48	19.81
12H	4H	16.57	17.00	17.56	18.00	19.27	16.20	16.63	17.19	17.63	18.90
	6H	17.25	17.60	18.25	18.61	19.89	16.88	17.23	17.88	18.24	19.52
	8H	17.50	17.81	18.51	18.81	20.14	17.12	17.43	18.13	18.43	19.76

END OF REPORT