

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P914859

Luminaire Tested: DFN2DIP-SQ4F0-060D080US927-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P914859
REPORT IS A COMBINATION OF REPORTS P901616 AND P898471
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-060D080US927-RLLONL
Description: 4 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10314.2 lumens
Efficiency: N/A
Efficacy: 94.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 109.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.946
Total Harmonic Distortion (THDi): 0.132
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P914859

CATALOG NUMBER: DFN2DIP-SQ4F0-060D080US927-RLLONL

Luminous Intensity Polar Plot

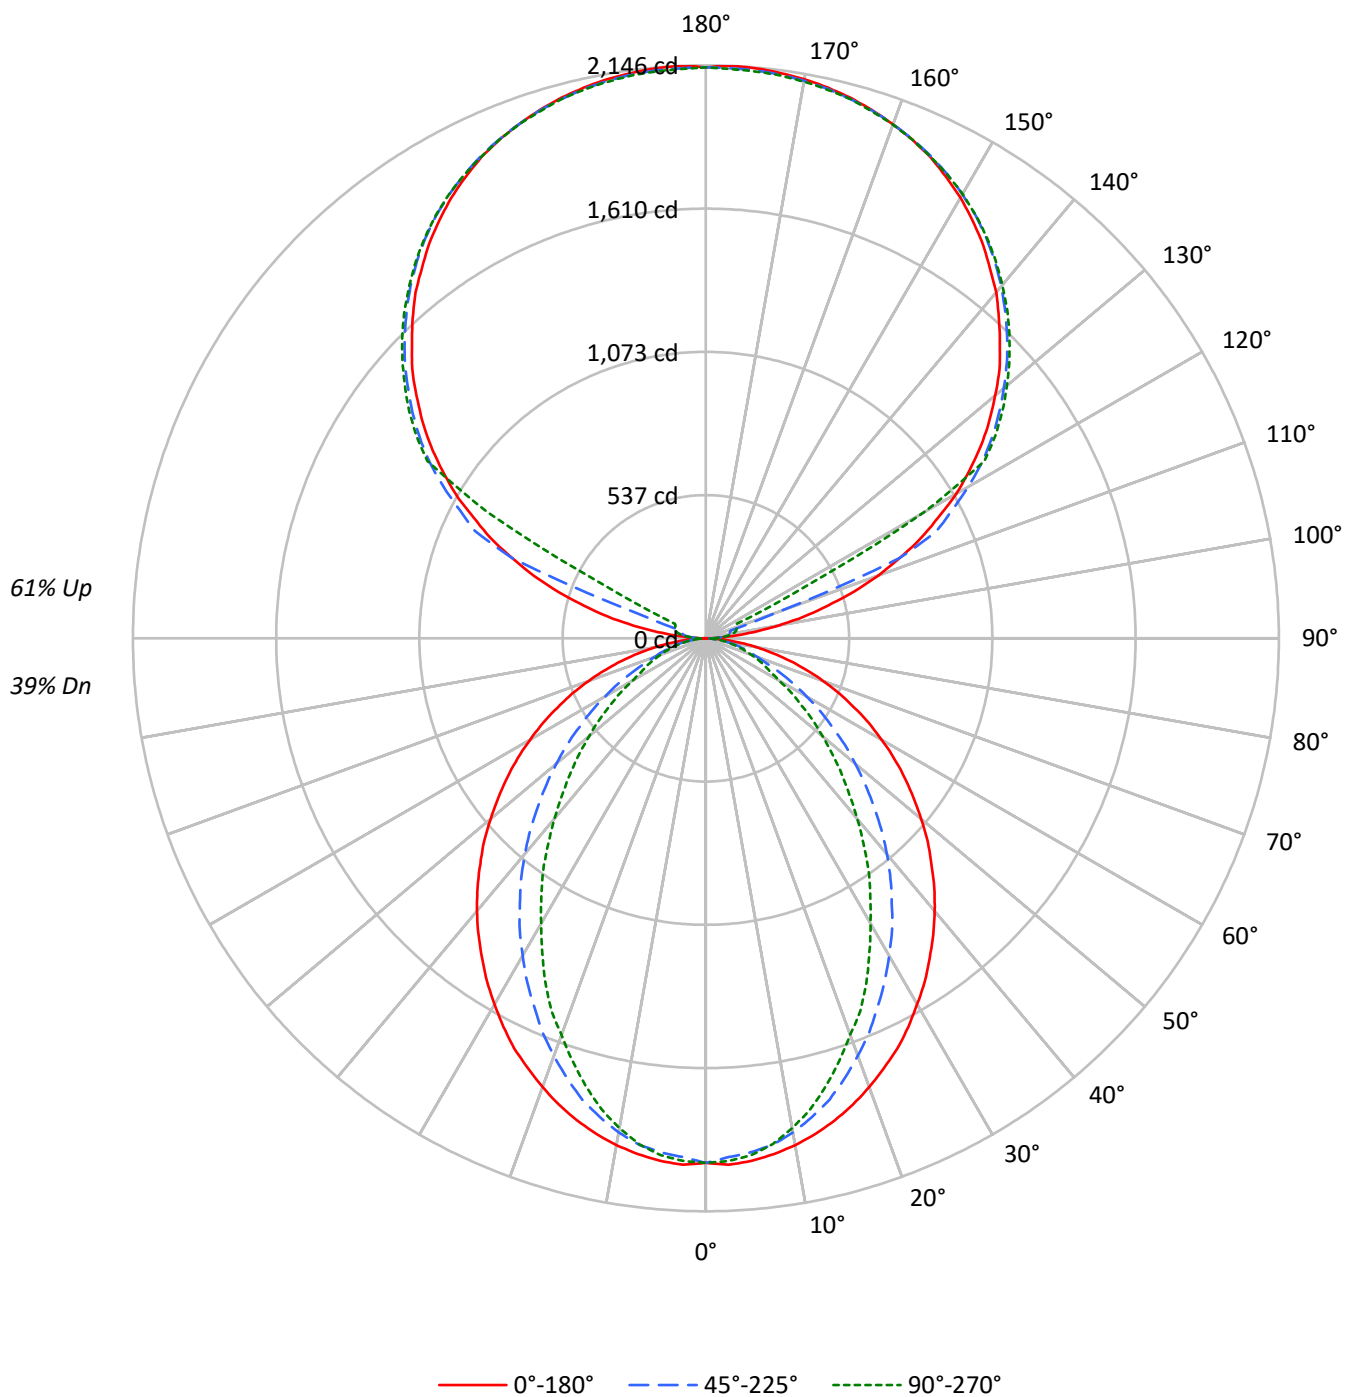

TEST NUMBER: P914859

CATALOG NUMBER: DFN2DIP-SQ4F0-060D080US927-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	95	95	95	95	77	77	77	61	61	61	46	46	46
1	96	92	88	85	87	83	80	78	68	66	64	54	53	52	41	41	40
2	87	80	75	70	79	73	68	64	60	57	54	48	46	44	37	35	34
3	80	71	64	58	73	65	59	54	53	49	46	43	40	37	33	31	29
4	73	63	55	50	67	58	51	46	48	43	39	38	35	32	30	27	26
5	67	56	48	43	61	52	45	40	43	38	34	35	31	28	27	25	23
6	62	51	43	37	56	46	40	35	39	34	30	31	28	25	25	22	20
7	57	46	38	33	52	42	35	31	35	30	26	29	25	22	23	20	18
8	53	42	34	29	49	38	32	27	32	27	23	26	22	20	21	18	16
9	50	38	31	26	45	35	29	24	29	24	21	24	20	18	19	17	15
10	46	35	28	23	42	32	26	22	27	22	19	22	19	16	18	15	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1378	1378	1378
5°	1381	1357	1366
10°	1367	1330	1322
15°	1348	1287	1253
20°	1323	1226	1169
25°	1298	1159	1088
30°	1263	1089	985
35°	1230	1015	895
40°	1196	937	791
45°	1156	851	697
50°	1115	765	605
55°	1072	672	516
60°	1023	575	425
65°	966	477	383
70°	896	385	348
75°	810	340	317
80°	684	286	276
85°	476	192	210

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1156 cd/sqm

TEST NUMBER: P914859

CATALOG NUMBER: DFN2DIP-SQ4F0-060D080US927-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	184.1	1.8
10°-20°	505.4	4.9
20°-30°	709.6	6.9
30°-40°	773.5	7.5
40°-50°	710.9	6.9
50°-60°	558.3	5.4
60°-70°	363.4	3.5
70°-80°	187.1	1.8
80°-90°	51.5	0.5
90°-100°	70.5	0.7
100°-110°	262.9	2.5
110°-120°	697.3	6.8
120°-130°	1156.5	11.2
130°-140°	1228.4	11.9
140°-150°	1141.7	11.1
150°-160°	917.9	8.9
160°-170°	591.5	5.7
170°-180°	203.6	2.0
0°-30°	1399.1	13.6
0°-40°	2172.6	21.1
0°-60°	3441.9	33.4
0°-90°	4043.9	39.2
90°-120°	1030.7	10.0
90°-150°	4557.3	44.2
90°-180°	6270.0	60.8
0°-180°	10314.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1964	1964	1964	1964	1964	
5°	1964	1956	1932	1948	1943	186
15°	1868	1849	1788	1755	1737	527
25°	1696	1639	1522	1449	1422	780
35°	1461	1371	1214	1102	1063	915
45°	1195	1076	889	763	720	923
55°	908	770	578	471	437	812
65°	613	469	309	249	244	608
75°	327	203	142	130	128	346
85°	76	39	34	34	34	88
90°	2	18	31	39	42	10
95°	100	49	60	68	66	119
105°	470	517	94	111	118	503
115°	890	916	955	238	127	876
125°	1258	1278	1308	1319	1323	1122
135°	1557	1582	1596	1611	1608	1203
145°	1806	1804	1831	1842	1834	1130
155°	1989	1975	1993	2003	1990	916
165°	2096	2086	2091	2102	2091	592
175°	2143	2133	2136	2146	2131	204
180°	2139	2139	2139	2139	2139	

TEST NUMBER: P914859

CATALOG NUMBER: DFN2DIP-SQ4F0-060D080US927-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1964.5	1964.5	1964.5	1964.5	1964.5
2.5°	1973.3	1964.5	1944.8	1962.7	1959.1
5°	1964.5	1955.6	1932.4	1948.4	1943.1
7.5°	1948.4	1937.8	1913.0	1919.9	1911.1
10°	1927.1	1914.6	1879.2	1873.7	1863.1
12.5°	1900.5	1884.4	1836.4	1825.8	1806.2
15°	1868.4	1848.8	1788.4	1754.7	1736.9
17.5°	1831.1	1802.6	1727.9	1688.9	1660.4
20°	1788.4	1752.8	1664.0	1619.6	1580.4
22.5°	1742.2	1701.3	1598.1	1537.8	1511.2
25°	1696.1	1639.1	1521.8	1449.0	1422.2
27.5°	1641.0	1580.4	1450.6	1367.1	1326.2
30°	1582.3	1514.6	1372.4	1281.8	1233.7
32.5°	1525.3	1443.5	1297.9	1191.1	1146.6
35°	1461.4	1370.7	1214.3	1102.2	1063.0
37.5°	1399.2	1301.2	1136.1	1013.3	968.9
40°	1333.3	1226.8	1054.2	928.0	881.8
42.5°	1265.8	1152.1	972.5	840.8	796.5
45°	1194.7	1075.5	889.0	762.6	719.9
47.5°	1127.2	1001.0	809.0	682.6	643.6
50°	1052.5	926.3	730.7	607.9	570.8
52.5°	979.5	846.1	656.0	538.7	504.9
55°	908.4	769.8	577.7	471.2	437.4
57.5°	835.6	693.3	508.5	408.9	380.4
60°	760.9	618.7	435.5	345.0	316.5
62.5°	688.1	545.9	373.3	288.0	273.9
65°	613.4	469.3	309.3	249.0	243.5
67.5°	542.2	398.2	249.0	218.6	213.3
70°	467.5	328.9	206.1	188.5	181.3
72.5°	396.5	264.8	172.4	158.3	154.6
75°	327.1	202.6	142.2	129.8	128.1
77.5°	257.9	143.9	112.0	104.9	101.3
80°	193.7	103.1	85.2	78.3	78.3
82.5°	135.1	69.4	58.6	55.1	55.1
85°	76.4	39.1	33.7	33.7	33.7
87.5°	28.5	14.2	14.2	12.4	12.4
90°	1.5	18.5	30.9	38.7	41.7
92.5°	38.7	32.6	37.2	40.2	41.7
95°	100.5	49.4	60.3	68.2	66.5
97.5°	181.0	54.2	78.8	83.7	85.1
100°	274.0	61.9	88.2	100.5	103.6
102.5°	376.0	373.0	91.3	108.2	113.0
105°	470.5	517.0	94.4	111.4	117.6
107.5°	580.4	618.9	97.6	114.5	120.7
110°	685.7	718.0	270.9	116.1	122.2

TEST NUMBER: P914859

CATALOG NUMBER: DFN2DIP-SQ4F0-060D080US927-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	784.7	812.5	786.2	119.1	123.9
115°	889.9	916.2	954.9	238.4	127.0
117.5°	981.2	1012.1	1038.5	817.1	411.7
120°	1083.4	1106.5	1134.5	1153.0	944.0
122.5°	1169.9	1194.8	1225.8	1235.0	1236.7
125°	1258.1	1278.3	1307.7	1318.6	1323.2
127.5°	1338.6	1360.3	1383.7	1399.1	1400.6
130°	1414.5	1439.3	1456.3	1473.4	1471.9
132.5°	1491.9	1512.1	1529.1	1543.0	1541.5
135°	1557.0	1581.7	1595.5	1611.2	1608.0
137.5°	1625.0	1643.5	1659.1	1674.6	1670.0
140°	1691.5	1704.0	1720.9	1734.9	1727.1
142.5°	1747.4	1758.2	1778.2	1790.6	1782.8
145°	1806.2	1804.5	1830.8	1841.7	1833.9
147.5°	1857.1	1852.5	1878.7	1886.5	1880.4
150°	1906.7	1895.8	1920.6	1929.8	1922.1
152.5°	1948.4	1936.1	1959.2	1968.6	1957.8
155°	1988.7	1974.9	1993.4	2002.6	1990.4
157.5°	2021.2	2008.9	2022.8	2033.7	2021.2
160°	2049.1	2039.8	2049.1	2058.3	2047.5
162.5°	2073.8	2064.6	2072.3	2083.1	2069.2
165°	2095.5	2086.3	2090.9	2101.7	2090.9
167.5°	2112.5	2103.2	2107.9	2118.8	2104.8
170°	2126.5	2117.1	2120.3	2131.1	2117.1
172.5°	2135.7	2126.5	2129.6	2140.5	2126.5
175°	2143.4	2132.6	2135.7	2146.5	2131.1
177.5°	2146.5	2135.7	2137.3	2148.2	2134.2
180°	2138.8	2138.8	2138.8	2138.8	2138.8

TEST NUMBER: P914859

CATALOG NUMBER: DFN2DIP-SQ4F0-060D080US927-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	7.18	7.93	8.23	8.98	10.40	3.14	3.89	4.19	4.94	6.36
	3H	8.85	9.52	9.91	10.58	12.02	4.32	4.99	5.38	6.05	7.49
	4H	9.46	10.09	10.53	11.16	12.60	4.77	5.40	5.84	6.46	7.91
	6H	9.88	10.46	10.96	11.53	12.99	5.08	5.67	6.17	6.73	8.19
	8H	10.01	10.56	11.09	11.64	13.10	5.17	5.73	6.26	6.81	8.26
	12H	10.07	10.60	11.16	11.67	13.15	5.21	5.74	6.30	6.82	8.29
4H	2H	7.18	7.82	8.26	8.88	10.33	3.72	4.36	4.80	5.42	6.87
	3H	9.01	9.54	10.10	10.63	12.09	5.07	5.60	6.15	6.69	8.14
	4H	9.70	10.19	10.79	11.27	12.75	5.61	6.10	6.70	7.18	8.66
	6H	10.22	10.63	11.32	11.74	13.21	6.03	6.44	7.13	7.55	9.02
	8H	10.39	10.78	11.49	11.88	13.36	6.16	6.54	7.26	7.64	9.13
	12H	10.49	10.84	11.60	11.95	13.44	6.22	6.57	7.34	7.68	9.17
8H	4H	9.67	10.05	10.76	11.15	12.64	5.89	6.28	6.99	7.37	8.86
	6H	10.23	10.55	11.35	11.69	13.17	6.41	6.73	7.53	7.86	9.35
	8H	10.45	10.73	11.58	11.85	13.36	6.60	6.88	7.73	8.00	9.50
	12H	10.59	10.84	11.72	11.95	13.49	6.72	6.96	7.85	8.08	9.62
12H	4H	9.61	9.96	10.73	11.07	12.56	5.89	6.24	7.01	7.35	8.84
	6H	10.21	10.49	11.33	11.61	13.11	6.46	6.74	7.58	7.86	9.36
	8H	10.43	10.67	11.56	11.79	13.33	6.67	6.91	7.80	8.03	9.57