

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P914879

Luminaire Tested: DFN2DIP-SQ4F0-060D140US927-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P914879
REPORT IS A COMBINATION OF REPORTS P901706 AND P898471
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-060D140US927-RLLONL
Description: 4 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 15019.7 lumens
Efficiency: N/A
Efficacy: 96.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 155.8
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.946
Total Harmonic Distortion (THDi): 0.132
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P914879

CATALOG NUMBER: DFN2DIP-SQ4F0-060D140US927-RLLONL

Luminous Intensity Polar Plot

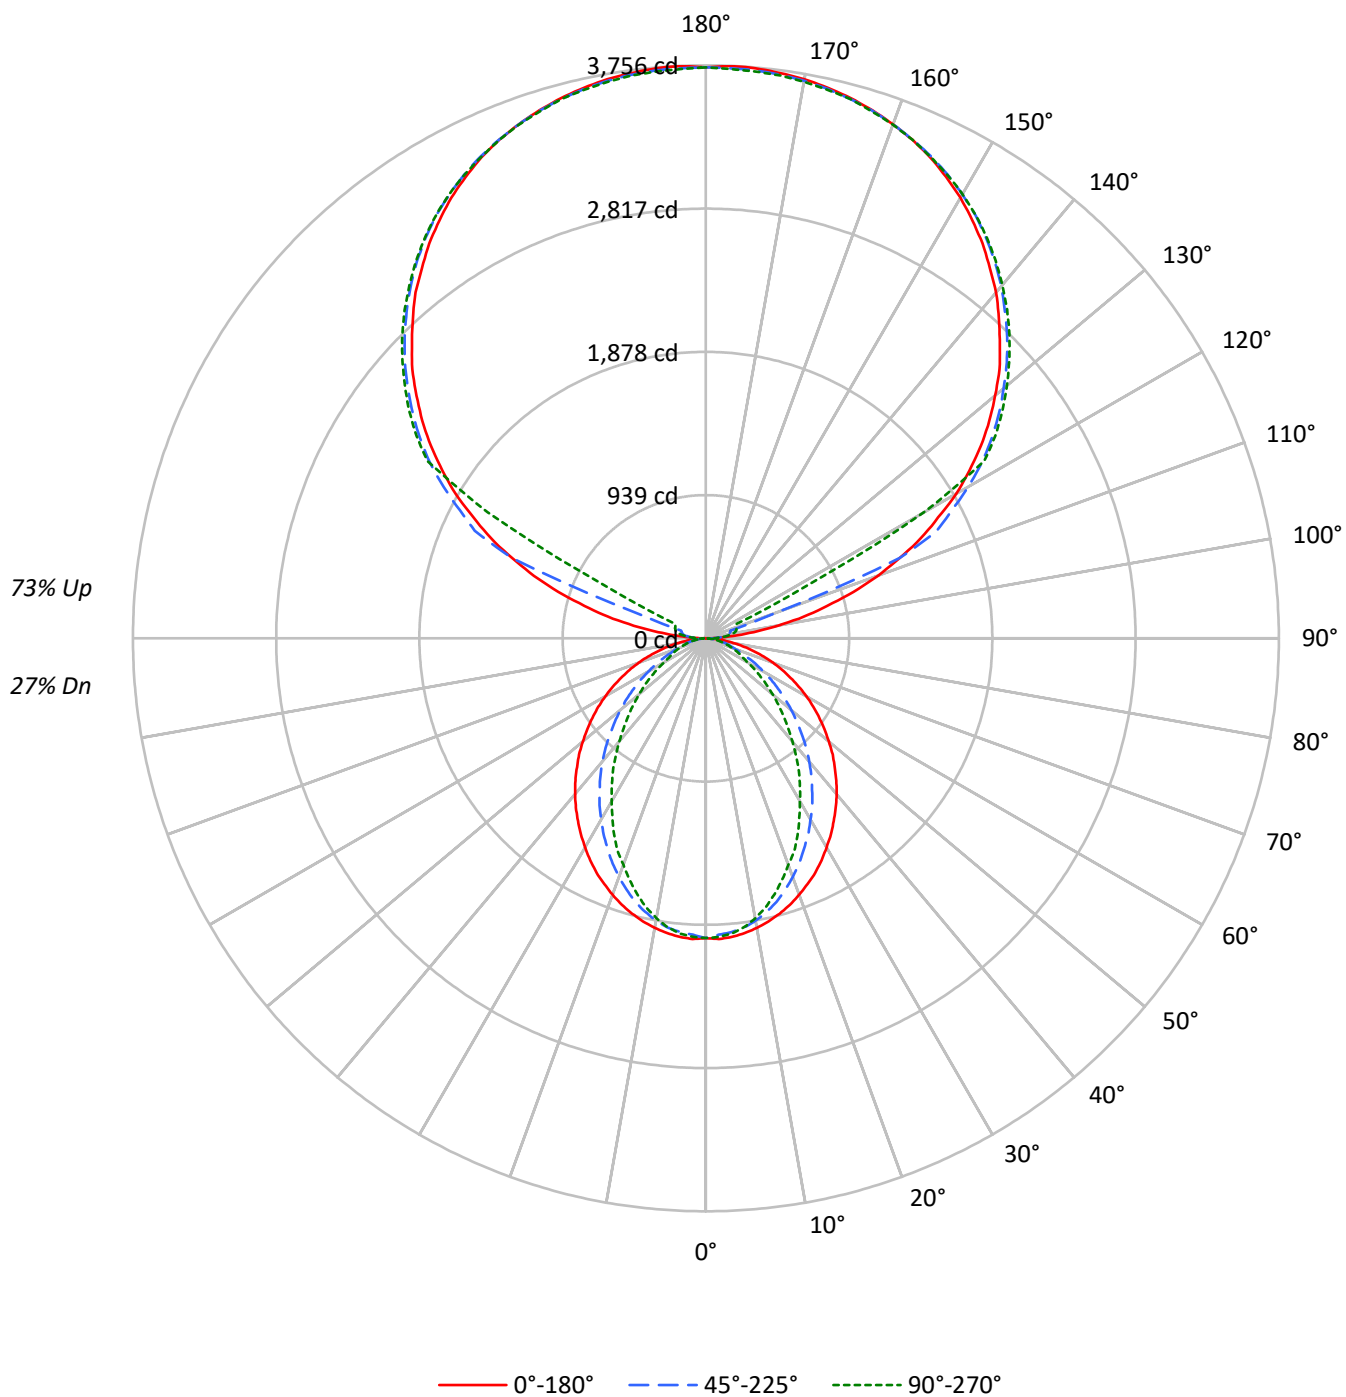

TEST NUMBER: P914879

CATALOG NUMBER: DFN2DIP-SQ4F0-060D140US927-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20					20					20					20					20
RC	80					70					50					30					10
RW	70	50	30	10		70	50	30	10		50	30	10		50	30	10		50	30	10
RCR																					
0	102	102	102	102		91	91	91	91		71	71	71		52	52	52		35	35	35
1	93	89	85	82		83	79	76	74		62	60	58		46	45	44		31	31	30
2	85	78	72	67		75	70	65	61		55	51	49		41	39	37		28	27	26
3	77	69	62	56		69	62	56	51		48	44	41		36	34	31		25	23	22
4	71	61	53	48		63	55	48	43		43	39	35		32	29	27		22	21	19
5	65	54	46	41		58	49	42	37		39	34	30		29	26	23		20	18	17
6	60	48	41	35		53	44	37	32		35	30	26		26	23	21		18	16	15
7	55	44	36	31		49	39	33	28		31	27	23		24	21	18		17	15	13
8	51	40	32	27		46	36	29	25		29	24	21		22	19	16		16	13	12
9	48	36	29	24		43	33	26	22		26	22	18		20	17	15		14	12	11
10	44	33	26	22		40	30	24	20		24	20	16		19	15	13		13	11	10

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1378	1378	1378
5°	1381	1357	1366
10°	1367	1330	1322
15°	1348	1287	1253
20°	1323	1226	1169
25°	1298	1159	1088
30°	1263	1089	985
35°	1230	1015	895
40°	1196	937	791
45°	1156	851	697
50°	1115	765	605
55°	1072	672	516
60°	1023	575	425
65°	966	477	383
70°	896	385	348
75°	810	340	317
80°	684	286	276
85°	476	192	210

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2006 cd/sqm

TEST NUMBER: P914879

CATALOG NUMBER: DFN2DIP-SQ4F0-060D140US927-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	184.1	1.2
10°-20°	505.4	3.4
20°-30°	709.6	4.7
30°-40°	773.5	5.1
40°-50°	710.9	4.7
50°-60°	558.3	3.7
60°-70°	363.4	2.4
70°-80°	187.1	1.2
80°-90°	54.3	0.4
90°-100°	123.4	0.8
100°-110°	460.1	3.1
110°-120°	1220.2	8.1
120°-130°	2023.8	13.5
130°-140°	2149.8	14.3
140°-150°	1998.0	13.3
150°-160°	1606.3	10.7
160°-170°	1035.1	6.9
170°-180°	356.3	2.4
0°-30°	1399.1	9.3
0°-40°	2172.6	14.5
0°-60°	3441.9	22.9
0°-90°	4046.7	26.9
90°-120°	1803.7	12.0
90°-150°	7975.4	53.1
90°-180°	10973.0	73.1
0°-180°	15019.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	1964	1964	1964	1964	1964	
5°	1964	1956	1932	1948	1943	186
15°	1868	1849	1788	1755	1737	527
25°	1696	1639	1522	1449	1422	780
35°	1461	1371	1214	1102	1063	915
45°	1195	1076	889	763	720	923
55°	908	770	578	471	437	812
65°	613	469	309	249	244	608
75°	327	203	142	130	128	346
85°	76	39	34	34	34	88
90°	2	32	54	68	73	14
95°	176	86	106	119	116	208
105°	823	905	165	195	206	880
115°	1557	1603	1671	417	222	1533
125°	2202	2237	2289	2308	2316	1964
135°	2725	2768	2792	2820	2814	2105
145°	3161	3158	3204	3223	3209	1977
155°	3480	3456	3488	3505	3483	1604
165°	3667	3651	3659	3678	3659	1036
175°	3751	3732	3737	3756	3729	357
180°	3743	3743	3743	3743	3743	

TEST NUMBER: P914879

CATALOG NUMBER: DFN2DIP-SQ4F0-060D140US927-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	1964.5	1964.5	1964.5	1964.5	1964.5
2.5°	1973.3	1964.5	1944.8	1962.7	1959.1
5°	1964.5	1955.6	1932.4	1948.4	1943.1
7.5°	1948.4	1937.8	1913.0	1919.9	1911.1
10°	1927.1	1914.6	1879.2	1873.7	1863.1
12.5°	1900.5	1884.4	1836.4	1825.8	1806.2
15°	1868.4	1848.8	1788.4	1754.7	1736.9
17.5°	1831.1	1802.6	1727.9	1688.9	1660.4
20°	1788.4	1752.8	1664.0	1619.6	1580.4
22.5°	1742.2	1701.3	1598.1	1537.8	1511.2
25°	1696.1	1639.1	1521.8	1449.0	1422.2
27.5°	1641.0	1580.4	1450.6	1367.1	1326.2
30°	1582.3	1514.6	1372.4	1281.8	1233.7
32.5°	1525.3	1443.5	1297.9	1191.1	1146.6
35°	1461.4	1370.7	1214.3	1102.2	1063.0
37.5°	1399.2	1301.2	1136.1	1013.3	968.9
40°	1333.3	1226.8	1054.2	928.0	881.8
42.5°	1265.8	1152.1	972.5	840.8	796.5
45°	1194.7	1075.5	889.0	762.6	719.9
47.5°	1127.2	1001.0	809.0	682.6	643.6
50°	1052.5	926.3	730.7	607.9	570.8
52.5°	979.5	846.1	656.0	538.7	504.9
55°	908.4	769.8	577.7	471.2	437.4
57.5°	835.6	693.3	508.5	408.9	380.4
60°	760.9	618.7	435.5	345.0	316.5
62.5°	688.1	545.9	373.3	288.0	273.9
65°	613.4	469.3	309.3	249.0	243.5
67.5°	542.2	398.2	249.0	218.6	213.3
70°	467.5	328.9	206.1	188.5	181.3
72.5°	396.5	264.8	172.4	158.3	154.6
75°	327.1	202.6	142.2	129.8	128.1
77.5°	257.9	143.9	112.0	104.9	101.3
80°	193.7	103.1	85.2	78.3	78.3
82.5°	135.1	69.4	58.6	55.1	55.1
85°	76.4	39.1	33.7	33.7	33.7
87.5°	28.5	14.2	14.2	12.4	12.4
90°	2.5	32.5	54.0	67.9	73.0
92.5°	67.9	57.0	65.0	70.4	73.0
95°	175.9	86.5	105.5	119.3	116.5
97.5°	316.8	94.9	138.0	146.3	148.9
100°	479.5	108.4	154.4	175.9	181.4
102.5°	658.0	652.8	159.9	189.4	197.8
105°	823.3	904.7	165.3	194.9	205.8
107.5°	1015.7	1083.1	170.8	200.3	211.3
110°	1199.9	1256.6	474.0	203.3	213.9

TEST NUMBER: P914879

CATALOG NUMBER: DFN2DIP-SQ4F0-060D140US927-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1373.2	1421.8	1375.9	208.4	216.7
115°	1557.3	1603.2	1671.1	417.2	222.2
117.5°	1717.1	1771.1	1817.4	1429.9	720.4
120°	1895.9	1936.4	1985.3	2017.8	1652.1
122.5°	2047.4	2090.8	2145.1	2161.2	2164.2
125°	2201.8	2237.1	2288.6	2307.5	2315.6
127.5°	2342.6	2380.6	2421.4	2448.4	2451.0
130°	2475.4	2518.9	2548.4	2578.4	2575.8
132.5°	2610.9	2646.2	2675.8	2700.2	2697.7
135°	2724.7	2768.1	2792.2	2819.5	2814.1
137.5°	2843.7	2876.2	2903.5	2930.5	2922.5
140°	2960.1	2982.0	3011.6	3036.0	3022.5
142.5°	3057.9	3076.8	3111.9	3133.5	3119.9
145°	3160.8	3157.9	3203.9	3222.9	3209.4
147.5°	3249.9	3241.8	3287.9	3301.3	3290.7
150°	3336.7	3317.7	3361.1	3377.2	3363.8
152.5°	3409.7	3388.2	3428.7	3445.1	3426.1
155°	3480.1	3456.0	3488.5	3504.6	3483.1
157.5°	3537.1	3515.5	3540.0	3559.0	3537.1
160°	3586.0	3569.6	3586.0	3602.0	3583.1
162.5°	3629.1	3613.0	3626.5	3645.5	3621.1
165°	3667.0	3650.9	3659.0	3677.9	3659.0
167.5°	3697.0	3680.6	3688.9	3707.9	3683.4
170°	3721.4	3705.0	3710.4	3729.4	3705.0
172.5°	3737.4	3721.4	3726.8	3745.8	3721.4
175°	3751.0	3732.0	3737.4	3756.4	3729.4
177.5°	3756.4	3737.4	3740.4	3759.3	3734.9
180°	3742.9	3742.9	3742.9	3742.9	3742.9

TEST NUMBER: P914879

CATALOG NUMBER: DFN2DIP-SQ4F0-060D140US927-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	5.60	6.28	6.74	7.40	8.97	1.56	2.24	2.70	3.36	4.93
	3H	7.27	7.87	8.42	9.01	10.59	2.74	3.34	3.89	4.48	6.06
	4H	7.88	8.45	9.03	9.58	11.17	3.18	3.76	4.34	4.89	6.48
	6H	8.29	8.82	9.46	9.95	11.55	3.50	4.02	4.66	5.16	6.76
	8H	8.42	8.92	9.58	10.07	11.66	3.59	4.08	4.75	5.23	6.83
	12H	8.48	8.95	9.65	10.09	11.71	3.62	4.10	4.79	5.24	6.86
4H	2H	5.60	6.17	6.76	7.31	8.89	2.14	2.71	3.30	3.85	5.43
	3H	7.42	7.90	8.59	9.06	10.66	3.48	3.95	4.65	5.11	6.71
	4H	8.11	8.55	9.28	9.70	11.32	4.02	4.46	5.19	5.61	7.23
	6H	8.62	8.99	9.80	10.17	11.78	4.43	4.81	5.61	5.98	7.59
	8H	8.80	9.14	9.97	10.31	11.93	4.56	4.91	5.73	6.07	7.70
	12H	8.89	9.20	10.07	10.38	12.01	4.62	4.93	5.81	6.11	7.74
8H	4H	8.07	8.42	9.24	9.58	11.20	4.29	4.64	5.47	5.80	7.43
	6H	8.63	8.92	9.82	10.12	11.75	4.81	5.09	6.00	6.30	7.92
	8H	8.85	9.10	10.05	10.28	11.93	5.00	5.25	6.20	6.43	8.07
	12H	8.99	9.21	10.19	10.39	12.06	5.11	5.33	6.31	6.51	8.19
12H	4H	8.01	8.33	9.20	9.50	11.13	4.29	4.61	5.48	5.78	7.41
	6H	8.61	8.86	9.80	10.04	11.68	4.86	5.11	6.05	6.29	7.93
	8H	8.82	9.04	10.02	10.22	11.90	5.06	5.28	6.26	6.46	8.14

END OF REPORT