

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P914944

Luminaire Tested: DFN2DIP-SQ4F0-080D120US927-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P914944
REPORT IS A COMBINATION OF REPORTS P900171 AND P896915
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-080D120US927-FLLFLL
Description: 4 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 14687.0 lumens
Efficiency: N/A
Efficacy: 90.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 161.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9954
Total Harmonic Distortion (THDi): 0.076
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P914944

CATALOG NUMBER: DFN2DIP-SQ4F0-080D120US927-FLLFLL

Luminous Intensity Polar Plot

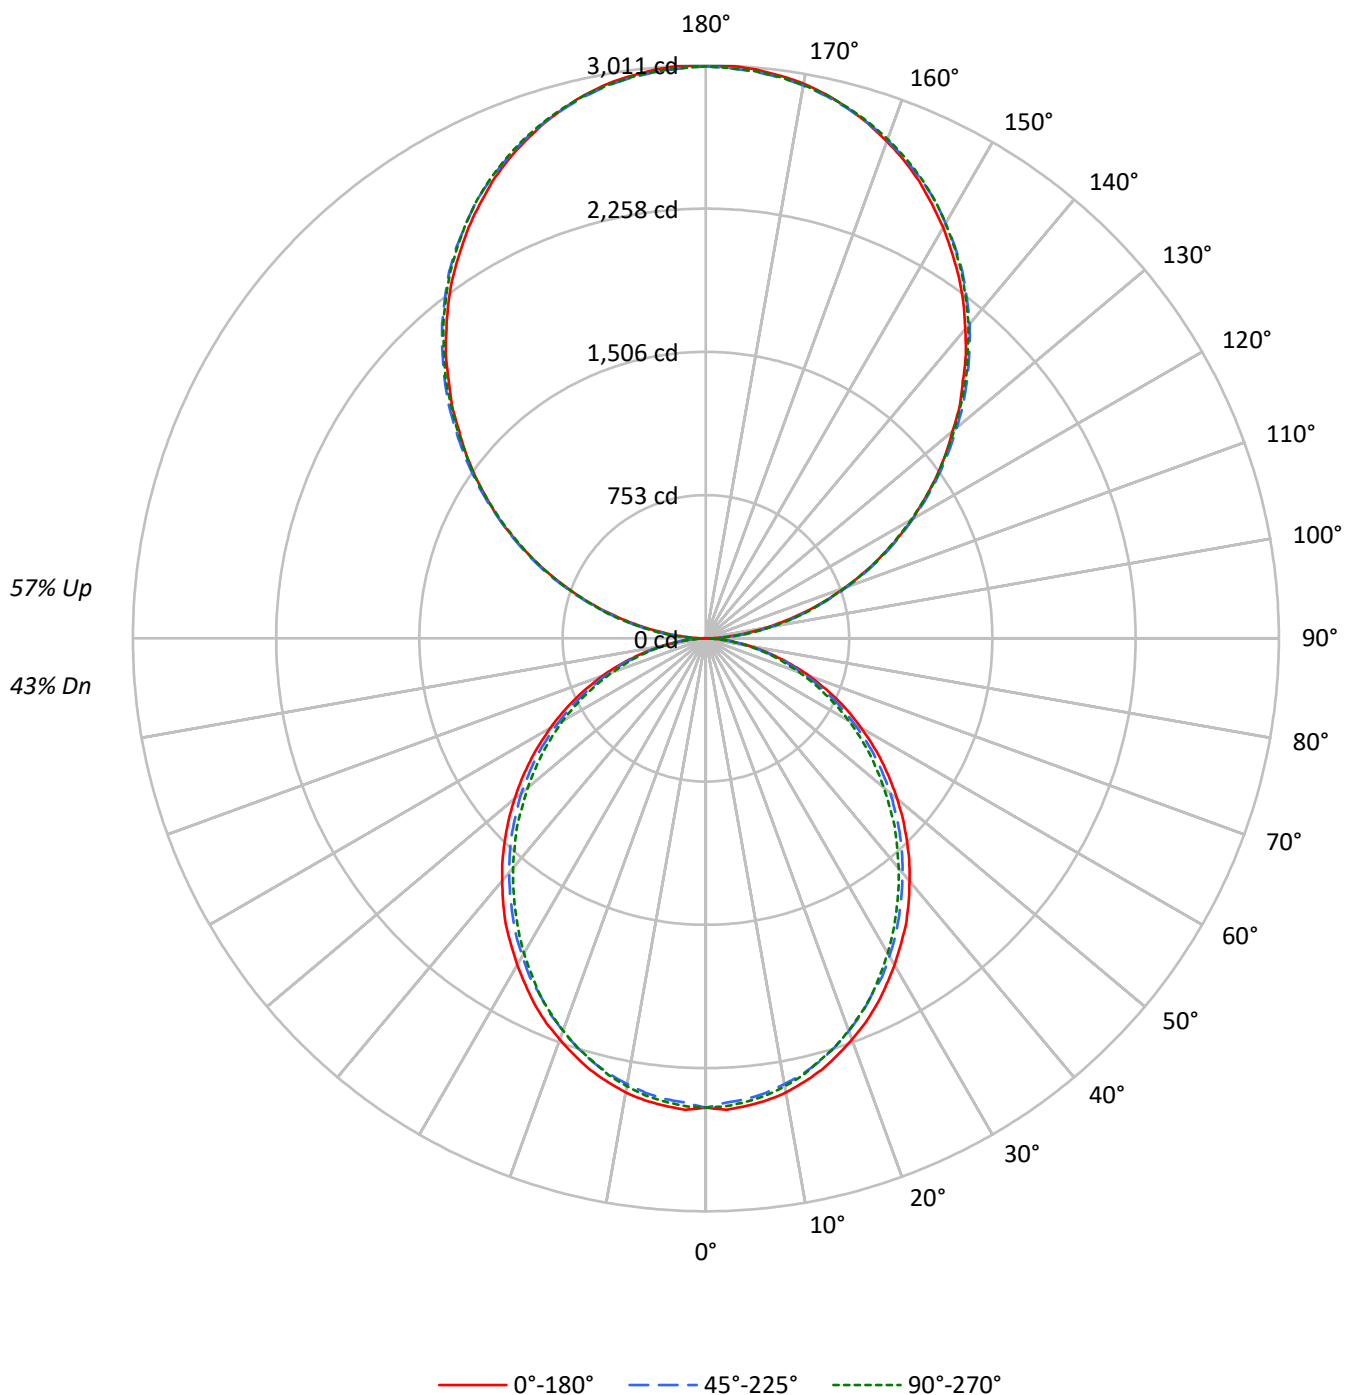

TEST NUMBER: P914944

CATALOG NUMBER: DFN2DIP-SQ4F0-080D120US927-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	96	96	96	96	79	79	79	64	64	64	49	49	49
1	96	92	88	85	88	84	81	78	69	67	65	56	54	53	44	43	42
2	88	80	74	69	80	73	68	64	61	57	54	49	47	44	38	37	35
3	80	70	63	57	73	65	58	53	54	49	45	44	40	37	34	32	30
4	73	62	55	49	66	57	50	45	48	43	39	39	35	32	30	28	26
5	67	56	47	42	61	51	44	39	43	37	33	35	31	28	27	25	22
6	62	50	42	36	56	46	39	34	38	33	29	31	27	24	25	22	20
7	57	45	37	31	52	41	34	29	35	29	25	29	24	21	23	20	18
8	53	41	33	28	48	38	31	26	32	26	23	26	22	19	21	18	16
9	49	37	30	25	45	34	28	23	29	24	20	24	20	17	19	16	14
10	46	34	27	22	42	31	25	21	27	22	18	22	18	15	18	15	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1730	1730	1730
5°	1733	1707	1718
10°	1719	1684	1695
15°	1694	1657	1660
20°	1660	1618	1623
25°	1626	1573	1580
30°	1583	1530	1526
35°	1542	1480	1469
40°	1493	1429	1414
45°	1443	1378	1358
50°	1389	1325	1294
55°	1332	1264	1234
60°	1268	1190	1166
65°	1198	1115	1086
70°	1109	1022	1000
75°	986	912	922
80°	838	771	770
85°	605	528	517

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2366 cd/sqm

TEST NUMBER: P914944

CATALOG NUMBER: DFN2DIP-SQ4F0-080D120US927-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	232.1	1.6
10°-20°	653.0	4.4
20°-30°	959.7	6.5
30°-40°	1114.6	7.6
40°-50°	1113.2	7.6
50°-60°	970.7	6.6
60°-70°	717.6	4.9
70°-80°	406.0	2.8
80°-90°	115.7	0.8
90°-100°	186.0	1.3
100°-110°	591.1	4.0
110°-120°	1011.6	6.9
120°-130°	1330.4	9.1
130°-140°	1493.3	10.2
140°-150°	1464.3	10.0
150°-160°	1228.4	8.4
160°-170°	814.6	5.5
170°-180°	284.7	1.9
0°-30°	1844.8	12.6
0°-40°	2959.4	20.2
0°-60°	5043.4	34.3
0°-90°	6282.6	42.8
90°-120°	1788.7	12.2
90°-150°	6076.6	41.4
90°-180°	8404.0	57.2
0°-180°	14687.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2466	2466	2466	2466	2466	
5°	2466	2457	2430	2449	2445	234
15°	2348	2333	2302	2312	2300	661
25°	2125	2106	2066	2070	2066	978
35°	1833	1809	1771	1757	1745	1145
45°	1492	1475	1439	1413	1404	1151
55°	1129	1114	1086	1058	1046	1009
65°	761	747	723	702	690	753
75°	398	394	382	368	372	425
85°	97	95	93	85	83	108
90°	3	33	89	83	86	14
95°	132	158	162	162	158	147
105°	546	553	558	563	563	576
115°	1015	1030	1025	1022	1015	1004
125°	1476	1499	1492	1484	1481	1319
135°	1910	1938	1943	1940	1933	1476
145°	2318	2337	2351	2354	2344	1449
155°	2651	2658	2667	2679	2671	1220
165°	2884	2881	2881	2900	2887	814
175°	3001	2994	2988	3006	2991	285
180°	3006	3006	3006	3006	3006	

TEST NUMBER: P914944

CATALOG NUMBER: DFN2DIP-SQ4F0-080D120US927-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2465.9	2465.9	2465.9	2465.9	2465.9
2.5°	2480.2	2468.4	2442.3	2465.9	2461.4
5°	2465.9	2456.6	2430.5	2449.3	2444.8
7.5°	2449.3	2435.2	2409.1	2428.2	2423.4
10°	2423.4	2406.8	2378.4	2397.2	2390.2
12.5°	2387.7	2373.6	2345.2	2357.0	2352.2
15°	2347.5	2333.4	2302.4	2312.0	2300.2
17.5°	2297.6	2283.5	2252.6	2264.4	2252.6
20°	2243.1	2229.0	2195.8	2202.8	2193.5
22.5°	2188.7	2167.3	2136.4	2136.4	2131.6
25°	2124.6	2105.7	2065.5	2070.0	2065.5
27.5°	2053.3	2036.8	2006.0	1999.0	1987.2
30°	1982.4	1963.3	1927.9	1920.8	1911.2
32.5°	1906.5	1892.4	1854.3	1840.0	1830.5
35°	1832.9	1809.3	1771.3	1757.0	1745.2
37.5°	1749.9	1728.5	1690.6	1674.0	1662.2
40°	1664.7	1645.5	1607.6	1586.4	1576.8
42.5°	1581.7	1562.5	1524.8	1500.9	1486.8
45°	1491.6	1475.0	1439.2	1413.3	1403.8
47.5°	1403.8	1387.2	1349.2	1323.0	1308.9
50°	1311.2	1299.4	1266.1	1233.0	1221.1
52.5°	1221.1	1204.5	1173.9	1147.7	1131.1
55°	1128.8	1114.4	1086.1	1057.6	1045.8
57.5°	1036.3	1024.4	993.5	965.0	955.4
60°	943.6	934.4	901.1	875.0	867.9
62.5°	853.6	837.0	813.3	789.7	780.1
65°	761.3	746.9	723.3	701.9	690.1
67.5°	666.4	654.3	633.2	616.6	607.0
70°	578.6	569.0	547.7	531.1	521.7
72.5°	488.5	479.0	467.1	450.6	443.5
75°	398.2	393.7	381.7	367.6	372.3
77.5°	317.7	308.2	303.4	296.4	289.3
80°	237.3	234.7	230.0	222.9	218.1
82.5°	161.3	161.3	159.0	149.4	149.4
85°	97.1	94.8	92.6	85.3	83.0
87.5°	42.8	38.0	33.2	26.1	23.7
90°	2.7	32.6	88.8	83.4	86.1
92.5°	56.2	76.1	78.8	81.6	81.6
95°	132.3	157.7	162.2	162.2	157.7
97.5°	220.2	243.8	253.8	253.8	253.8
100°	321.8	342.6	349.8	349.8	347.1
102.5°	428.7	444.1	454.1	456.9	454.1
105°	545.7	552.9	558.3	562.8	562.8
107.5°	661.6	672.6	672.6	674.3	661.6
110°	774.0	788.5	788.5	788.5	781.3

TEST NUMBER: P914944

CATALOG NUMBER: DFN2DIP-SQ4F0-080D120US927-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	895.5	910.9	908.2	900.9	895.5
115°	1015.1	1029.7	1025.1	1022.4	1015.1
117.5°	1133.8	1153.8	1141.1	1133.8	1126.6
120°	1253.5	1273.4	1253.5	1253.5	1245.4
122.5°	1362.3	1387.7	1375.0	1367.7	1362.3
125°	1476.5	1499.1	1491.9	1483.8	1481.0
127.5°	1588.0	1616.0	1606.1	1595.2	1588.0
130°	1692.2	1724.8	1720.3	1714.8	1704.9
132.5°	1809.1	1834.5	1836.3	1823.6	1816.4
135°	1909.7	1937.8	1943.3	1940.5	1933.3
137.5°	2022.1	2044.8	2049.3	2047.5	2036.6
140°	2120.9	2143.6	2156.2	2156.2	2146.3
142.5°	2222.5	2245.1	2252.3	2255.0	2245.1
145°	2318.5	2336.6	2351.1	2353.9	2343.9
147.5°	2404.6	2427.2	2438.2	2442.7	2432.7
150°	2493.5	2508.8	2518.8	2527.0	2518.8
152.5°	2572.3	2587.7	2600.4	2610.4	2600.4
155°	2651.1	2658.4	2666.6	2679.2	2671.1
157.5°	2719.2	2724.5	2729.1	2747.2	2734.5
160°	2779.8	2785.3	2788.0	2803.4	2792.5
162.5°	2836.0	2836.0	2838.8	2856.0	2843.3
165°	2884.1	2881.4	2881.4	2899.5	2886.8
167.5°	2927.6	2919.4	2919.4	2937.6	2924.9
170°	2960.2	2952.9	2950.2	2968.4	2952.9
172.5°	2982.9	2975.6	2972.9	2991.0	2975.6
175°	3001.0	2993.7	2988.3	3006.4	2991.0
177.5°	3011.0	3003.7	2998.2	3013.7	2998.2
180°	3006.4	3006.4	3006.4	3006.4	3006.4

TEST NUMBER: P914944

CATALOG NUMBER: DFN2DIP-SQ4F0-080D120US927-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.48	9.28	9.50	10.31	11.68	8.04	8.84	9.05	9.86	11.23
	3H	10.14	10.86	11.17	11.89	13.28	9.65	10.37	10.68	11.40	12.79
	4H	10.73	11.41	11.77	12.45	13.84	10.23	10.91	11.27	11.95	13.35
	6H	11.13	11.75	12.18	12.80	14.21	10.63	11.25	11.68	12.30	13.71
	8H	11.23	11.83	12.29	12.89	14.29	10.73	11.33	11.79	12.38	13.79
	12H	11.28	11.85	12.34	12.90	14.33	10.77	11.34	11.83	12.39	13.82
4H	2H	8.93	9.61	9.98	10.65	12.05	8.58	9.26	9.63	10.30	11.69
	3H	10.80	11.37	11.85	12.43	13.84	10.39	10.96	11.45	12.02	13.44
	4H	11.51	12.03	12.58	13.09	14.52	11.09	11.61	12.15	12.67	14.10
	6H	12.03	12.48	13.10	13.56	14.99	11.60	12.05	12.67	13.13	14.55
	8H	12.18	12.60	13.25	13.67	15.11	11.74	12.16	12.81	13.23	14.68
	12H	12.25	12.63	13.34	13.72	15.17	11.80	12.18	12.89	13.27	14.72
8H	4H	11.71	12.12	12.78	13.20	14.64	11.33	11.75	12.40	12.82	14.26
	6H	12.34	12.69	13.43	13.80	15.24	11.96	12.30	13.05	13.42	14.86
	8H	12.56	12.87	13.66	13.96	15.42	12.17	12.47	13.27	13.57	15.03
	12H	12.70	12.96	13.80	14.05	15.55	12.28	12.55	13.39	13.64	15.14
12H	4H	11.69	12.07	12.78	13.15	14.60	11.32	11.70	12.41	12.79	14.23
	6H	12.37	12.67	13.47	13.77	15.23	12.00	12.30	13.10	13.40	14.86
	8H	12.61	12.88	13.72	13.97	15.47	12.23	12.50	13.34	13.59	15.09