

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P914951

Luminaire Tested: DFN2DIP-SQ4F0-080D140US927-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P914951
REPORT IS A COMBINATION OF REPORTS P901710 AND P898471
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-080D140US927-RLLONL
Description: 4 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 16366.4 lumens
Efficiency: N/A
Efficacy: 92.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 177.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9954
Total Harmonic Distortion (THDi): 0.076
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P914951

CATALOG NUMBER: DFN2DIP-SQ4F0-080D140US927-RLLONL

Luminous Intensity Polar Plot

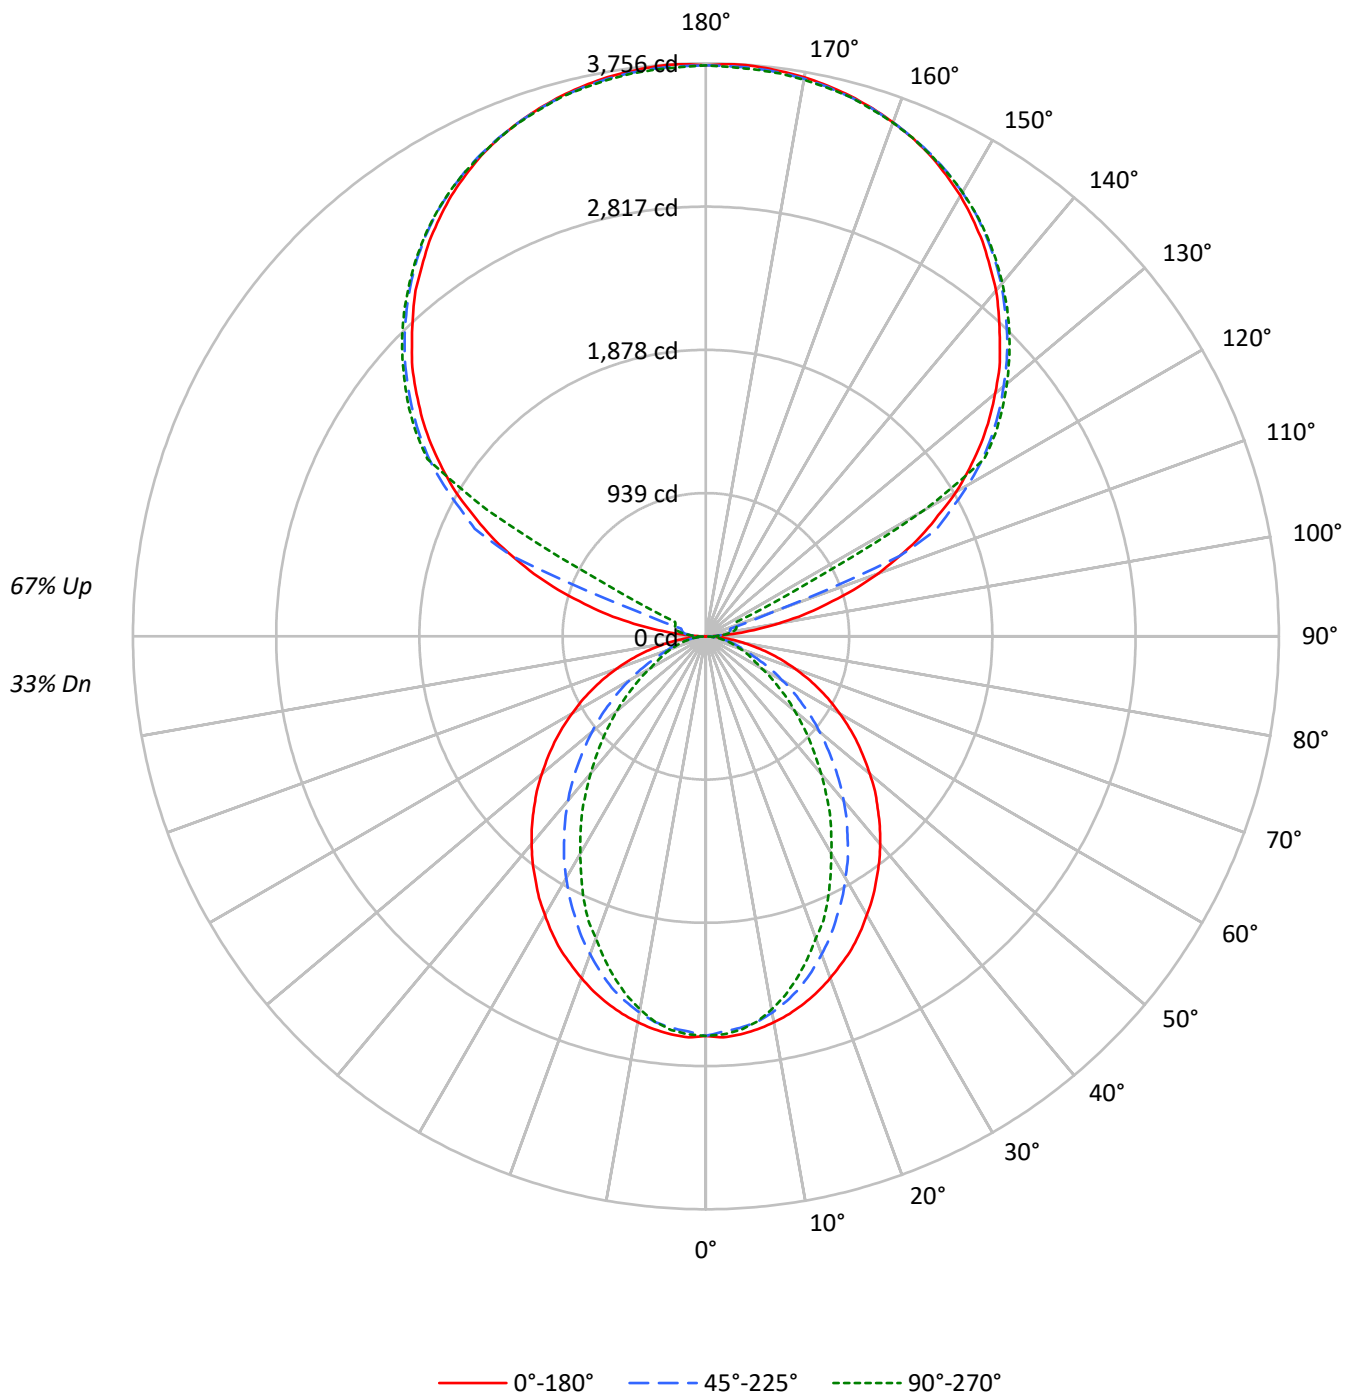

TEST NUMBER: P914951

CATALOG NUMBER: DFN2DIP-SQ4F0-080D140US927-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	103	103	103	103	93	93	93	93	74	74	74	56	56	56	40	40	40
1	94	90	87	83	85	81	78	76	65	63	61	50	49	48	36	35	35
2	86	79	73	68	77	72	67	62	57	54	51	44	42	40	32	31	30
3	79	70	63	57	71	63	57	53	51	47	43	39	37	34	29	27	26
4	72	62	54	49	65	56	50	45	45	41	37	35	32	30	26	24	22
5	66	55	47	42	59	50	43	38	41	36	32	32	28	26	24	21	20
6	61	49	42	36	55	45	38	33	37	32	28	29	25	23	21	19	17
7	56	45	37	32	51	41	34	29	33	28	25	26	23	20	20	17	16
8	52	41	33	28	47	37	31	26	30	25	22	24	21	18	18	16	14
9	49	37	30	25	44	34	27	23	28	23	20	22	19	16	17	14	13
10	45	34	27	22	41	31	25	21	26	21	18	20	17	15	16	13	12

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1838	1838	1838
5°	1841	1809	1821
10°	1822	1774	1762
15°	1797	1716	1671
20°	1764	1635	1559
25°	1730	1545	1451
30°	1685	1452	1313
35°	1640	1353	1193
40°	1594	1250	1054
45°	1541	1135	929
50°	1487	1020	806
55°	1430	896	688
60°	1363	767	567
65°	1287	636	511
70°	1195	513	463
75°	1079	453	423
80°	912	381	368
85°	635	256	280

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2006 cd/sqm

TEST NUMBER: P914951

CATALOG NUMBER: DFN2DIP-SQ4F0-080D140US927-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	245.5	1.5
10°-20°	673.9	4.1
20°-30°	946.1	5.8
30°-40°	1031.3	6.3
40°-50°	947.9	5.8
50°-60°	744.4	4.5
60°-70°	484.5	3.0
70°-80°	249.4	1.5
80°-90°	70.3	0.4
90°-100°	123.4	0.8
100°-110°	460.1	2.8
110°-120°	1220.2	7.5
120°-130°	2023.8	12.4
130°-140°	2149.8	13.1
140°-150°	1998.0	12.2
150°-160°	1606.3	9.8
160°-170°	1035.1	6.3
170°-180°	356.3	2.2
0°-30°	1865.5	11.4
0°-40°	2896.8	17.7
0°-60°	4589.2	28.0
0°-90°	5393.4	33.0
90°-120°	1803.7	11.0
90°-150°	7975.4	48.7
90°-180°	10973.0	67.0
0°-180°	16366.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2619	2619	2619	2619	2619	
5°	2619	2608	2576	2598	2591	248
15°	2491	2465	2385	2340	2316	702
25°	2261	2186	2029	1932	1896	1040
35°	1948	1828	1619	1470	1417	1220
45°	1593	1434	1185	1017	960	1230
55°	1211	1026	770	628	583	1082
65°	818	626	412	332	325	811
75°	436	270	190	173	171	461
85°	102	52	45	45	45	117
90°	2	32	54	68	73	15
95°	176	86	106	119	116	208
105°	823	905	165	195	206	880
115°	1557	1603	1671	417	222	1533
125°	2202	2237	2289	2308	2316	1964
135°	2725	2768	2792	2820	2814	2105
145°	3161	3158	3204	3223	3209	1977
155°	3480	3456	3488	3505	3483	1604
165°	3667	3651	3659	3678	3659	1036
175°	3751	3732	3737	3756	3729	357
180°	3743	3743	3743	3743	3743	

TEST NUMBER: P914951

CATALOG NUMBER: DFN2DIP-SQ4F0-080D140US927-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2619.3	2619.3	2619.3	2619.3	2619.3
2.5°	2631.1	2619.3	2593.1	2617.0	2612.2
5°	2619.3	2607.5	2576.5	2597.9	2590.8
7.5°	2597.9	2583.8	2550.6	2559.9	2548.1
10°	2569.4	2552.9	2505.6	2498.3	2484.2
12.5°	2534.0	2512.6	2448.5	2434.4	2408.2
15°	2491.3	2465.1	2384.6	2339.6	2315.9
17.5°	2441.4	2403.5	2303.9	2251.9	2213.8
20°	2384.6	2337.1	2218.7	2159.6	2107.2
22.5°	2323.0	2268.4	2130.9	2050.4	2014.9
25°	2261.4	2185.5	2029.0	1932.0	1896.2
27.5°	2187.9	2107.2	1934.2	1822.8	1768.2
30°	2109.7	2019.4	1829.9	1709.1	1645.0
32.5°	2033.8	1924.7	1730.5	1588.2	1528.8
35°	1948.5	1827.6	1619.1	1469.7	1417.4
37.5°	1865.5	1735.0	1514.7	1351.0	1291.9
40°	1777.8	1635.7	1405.6	1237.3	1175.7
42.5°	1687.7	1536.1	1296.6	1121.2	1062.0
45°	1592.9	1434.0	1185.3	1016.8	960.0
47.5°	1502.9	1334.7	1078.6	910.1	858.1
50°	1403.3	1235.1	974.3	810.6	761.0
52.5°	1306.0	1128.1	874.6	718.3	673.3
55°	1211.2	1026.3	770.3	628.2	583.2
57.5°	1114.1	924.5	678.0	545.3	507.2
60°	1014.5	824.9	580.7	459.9	422.0
62.5°	917.4	727.8	497.7	384.0	365.2
65°	817.8	625.7	412.4	332.0	324.6
67.5°	723.0	530.9	332.0	291.4	284.5
70°	623.4	438.6	274.9	251.2	241.7
72.5°	528.6	353.1	229.9	211.0	206.2
75°	436.1	270.1	189.6	173.0	170.8
77.5°	343.8	191.9	149.4	139.8	135.1
80°	258.3	137.6	113.7	104.3	104.3
82.5°	180.1	92.5	78.2	73.4	73.4
85°	101.9	52.0	45.0	45.0	45.0
87.5°	37.9	18.9	18.9	16.6	16.6
90°	2.5	32.5	54.0	67.9	73.0
92.5°	67.9	57.0	65.0	70.4	73.0
95°	175.9	86.5	105.5	119.3	116.5
97.5°	316.8	94.9	138.0	146.3	148.9
100°	479.5	108.4	154.4	175.9	181.4
102.5°	658.0	652.8	159.9	189.4	197.8
105°	823.3	904.7	165.3	194.9	205.8
107.5°	1015.7	1083.1	170.8	200.3	211.3
110°	1199.9	1256.6	474.0	203.3	213.9

TEST NUMBER: P914951

CATALOG NUMBER: DFN2DIP-SQ4F0-080D140US927-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1373.2	1421.8	1375.9	208.4	216.7
115°	1557.3	1603.2	1671.1	417.2	222.2
117.5°	1717.1	1771.1	1817.4	1429.9	720.4
120°	1895.9	1936.4	1985.3	2017.8	1652.1
122.5°	2047.4	2090.8	2145.1	2161.2	2164.2
125°	2201.8	2237.1	2288.6	2307.5	2315.6
127.5°	2342.6	2380.6	2421.4	2448.4	2451.0
130°	2475.4	2518.9	2548.4	2578.4	2575.8
132.5°	2610.9	2646.2	2675.8	2700.2	2697.7
135°	2724.7	2768.1	2792.2	2819.5	2814.1
137.5°	2843.7	2876.2	2903.5	2930.5	2922.5
140°	2960.1	2982.0	3011.6	3036.0	3022.5
142.5°	3057.9	3076.8	3111.9	3133.5	3119.9
145°	3160.8	3157.9	3203.9	3222.9	3209.4
147.5°	3249.9	3241.8	3287.9	3301.3	3290.7
150°	3336.7	3317.7	3361.1	3377.2	3363.8
152.5°	3409.7	3388.2	3428.7	3445.1	3426.1
155°	3480.1	3456.0	3488.5	3504.6	3483.1
157.5°	3537.1	3515.5	3540.0	3559.0	3537.1
160°	3586.0	3569.6	3586.0	3602.0	3583.1
162.5°	3629.1	3613.0	3626.5	3645.5	3621.1
165°	3667.0	3650.9	3659.0	3677.9	3659.0
167.5°	3697.0	3680.6	3688.9	3707.9	3683.4
170°	3721.4	3705.0	3710.4	3729.4	3705.0
172.5°	3737.4	3721.4	3726.8	3745.8	3721.4
175°	3751.0	3732.0	3737.4	3756.4	3729.4
177.5°	3756.4	3737.4	3740.4	3759.3	3734.9
180°	3742.9	3742.9	3742.9	3742.9	3742.9

TEST NUMBER: P914951

CATALOG NUMBER: DFN2DIP-SQ4F0-080D140US927-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	7.43	8.14	8.53	9.23	10.73	3.39	4.10	4.49	5.19	6.69
	3H	9.11	9.74	10.21	10.84	12.35	4.57	5.21	5.68	6.31	7.82
	4H	9.71	10.31	10.83	11.41	12.93	5.02	5.62	6.13	6.72	8.24
	6H	10.13	10.68	11.25	11.79	13.32	5.33	5.89	6.46	6.99	8.52
	8H	10.26	10.78	11.38	11.90	13.42	5.42	5.95	6.55	7.06	8.59
	12H	10.32	10.81	11.45	11.93	13.47	5.46	5.96	6.59	7.07	8.62
4H	2H	7.44	8.04	8.56	9.14	10.66	3.98	4.58	5.10	5.68	7.20
	3H	9.26	9.76	10.39	10.88	12.42	5.32	5.82	6.44	6.94	8.47
	4H	9.95	10.41	11.08	11.52	13.08	5.86	6.32	6.99	7.43	8.99
	6H	10.46	10.85	11.60	11.99	13.54	6.27	6.67	7.41	7.80	9.35
	8H	10.64	11.00	11.78	12.13	13.70	6.40	6.77	7.54	7.90	9.46
	12H	10.73	11.06	11.88	12.20	13.77	6.46	6.79	7.61	7.93	9.50
8H	4H	9.91	10.27	11.05	11.41	12.97	6.13	6.50	7.27	7.63	9.19
	6H	10.47	10.78	11.63	11.95	13.51	6.65	6.95	7.81	8.12	9.68
	8H	10.69	10.96	11.86	12.11	13.69	6.84	7.10	8.00	8.26	9.83
	12H	10.83	11.06	12.00	12.21	13.82	6.95	7.19	8.12	8.33	9.95
12H	4H	9.85	10.19	11.01	11.33	12.89	6.13	6.47	7.29	7.61	9.17
	6H	10.45	10.71	11.61	11.87	13.44	6.70	6.96	7.86	8.11	9.69
	8H	10.67	10.90	11.84	12.05	13.66	6.90	7.14	8.07	8.29	9.90