

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P915002

Luminaire Tested: DFN2DIP-SQ4F0-100D080US927-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P915002
REPORT IS A COMBINATION OF REPORTS P900104 AND P896915
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-100D080US927-RLLFLL
Description: 4 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 12342.2 lumens
Efficiency: N/A
Efficacy: 81.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 152.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9968
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P915002
CATALOG NUMBER: DFN2DIP-SQ4F0-100D080US927-RLLFLL

Luminous Intensity Polar Plot

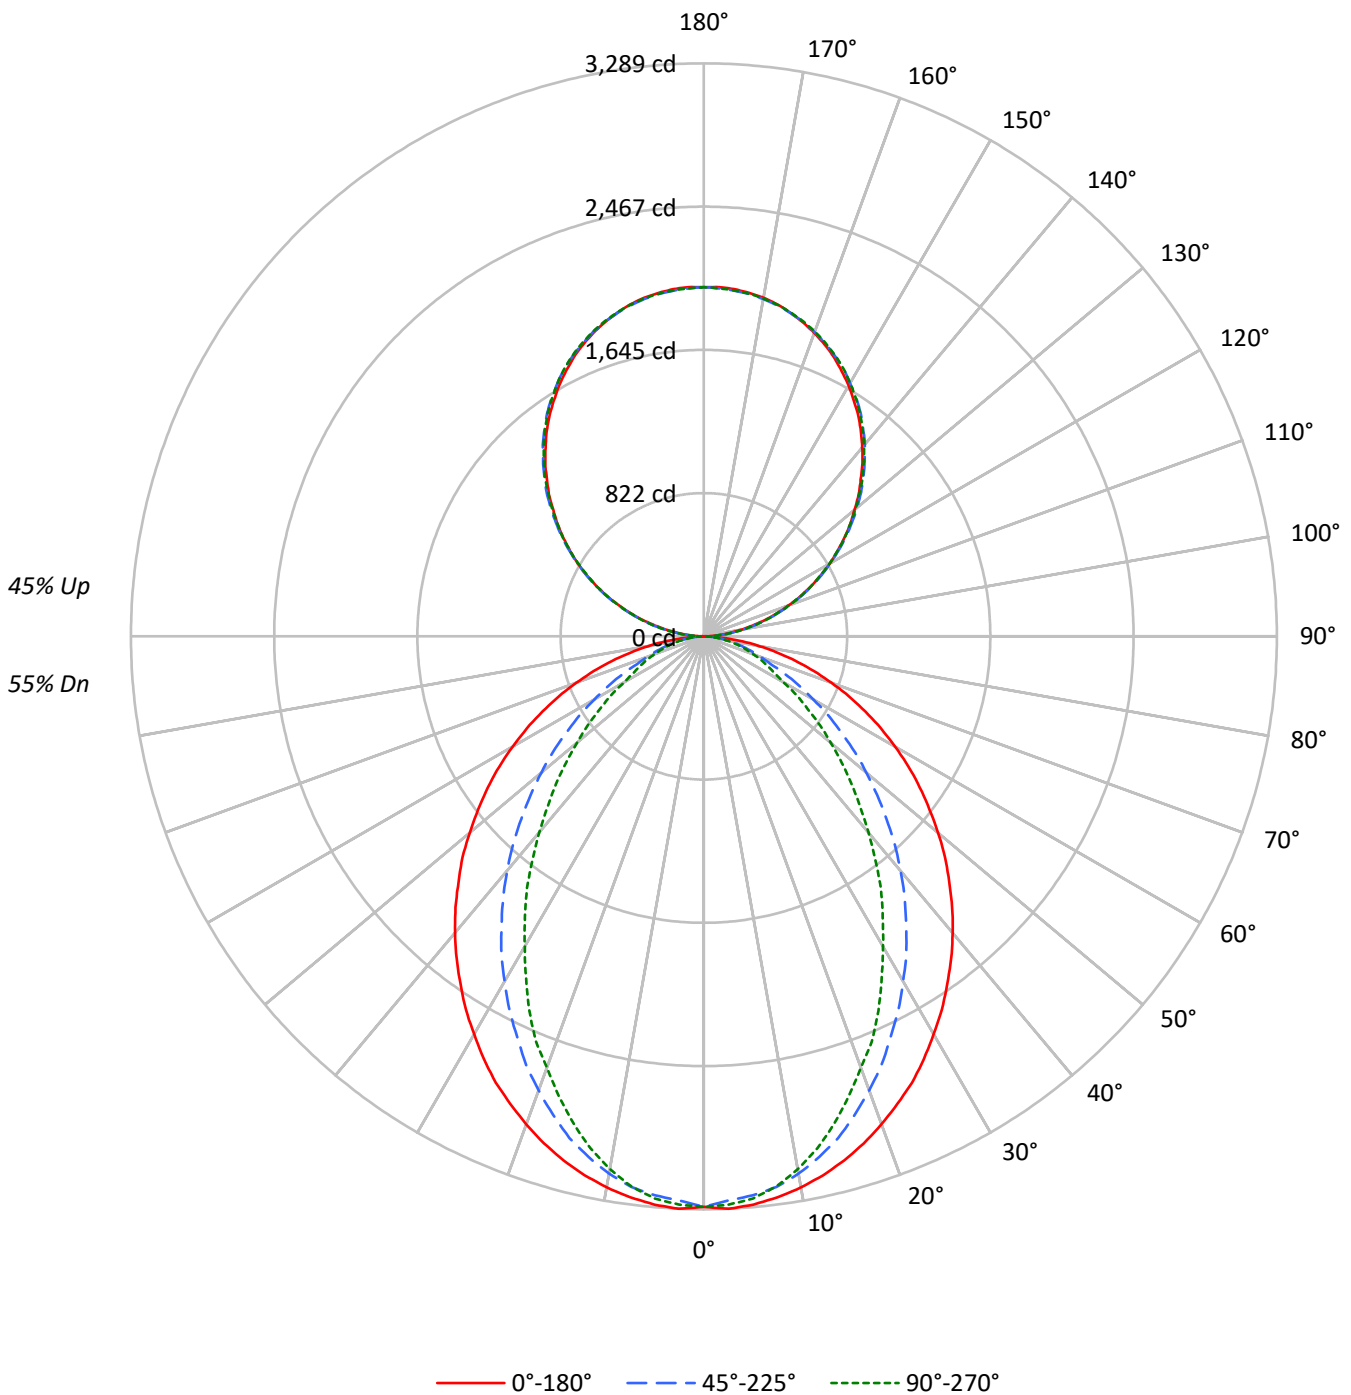



TEST NUMBER: P915002

CATALOG NUMBER: DFN2DIP-SQ4F0-100D080US927-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	108	108	108	108	100	100	100	100	86	86	86	73	73	73	60	60	60	60	60	60	55
1	99	95	91	88	92	89	85	82	76	74	72	65	63	62	54	53	52	54	53	52	47
2	91	84	78	73	84	78	73	69	67	63	60	57	55	52	48	46	45	48	46	45	40
3	83	74	67	61	77	69	63	58	60	55	51	51	48	45	43	41	39	43	41	39	35
4	76	66	58	52	71	62	55	50	54	48	44	46	42	39	39	36	34	39	36	34	30
5	70	59	51	45	65	55	48	43	48	43	38	42	37	34	35	32	30	35	32	30	27
6	65	53	45	40	60	50	43	38	44	38	34	38	33	30	32	29	26	32	29	26	24
7	60	48	40	35	56	45	38	33	40	34	30	35	30	27	30	26	24	30	26	24	21
8	56	44	36	31	52	41	34	30	36	31	27	32	27	24	27	24	21	27	24	21	19
9	52	40	33	28	49	38	31	27	34	28	24	29	25	22	25	22	19	25	22	19	17
10	49	37	30	25	46	35	28	24	31	26	22	27	23	20	24	20	18	24	20	18	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2297	2297	2297
5°	2301	2261	2276
10°	2278	2217	2203
15°	2247	2145	2089
20°	2205	2044	1949
25°	2163	1931	1814
30°	2106	1815	1642
35°	2050	1691	1491
40°	1993	1562	1318
45°	1927	1419	1161
50°	1858	1275	1008
55°	1787	1120	860
60°	1704	959	709
65°	1609	795	639
70°	1494	641	579
75°	1349	566	528
80°	1139	477	461
85°	793	320	350

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 1927 cd/sqm



TEST NUMBER: P915002

CATALOG NUMBER: DFN2DIP-SQ4F0-100D080US927-RLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	306.9	2.5
10°-20°	842.4	6.8
20°-30°	1182.6	9.6
30°-40°	1289.2	10.4
40°-50°	1184.9	9.6
50°-60°	930.5	7.5
60°-70°	605.7	4.9
70°-80°	311.8	2.5
80°-90°	85.3	0.7
90°-100°	124.0	1.0
100°-110°	394.1	3.2
110°-120°	674.4	5.5
120°-130°	886.9	7.2
130°-140°	995.5	8.1
140°-150°	976.2	7.9
150°-160°	818.9	6.6
160°-170°	543.1	4.4
170°-180°	189.8	1.5
0°-30°	2331.9	18.9
0°-40°	3621.0	29.3
0°-60°	5736.5	46.5
0°-90°	6739.2	54.6
90°-120°	1192.5	9.7
90°-150°	4051.1	32.8
90°-180°	5603.0	45.4
0°-180°	12342.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3274	3274	3274	3274	3274	
5°	3274	3259	3221	3247	3238	310
15°	3114	3081	2981	2924	2895	878
25°	2827	2732	2536	2415	2370	1300
35°	2436	2284	2024	1837	1772	1524
45°	1991	1792	1482	1271	1200	1538
55°	1514	1283	963	785	729	1353
65°	1022	782	516	415	406	1014
75°	545	338	237	216	213	577
85°	127	65	56	56	56	146
90°	2	22	59	56	57	12
95°	88	105	108	108	105	98
105°	364	369	372	375	375	384
115°	677	686	683	682	677	669
125°	984	999	995	989	987	880
135°	1273	1292	1296	1294	1289	984
145°	1546	1558	1567	1569	1563	966
155°	1767	1772	1778	1786	1781	813
165°	1923	1921	1921	1933	1924	542
175°	2001	1996	1992	2004	1994	190
180°	2004	2004	2004	2004	2004	



TEST NUMBER: P915002

CATALOG NUMBER: DFN2DIP-SQ4F0-100D080US927-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3274.1	3274.1	3274.1	3274.1	3274.1
2.5°	3288.8	3274.1	3241.4	3271.2	3265.3
5°	3274.1	3259.3	3220.6	3247.4	3238.5
7.5°	3247.4	3229.7	3188.2	3199.9	3185.1
10°	3211.8	3191.1	3132.0	3122.9	3105.3
12.5°	3167.5	3140.8	3060.6	3043.0	3010.3
15°	3114.1	3081.3	2980.7	2924.5	2894.9
17.5°	3051.8	3004.3	2879.9	2814.8	2767.3
20°	2980.7	2921.3	2773.3	2699.4	2634.0
22.5°	2903.7	2835.5	2663.6	2563.0	2518.7
25°	2826.7	2731.8	2536.2	2414.9	2370.3
27.5°	2734.9	2634.0	2417.7	2278.5	2210.3
30°	2637.2	2524.3	2287.3	2136.4	2056.3
32.5°	2542.3	2405.8	2163.1	1985.2	1911.0
35°	2435.6	2284.5	2023.9	1837.1	1771.7
37.5°	2331.9	2168.8	1893.4	1688.8	1614.9
40°	2222.2	2044.6	1757.0	1546.7	1469.7
42.5°	2109.7	1920.1	1620.9	1401.4	1327.5
45°	1991.1	1792.5	1481.6	1271.0	1199.9
47.5°	1878.7	1668.3	1348.3	1137.7	1072.6
50°	1754.1	1543.8	1217.8	1013.2	951.3
52.5°	1632.4	1410.2	1093.4	897.8	841.5
55°	1513.9	1282.9	962.9	785.3	729.0
57.5°	1392.7	1155.6	847.6	681.5	634.1
60°	1268.1	1031.1	725.9	575.0	527.5
62.5°	1146.8	909.7	622.1	480.1	456.5
65°	1022.3	782.1	515.6	414.9	405.8
67.5°	903.8	663.6	414.9	364.3	355.5
70°	779.3	548.3	343.6	314.0	302.1
72.5°	660.8	441.3	287.3	263.7	257.8
75°	545.1	337.6	237.0	216.3	213.4
77.5°	429.8	239.9	186.7	174.8	168.8
80°	322.8	172.0	142.1	130.5	130.5
82.5°	225.1	115.7	97.8	91.8	91.8
85°	127.3	65.0	56.2	56.2	56.2
87.5°	47.5	23.6	23.6	20.8	20.8
90°	1.8	21.8	59.3	55.6	57.4
92.5°	37.5	50.8	52.6	54.3	54.3
95°	88.2	105.1	108.1	108.1	105.1
97.5°	146.9	162.6	169.2	169.2	169.2
100°	214.5	228.4	233.2	233.2	231.4
102.5°	285.8	296.1	302.7	304.5	302.7
105°	363.8	368.6	372.2	375.3	375.3
107.5°	441.1	448.4	448.4	449.6	441.1
110°	516.0	525.7	525.7	525.7	520.9



TEST NUMBER: P915002

CATALOG NUMBER: DFN2DIP-SQ4F0-100D080US927-RLFL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	597.0	607.3	605.5	600.6	597.0
115°	676.8	686.4	683.4	681.6	676.8
117.5°	755.9	769.2	760.7	755.9	751.1
120°	835.7	849.0	835.7	835.7	830.2
122.5°	908.2	925.1	916.6	911.8	908.2
125°	984.3	999.4	994.6	989.1	987.4
127.5°	1058.7	1077.4	1070.7	1063.5	1058.7
130°	1128.1	1149.9	1146.8	1143.3	1136.6
132.5°	1206.1	1223.0	1224.2	1215.8	1210.9
135°	1273.1	1291.9	1295.5	1293.7	1288.9
137.5°	1348.1	1363.2	1366.2	1365.0	1357.7
140°	1414.0	1429.0	1437.5	1437.5	1430.8
142.5°	1481.6	1496.7	1501.6	1503.4	1496.7
145°	1545.7	1557.7	1567.4	1569.2	1562.6
147.5°	1603.1	1618.2	1625.4	1628.5	1621.8
150°	1662.3	1672.5	1679.2	1684.7	1679.2
152.5°	1714.8	1725.1	1733.6	1740.3	1733.6
155°	1767.4	1772.3	1777.7	1786.1	1780.7
157.5°	1812.7	1816.4	1819.4	1831.4	1823.0
160°	1853.2	1856.9	1858.7	1868.9	1861.7
162.5°	1890.7	1890.7	1892.5	1904.0	1895.5
165°	1922.7	1920.9	1920.9	1933.0	1924.5
167.5°	1951.7	1946.3	1946.3	1958.4	1949.9
170°	1973.5	1968.6	1966.8	1978.9	1968.6
172.5°	1988.6	1983.8	1982.0	1994.0	1983.8
175°	2000.7	1995.8	1992.2	2004.3	1994.0
177.5°	2007.3	2002.5	1998.8	2009.1	1998.8
180°	2004.3	2004.3	2004.3	2004.3	2004.3



TEST NUMBER: P915002
 CATALOG NUMBER: DFN2DIP-SQ4F0-100D080US927-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.47	11.34	11.39	12.27	13.48	6.43	7.30	7.35	8.23	9.44
	3H	12.15	12.93	13.09	13.88	15.11	7.62	8.40	8.56	9.34	10.57
	4H	12.77	13.50	13.72	14.45	15.69	8.07	8.81	9.02	9.76	11.00
	6H	13.19	13.87	14.15	14.83	16.08	8.40	9.07	9.36	10.03	11.28
	8H	13.32	13.97	14.29	14.94	16.19	8.49	9.13	9.46	10.11	11.36
	12H	13.39	14.00	14.36	14.97	16.24	8.53	9.15	9.51	10.11	11.39
4H	2H	10.49	11.23	11.45	12.18	13.42	7.03	7.77	7.99	8.72	9.96
	3H	12.33	12.94	13.29	13.92	15.17	8.39	9.00	9.35	9.98	11.23
	4H	13.03	13.58	14.00	14.56	15.84	8.94	9.49	9.91	10.47	11.75
	6H	13.55	14.03	14.53	15.02	16.30	9.36	9.84	10.34	10.84	12.11
	8H	13.73	14.17	14.71	15.16	16.46	9.49	9.94	10.48	10.93	12.22
	12H	13.83	14.23	14.83	15.24	16.53	9.56	9.96	10.56	10.97	12.26
8H	4H	13.00	13.44	13.98	14.44	15.73	9.22	9.67	10.21	10.66	11.95
	6H	13.57	13.94	14.58	14.97	16.26	9.74	10.11	10.76	11.15	12.43
	8H	13.79	14.11	14.81	15.13	16.44	9.94	10.26	10.96	11.28	12.59
	12H	13.93	14.22	14.96	15.23	16.59	10.06	10.34	11.08	11.36	12.71
12H	4H	12.95	13.35	13.96	14.36	15.66	9.23	9.63	10.24	10.64	11.94
	6H	13.54	13.87	14.57	14.89	16.20	9.79	10.12	10.81	11.14	12.45
	8H	13.77	14.06	14.79	15.07	16.42	10.01	10.29	11.03	11.31	12.66