

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P915039

Luminaire Tested: DFN2DIP-SQ4F0-110D080US927-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P915039
REPORT IS A COMBINATION OF REPORTS P901626 AND P898471
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-110D080US927-RLLONL
Description: 4 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 13681.0 lumens
Efficiency: N/A
Efficacy: 83.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 164.6
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9951
Total Harmonic Distortion (THDi): 0.07
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P915039

CATALOG NUMBER: DFN2DIP-SQ4F0-110D080US927-RLLONL

Luminous Intensity Polar Plot

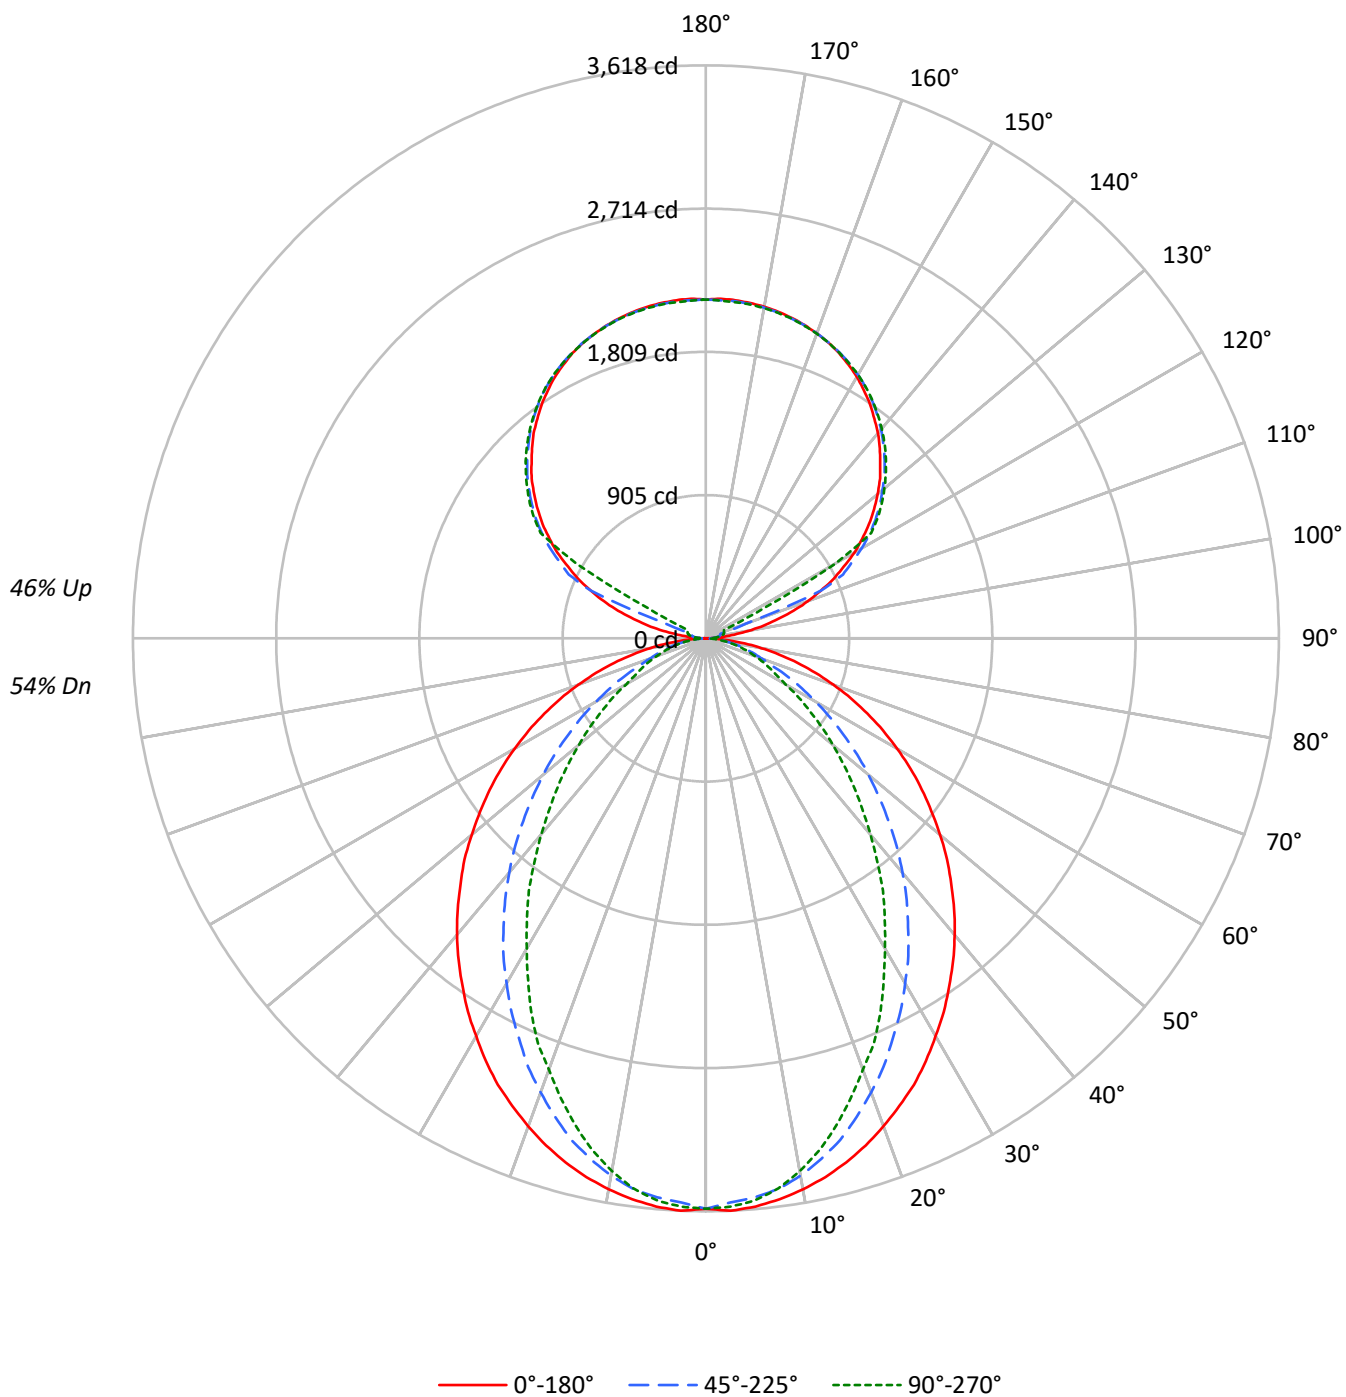

TEST NUMBER: P915039

CATALOG NUMBER: DFN2DIP-SQ4F0-110D080US927-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	86	86	86	72	72	72	60	60	60
1	99	95	91	88	92	88	85	82	76	74	71	64	63	61	54	53	52
2	91	84	78	73	84	78	73	68	67	63	60	57	54	52	48	46	44
3	83	74	67	61	77	69	63	58	60	55	51	51	48	45	43	40	38
4	76	66	58	52	71	62	55	49	53	48	44	46	42	39	39	36	33
5	70	59	51	45	65	55	48	43	48	43	38	41	37	34	35	32	30
6	65	53	45	40	60	50	43	38	44	38	34	38	33	30	32	29	26
7	60	48	40	35	56	45	38	33	40	34	30	34	30	27	29	26	24
8	56	44	36	31	52	41	34	30	36	31	27	32	27	24	27	24	21
9	52	40	33	28	49	38	31	27	33	28	24	29	25	22	25	22	19
10	49	37	30	25	45	35	28	24	31	26	22	27	23	20	23	20	18

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2527	2527	2527
5°	2531	2487	2504
10°	2506	2439	2423
15°	2471	2359	2298
20°	2426	2248	2144
25°	2379	2124	1995
30°	2316	1997	1806
35°	2255	1860	1640
40°	2192	1718	1450
45°	2119	1561	1277
50°	2044	1402	1109
55°	1966	1232	946
60°	1875	1054	780
65°	1770	874	703
70°	1643	705	637
75°	1484	623	581
80°	1253	524	507
85°	873	353	386

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2119 cd/sqm

TEST NUMBER: P915039

CATALOG NUMBER: DFN2DIP-SQ4F0-110D080US927-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	337.5	2.5
10°-20°	926.6	6.8
20°-30°	1300.9	9.5
30°-40°	1418.1	10.4
40°-50°	1303.4	9.5
50°-60°	1023.6	7.5
60°-70°	666.3	4.9
70°-80°	343.0	2.5
80°-90°	91.3	0.7
90°-100°	70.5	0.5
100°-110°	262.9	1.9
110°-120°	697.3	5.1
120°-130°	1156.5	8.5
130°-140°	1228.4	9.0
140°-150°	1141.7	8.3
150°-160°	917.9	6.7
160°-170°	591.5	4.3
170°-180°	203.6	1.5
0°-30°	2565.1	18.7
0°-40°	3983.1	29.1
0°-60°	6310.1	46.1
0°-90°	7410.7	54.2
90°-120°	1030.7	7.5
90°-150°	4557.3	33.3
90°-180°	6270.0	45.8
0°-180°	13681.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3602	3602	3602	3602	3602	
5°	3602	3585	3543	3572	3562	341
15°	3426	3390	3279	3217	3184	965
25°	3109	3005	2790	2656	2607	1430
35°	2679	2513	2226	2021	1949	1677
45°	2190	1972	1630	1398	1320	1691
55°	1665	1411	1059	864	802	1488
65°	1124	860	567	456	446	1115
75°	600	371	261	238	235	634
85°	140	72	62	62	62	161
90°	2	18	31	39	42	13
95°	100	49	60	68	66	119
105°	470	517	94	111	118	503
115°	890	916	955	238	127	876
125°	1258	1278	1308	1319	1323	1122
135°	1557	1582	1596	1611	1608	1203
145°	1806	1804	1831	1842	1834	1130
155°	1989	1975	1993	2003	1990	916
165°	2096	2086	2091	2102	2091	592
175°	2143	2133	2136	2146	2131	204
180°	2139	2139	2139	2139	2139	

TEST NUMBER: P915039

CATALOG NUMBER: DFN2DIP-SQ4F0-110D080US927-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3601.5	3601.5	3601.5	3601.5	3601.5
2.5°	3617.7	3601.5	3565.5	3598.4	3591.8
5°	3601.5	3585.3	3542.7	3572.1	3562.4
7.5°	3572.1	3552.7	3507.1	3519.9	3503.6
10°	3533.0	3510.2	3445.2	3435.1	3415.8
12.5°	3484.3	3454.9	3366.7	3347.3	3311.3
15°	3425.5	3389.5	3278.8	3217.0	3184.4
17.5°	3357.0	3304.8	3167.9	3096.2	3044.0
20°	3278.8	3213.5	3050.6	2969.3	2897.4
22.5°	3194.2	3119.1	2930.0	2819.3	2770.5
25°	3109.4	3005.0	2789.9	2656.4	2607.3
27.5°	3008.5	2897.4	2659.5	2506.3	2431.3
30°	2900.9	2776.8	2516.0	2350.0	2261.8
32.5°	2796.5	2646.4	2379.4	2183.7	2102.1
35°	2679.2	2512.9	2226.3	2020.9	1948.9
37.5°	2565.2	2385.7	2082.7	1857.6	1776.4
40°	2444.4	2249.1	1932.7	1701.3	1616.6
42.5°	2320.6	2112.1	1783.0	1541.6	1460.3
45°	2190.3	1971.7	1629.8	1398.0	1319.9
47.5°	2066.5	1835.2	1483.1	1251.4	1179.9
50°	1929.5	1698.2	1339.7	1114.5	1046.4
52.5°	1795.7	1551.2	1202.7	987.6	925.7
55°	1665.3	1411.2	1059.1	863.8	801.9
57.5°	1531.9	1271.1	932.2	749.7	697.4
60°	1395.0	1134.2	798.4	632.5	580.3
62.5°	1261.5	1000.8	684.4	528.1	502.1
65°	1124.5	860.3	567.1	456.5	446.4
67.5°	994.2	730.0	456.5	400.8	391.1
70°	857.2	603.1	377.9	345.5	332.3
72.5°	726.8	485.5	316.1	290.1	283.5
75°	599.6	371.4	260.7	237.9	234.8
77.5°	472.7	263.9	205.4	192.3	185.7
80°	355.1	189.2	156.3	143.5	143.5
82.5°	247.6	127.2	107.6	101.0	101.0
85°	140.1	71.6	61.9	61.9	61.9
87.5°	52.2	25.9	25.9	22.8	22.8
90°	1.5	18.5	30.9	38.7	41.7
92.5°	38.7	32.6	37.2	40.2	41.7
95°	100.5	49.4	60.3	68.2	66.5
97.5°	181.0	54.2	78.8	83.7	85.1
100°	274.0	61.9	88.2	100.5	103.6
102.5°	376.0	373.0	91.3	108.2	113.0
105°	470.5	517.0	94.4	111.4	117.6
107.5°	580.4	618.9	97.6	114.5	120.7
110°	685.7	718.0	270.9	116.1	122.2

TEST NUMBER: P915039

CATALOG NUMBER: DFN2DIP-SQ4F0-110D080US927-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	784.7	812.5	786.2	119.1	123.9
115°	889.9	916.2	954.9	238.4	127.0
117.5°	981.2	1012.1	1038.5	817.1	411.7
120°	1083.4	1106.5	1134.5	1153.0	944.0
122.5°	1169.9	1194.8	1225.8	1235.0	1236.7
125°	1258.1	1278.3	1307.7	1318.6	1323.2
127.5°	1338.6	1360.3	1383.7	1399.1	1400.6
130°	1414.5	1439.3	1456.3	1473.4	1471.9
132.5°	1491.9	1512.1	1529.1	1543.0	1541.5
135°	1557.0	1581.7	1595.5	1611.2	1608.0
137.5°	1625.0	1643.5	1659.1	1674.6	1670.0
140°	1691.5	1704.0	1720.9	1734.9	1727.1
142.5°	1747.4	1758.2	1778.2	1790.6	1782.8
145°	1806.2	1804.5	1830.8	1841.7	1833.9
147.5°	1857.1	1852.5	1878.7	1886.5	1880.4
150°	1906.7	1895.8	1920.6	1929.8	1922.1
152.5°	1948.4	1936.1	1959.2	1968.6	1957.8
155°	1988.7	1974.9	1993.4	2002.6	1990.4
157.5°	2021.2	2008.9	2022.8	2033.7	2021.2
160°	2049.1	2039.8	2049.1	2058.3	2047.5
162.5°	2073.8	2064.6	2072.3	2083.1	2069.2
165°	2095.5	2086.3	2090.9	2101.7	2090.9
167.5°	2112.5	2103.2	2107.9	2118.8	2104.8
170°	2126.5	2117.1	2120.3	2131.1	2117.1
172.5°	2135.7	2126.5	2129.6	2140.5	2126.5
175°	2143.4	2132.6	2135.7	2146.5	2131.1
177.5°	2146.5	2135.7	2137.3	2148.2	2134.2
180°	2138.8	2138.8	2138.8	2138.8	2138.8

TEST NUMBER: P915039

CATALOG NUMBER: DFN2DIP-SQ4F0-110D080US927-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.76	11.63	11.69	12.57	13.78	6.72	7.59	7.65	8.53	9.74
	3H	12.45	13.22	13.39	14.17	15.41	7.91	8.69	8.85	9.64	10.88
	4H	13.06	13.79	14.01	14.74	15.99	8.37	9.10	9.32	10.05	11.30
	6H	13.49	14.16	14.45	15.12	16.38	8.69	9.36	9.66	10.32	11.58
	8H	13.62	14.26	14.59	15.23	16.49	8.78	9.42	9.75	10.40	11.66
	12H	13.68	14.29	14.66	15.26	16.54	8.83	9.44	9.80	10.41	11.69
4H	2H	10.78	11.52	11.74	12.47	13.72	7.32	8.06	8.28	9.01	10.26
	3H	12.62	13.23	13.59	14.21	15.47	8.68	9.29	9.65	10.27	11.53
	4H	13.32	13.87	14.30	14.85	16.14	9.23	9.78	10.21	10.76	12.05
	6H	13.84	14.32	14.83	15.32	16.60	9.65	10.13	10.64	11.13	12.41
	8H	14.02	14.46	15.01	15.46	16.76	9.78	10.23	10.77	11.22	12.52
	12H	14.12	14.52	15.13	15.53	16.83	9.85	10.25	10.86	11.26	12.56
8H	4H	13.29	13.73	14.28	14.73	16.03	9.51	9.96	10.51	10.95	12.25
	6H	13.86	14.23	14.88	15.27	16.56	10.04	10.40	11.05	11.44	12.73
	8H	14.08	14.40	15.11	15.43	16.74	10.23	10.55	11.25	11.58	12.89
	12H	14.22	14.51	15.25	15.53	16.89	10.35	10.63	11.38	11.65	13.01
12H	4H	13.24	13.64	14.25	14.65	15.96	9.52	9.92	10.53	10.93	12.24
	6H	13.84	14.16	14.86	15.18	16.50	10.09	10.41	11.11	11.43	12.75
	8H	14.06	14.35	15.09	15.36	16.72	10.30	10.58	11.33	11.60	12.96

END OF REPORT