

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P915091

Luminaire Tested: DFN2DIP-SQ4F0-120D120US927-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P915091
REPORT IS A COMBINATION OF REPORTS P901700 AND P898471
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-120D120US927-RLLONL
Description: 4 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 17491.4 lumens
Efficiency: N/A
Efficacy: 84.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 207.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9933
Total Harmonic Distortion (THDi): 0.066
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P915091

CATALOG NUMBER: DFN2DIP-SQ4F0-120D120US927-RLLONL

Luminous Intensity Polar Plot

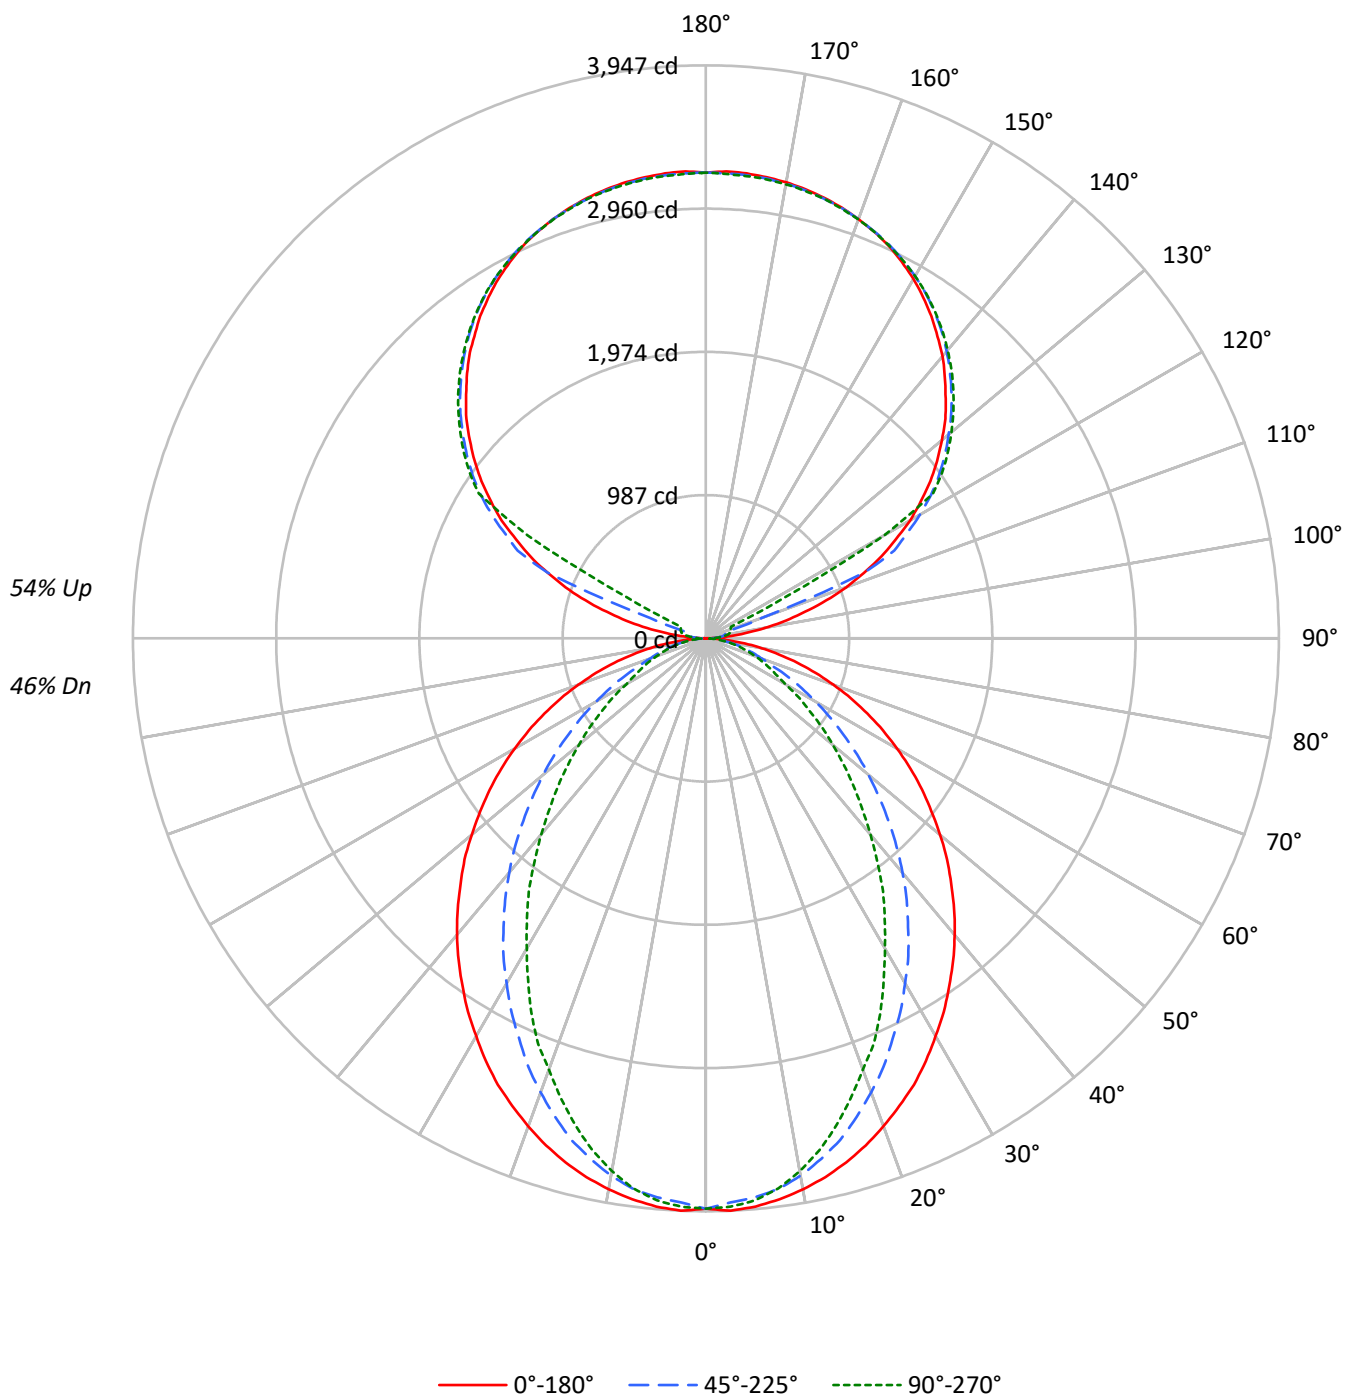

TEST NUMBER: P915091

CATALOG NUMBER: DFN2DIP-SQ4F0-120D120US927-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	98	98	98	98	81	81	81	66	66	66	53	53	53
1	97	93	90	86	89	86	83	80	72	70	68	59	58	56	47	46	45
2	89	82	76	71	82	76	70	66	63	60	57	52	50	48	42	40	39
3	81	72	65	60	75	67	61	56	56	52	48	47	43	41	38	35	34
4	75	64	57	51	68	60	53	48	50	45	41	42	38	35	34	31	29
5	69	58	50	44	63	53	46	41	45	40	36	38	34	31	31	28	26
6	63	52	44	38	58	48	41	36	41	36	32	34	30	27	28	25	23
7	59	47	39	34	54	44	37	32	37	32	28	31	27	24	26	23	21
8	55	43	35	30	50	40	33	28	34	29	25	29	25	22	24	21	19
9	51	39	32	27	47	36	30	25	31	26	22	27	23	20	22	19	17
10	48	36	29	24	44	33	27	23	29	24	20	25	21	18	20	18	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2757	2757	2757
5°	2761	2714	2731
10°	2734	2661	2643
15°	2696	2573	2506
20°	2646	2453	2338
25°	2595	2317	2176
30°	2527	2178	1970
35°	2460	2029	1789
40°	2391	1874	1582
45°	2312	1703	1393
50°	2230	1529	1209
55°	2144	1344	1033
60°	2045	1150	851
65°	1931	953	767
70°	1793	770	695
75°	1619	680	634
80°	1368	572	552
85°	952	385	421

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2312 cd/sqm

TEST NUMBER: P915091

CATALOG NUMBER: DFN2DIP-SQ4F0-120D120US927-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	368.2	2.1
10°-20°	1010.8	5.8
20°-30°	1419.2	8.1
30°-40°	1547.0	8.8
40°-50°	1421.9	8.1
50°-60°	1116.7	6.4
60°-70°	726.9	4.2
70°-80°	374.2	2.1
80°-90°	101.2	0.6
90°-100°	105.8	0.6
100°-110°	394.4	2.3
110°-120°	1045.9	6.0
120°-130°	1734.7	9.9
130°-140°	1842.7	10.5
140°-150°	1712.6	9.8
150°-160°	1376.9	7.9
160°-170°	887.2	5.1
170°-180°	305.4	1.7
0°-30°	2798.2	16.0
0°-40°	4345.2	24.8
0°-60°	6883.7	39.4
0°-90°	8085.9	46.2
90°-120°	1546.1	8.8
90°-150°	6836.0	39.1
90°-180°	9405.0	53.8
0°-180°	17491.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3929	3929	3929	3929	3929	
5°	3929	3911	3865	3897	3886	373
15°	3737	3698	3577	3509	3474	1053
25°	3392	3278	3044	2898	2844	1560
35°	2923	2741	2429	2205	2126	1829
45°	2389	2151	1778	1525	1440	1845
55°	1817	1540	1156	942	875	1623
65°	1227	939	619	498	487	1216
75°	654	405	284	260	256	692
85°	153	78	68	68	68	175
90°	2	28	46	58	63	16
95°	151	74	90	102	100	179
105°	706	776	142	167	176	754
115°	1335	1374	1432	358	190	1314
125°	1887	1918	1962	1978	1985	1683
135°	2335	2373	2393	2417	2412	1804
145°	2709	2707	2746	2762	2751	1694
155°	2983	2962	2990	3004	2986	1375
165°	3143	3129	3136	3153	3136	888
175°	3215	3199	3204	3220	3197	306
180°	3208	3208	3208	3208	3208	

TEST NUMBER: P915091

CATALOG NUMBER: DFN2DIP-SQ4F0-120D120US927-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3928.9	3928.9	3928.9	3928.9	3928.9
2.5°	3946.6	3928.9	3889.7	3925.5	3918.3
5°	3928.9	3911.2	3864.7	3896.8	3886.3
7.5°	3896.8	3875.7	3825.9	3839.9	3822.1
10°	3854.2	3829.3	3758.3	3747.4	3726.3
12.5°	3801.0	3769.0	3672.7	3651.6	3612.4
15°	3736.9	3697.7	3576.9	3509.4	3474.0
17.5°	3662.2	3605.2	3455.8	3377.8	3320.8
20°	3576.9	3505.6	3328.0	3239.3	3160.8
22.5°	3484.5	3402.7	3196.3	3075.6	3022.4
25°	3392.1	3278.1	3043.5	2897.9	2844.3
27.5°	3281.9	3160.8	2901.3	2734.2	2652.3
30°	3164.6	3029.2	2744.7	2563.7	2467.5
32.5°	3050.7	2886.9	2595.7	2382.2	2293.2
35°	2922.8	2741.3	2428.6	2204.6	2126.1
37.5°	2798.3	2602.6	2272.1	2026.5	1937.8
40°	2666.6	2453.5	2108.4	1856.0	1763.6
42.5°	2531.6	2304.1	1945.0	1681.7	1593.1
45°	2389.4	2151.0	1777.9	1525.2	1439.9
47.5°	2254.3	2002.0	1618.0	1365.2	1287.1
50°	2105.0	1852.6	1461.4	1215.8	1141.5
52.5°	1959.0	1692.3	1312.0	1077.4	1009.9
55°	1816.8	1539.5	1155.5	942.3	874.8
57.5°	1671.1	1386.7	1017.0	817.8	760.9
60°	1521.8	1237.3	871.0	690.0	633.0
62.5°	1376.2	1091.7	746.6	576.1	547.7
65°	1226.8	938.6	618.7	498.0	487.0
67.5°	1084.6	796.3	498.0	437.2	426.7
70°	935.2	657.9	412.3	376.8	362.5
72.5°	793.0	529.7	344.8	316.5	309.3
75°	654.1	405.1	284.5	259.5	256.1
77.5°	515.7	287.8	224.1	209.8	202.6
80°	387.5	206.4	170.5	156.5	156.5
82.5°	270.1	138.8	117.3	110.1	110.1
85°	152.8	78.1	67.5	67.5	67.5
87.5°	57.0	28.3	28.3	24.9	24.9
90°	2.2	27.8	46.3	58.1	62.6
92.5°	58.1	48.8	55.7	60.4	62.6
95°	150.8	74.1	90.4	102.3	99.8
97.5°	271.6	81.4	118.3	125.4	127.6
100°	411.0	92.9	132.3	150.8	155.5
102.5°	564.0	559.6	137.0	162.4	169.5
105°	705.7	775.5	141.7	167.1	176.4
107.5°	870.5	928.4	146.4	171.7	181.1
110°	1028.5	1077.0	406.3	174.2	183.3

TEST NUMBER: P915091

CATALOG NUMBER: DFN2DIP-SQ4F0-120D120US927-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1177.1	1218.7	1179.3	178.6	185.8
115°	1334.7	1374.2	1432.3	357.5	190.5
117.5°	1471.8	1518.1	1557.8	1225.6	617.5
120°	1625.1	1659.8	1701.7	1729.6	1416.1
122.5°	1754.9	1792.2	1838.7	1852.5	1855.0
125°	1887.2	1917.6	1961.7	1977.9	1984.8
127.5°	2007.9	2040.5	2075.5	2098.6	2100.9
130°	2121.8	2159.0	2184.4	2210.0	2207.8
132.5°	2237.8	2268.2	2293.5	2314.5	2312.3
135°	2335.4	2372.7	2393.3	2416.8	2412.1
137.5°	2437.5	2465.3	2488.7	2511.8	2505.0
140°	2537.3	2556.0	2581.3	2602.3	2590.7
142.5°	2621.0	2637.3	2667.4	2685.8	2674.2
145°	2709.3	2706.8	2746.2	2762.5	2750.8
147.5°	2785.6	2778.7	2818.2	2829.8	2820.6
150°	2860.0	2843.8	2881.0	2894.8	2883.2
152.5°	2922.6	2904.1	2938.9	2952.9	2936.7
155°	2983.0	2962.3	2990.2	3004.0	2985.5
157.5°	3031.8	3013.3	3034.3	3050.5	3031.8
160°	3073.7	3059.6	3073.7	3087.4	3071.2
162.5°	3110.7	3096.9	3108.4	3124.7	3103.8
165°	3143.1	3129.4	3136.2	3152.6	3136.2
167.5°	3168.8	3154.7	3161.9	3178.2	3157.2
170°	3189.7	3175.7	3180.4	3196.6	3175.7
172.5°	3203.5	3189.7	3194.5	3210.7	3189.7
175°	3215.1	3198.8	3203.5	3219.8	3196.6
177.5°	3219.8	3203.5	3206.0	3222.3	3201.4
180°	3208.3	3208.3	3208.3	3208.3	3208.3

TEST NUMBER: P915091

CATALOG NUMBER: DFN2DIP-SQ4F0-120D120US927-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.32	11.12	11.32	12.12	13.45	6.28	7.08	7.28	8.08	9.41
	3H	12.00	12.71	13.01	13.73	15.07	7.47	8.18	8.47	9.19	10.54
	4H	12.61	13.29	13.63	14.30	15.66	7.92	8.59	8.94	9.61	10.96
	6H	13.03	13.66	14.06	14.68	16.04	8.24	8.86	9.27	9.88	11.25
	8H	13.16	13.75	14.20	14.79	16.15	8.33	8.92	9.36	9.95	11.32
	12H	13.22	13.79	14.26	14.82	16.20	8.37	8.93	9.41	9.96	11.35
4H	2H	10.33	11.01	11.36	12.03	13.38	6.87	7.55	7.90	8.57	9.92
	3H	12.17	12.73	13.20	13.77	15.14	8.22	8.79	9.26	9.83	11.20
	4H	12.86	13.37	13.90	14.41	15.80	8.77	9.28	9.81	10.32	11.71
	6H	13.38	13.82	14.43	14.88	16.27	9.19	9.63	10.24	10.69	12.08
	8H	13.56	13.97	14.61	15.02	16.42	9.32	9.73	10.37	10.78	12.18
	12H	13.65	14.02	14.72	15.09	16.50	9.38	9.75	10.45	10.82	12.23
8H	4H	12.83	13.24	13.88	14.29	15.69	9.05	9.46	10.10	10.51	11.92
	6H	13.40	13.74	14.47	14.83	16.23	9.57	9.91	10.64	11.00	12.40
	8H	13.61	13.91	14.70	14.99	16.41	9.76	10.06	10.84	11.14	12.56
	12H	13.76	14.02	14.84	15.09	16.55	9.88	10.14	10.96	11.21	12.67
12H	4H	12.78	13.15	13.84	14.21	15.62	9.06	9.43	10.12	10.49	11.90
	6H	13.37	13.67	14.45	14.75	16.17	9.62	9.92	10.70	11.00	12.41
	8H	13.59	13.86	14.68	14.93	16.39	9.83	10.09	10.91	11.16	12.62

END OF REPORT