

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P915101

Luminaire Tested: DFN2DIP-SQ4F0-140D060US927-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P915101
REPORT IS A COMBINATION OF REPORTS P901593 AND P898471
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-140D060US927-FLLONL
Description: 4 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 15685.2 lumens
Efficiency: N/A
Efficacy: 83.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 189
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P915101

CATALOG NUMBER: DFN2DIP-SQ4F0-140D060US927-FLLONL

Luminous Intensity Polar Plot

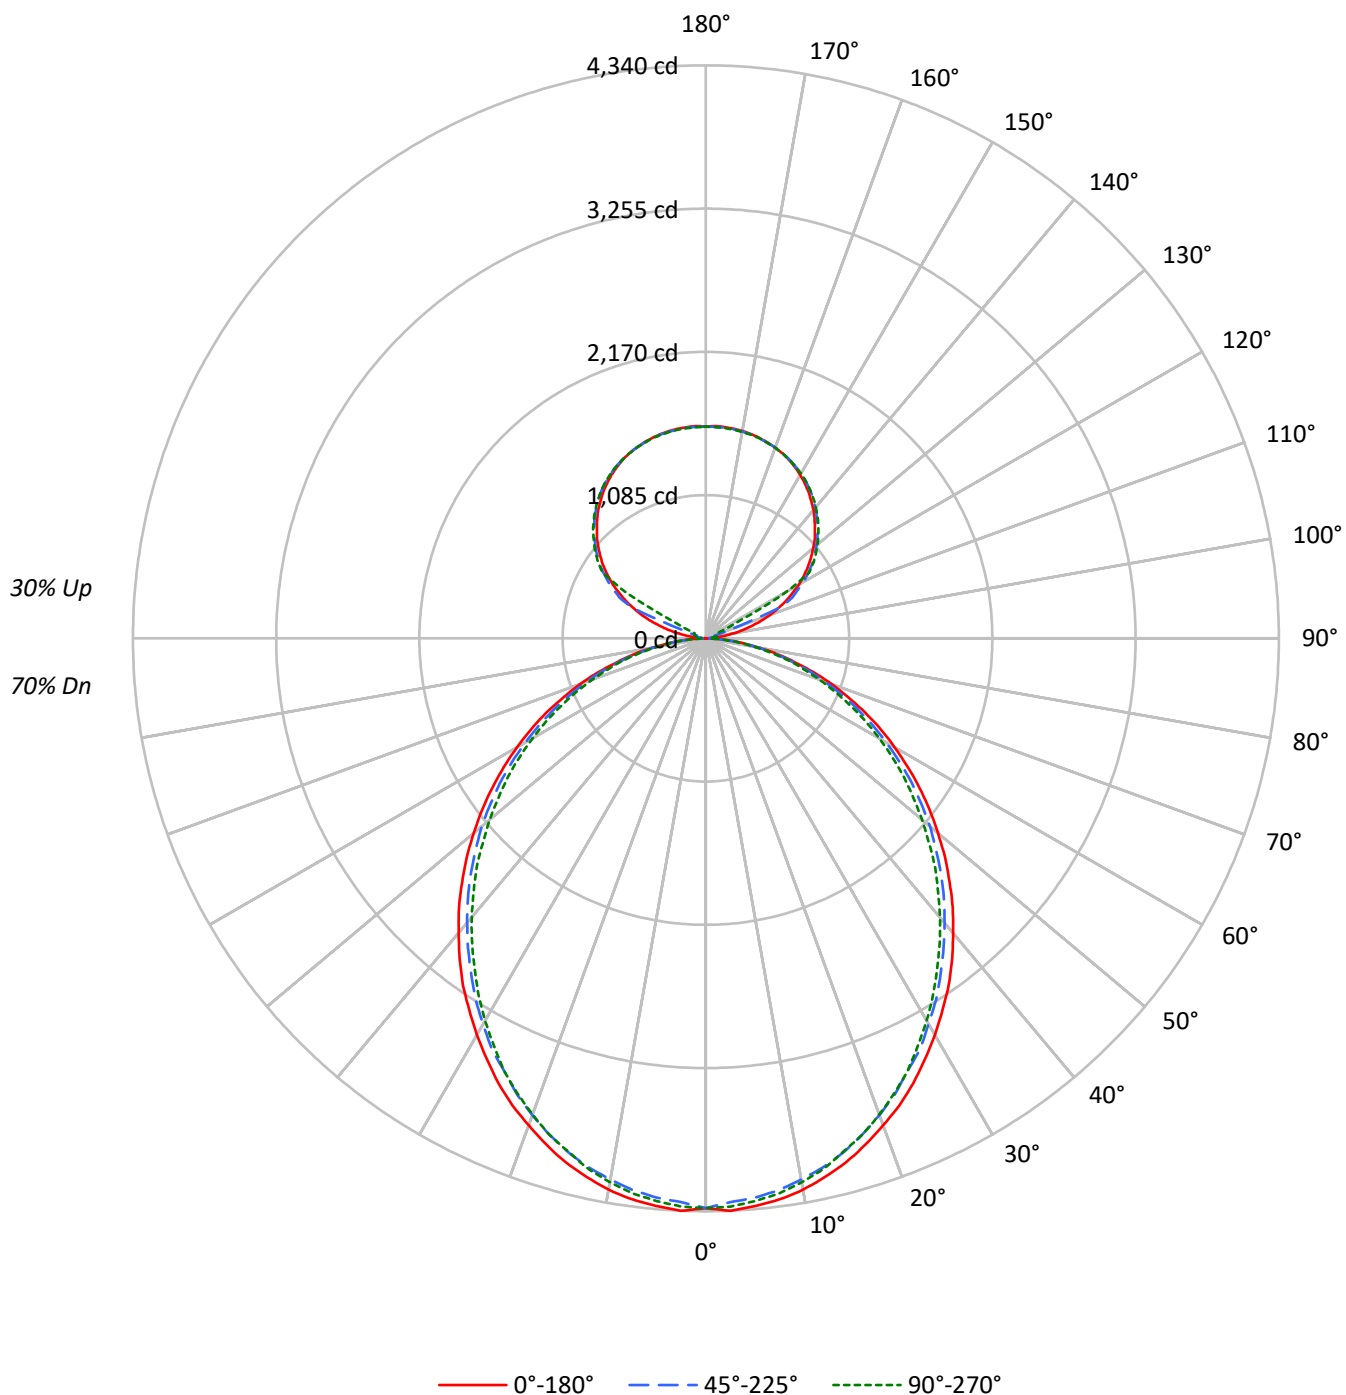

TEST NUMBER: P915101

CATALOG NUMBER: DFN2DIP-SQ4F0-140D060US927-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	112	112	112	112	106	106	106	106	94	94	94	84	84	84	75	75	75
1	102	98	94	90	97	93	89	86	83	80	78	74	72	70	66	64	63
2	93	85	79	74	88	81	75	71	73	68	64	65	62	59	58	55	53
3	85	75	68	62	80	71	65	59	64	59	54	58	53	50	51	48	45
4	78	67	58	52	73	63	56	50	57	51	46	51	47	43	46	42	39
5	72	60	51	45	67	57	49	43	51	45	40	46	41	37	41	37	34
6	66	54	45	39	62	51	43	38	46	40	35	42	37	33	38	33	30
7	61	48	40	34	58	46	39	33	42	36	31	38	33	29	34	30	27
8	57	44	36	31	54	42	35	30	38	32	28	35	30	26	32	27	24
9	53	40	33	27	50	39	32	27	35	29	25	32	27	23	29	25	22
10	50	37	30	25	47	36	29	24	33	27	23	30	25	21	27	23	20

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3028	3028	3028
5°	3033	2986	3007
10°	3008	2947	2967
15°	2964	2899	2904
20°	2904	2832	2840
25°	2845	2752	2765
30°	2770	2678	2671
35°	2699	2590	2570
40°	2612	2501	2475
45°	2526	2412	2377
50°	2431	2319	2264
55°	2332	2211	2160
60°	2219	2083	2041
65°	2097	1950	1901
70°	1941	1789	1750
75°	1725	1596	1613
80°	1466	1350	1347
85°	1059	923	906

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2526 cd/sqm

TEST NUMBER: P915101

CATALOG NUMBER: DFN2DIP-SQ4F0-140D060US927-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	406.2	2.6
10°-20°	1142.8	7.3
20°-30°	1679.5	10.7
30°-40°	1950.6	12.4
40°-50°	1948.2	12.4
50°-60°	1698.7	10.8
60°-70°	1255.7	8.0
70°-80°	710.5	4.5
80°-90°	190.3	1.2
90°-100°	52.9	0.3
100°-110°	197.2	1.3
110°-120°	523.0	3.3
120°-130°	867.4	5.5
130°-140°	921.3	5.9
140°-150°	856.3	5.5
150°-160°	688.4	4.4
160°-170°	443.6	2.8
170°-180°	152.7	1.0
0°-30°	3228.4	20.6
0°-40°	5179.0	33.0
0°-60°	8825.9	56.3
0°-90°	10982.5	70.0
90°-120°	773.0	4.9
90°-150°	3418.0	21.8
90°-180°	4703.0	30.0
0°-180°	15685.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4315	4315	4315	4315	4315	
5°	4315	4299	4253	4286	4278	410
15°	4108	4083	4029	4046	4025	1157
25°	3718	3685	3614	3622	3614	1711
35°	3208	3166	3100	3075	3054	2003
45°	2610	2581	2519	2473	2457	2014
55°	1976	1950	1901	1851	1830	1766
65°	1332	1307	1266	1228	1208	1317
75°	697	689	668	643	652	744
85°	170	166	162	149	145	190
90°	1	14	23	29	31	15
95°	75	37	45	51	50	89
105°	353	388	71	84	88	377
115°	667	687	716	179	95	657
125°	944	959	981	989	992	842
135°	1168	1186	1197	1208	1206	902
145°	1355	1353	1373	1381	1376	847
155°	1492	1481	1495	1502	1493	687
165°	1572	1565	1568	1576	1568	444
175°	1608	1599	1602	1610	1598	153
180°	1604	1604	1604	1604	1604	

TEST NUMBER: P915101

CATALOG NUMBER: DFN2DIP-SQ4F0-140D060US927-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4315.4	4315.4	4315.4	4315.4	4315.4
2.5°	4340.4	4319.8	4274.0	4315.4	4307.5
5°	4315.4	4299.1	4253.3	4286.3	4278.4
7.5°	4286.3	4261.7	4215.9	4249.3	4240.9
10°	4240.9	4211.9	4162.2	4195.2	4182.9
12.5°	4178.4	4153.8	4104.1	4124.7	4116.4
15°	4108.0	4083.4	4029.2	4046.0	4025.2
17.5°	4020.9	3996.2	3942.1	3962.7	3942.1
20°	3925.3	3900.7	3842.6	3854.9	3838.6
22.5°	3830.2	3792.8	3738.6	3738.6	3730.3
25°	3717.9	3684.9	3614.5	3622.4	3614.5
27.5°	3593.3	3564.3	3510.6	3498.3	3477.6
30°	3469.2	3435.8	3373.7	3361.4	3344.6
32.5°	3336.3	3311.6	3245.1	3220.1	3203.3
35°	3207.7	3166.3	3099.8	3074.8	3054.0
37.5°	3062.4	3025.0	2958.5	2929.5	2908.7
40°	2913.2	2879.7	2813.2	2776.3	2759.5
42.5°	2767.9	2734.5	2668.4	2626.6	2601.9
45°	2610.2	2581.2	2518.7	2473.3	2456.6
47.5°	2456.6	2427.6	2361.1	2315.3	2290.7
50°	2294.6	2274.0	2215.8	2157.7	2137.0
52.5°	2137.0	2107.9	2054.2	2008.4	1979.4
55°	1975.5	1950.4	1900.6	1850.9	1830.2
57.5°	1813.4	1792.7	1738.6	1688.9	1672.1
60°	1651.4	1635.1	1577.0	1531.2	1518.8
62.5°	1493.8	1464.7	1423.3	1382.0	1365.2
65°	1332.2	1307.1	1265.7	1228.3	1207.6
67.5°	1166.2	1145.1	1108.1	1079.0	1062.3
70°	1012.6	995.9	958.5	929.4	913.1
72.5°	855.0	838.2	817.5	788.5	776.2
75°	697.0	689.0	667.9	643.3	651.6
77.5°	556.0	539.3	530.9	518.6	506.3
80°	415.2	410.7	402.4	390.1	381.7
82.5°	282.2	282.2	278.2	261.5	261.5
85°	169.9	166.0	162.0	149.2	145.3
87.5°	74.9	66.5	58.1	45.8	41.4
90°	1.1	13.9	23.1	29.1	31.3
92.5°	29.1	24.4	27.8	30.2	31.3
95°	75.4	37.1	45.2	51.2	49.9
97.5°	135.8	40.6	59.1	62.7	63.8
100°	205.5	46.4	66.1	75.4	77.7
102.5°	282.0	279.8	68.5	81.2	84.8
105°	352.8	387.7	70.8	83.5	88.2
107.5°	435.3	464.2	73.2	85.9	90.5
110°	514.3	538.5	203.2	87.1	91.7

TEST NUMBER: P915101

CATALOG NUMBER: DFN2DIP-SQ4F0-140D060US927-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	588.5	609.3	589.6	89.3	92.9
115°	667.4	687.1	716.2	178.8	95.2
117.5°	735.9	759.1	778.9	612.8	308.7
120°	812.5	829.9	850.9	864.7	708.1
122.5°	877.4	896.0	919.3	926.2	927.5
125°	943.6	958.8	980.8	989.0	992.4
127.5°	1004.0	1020.3	1037.8	1049.3	1050.4
130°	1060.9	1079.5	1092.2	1105.0	1103.9
132.5°	1119.0	1134.1	1146.8	1157.2	1156.1
135°	1167.8	1186.4	1196.7	1208.4	1206.0
137.5°	1218.7	1232.6	1244.4	1255.9	1252.5
140°	1268.6	1278.0	1290.7	1301.2	1295.4
142.5°	1310.5	1318.7	1333.7	1342.9	1337.1
145°	1354.6	1353.4	1373.1	1381.2	1375.5
147.5°	1392.8	1389.3	1409.1	1414.8	1410.3
150°	1430.0	1421.9	1440.5	1447.4	1441.6
152.5°	1461.3	1452.1	1469.4	1476.5	1468.3
155°	1491.5	1481.1	1495.1	1502.0	1492.7
157.5°	1515.9	1506.6	1517.1	1525.3	1515.9
160°	1536.8	1529.8	1536.8	1543.7	1535.6
162.5°	1555.3	1548.4	1554.2	1562.3	1551.9
165°	1571.6	1564.7	1568.1	1576.3	1568.1
167.5°	1584.4	1577.4	1581.0	1589.1	1578.6
170°	1594.9	1587.8	1590.2	1598.3	1587.8
172.5°	1601.8	1594.9	1597.2	1605.4	1594.9
175°	1607.6	1599.4	1601.8	1609.9	1598.3
177.5°	1609.9	1601.8	1603.0	1611.1	1600.7
180°	1604.1	1604.1	1604.1	1604.1	1604.1

TEST NUMBER: P915101

CATALOG NUMBER: DFN2DIP-SQ4F0-140D060US927-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.80	13.88	13.57	14.67	15.62	12.36	13.44	13.12	14.22	15.18
	3H	14.48	15.45	15.26	16.25	17.23	13.99	14.96	14.77	15.76	16.74
	4H	15.08	16.00	15.88	16.80	17.80	14.59	15.50	15.39	16.31	17.30
	6H	15.50	16.34	16.31	17.15	18.16	15.00	15.84	15.81	16.65	17.66
	8H	15.61	16.41	16.43	17.25	18.26	15.11	15.91	15.93	16.74	17.75
	12H	15.67	16.43	16.49	17.26	18.30	15.16	15.92	15.98	16.75	17.79
4H	2H	13.29	14.20	14.09	15.01	16.00	12.94	13.85	13.74	14.65	15.65
	3H	15.18	15.94	15.99	16.78	17.79	14.77	15.54	15.58	16.37	17.39
	4H	15.91	16.60	16.73	17.44	18.48	15.48	16.18	16.31	17.01	18.05
	6H	16.44	17.04	17.28	17.90	18.94	16.01	16.61	16.85	17.47	18.51
	8H	16.60	17.16	17.44	18.01	19.07	16.16	16.72	17.00	17.58	18.63
	12H	16.68	17.19	17.55	18.06	19.13	16.23	16.74	17.10	17.61	18.68
8H	4H	16.12	16.68	16.97	17.54	18.60	15.74	16.31	16.59	17.16	18.22
	6H	16.77	17.23	17.64	18.13	19.19	16.38	16.85	17.26	17.75	18.80
	8H	16.99	17.40	17.88	18.30	19.37	16.60	17.01	17.48	17.91	18.98
	12H	17.14	17.50	18.02	18.39	19.51	16.73	17.09	17.61	17.97	19.10
12H	4H	16.12	16.62	16.98	17.50	18.56	15.75	16.26	16.61	17.13	18.19
	6H	16.80	17.21	17.68	18.11	19.18	16.43	16.84	17.31	17.73	18.81
	8H	17.05	17.42	17.94	18.30	19.43	16.67	17.04	17.56	17.92	19.05

END OF REPORT