

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P915123

Luminaire Tested: DFN2DIP-SQ4F0-140D110US927-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P915123
REPORT IS A COMBINATION OF REPORTS P901684 AND P898471
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-140D110US927-RLLONL
Description: 4 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 18053.8 lumens
Efficiency: N/A
Efficacy: 79.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 226.6
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P915123

CATALOG NUMBER: DFN2DIP-SQ4F0-140D110US927-RLLONL

Luminous Intensity Polar Plot

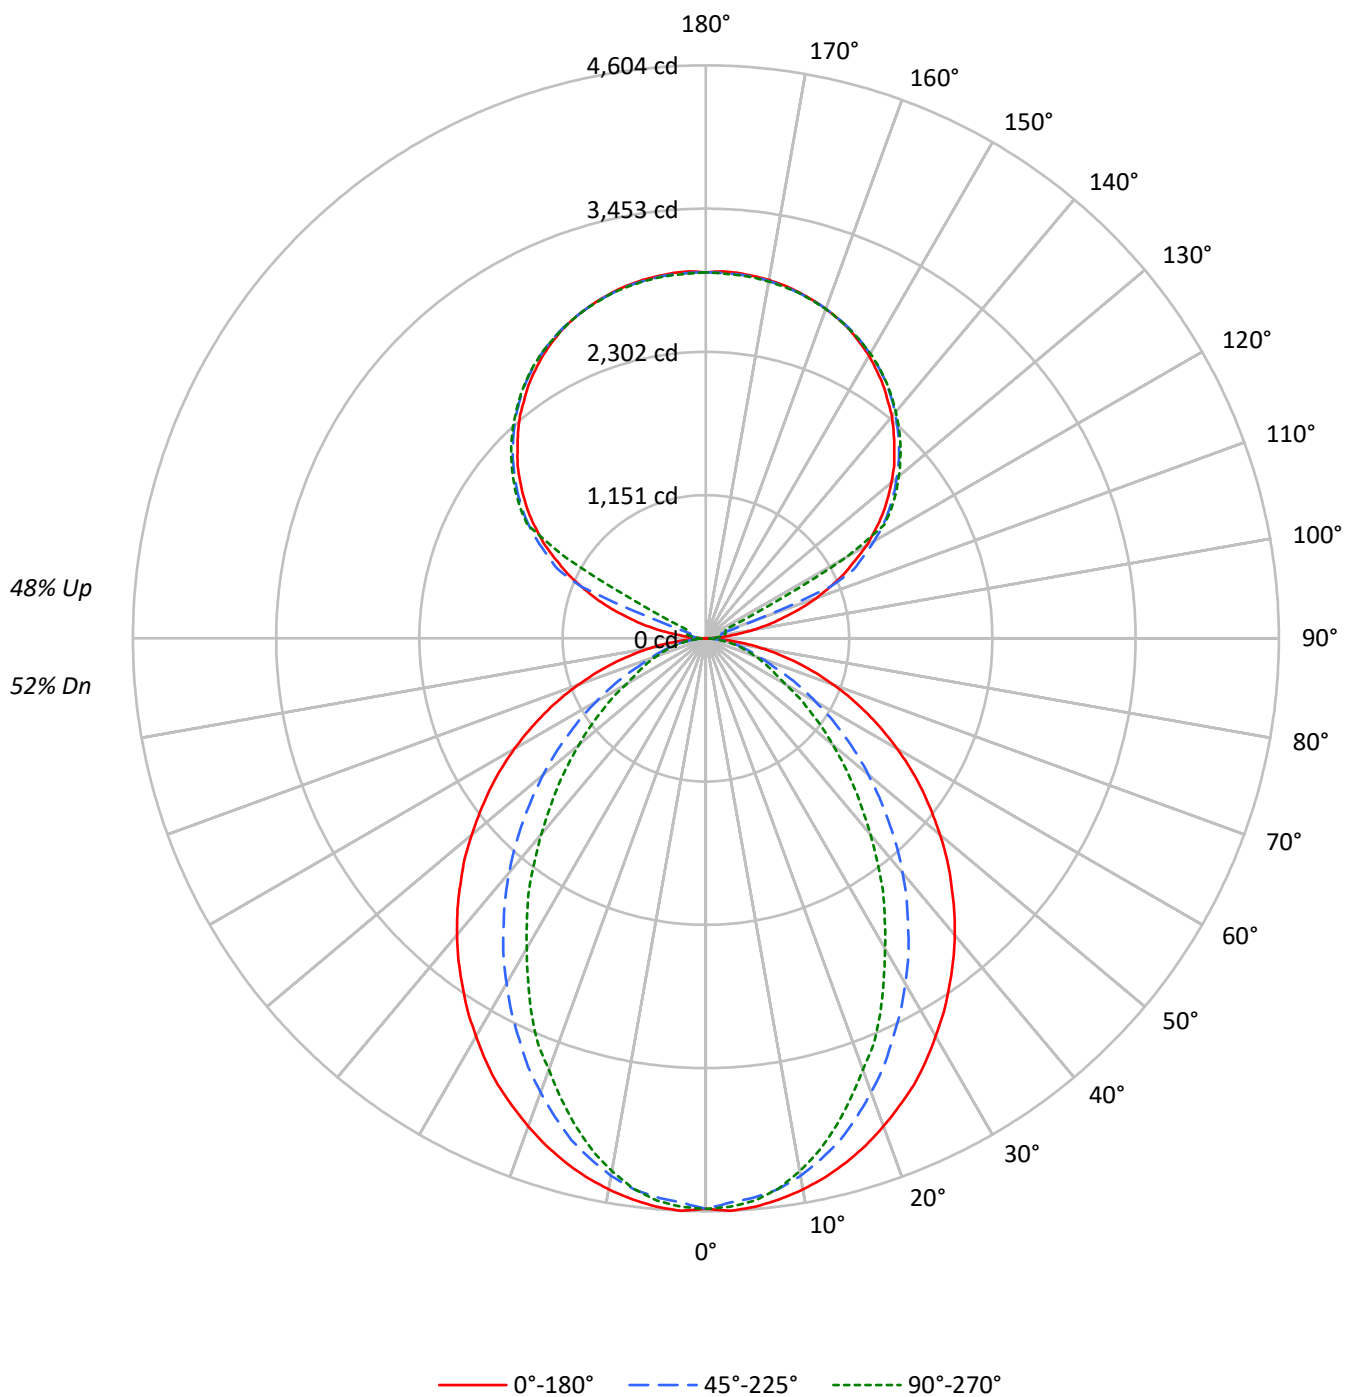

TEST NUMBER: P915123

CATALOG NUMBER: DFN2DIP-SQ4F0-140D110US927-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	100	100	100	100	85	85	85	71	71	71	58	58	58
1	99	95	91	88	91	88	85	82	75	73	71	63	61	60	52	51	50
2	90	83	77	72	83	77	72	68	66	62	59	56	53	51	47	45	43
3	83	74	67	61	76	69	62	57	59	54	50	50	47	44	42	39	37
4	76	65	58	52	70	61	54	49	53	47	43	45	41	38	38	35	32
5	70	59	51	45	65	55	48	42	47	42	38	41	36	33	34	31	29
6	65	53	45	39	60	49	42	37	43	37	33	37	33	29	31	28	25
7	60	48	40	35	55	45	38	33	39	34	29	34	29	26	29	25	23
8	56	44	36	31	52	41	34	29	36	30	26	31	27	23	26	23	21
9	52	40	33	28	48	37	31	26	33	28	24	29	24	21	24	21	19
10	49	37	30	25	45	35	28	24	30	25	22	26	22	19	23	19	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3216	3216	3216
5°	3221	3166	3186
10°	3189	3104	3084
15°	3145	3002	2924
20°	3087	2862	2728
25°	3028	2704	2539
30°	2948	2542	2299
35°	2870	2367	2087
40°	2790	2187	1845
45°	2697	1987	1625
50°	2602	1784	1411
55°	2502	1568	1205
60°	2386	1342	992
65°	2253	1112	894
70°	2092	898	811
75°	1889	793	740
80°	1595	667	645
85°	1111	448	490

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 2697 cd/sqm

TEST NUMBER: P915123

CATALOG NUMBER: DFN2DIP-SQ4F0-140D110US927-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	429.6	2.4
10°-20°	1179.3	6.5
20°-30°	1655.7	9.2
30°-40°	1804.8	10.0
40°-50°	1658.8	9.2
50°-60°	1302.8	7.2
60°-70°	848.0	4.7
70°-80°	436.5	2.4
80°-90°	116.6	0.6
90°-100°	97.0	0.5
100°-110°	361.5	2.0
110°-120°	958.7	5.3
120°-130°	1590.2	8.8
130°-140°	1689.1	9.4
140°-150°	1569.9	8.7
150°-160°	1262.1	7.0
160°-170°	813.3	4.5
170°-180°	279.9	1.6
0°-30°	3264.6	18.1
0°-40°	5069.5	28.1
0°-60°	8031.0	44.5
0°-90°	9432.1	52.2
90°-120°	1417.2	7.8
90°-150°	6266.3	34.7
90°-180°	8622.0	47.8
0°-180°	18053.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4584	4584	4584	4584	4584	
5°	4584	4563	4509	4546	4534	435
15°	4360	4314	4173	4094	4053	1229
25°	3957	3824	3551	3381	3318	1820
35°	3410	3198	2833	2572	2480	2134
45°	2788	2510	2074	1779	1680	2153
55°	2120	1796	1348	1099	1021	1894
65°	1431	1095	722	581	568	1419
75°	763	473	332	303	299	807
85°	178	91	79	79	79	205
90°	2	26	42	53	57	17
95°	138	68	83	94	92	164
105°	647	711	130	153	162	691
115°	1224	1260	1313	328	175	1205
125°	1730	1758	1798	1813	1819	1543
135°	2141	2175	2194	2215	2211	1654
145°	2484	2481	2517	2532	2522	1553
155°	2734	2715	2741	2754	2737	1260
165°	2881	2869	2875	2890	2875	814
175°	2947	2932	2936	2952	2930	280
180°	2941	2941	2941	2941	2941	

TEST NUMBER: P915123

CATALOG NUMBER: DFN2DIP-SQ4F0-140D110US927-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4583.7	4583.7	4583.7	4583.7	4583.7
2.5°	4604.4	4583.7	4537.9	4579.8	4571.4
5°	4583.7	4563.0	4508.9	4546.3	4534.0
7.5°	4546.3	4521.6	4463.5	4479.9	4459.2
10°	4496.6	4467.5	4384.8	4372.0	4347.3
12.5°	4434.5	4397.1	4284.8	4260.2	4214.5
15°	4359.7	4313.9	4173.1	4094.3	4053.0
17.5°	4272.5	4206.1	4031.8	3940.7	3874.2
20°	4173.1	4089.9	3882.6	3779.2	3687.7
22.5°	4065.2	3969.8	3729.0	3588.2	3526.2
25°	3957.4	3824.5	3550.8	3380.9	3318.4
27.5°	3828.9	3687.7	3384.8	3189.9	3094.4
30°	3692.0	3534.1	3202.2	2991.0	2878.7
32.5°	3559.1	3368.1	3028.4	2779.3	2675.4
35°	3409.9	3198.3	2833.4	2572.0	2480.4
37.5°	3264.7	3036.3	2650.7	2364.3	2260.8
40°	3111.1	2862.5	2459.7	2165.3	2057.5
42.5°	2953.6	2688.2	2269.2	1962.0	1858.5
45°	2787.6	2509.5	2074.2	1779.3	1679.9
47.5°	2630.0	2335.7	1887.6	1592.8	1501.7
50°	2455.8	2161.4	1704.9	1418.5	1331.7
52.5°	2285.4	1974.3	1530.7	1257.0	1178.1
55°	2119.6	1796.0	1348.1	1099.4	1020.6
57.5°	1949.6	1617.8	1186.5	954.2	887.7
60°	1775.4	1443.5	1016.2	804.9	738.5
62.5°	1605.5	1273.7	871.0	672.0	639.1
65°	1431.2	1095.0	721.8	580.9	568.2
67.5°	1265.3	929.1	580.9	510.1	497.7
70°	1091.0	767.5	481.0	439.7	422.9
72.5°	925.1	617.9	402.3	369.2	360.9
75°	763.1	472.7	331.8	302.8	298.8
77.5°	601.7	335.8	261.4	244.7	236.3
80°	452.0	240.7	198.9	182.7	182.7
82.5°	315.1	161.9	136.9	128.5	128.5
85°	178.2	91.1	78.7	78.7	78.7
87.5°	66.5	33.0	33.0	29.1	29.1
90°	2.1	25.5	42.5	53.3	57.4
92.5°	53.3	44.8	51.0	55.4	57.4
95°	138.2	68.0	82.9	93.7	91.5
97.5°	248.9	74.5	108.4	114.9	117.0
100°	376.8	85.2	121.3	138.2	142.5
102.5°	517.0	512.9	125.6	148.9	155.4
105°	646.9	710.8	129.9	153.1	161.8
107.5°	798.0	851.0	134.2	157.4	166.0
110°	942.8	987.3	372.5	159.7	168.0

TEST NUMBER: P915123

CATALOG NUMBER: DFN2DIP-SQ4F0-140D110US927-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1079.0	1117.1	1081.0	163.7	170.3
115°	1223.5	1259.6	1313.0	327.7	174.6
117.5°	1349.2	1391.6	1428.0	1123.5	566.0
120°	1489.6	1521.5	1559.9	1585.4	1298.1
122.5°	1608.7	1642.7	1685.4	1698.1	1700.4
125°	1730.0	1757.8	1798.2	1813.1	1819.4
127.5°	1840.6	1870.4	1902.5	1923.7	1925.8
130°	1945.0	1979.1	2002.3	2025.8	2023.9
132.5°	2051.4	2079.2	2102.4	2121.6	2119.6
135°	2140.9	2174.9	2193.9	2215.4	2211.1
137.5°	2234.3	2259.9	2281.3	2302.6	2296.2
140°	2325.8	2343.0	2366.2	2385.4	2374.8
142.5°	2402.6	2417.5	2445.1	2462.0	2451.4
145°	2483.5	2481.2	2517.3	2532.3	2521.7
147.5°	2553.5	2547.2	2583.3	2593.9	2585.6
150°	2621.7	2606.8	2640.9	2653.6	2643.0
152.5°	2679.1	2662.1	2694.0	2706.9	2692.0
155°	2734.5	2715.4	2740.9	2753.6	2736.7
157.5°	2779.1	2762.2	2781.4	2796.3	2779.1
160°	2817.6	2804.6	2817.6	2830.1	2815.3
162.5°	2851.4	2838.8	2849.4	2864.3	2845.1
165°	2881.2	2868.6	2874.9	2889.8	2874.9
167.5°	2904.7	2891.9	2898.4	2913.3	2894.2
170°	2923.9	2911.0	2915.3	2930.3	2911.0
172.5°	2936.5	2923.9	2928.2	2943.1	2923.9
175°	2947.2	2932.3	2936.5	2951.5	2930.3
177.5°	2951.5	2936.5	2938.8	2953.7	2934.6
180°	2940.9	2940.9	2940.9	2940.9	2940.9

TEST NUMBER: P915123

CATALOG NUMBER: DFN2DIP-SQ4F0-140D110US927-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.43	12.27	12.37	13.23	14.47	7.39	8.24	8.33	9.19	10.43
	3H	13.11	13.87	14.07	14.83	16.10	8.58	9.34	9.53	10.30	11.57
	4H	13.72	14.44	14.69	15.41	16.68	9.03	9.75	10.00	10.72	11.99
	6H	14.15	14.81	15.13	15.78	17.07	9.35	10.01	10.33	10.99	12.27
	8H	14.28	14.91	15.26	15.90	17.18	9.44	10.07	10.43	11.06	12.35
	12H	14.34	14.94	15.33	15.92	17.23	9.49	10.08	10.48	11.07	12.38
4H	2H	11.45	12.16	12.42	13.13	14.41	7.99	8.70	8.96	9.67	10.95
	3H	13.28	13.88	14.27	14.88	16.17	9.34	9.94	10.33	10.94	12.22
	4H	13.98	14.52	14.97	15.52	16.83	9.89	10.43	10.88	11.43	12.74
	6H	14.50	14.97	15.50	15.98	17.29	10.31	10.78	11.32	11.79	13.10
	8H	14.68	15.11	15.68	16.12	17.45	10.44	10.88	11.45	11.89	13.21
	12H	14.78	15.17	15.80	16.19	17.52	10.51	10.90	11.53	11.93	13.25
8H	4H	13.95	14.38	14.95	15.39	16.72	10.17	10.61	11.18	11.62	12.94
	6H	14.52	14.88	15.55	15.93	17.25	10.69	11.05	11.72	12.11	13.43
	8H	14.74	15.06	15.78	16.09	17.43	10.89	11.20	11.92	12.24	13.58
	12H	14.88	15.16	15.92	16.19	17.58	11.01	11.29	12.05	12.32	13.70
12H	4H	13.90	14.29	14.93	15.32	16.65	10.18	10.57	11.20	11.60	12.93
	6H	14.49	14.81	15.53	15.85	17.19	10.74	11.06	11.78	12.10	13.44
	8H	14.72	15.00	15.76	16.03	17.41	10.96	11.24	12.00	12.27	13.65

END OF REPORT