

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P915131

Luminaire Tested: DFN2DIP-SQ4F0-140D140US927-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P915131
REPORT IS A COMBINATION OF REPORTS P901720 AND P898471
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-140D140US927-RLLONL
Description: 4 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 20406.6 lumens
Efficiency: N/A
Efficacy: 81.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 249.6
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P915131

CATALOG NUMBER: DFN2DIP-SQ4F0-140D140US927-RLLONL

Luminous Intensity Polar Plot

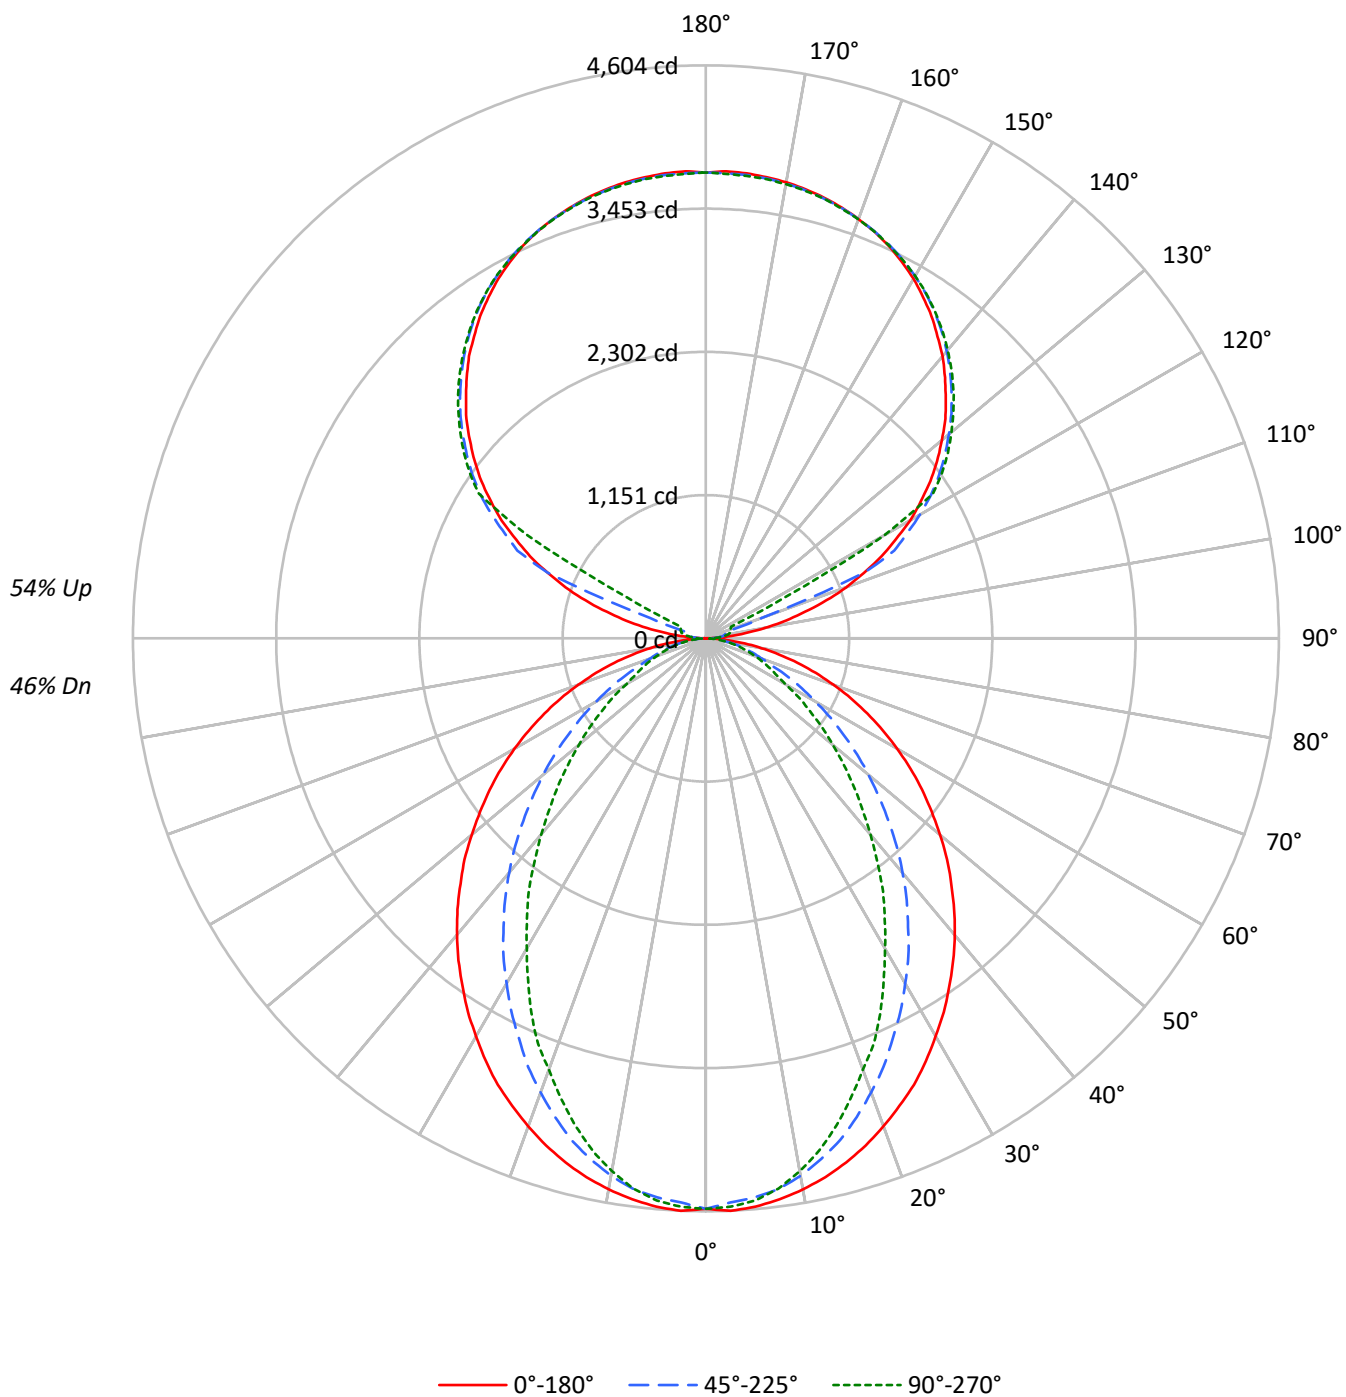

TEST NUMBER: P915131

CATALOG NUMBER: DFN2DIP-SQ4F0-140D140US927-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	98	98	98	98	81	81	81	66	66	66	53	53	53
1	97	93	90	86	89	86	83	80	72	70	68	59	58	56	47	46	45
2	89	82	76	71	82	76	70	66	63	60	57	52	50	48	42	40	39
3	81	72	65	60	75	67	61	56	56	52	48	47	43	41	38	35	34
4	75	64	57	51	68	60	53	48	50	45	41	42	38	35	34	31	29
5	69	58	50	44	63	53	46	41	45	40	36	38	34	31	31	28	26
6	63	52	44	38	58	48	41	36	41	36	32	34	30	27	28	25	23
7	59	47	39	34	54	44	37	32	37	32	28	31	27	24	26	23	21
8	55	43	35	30	50	40	33	28	34	29	25	29	25	22	24	21	19
9	51	39	32	27	47	36	30	25	31	26	22	27	23	20	22	19	17
10	48	36	29	24	44	33	27	23	29	24	20	25	21	18	20	18	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3216	3216	3216
5°	3221	3166	3186
10°	3189	3104	3084
15°	3145	3002	2924
20°	3087	2862	2728
25°	3028	2704	2539
30°	2948	2542	2299
35°	2870	2367	2087
40°	2790	2187	1845
45°	2697	1987	1625
50°	2602	1784	1411
55°	2502	1568	1205
60°	2386	1342	992
65°	2253	1112	894
70°	2092	898	811
75°	1889	793	740
80°	1595	667	645
85°	1111	448	490

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 2697 cd/sqm

TEST NUMBER: P915131

CATALOG NUMBER: DFN2DIP-SQ4F0-140D140US927-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	429.6	2.1
10°-20°	1179.3	5.8
20°-30°	1655.7	8.1
30°-40°	1804.8	8.8
40°-50°	1658.8	8.1
50°-60°	1302.8	6.4
60°-70°	848.0	4.2
70°-80°	436.5	2.1
80°-90°	118.0	0.6
90°-100°	123.4	0.6
100°-110°	460.1	2.3
110°-120°	1220.2	6.0
120°-130°	2023.8	9.9
130°-140°	2149.8	10.5
140°-150°	1998.0	9.8
150°-160°	1606.3	7.9
160°-170°	1035.1	5.1
170°-180°	356.3	1.7
0°-30°	3264.6	16.0
0°-40°	5069.5	24.8
0°-60°	8031.0	39.4
0°-90°	9433.5	46.2
90°-120°	1803.7	8.8
90°-150°	7975.4	39.1
90°-180°	10973.0	53.8
0°-180°	20406.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4584	4584	4584	4584	4584	
5°	4584	4563	4509	4546	4534	435
15°	4360	4314	4173	4094	4053	1229
25°	3957	3824	3551	3381	3318	1820
35°	3410	3198	2833	2572	2480	2134
45°	2788	2510	2074	1779	1680	2153
55°	2120	1796	1348	1099	1021	1894
65°	1431	1095	722	581	568	1419
75°	763	473	332	303	299	807
85°	178	91	79	79	79	205
90°	2	32	54	68	73	19
95°	176	86	106	119	116	208
105°	823	905	165	195	206	880
115°	1557	1603	1671	417	222	1533
125°	2202	2237	2289	2308	2316	1964
135°	2725	2768	2792	2820	2814	2105
145°	3161	3158	3204	3223	3209	1977
155°	3480	3456	3488	3505	3483	1604
165°	3667	3651	3659	3678	3659	1036
175°	3751	3732	3737	3756	3729	357
180°	3743	3743	3743	3743	3743	

TEST NUMBER: P915131

CATALOG NUMBER: DFN2DIP-SQ4F0-140D140US927-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4583.7	4583.7	4583.7	4583.7	4583.7
2.5°	4604.4	4583.7	4537.9	4579.8	4571.4
5°	4583.7	4563.0	4508.9	4546.3	4534.0
7.5°	4546.3	4521.6	4463.5	4479.9	4459.2
10°	4496.6	4467.5	4384.8	4372.0	4347.3
12.5°	4434.5	4397.1	4284.8	4260.2	4214.5
15°	4359.7	4313.9	4173.1	4094.3	4053.0
17.5°	4272.5	4206.1	4031.8	3940.7	3874.2
20°	4173.1	4089.9	3882.6	3779.2	3687.7
22.5°	4065.2	3969.8	3729.0	3588.2	3526.2
25°	3957.4	3824.5	3550.8	3380.9	3318.4
27.5°	3828.9	3687.7	3384.8	3189.9	3094.4
30°	3692.0	3534.1	3202.2	2991.0	2878.7
32.5°	3559.1	3368.1	3028.4	2779.3	2675.4
35°	3409.9	3198.3	2833.4	2572.0	2480.4
37.5°	3264.7	3036.3	2650.7	2364.3	2260.8
40°	3111.1	2862.5	2459.7	2165.3	2057.5
42.5°	2953.6	2688.2	2269.2	1962.0	1858.5
45°	2787.6	2509.5	2074.2	1779.3	1679.9
47.5°	2630.0	2335.7	1887.6	1592.8	1501.7
50°	2455.8	2161.4	1704.9	1418.5	1331.7
52.5°	2285.4	1974.3	1530.7	1257.0	1178.1
55°	2119.6	1796.0	1348.1	1099.4	1020.6
57.5°	1949.6	1617.8	1186.5	954.2	887.7
60°	1775.4	1443.5	1016.2	804.9	738.5
62.5°	1605.5	1273.7	871.0	672.0	639.1
65°	1431.2	1095.0	721.8	580.9	568.2
67.5°	1265.3	929.1	580.9	510.1	497.7
70°	1091.0	767.5	481.0	439.7	422.9
72.5°	925.1	617.9	402.3	369.2	360.9
75°	763.1	472.7	331.8	302.8	298.8
77.5°	601.7	335.8	261.4	244.7	236.3
80°	452.0	240.7	198.9	182.7	182.7
82.5°	315.1	161.9	136.9	128.5	128.5
85°	178.2	91.1	78.7	78.7	78.7
87.5°	66.5	33.0	33.0	29.1	29.1
90°	2.5	32.5	54.0	67.9	73.0
92.5°	67.9	57.0	65.0	70.4	73.0
95°	175.9	86.5	105.5	119.3	116.5
97.5°	316.8	94.9	138.0	146.3	148.9
100°	479.5	108.4	154.4	175.9	181.4
102.5°	658.0	652.8	159.9	189.4	197.8
105°	823.3	904.7	165.3	194.9	205.8
107.5°	1015.7	1083.1	170.8	200.3	211.3
110°	1199.9	1256.6	474.0	203.3	213.9

TEST NUMBER: P915131

CATALOG NUMBER: DFN2DIP-SQ4F0-140D140US927-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1373.2	1421.8	1375.9	208.4	216.7
115°	1557.3	1603.2	1671.1	417.2	222.2
117.5°	1717.1	1771.1	1817.4	1429.9	720.4
120°	1895.9	1936.4	1985.3	2017.8	1652.1
122.5°	2047.4	2090.8	2145.1	2161.2	2164.2
125°	2201.8	2237.1	2288.6	2307.5	2315.6
127.5°	2342.6	2380.6	2421.4	2448.4	2451.0
130°	2475.4	2518.9	2548.4	2578.4	2575.8
132.5°	2610.9	2646.2	2675.8	2700.2	2697.7
135°	2724.7	2768.1	2792.2	2819.5	2814.1
137.5°	2843.7	2876.2	2903.5	2930.5	2922.5
140°	2960.1	2982.0	3011.6	3036.0	3022.5
142.5°	3057.9	3076.8	3111.9	3133.5	3119.9
145°	3160.8	3157.9	3203.9	3222.9	3209.4
147.5°	3249.9	3241.8	3287.9	3301.3	3290.7
150°	3336.7	3317.7	3361.1	3377.2	3363.8
152.5°	3409.7	3388.2	3428.7	3445.1	3426.1
155°	3480.1	3456.0	3488.5	3504.6	3483.1
157.5°	3537.1	3515.5	3540.0	3559.0	3537.1
160°	3586.0	3569.6	3586.0	3602.0	3583.1
162.5°	3629.1	3613.0	3626.5	3645.5	3621.1
165°	3667.0	3650.9	3659.0	3677.9	3659.0
167.5°	3697.0	3680.6	3688.9	3707.9	3683.4
170°	3721.4	3705.0	3710.4	3729.4	3705.0
172.5°	3737.4	3721.4	3726.8	3745.8	3721.4
175°	3751.0	3732.0	3737.4	3756.4	3729.4
177.5°	3756.4	3737.4	3740.4	3759.3	3734.9
180°	3742.9	3742.9	3742.9	3742.9	3742.9

TEST NUMBER: P915131

CATALOG NUMBER: DFN2DIP-SQ4F0-140D140US927-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.86	11.66	11.85	12.66	13.98	6.82	7.62	7.81	8.62	9.95
	3H	12.53	13.25	13.54	14.26	15.61	8.00	8.72	9.01	9.73	11.08
	4H	13.14	13.82	14.16	14.84	16.19	8.45	9.13	9.47	10.14	11.50
	6H	13.57	14.19	14.60	15.21	16.58	8.77	9.40	9.80	10.41	11.78
	8H	13.70	14.29	14.73	15.32	16.69	8.86	9.45	9.90	10.49	11.85
	12H	13.76	14.32	14.80	15.35	16.74	8.91	9.47	9.94	10.50	11.88
4H	2H	10.87	11.55	11.90	12.56	13.92	7.41	8.09	8.44	9.10	10.46
	3H	12.70	13.26	13.73	14.31	15.68	8.76	9.32	9.79	10.36	11.73
	4H	13.40	13.91	14.44	14.95	16.34	9.31	9.82	10.35	10.86	12.25
	6H	13.91	14.35	14.96	15.41	16.80	9.72	10.17	10.78	11.22	12.61
	8H	14.09	14.50	15.14	15.55	16.96	9.85	10.27	10.90	11.32	12.72
	12H	14.19	14.56	15.26	15.62	17.03	9.92	10.29	10.99	11.36	12.76
8H	4H	13.36	13.77	14.41	14.82	16.23	9.59	10.00	10.64	11.05	12.45
	6H	13.93	14.27	15.00	15.36	16.76	10.11	10.45	11.18	11.54	12.94
	8H	14.15	14.45	15.23	15.53	16.95	10.30	10.60	11.38	11.67	13.09
	12H	14.29	14.55	15.38	15.63	17.09	10.42	10.68	11.50	11.75	13.21
12H	4H	13.31	13.68	14.38	14.75	16.16	9.59	9.96	10.66	11.03	12.44
	6H	13.91	14.21	14.99	15.28	16.70	10.16	10.45	11.24	11.53	12.95
	8H	14.13	14.39	15.21	15.46	16.92	10.37	10.63	11.45	11.70	13.16

END OF REPORT