

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P915137

Luminaire Tested: DFN2DIP-SQ4F0-160D060US927-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P915137
REPORT IS A COMBINATION OF REPORTS P901595 AND P898471
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-160D060US927-FLLONL
Description: 4 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 17253.7 lumens
Efficiency: N/A
Efficacy: 81.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 211.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P915137

CATALOG NUMBER: DFN2DIP-SQ4F0-160D060US927-FLLONL

Luminous Intensity Polar Plot

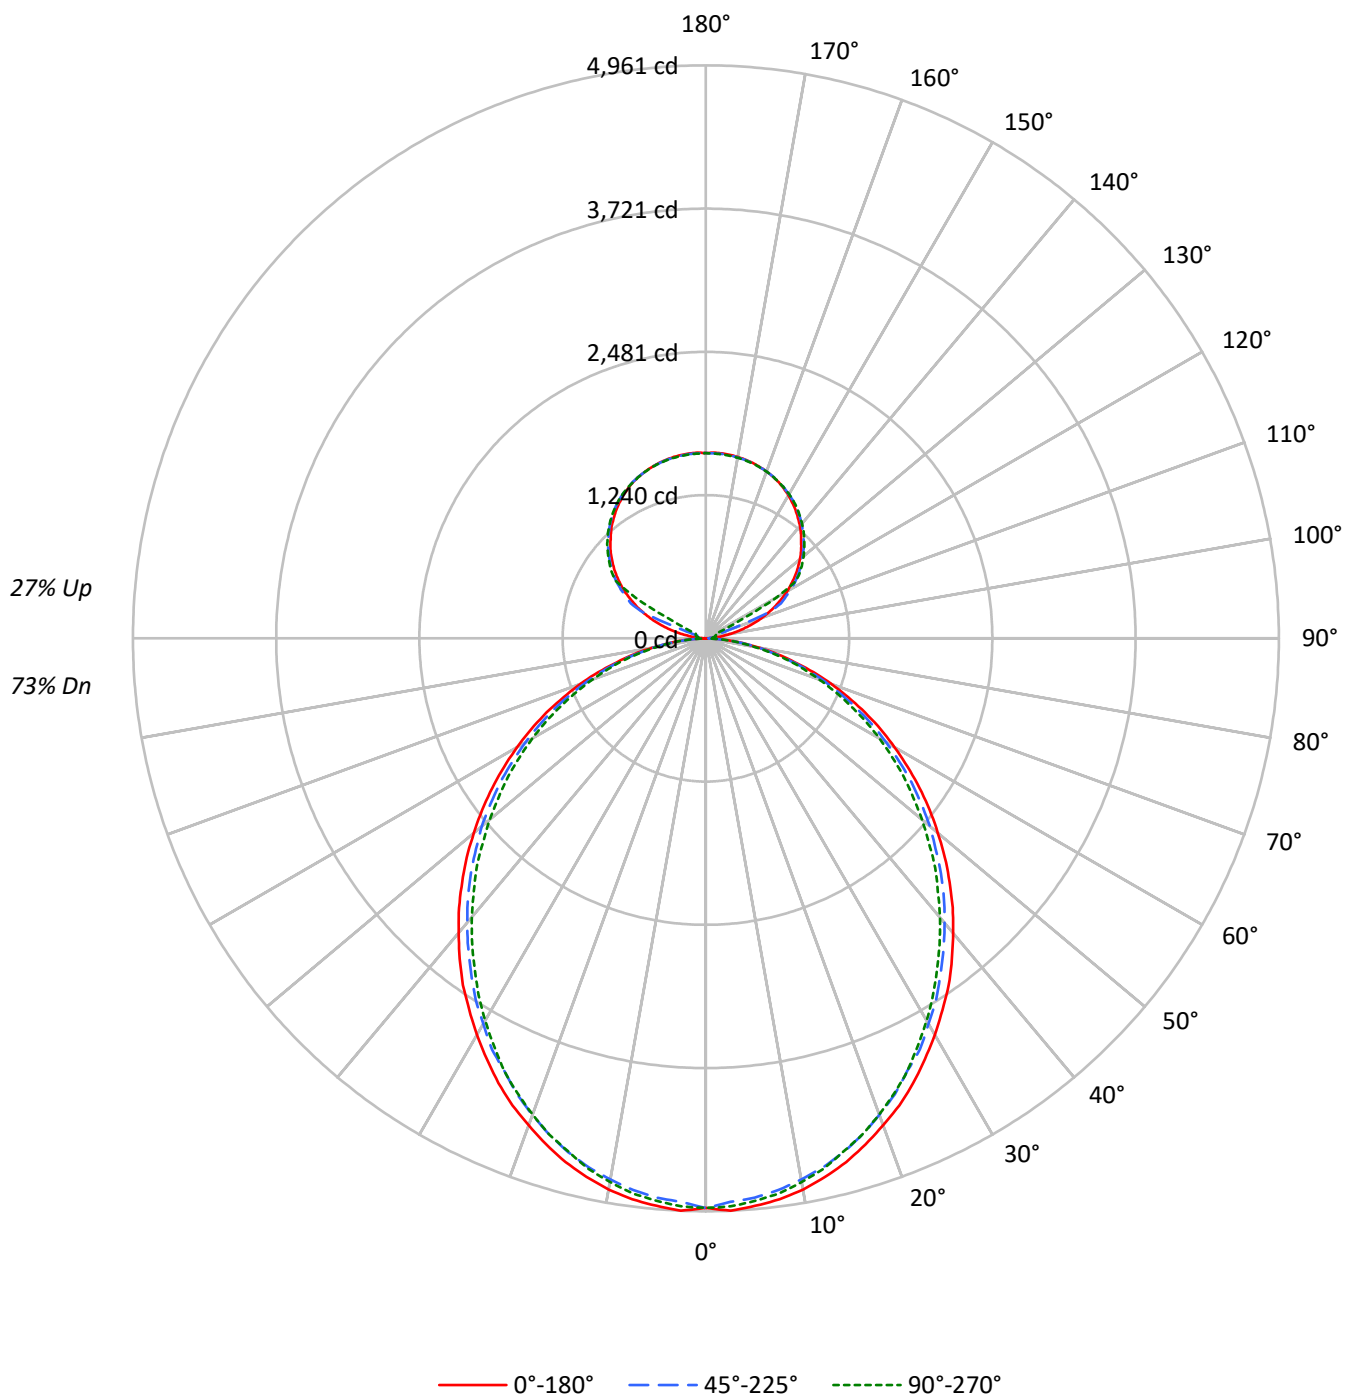

TEST NUMBER: P915137

CATALOG NUMBER: DFN2DIP-SQ4F0-160D060US927-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	113	113	113	113	107	107	107	107	96	96	96	86	86	86	77	77	77
1	103	98	94	91	97	94	90	87	84	82	79	76	74	72	68	67	65
2	94	86	80	74	89	82	76	71	74	69	66	67	63	60	60	57	55
3	86	76	68	62	81	72	65	60	65	60	55	59	55	51	53	50	47
4	78	67	59	53	74	64	57	51	58	52	47	53	48	44	48	44	40
5	72	60	51	45	68	57	50	44	52	46	41	47	42	38	43	39	35
6	67	54	45	39	63	52	44	38	47	41	36	43	37	33	39	35	31
7	62	49	41	35	58	47	39	34	43	36	32	39	34	30	36	31	28
8	57	44	36	31	54	43	35	30	39	33	28	36	30	27	33	28	25
9	53	41	33	28	51	39	32	27	36	30	25	33	28	24	30	26	22
10	50	38	30	25	48	36	29	24	33	27	23	31	25	22	28	24	20

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3461	3461	3461
5°	3466	3413	3436
10°	3438	3368	3391
15°	3387	3313	3319
20°	3319	3237	3246
25°	3251	3145	3160
30°	3166	3060	3052
35°	3085	2960	2937
40°	2986	2858	2828
45°	2887	2757	2717
50°	2778	2650	2587
55°	2665	2527	2469
60°	2536	2380	2333
65°	2397	2229	2172
70°	2218	2044	2000
75°	1972	1824	1843
80°	1674	1542	1540
85°	1210	1055	1035

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2887 cd/sqm

TEST NUMBER: P915137

CATALOG NUMBER: DFN2DIP-SQ4F0-160D060US927-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	464.2	2.7
10°-20°	1306.0	7.6
20°-30°	1919.4	11.1
30°-40°	2229.2	12.9
40°-50°	2226.5	12.9
50°-60°	1941.4	11.3
60°-70°	1435.1	8.3
70°-80°	812.0	4.7
80°-90°	217.1	1.3
90°-100°	52.9	0.3
100°-110°	197.2	1.1
110°-120°	523.0	3.0
120°-130°	867.4	5.0
130°-140°	921.3	5.3
140°-150°	856.3	5.0
150°-160°	688.4	4.0
160°-170°	443.6	2.6
170°-180°	152.7	0.9
0°-30°	3689.6	21.4
0°-40°	5918.9	34.3
0°-60°	10086.7	58.5
0°-90°	12551.0	72.7
90°-120°	773.0	4.5
90°-150°	3418.0	19.8
90°-180°	4703.0	27.3
0°-180°	17253.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4932	4932	4932	4932	4932	
5°	4932	4913	4861	4899	4890	468
15°	4695	4667	4605	4624	4600	1322
25°	4249	4211	4131	4140	4131	1955
35°	3666	3619	3543	3514	3490	2289
45°	2983	2950	2878	2827	2808	2302
55°	2258	2229	2172	2115	2092	2018
65°	1522	1494	1446	1404	1380	1505
75°	796	787	763	735	745	850
85°	194	190	185	171	166	217
90°	1	14	23	29	31	16
95°	75	37	45	51	50	89
105°	353	388	71	84	88	377
115°	667	687	716	179	95	657
125°	944	959	981	989	992	842
135°	1168	1186	1197	1208	1206	902
145°	1355	1353	1373	1381	1376	847
155°	1492	1481	1495	1502	1493	687
165°	1572	1565	1568	1576	1568	444
175°	1608	1599	1602	1610	1598	153
180°	1604	1604	1604	1604	1604	

TEST NUMBER: P915137

CATALOG NUMBER: DFN2DIP-SQ4F0-160D060US927-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4931.9	4931.9	4931.9	4931.9	4931.9
2.5°	4960.6	4936.9	4884.6	4931.9	4922.8
5°	4931.9	4913.3	4860.9	4898.7	4889.6
7.5°	4898.7	4870.5	4818.1	4856.4	4846.8
10°	4846.8	4813.6	4756.8	4794.5	4780.4
12.5°	4775.4	4747.2	4690.3	4714.0	4704.4
15°	4694.9	4666.7	4604.8	4624.0	4600.3
17.5°	4595.3	4567.1	4505.2	4528.8	4505.2
20°	4486.0	4457.9	4391.5	4405.6	4386.9
22.5°	4377.4	4334.7	4272.7	4272.7	4263.2
25°	4249.1	4211.4	4130.8	4139.9	4130.8
27.5°	4106.7	4073.5	4012.1	3998.1	3974.4
30°	3964.8	3926.6	3855.6	3841.5	3822.4
32.5°	3812.8	3784.7	3708.7	3680.0	3660.9
35°	3666.0	3618.7	3542.6	3514.0	3490.4
37.5°	3499.9	3457.2	3381.2	3347.9	3324.3
40°	3329.3	3291.1	3215.1	3172.8	3153.8
42.5°	3163.3	3125.1	3049.6	3001.8	2973.6
45°	2983.2	2949.9	2878.5	2826.7	2807.6
47.5°	2807.6	2774.4	2698.4	2646.0	2617.9
50°	2622.4	2598.8	2532.4	2465.9	2442.3
52.5°	2442.3	2409.1	2347.7	2295.3	2262.2
55°	2257.6	2229.0	2172.1	2115.2	2091.6
57.5°	2072.5	2048.8	1986.9	1930.1	1911.0
60°	1887.3	1868.7	1802.3	1749.9	1735.8
62.5°	1707.2	1674.0	1626.7	1579.4	1560.3
65°	1522.5	1493.8	1446.5	1403.8	1380.1
67.5°	1332.8	1308.7	1266.5	1233.2	1214.1
70°	1157.2	1138.1	1095.3	1062.2	1043.5
72.5°	977.1	958.0	934.4	901.1	887.1
75°	796.5	787.4	763.3	735.1	744.7
77.5°	635.5	616.4	606.8	592.7	578.6
80°	474.4	469.4	459.9	445.8	436.3
82.5°	322.5	322.5	318.0	298.9	298.9
85°	194.2	189.6	185.1	170.6	166.0
87.5°	85.6	76.0	66.4	52.4	47.3
90°	1.1	13.9	23.1	29.1	31.3
92.5°	29.1	24.4	27.8	30.2	31.3
95°	75.4	37.1	45.2	51.2	49.9
97.5°	135.8	40.6	59.1	62.7	63.8
100°	205.5	46.4	66.1	75.4	77.7
102.5°	282.0	279.8	68.5	81.2	84.8
105°	352.8	387.7	70.8	83.5	88.2
107.5°	435.3	464.2	73.2	85.9	90.5
110°	514.3	538.5	203.2	87.1	91.7

TEST NUMBER: P915137

CATALOG NUMBER: DFN2DIP-SQ4F0-160D060US927-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	588.5	609.3	589.6	89.3	92.9
115°	667.4	687.1	716.2	178.8	95.2
117.5°	735.9	759.1	778.9	612.8	308.7
120°	812.5	829.9	850.9	864.7	708.1
122.5°	877.4	896.0	919.3	926.2	927.5
125°	943.6	958.8	980.8	989.0	992.4
127.5°	1004.0	1020.3	1037.8	1049.3	1050.4
130°	1060.9	1079.5	1092.2	1105.0	1103.9
132.5°	1119.0	1134.1	1146.8	1157.2	1156.1
135°	1167.8	1186.4	1196.7	1208.4	1206.0
137.5°	1218.7	1232.6	1244.4	1255.9	1252.5
140°	1268.6	1278.0	1290.7	1301.2	1295.4
142.5°	1310.5	1318.7	1333.7	1342.9	1337.1
145°	1354.6	1353.4	1373.1	1381.2	1375.5
147.5°	1392.8	1389.3	1409.1	1414.8	1410.3
150°	1430.0	1421.9	1440.5	1447.4	1441.6
152.5°	1461.3	1452.1	1469.4	1476.5	1468.3
155°	1491.5	1481.1	1495.1	1502.0	1492.7
157.5°	1515.9	1506.6	1517.1	1525.3	1515.9
160°	1536.8	1529.8	1536.8	1543.7	1535.6
162.5°	1555.3	1548.4	1554.2	1562.3	1551.9
165°	1571.6	1564.7	1568.1	1576.3	1568.1
167.5°	1584.4	1577.4	1581.0	1589.1	1578.6
170°	1594.9	1587.8	1590.2	1598.3	1587.8
172.5°	1601.8	1594.9	1597.2	1605.4	1594.9
175°	1607.6	1599.4	1601.8	1609.9	1598.3
177.5°	1609.9	1601.8	1603.0	1611.1	1600.7
180°	1604.1	1604.1	1604.1	1604.1	1604.1

TEST NUMBER: P915137

CATALOG NUMBER: DFN2DIP-SQ4F0-160D060US927-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.48	14.59	14.21	15.34	16.25	13.03	14.14	13.76	14.90	15.80
	3H	15.16	16.16	15.91	16.92	17.86	14.67	15.67	15.41	16.43	17.37
	4H	15.76	16.70	16.53	17.48	18.42	15.27	16.21	16.03	16.98	17.93
	6H	16.18	17.05	16.95	17.83	18.79	15.68	16.55	16.45	17.33	18.29
	8H	16.29	17.12	17.08	17.92	18.88	15.79	16.62	16.58	17.42	18.38
	12H	16.35	17.14	17.14	17.93	18.93	15.84	16.63	16.63	17.43	18.42
4H	2H	13.97	14.91	14.73	15.68	16.63	13.61	14.55	14.38	15.33	16.28
	3H	15.86	16.65	16.64	17.46	18.42	15.45	16.24	16.23	17.05	18.01
	4H	16.59	17.30	17.38	18.11	19.10	16.16	16.88	16.96	17.69	18.68
	6H	17.12	17.74	17.93	18.57	19.57	16.69	17.31	17.50	18.14	19.14
	8H	17.28	17.86	18.10	18.69	19.70	16.84	17.42	17.66	18.25	19.26
	12H	17.37	17.89	18.20	18.74	19.75	16.92	17.44	17.75	18.29	19.31
8H	4H	16.80	17.38	17.62	18.21	19.22	16.43	17.01	17.24	17.84	18.85
	6H	17.45	17.93	18.30	18.80	19.81	17.07	17.55	17.91	18.42	19.43
	8H	17.68	18.10	18.53	18.97	20.00	17.28	17.71	18.14	18.58	19.61
	12H	17.82	18.20	18.68	19.06	20.14	17.41	17.79	18.27	18.65	19.73
12H	4H	16.80	17.32	17.64	18.17	19.19	16.43	16.96	17.27	17.81	18.82
	6H	17.48	17.91	18.34	18.78	19.81	17.11	17.54	17.97	18.41	19.43
	8H	17.74	18.12	18.60	18.97	20.06	17.36	17.74	18.22	18.59	19.68

END OF REPORT