

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P915139

Luminaire Tested: DFN2DIP-SQ4F0-160D060US927-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P915139
REPORT IS A COMBINATION OF REPORTS P901596 AND P898471
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-160D060US927-RLLONL
Description: 4 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 15479.2 lumens
Efficiency: N/A
Efficacy: 73.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 211.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P915139

CATALOG NUMBER: DFN2DIP-SQ4F0-160D060US927-RLLONL

Luminous Intensity Polar Plot

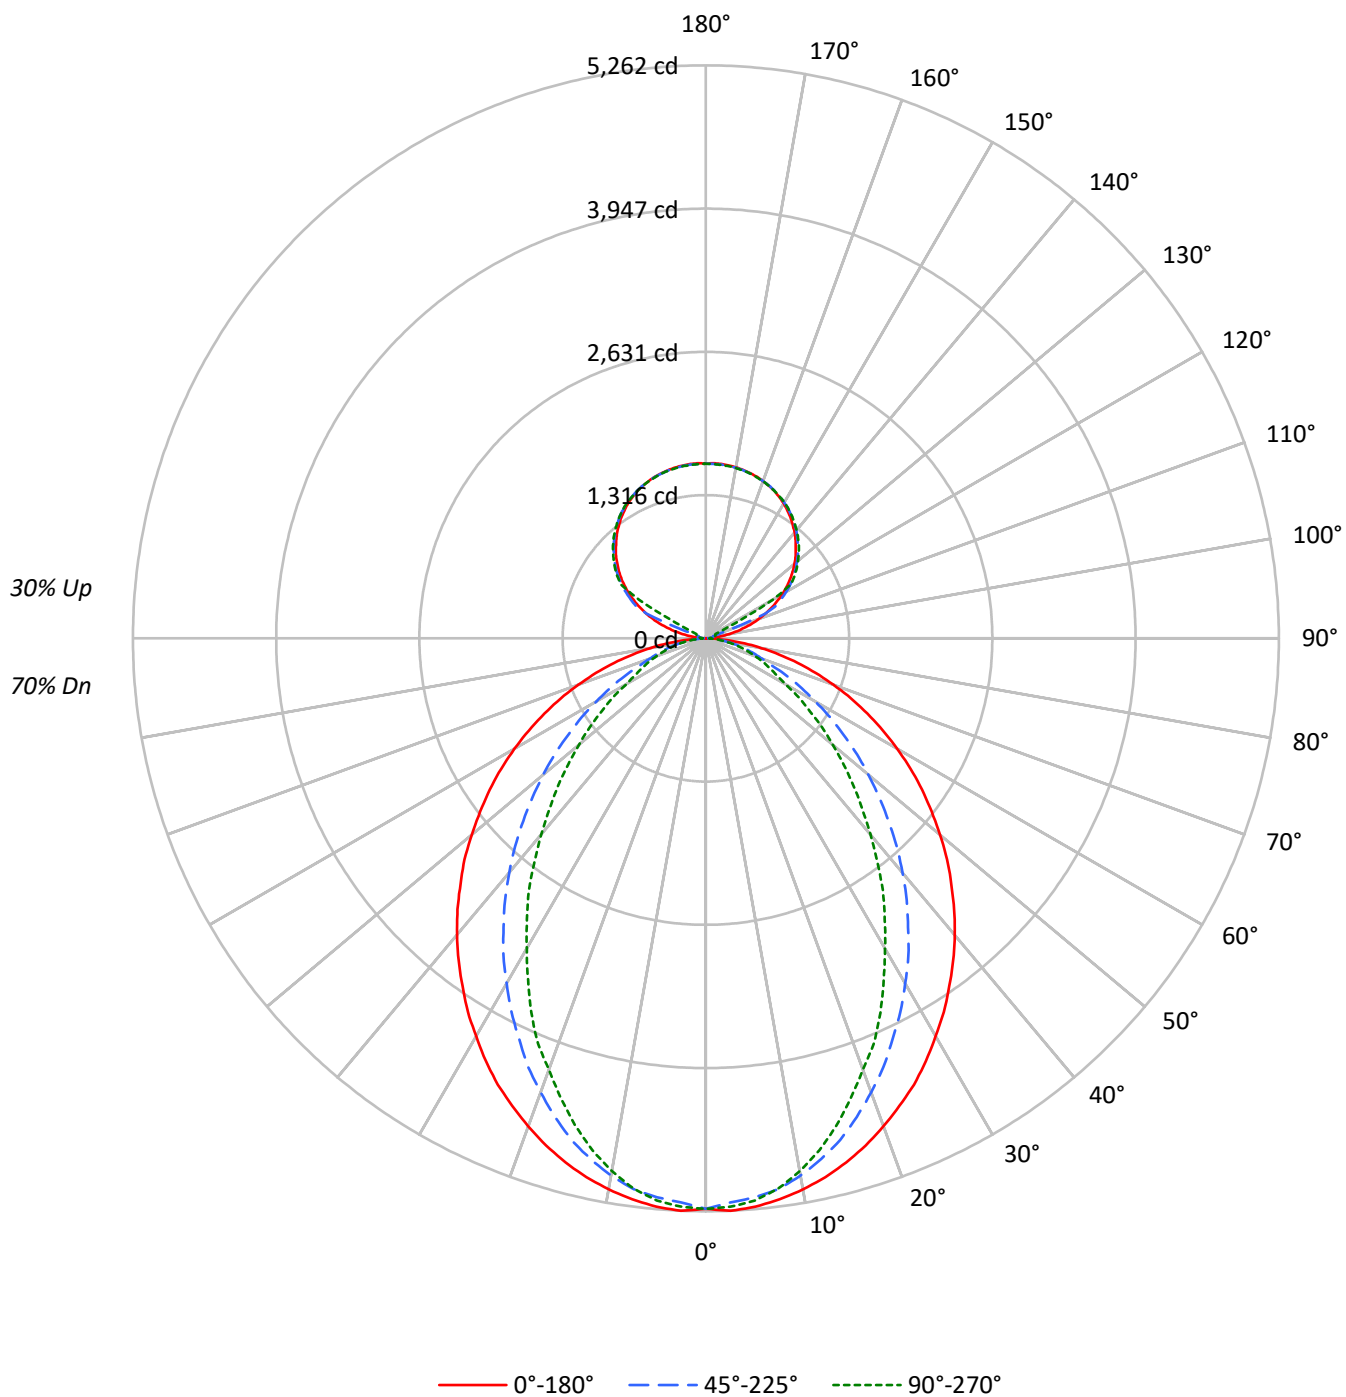

TEST NUMBER: P915139

CATALOG NUMBER: DFN2DIP-SQ4F0-160D060US927-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	112	112	112	112	106	106	106	106	94	94	94	84	84	84	74	74	74
1	103	99	95	92	97	93	90	87	84	81	79	75	73	71	67	65	64
2	94	87	81	76	89	83	77	73	74	70	67	67	63	61	59	57	55
3	86	77	70	64	82	73	67	62	66	61	57	59	55	52	53	50	48
4	79	69	61	55	75	65	58	53	59	54	49	53	49	45	48	45	42
5	73	62	54	48	69	59	52	46	53	47	43	48	44	40	44	40	37
6	68	56	48	42	64	53	46	41	49	42	38	44	39	35	40	36	33
7	63	51	43	37	60	49	41	36	44	38	34	40	35	32	37	32	29
8	59	46	39	33	56	44	37	32	41	35	30	37	32	28	34	30	27
9	55	43	35	30	52	41	34	29	37	32	27	34	29	26	31	27	24
10	51	39	32	27	49	38	31	26	35	29	25	32	27	24	29	25	22

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3676	3676	3676
5°	3682	3618	3642
10°	3645	3548	3524
15°	3595	3431	3342
20°	3528	3270	3118
25°	3460	3090	2902
30°	3369	2905	2627
35°	3280	2705	2386
40°	3188	2499	2109
45°	3083	2270	1858
50°	2973	2039	1612
55°	2859	1792	1377
60°	2727	1534	1134
65°	2575	1271	1022
70°	2390	1026	927
75°	2159	906	845
80°	1823	763	737
85°	1269	513	562

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 3083 cd/sqm

TEST NUMBER: P915139

CATALOG NUMBER: DFN2DIP-SQ4F0-160D060US927-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	491.0	3.2
10°-20°	1347.8	8.7
20°-30°	1892.2	12.2
30°-40°	2062.7	13.3
40°-50°	1895.8	12.2
50°-60°	1488.9	9.6
60°-70°	969.1	6.3
70°-80°	498.8	3.2
80°-90°	130.2	0.8
90°-100°	52.9	0.3
100°-110°	197.2	1.3
110°-120°	523.0	3.4
120°-130°	867.4	5.6
130°-140°	921.3	6.0
140°-150°	856.3	5.5
150°-160°	688.4	4.4
160°-170°	443.6	2.9
170°-180°	152.7	1.0
0°-30°	3731.0	24.1
0°-40°	5793.7	37.4
0°-60°	9178.3	59.3
0°-90°	10776.5	69.6
90°-120°	773.0	5.0
90°-150°	3418.0	22.1
90°-180°	4703.0	30.4
0°-180°	15479.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	5238	5238	5238	5238	5238	
5°	5238	5215	5153	5196	5182	497
15°	4982	4930	4769	4679	4632	1404
25°	4523	4371	4058	3864	3792	2080
35°	3897	3655	3238	2939	2835	2439
45°	3186	2868	2370	2034	1920	2460
55°	2422	2053	1541	1256	1166	2165
65°	1636	1251	825	664	649	1622
75°	872	540	379	346	342	922
85°	204	104	90	90	90	234
90°	1	14	23	29	31	15
95°	75	37	45	51	50	89
105°	353	388	71	84	88	377
115°	667	687	716	179	95	657
125°	944	959	981	989	992	842
135°	1168	1186	1197	1208	1206	902
145°	1355	1353	1373	1381	1376	847
155°	1492	1481	1495	1502	1493	687
165°	1572	1565	1568	1576	1568	444
175°	1608	1599	1602	1610	1598	153
180°	1604	1604	1604	1604	1604	

TEST NUMBER: P915139

CATALOG NUMBER: DFN2DIP-SQ4F0-160D060US927-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	5238.5	5238.5	5238.5	5238.5	5238.5
2.5°	5262.1	5238.5	5186.2	5234.0	5224.4
5°	5238.5	5214.8	5153.0	5195.8	5181.7
7.5°	5195.8	5167.6	5101.2	5119.8	5096.2
10°	5139.0	5105.8	5011.2	4996.6	4968.4
12.5°	5068.0	5025.3	4897.0	4868.8	4816.5
15°	4982.5	4930.2	4769.2	4679.2	4631.9
17.5°	4882.9	4807.0	4607.8	4503.6	4427.7
20°	4769.2	4674.2	4437.2	4319.1	4214.5
22.5°	4646.0	4536.8	4261.7	4100.8	4029.8
25°	4522.8	4370.9	4058.0	3863.9	3792.5
27.5°	4375.9	4214.5	3868.4	3645.6	3536.5
30°	4219.5	4038.9	3659.6	3418.3	3290.0
32.5°	4067.6	3849.3	3461.0	3176.3	3057.6
35°	3897.1	3655.1	3238.2	2939.4	2834.8
37.5°	3731.1	3470.1	3029.5	2702.0	2583.8
40°	3555.5	3271.4	2811.1	2474.6	2351.4
42.5°	3375.5	3072.2	2593.4	2242.3	2124.1
45°	3185.8	2868.0	2370.5	2033.5	1919.9
47.5°	3005.8	2669.3	2157.3	1820.3	1716.2
50°	2806.6	2470.1	1948.5	1621.1	1522.0
52.5°	2612.0	2256.4	1749.4	1436.5	1346.5
55°	2422.3	2052.6	1540.6	1256.4	1166.4
57.5°	2228.2	1849.0	1356.1	1090.4	1014.5
60°	2029.0	1649.8	1161.3	920.0	844.0
62.5°	1834.8	1455.6	995.4	768.0	730.3
65°	1635.7	1251.4	824.9	663.9	649.4
67.5°	1446.0	1061.8	663.9	583.0	568.9
70°	1246.9	877.2	549.8	502.5	483.4
72.5°	1057.2	706.2	459.7	422.0	412.4
75°	872.2	540.2	379.2	346.0	341.5
77.5°	687.5	383.7	298.7	279.6	270.1
80°	516.6	275.1	227.4	208.7	208.7
82.5°	360.1	185.1	156.5	146.9	146.9
85°	203.7	104.1	90.1	90.1	90.1
87.5°	76.0	37.7	37.7	33.2	33.2
90°	1.1	13.9	23.1	29.1	31.3
92.5°	29.1	24.4	27.8	30.2	31.3
95°	75.4	37.1	45.2	51.2	49.9
97.5°	135.8	40.6	59.1	62.7	63.8
100°	205.5	46.4	66.1	75.4	77.7
102.5°	282.0	279.8	68.5	81.2	84.8
105°	352.8	387.7	70.8	83.5	88.2
107.5°	435.3	464.2	73.2	85.9	90.5
110°	514.3	538.5	203.2	87.1	91.7

TEST NUMBER: P915139

CATALOG NUMBER: DFN2DIP-SQ4F0-160D060US927-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	588.5	609.3	589.6	89.3	92.9
115°	667.4	687.1	716.2	178.8	95.2
117.5°	735.9	759.1	778.9	612.8	308.7
120°	812.5	829.9	850.9	864.7	708.1
122.5°	877.4	896.0	919.3	926.2	927.5
125°	943.6	958.8	980.8	989.0	992.4
127.5°	1004.0	1020.3	1037.8	1049.3	1050.4
130°	1060.9	1079.5	1092.2	1105.0	1103.9
132.5°	1119.0	1134.1	1146.8	1157.2	1156.1
135°	1167.8	1186.4	1196.7	1208.4	1206.0
137.5°	1218.7	1232.6	1244.4	1255.9	1252.5
140°	1268.6	1278.0	1290.7	1301.2	1295.4
142.5°	1310.5	1318.7	1333.7	1342.9	1337.1
145°	1354.6	1353.4	1373.1	1381.2	1375.5
147.5°	1392.8	1389.3	1409.1	1414.8	1410.3
150°	1430.0	1421.9	1440.5	1447.4	1441.6
152.5°	1461.3	1452.1	1469.4	1476.5	1468.3
155°	1491.5	1481.1	1495.1	1502.0	1492.7
157.5°	1515.9	1506.6	1517.1	1525.3	1515.9
160°	1536.8	1529.8	1536.8	1543.7	1535.6
162.5°	1555.3	1548.4	1554.2	1562.3	1551.9
165°	1571.6	1564.7	1568.1	1576.3	1568.1
167.5°	1584.4	1577.4	1581.0	1589.1	1578.6
170°	1594.9	1587.8	1590.2	1598.3	1587.8
172.5°	1601.8	1594.9	1597.2	1605.4	1594.9
175°	1607.6	1599.4	1601.8	1609.9	1598.3
177.5°	1609.9	1601.8	1603.0	1611.1	1600.7
180°	1604.1	1604.1	1604.1	1604.1	1604.1

TEST NUMBER: P915139

CATALOG NUMBER: DFN2DIP-SQ4F0-160D060US927-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.35	14.37	14.12	15.16	16.12	9.31	10.33	10.08	11.12	12.08
	3H	15.04	15.96	15.83	16.76	17.75	10.51	11.42	11.30	12.23	13.22
	4H	15.66	16.52	16.47	17.33	18.34	10.97	11.83	11.78	12.64	13.65
	6H	16.10	16.89	16.92	17.71	18.73	11.30	12.09	12.12	12.91	13.93
	8H	16.23	16.99	17.06	17.82	18.84	11.40	12.15	12.23	12.99	14.01
	12H	16.30	17.02	17.13	17.85	18.89	11.45	12.17	12.28	13.00	14.04
4H	2H	13.39	14.25	14.20	15.06	16.06	9.93	10.79	10.74	11.60	12.60
	3H	15.24	15.95	16.06	16.80	17.82	11.30	12.01	12.12	12.85	13.88
	4H	15.94	16.59	16.78	17.43	18.48	11.85	12.50	12.69	13.34	14.39
	6H	16.47	17.03	17.32	17.90	18.95	12.28	12.84	13.13	13.71	14.76
	8H	16.65	17.17	17.51	18.04	19.10	12.41	12.94	13.27	13.80	14.87
	12H	16.76	17.23	17.63	18.11	19.18	12.49	12.96	13.36	13.84	14.91
8H	4H	15.92	16.45	16.78	17.31	18.37	12.15	12.67	13.00	13.53	14.60
	6H	16.50	16.93	17.38	17.84	18.90	12.67	13.11	13.56	14.01	15.08
	8H	16.72	17.10	17.61	18.00	19.09	12.87	13.25	13.76	14.15	15.23
	12H	16.87	17.21	17.77	18.10	19.24	13.00	13.33	13.89	14.22	15.36
12H	4H	15.88	16.35	16.76	17.24	18.31	12.16	12.63	13.04	13.51	14.59
	6H	16.48	16.86	17.37	17.76	18.84	12.73	13.11	13.62	14.01	15.09
	8H	16.71	17.05	17.60	17.94	19.07	12.95	13.28	13.84	14.17	15.31

END OF REPORT