

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P917595

Luminaire Tested: DFN2DIP-SQ4F0-060D100US930-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P917595
REPORT IS A COMBINATION OF REPORTS P901652 AND P898471
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-060D100US930-RLLONL
Description: 4 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 12229.4 lumens
Efficiency: N/A
Efficacy: 98.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 124.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.946
Total Harmonic Distortion (THDi): 0.132
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P917595

CATALOG NUMBER: DFN2DIP-SQ4F0-060D100US930-RLLONL

Luminous Intensity Polar Plot

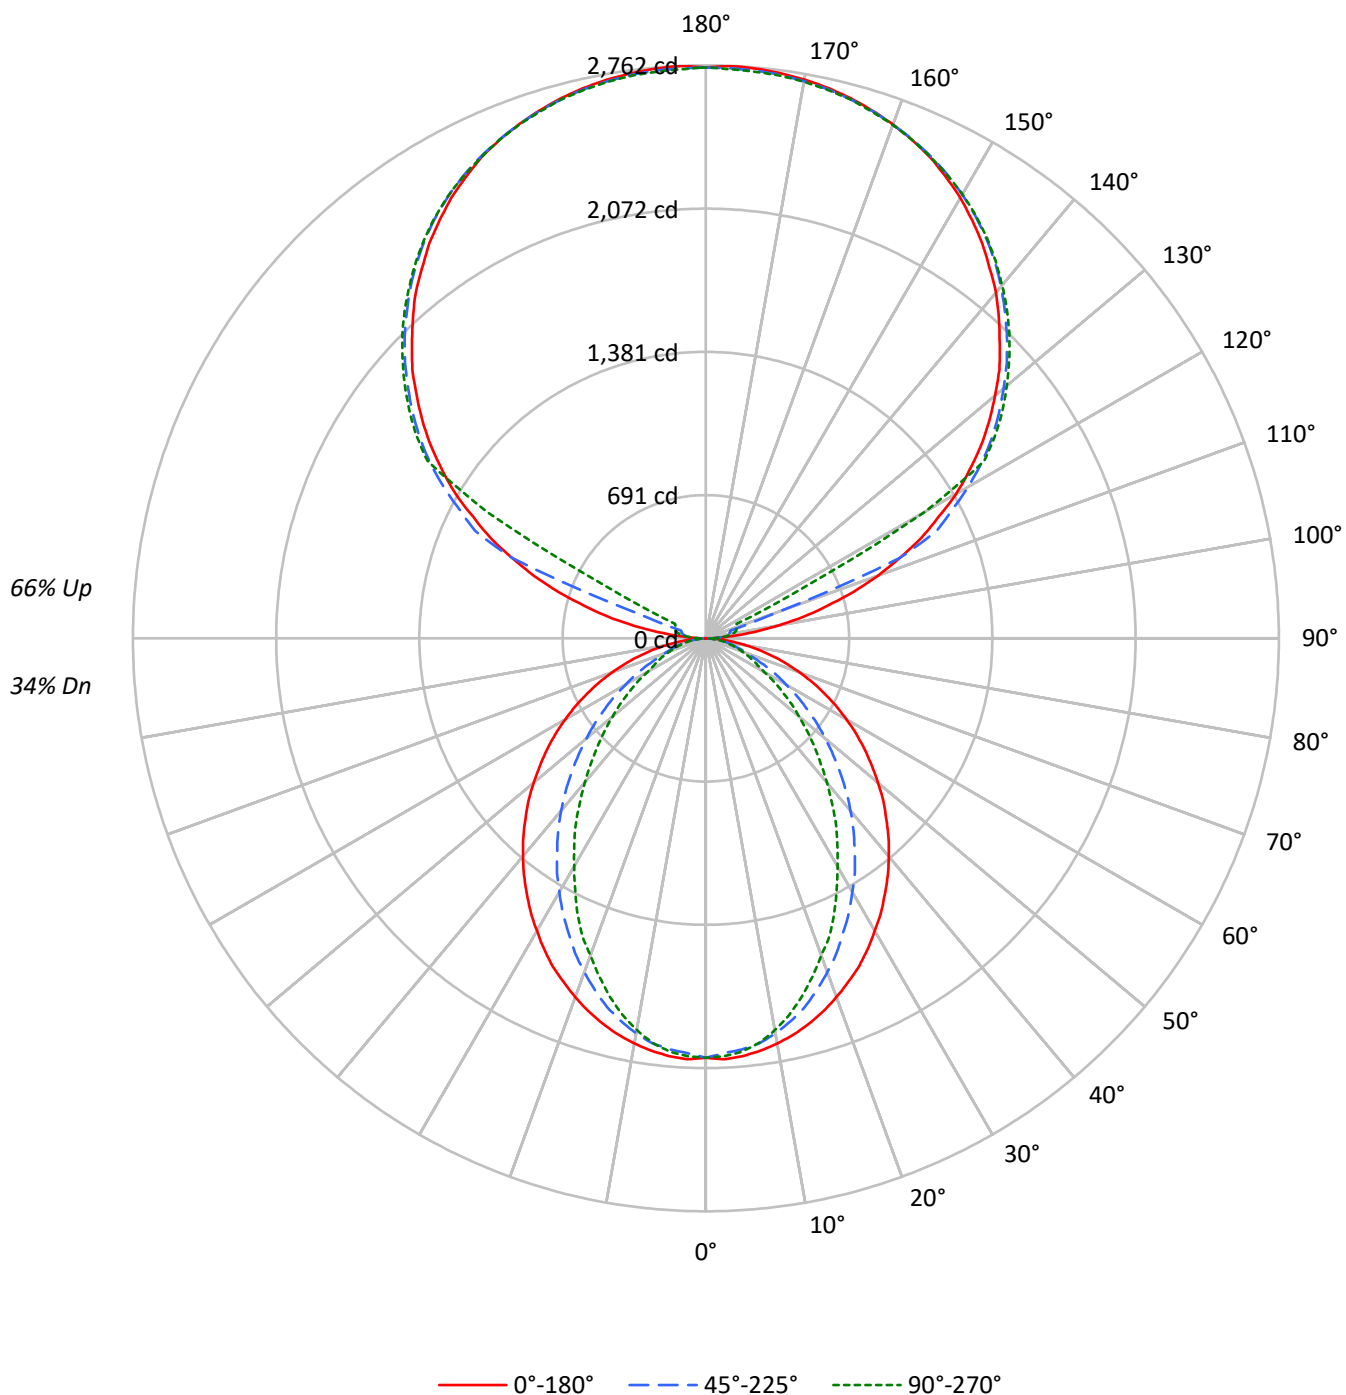

TEST NUMBER: P917595

CATALOG NUMBER: DFN2DIP-SQ4F0-060D100US930-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	103	103	103	103	93	93	93	93	74	74	74	57	57	57	41	41	41
1	95	90	87	83	85	82	79	76	66	64	62	51	49	48	37	36	36
2	86	79	74	69	78	72	67	63	58	54	52	45	43	41	33	32	30
3	79	70	63	58	71	63	58	53	51	47	44	40	37	35	30	28	26
4	72	62	55	49	65	56	50	45	46	41	37	36	33	30	27	25	23
5	66	55	48	42	60	50	44	39	41	36	32	32	29	26	24	22	20
6	61	50	42	36	55	45	39	34	37	32	28	29	26	23	22	20	18
7	57	45	37	32	51	41	34	30	34	29	25	27	23	20	20	18	16
8	52	41	33	28	47	37	31	26	31	26	22	24	21	18	19	16	14
9	49	37	30	25	44	34	28	23	28	23	20	22	19	16	17	15	13
10	46	34	27	22	41	31	25	21	26	21	18	21	17	15	16	14	12

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1419	1419	1419
5°	1421	1396	1405
10°	1407	1369	1360
15°	1387	1324	1290
20°	1362	1262	1203
25°	1336	1192	1120
30°	1300	1121	1014
35°	1266	1044	921
40°	1231	965	814
45°	1190	876	717
50°	1148	787	622
55°	1103	692	531
60°	1052	592	438
65°	994	491	394
70°	923	396	358
75°	833	350	326
80°	703	294	284
85°	490	198	216

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1473 cd/sqm

TEST NUMBER: P917595

CATALOG NUMBER: DFN2DIP-SQ4F0-060D100US930-RLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	189.5	1.5
10°-20°	520.2	4.3
20°-30°	730.3	6.0
30°-40°	796.1	6.5
40°-50°	731.7	6.0
50°-60°	574.6	4.7
60°-70°	374.0	3.1
70°-80°	192.5	1.6
80°-90°	54.0	0.4
90°-100°	90.7	0.7
100°-110°	338.2	2.8
110°-120°	897.0	7.3
120°-130°	1487.8	12.2
130°-140°	1580.4	12.9
140°-150°	1468.8	12.0
150°-160°	1180.9	9.7
160°-170°	760.9	6.2
170°-180°	261.9	2.1
0°-30°	1439.9	11.8
0°-40°	2236.0	18.3
0°-60°	3542.3	29.0
0°-90°	4162.8	34.0
90°-120°	1326.0	10.8
90°-150°	5862.9	47.9
90°-180°	8067.0	66.0
0°-180°	12229.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2022	2022	2022	2022	2022	
5°	2022	2013	1989	2005	2000	192
15°	1923	1903	1841	1806	1788	542
25°	1746	1687	1566	1491	1464	803
35°	1504	1411	1250	1134	1094	941
45°	1230	1107	915	785	741	950
55°	935	792	595	485	450	835
65°	631	483	318	256	251	626
75°	337	208	146	134	132	356
85°	79	40	35	35	35	90
90°	2	24	40	50	54	11
95°	129	64	78	88	86	153
105°	605	665	122	143	151	647
115°	1145	1179	1228	307	163	1127
125°	1619	1645	1682	1696	1702	1444
135°	2003	2035	2053	2073	2069	1547
145°	2324	2322	2355	2369	2359	1453
155°	2558	2541	2564	2576	2560	1179
165°	2696	2684	2690	2704	2690	762
175°	2757	2744	2748	2762	2742	262
180°	2752	2752	2752	2752	2752	

TEST NUMBER: P917595

CATALOG NUMBER: DFN2DIP-SQ4F0-060D100US930-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2021.8	2021.8	2021.8	2021.8	2021.8
2.5°	2030.9	2021.8	2001.6	2020.0	2016.3
5°	2021.8	2012.6	1988.8	2005.3	1999.8
7.5°	2005.3	1994.4	1968.8	1976.0	1966.8
10°	1983.3	1970.5	1934.1	1928.4	1917.5
12.5°	1956.0	1939.4	1889.9	1879.1	1858.9
15°	1923.0	1902.7	1840.6	1805.9	1787.6
17.5°	1884.6	1855.2	1778.3	1738.1	1708.9
20°	1840.6	1803.9	1712.5	1666.9	1626.5
22.5°	1793.1	1750.9	1644.8	1582.7	1555.3
25°	1745.6	1686.9	1566.2	1491.3	1463.7
27.5°	1688.9	1626.5	1493.0	1407.0	1364.9
30°	1628.5	1558.8	1412.4	1319.2	1269.7
32.5°	1569.9	1485.6	1335.8	1225.9	1180.1
35°	1504.1	1410.7	1249.8	1134.4	1094.0
37.5°	1440.0	1339.2	1169.2	1042.8	997.2
40°	1372.2	1262.6	1084.9	955.0	907.5
42.5°	1302.8	1185.7	1000.9	865.4	819.8
45°	1229.6	1106.8	914.9	784.8	740.9
47.5°	1160.1	1030.2	832.6	702.5	662.3
50°	1083.2	953.3	752.0	625.7	587.4
52.5°	1008.0	870.8	675.1	554.4	519.7
55°	934.9	792.2	594.6	484.9	450.1
57.5°	860.0	713.5	523.3	420.9	391.5
60°	783.1	636.7	448.3	355.1	325.7
62.5°	708.2	561.8	384.2	296.4	281.8
65°	631.3	483.0	318.4	256.2	250.6
67.5°	558.1	409.8	256.2	225.0	219.6
70°	481.2	338.5	212.1	194.0	186.5
72.5°	408.1	272.6	177.4	162.9	159.1
75°	336.6	208.5	146.3	133.5	131.8
77.5°	265.4	148.1	115.3	107.9	104.3
80°	199.3	106.2	87.7	80.6	80.6
82.5°	139.0	71.4	60.3	56.7	56.7
85°	78.6	40.2	34.7	34.7	34.7
87.5°	29.4	14.6	14.6	12.8	12.8
90°	1.9	23.9	39.7	49.9	53.6
92.5°	49.9	41.8	47.8	51.8	53.6
95°	129.3	63.6	77.5	87.7	85.6
97.5°	232.8	69.7	101.4	107.5	109.5
100°	352.5	79.7	113.5	129.3	133.4
102.5°	483.7	480.0	117.5	139.3	145.4
105°	605.3	665.0	121.6	143.2	151.3
107.5°	746.7	796.3	125.6	147.3	155.3
110°	882.1	923.7	348.5	149.4	157.2

TEST NUMBER: P917595

CATALOG NUMBER: DFN2DIP-SQ4F0-060D100US930-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1009.5	1045.2	1011.5	153.2	159.4
115°	1144.8	1178.6	1228.5	306.6	163.4
117.5°	1262.2	1302.0	1336.0	1051.2	529.6
120°	1393.8	1423.5	1459.5	1483.4	1214.5
122.5°	1505.1	1537.0	1576.9	1588.8	1590.9
125°	1618.6	1644.6	1682.4	1696.4	1702.3
127.5°	1722.2	1750.0	1780.0	1799.9	1801.8
130°	1819.7	1851.7	1873.5	1895.4	1893.5
132.5°	1919.3	1945.3	1967.1	1985.0	1983.1
135°	2003.0	2034.9	2052.7	2072.7	2068.7
137.5°	2090.5	2114.4	2134.5	2154.3	2148.4
140°	2176.0	2192.2	2213.9	2231.9	2221.9
142.5°	2247.9	2261.9	2287.6	2303.5	2293.6
145°	2323.6	2321.5	2355.3	2369.3	2359.3
147.5°	2389.1	2383.2	2417.0	2426.9	2419.2
150°	2452.9	2439.0	2470.9	2482.7	2472.8
152.5°	2506.6	2490.7	2520.6	2532.6	2518.6
155°	2558.4	2540.6	2564.5	2576.3	2560.5
157.5°	2600.2	2584.4	2602.4	2616.3	2600.2
160°	2636.2	2624.1	2636.2	2648.0	2634.1
162.5°	2667.8	2656.0	2665.9	2679.9	2661.9
165°	2695.7	2683.9	2689.8	2703.8	2689.8
167.5°	2717.7	2705.6	2711.8	2725.8	2707.8
170°	2735.7	2723.7	2727.7	2741.6	2723.7
172.5°	2747.5	2735.7	2739.7	2753.7	2735.7
175°	2757.4	2743.5	2747.5	2761.5	2741.6
177.5°	2761.5	2747.5	2749.7	2763.6	2745.6
180°	2751.6	2751.6	2751.6	2751.6	2751.6

TEST NUMBER: P917595

CATALOG NUMBER: DFN2DIP-SQ4F0-060D100US930-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	6.67	7.38	7.76	8.47	9.95	2.63	3.35	3.72	4.43	5.91
	3H	8.34	8.98	9.44	10.07	11.58	3.81	4.45	4.91	5.54	7.04
	4H	8.95	9.55	10.06	10.65	12.16	4.26	4.86	5.36	5.96	7.46
	6H	9.37	9.93	10.48	11.02	12.54	4.57	5.13	5.69	6.23	7.75
	8H	9.49	10.02	10.61	11.14	12.65	4.66	5.19	5.78	6.30	7.81
	12H	9.55	10.06	10.68	11.16	12.70	4.70	5.20	5.82	6.31	7.84
4H	2H	6.67	7.28	7.79	8.37	9.88	3.21	3.82	4.33	4.91	6.42
	3H	8.50	9.00	9.62	10.12	11.64	4.55	5.06	5.68	6.18	7.70
	4H	9.19	9.65	10.31	10.76	12.30	5.10	5.56	6.22	6.67	8.21
	6H	9.70	10.10	10.83	11.23	12.76	5.51	5.91	6.64	7.04	8.57
	8H	9.88	10.25	11.01	11.37	12.92	5.64	6.01	6.77	7.13	8.68
	12H	9.97	10.30	11.12	11.44	12.99	5.70	6.03	6.85	7.17	8.73
8H	4H	9.15	9.52	10.28	10.64	12.19	5.37	5.74	6.50	6.87	8.42
	6H	9.71	10.02	10.87	11.19	12.73	5.89	6.19	7.04	7.36	8.91
	8H	9.93	10.20	11.09	11.35	12.91	6.08	6.35	7.24	7.49	9.06
	12H	10.07	10.30	11.23	11.45	13.05	6.19	6.43	7.36	7.57	9.17
12H	4H	9.09	9.43	10.24	10.57	12.12	5.37	5.71	6.52	6.84	8.40
	6H	9.69	9.96	10.85	11.10	12.67	5.94	6.20	7.10	7.35	8.92
	8H	9.91	10.14	11.07	11.28	12.89	6.15	6.38	7.31	7.52	9.12

END OF REPORT