

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P917695

Luminaire Tested: DFN2DIP-SQ4F0-090D080US930-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P917695
REPORT IS A COMBINATION OF REPORTS P901622 AND P898471
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-090D080US930-RLLONL
Description: 4 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 12694.2 lumens
Efficiency: N/A
Efficacy: 89.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 142.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.983
Total Harmonic Distortion (THDi): 0.073
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P917695

CATALOG NUMBER: DFN2DIP-SQ4F0-090D080US930-RLLONL

Luminous Intensity Polar Plot

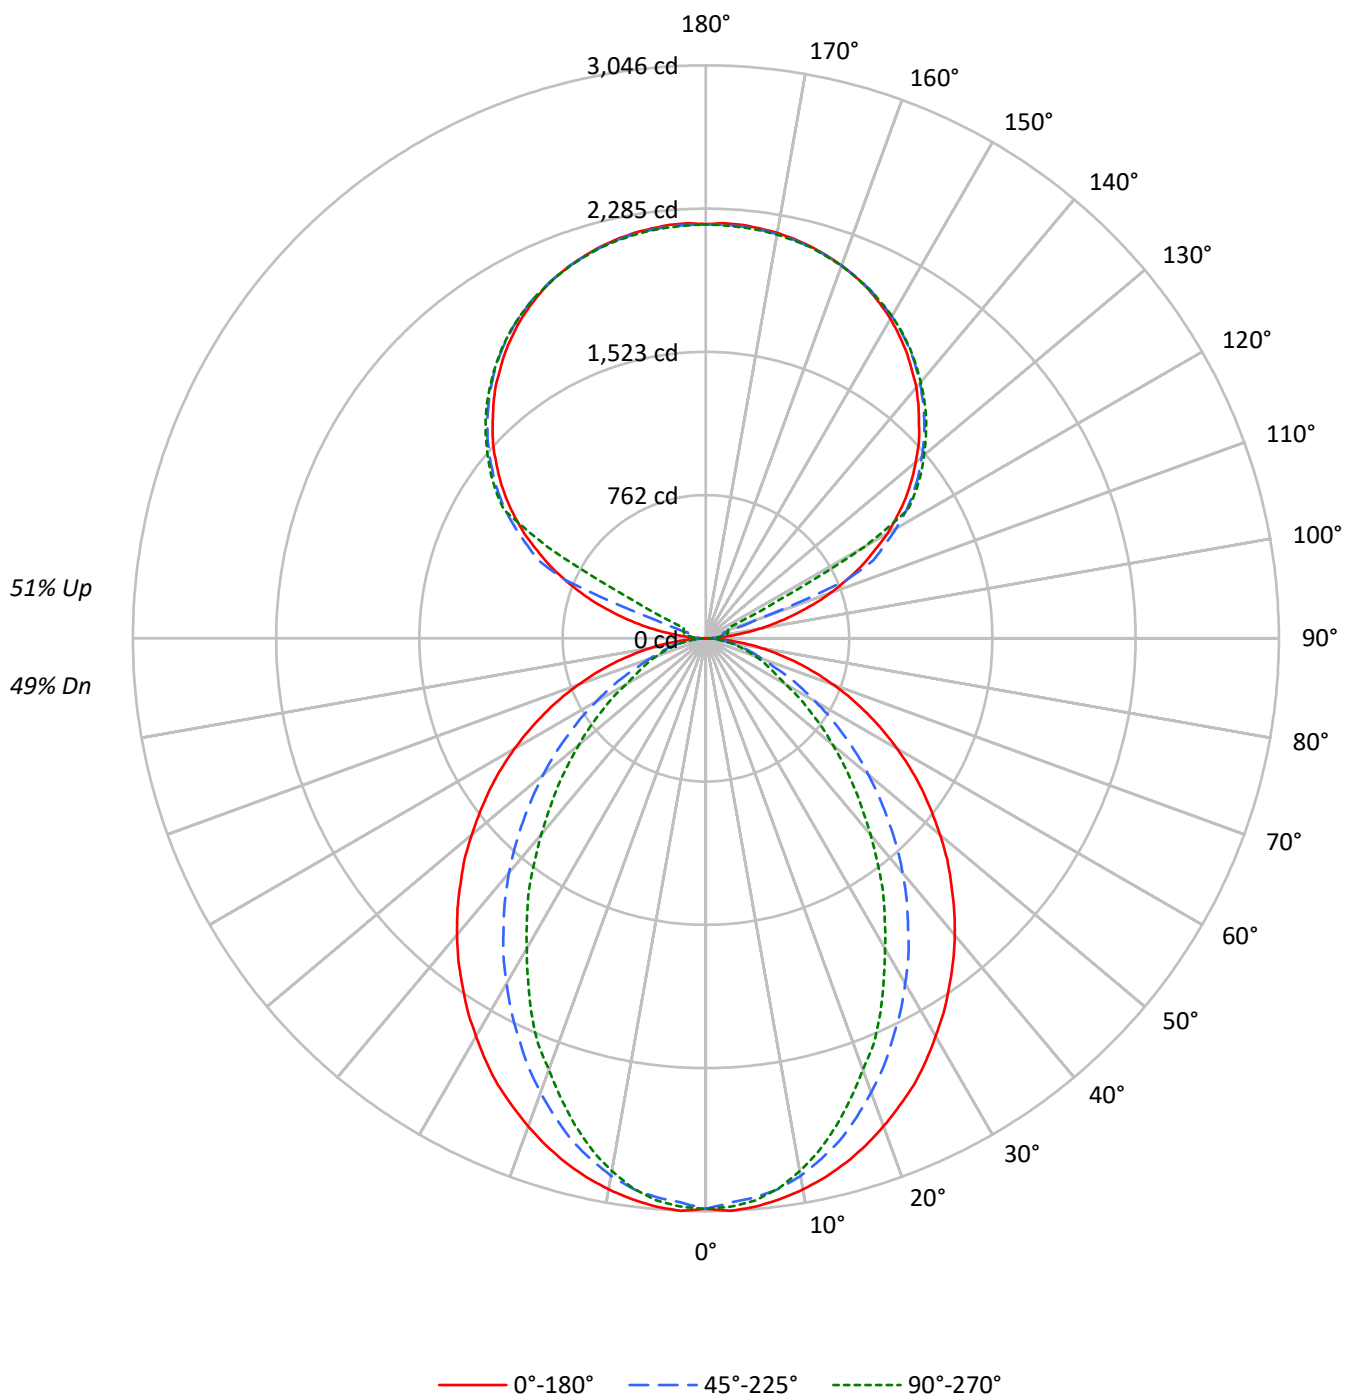

TEST NUMBER: P917695

CATALOG NUMBER: DFN2DIP-SQ4F0-090D080US930-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	69	69	69	55	55	55
1	98	94	90	87	90	87	84	81	73	71	69	61	59	58	50	49	48
2	90	83	77	72	82	76	71	67	65	61	58	54	52	49	44	42	41
3	82	73	66	60	75	68	62	57	58	53	49	48	45	42	40	37	35
4	75	65	57	51	69	60	54	48	51	46	42	43	40	37	36	33	31
5	69	58	50	44	64	54	47	42	46	41	37	39	35	32	32	30	27
6	64	52	44	39	59	49	42	37	42	36	32	36	31	28	30	27	24
7	59	47	40	34	55	44	37	32	38	33	29	32	28	25	27	24	22
8	55	43	36	30	51	40	33	29	35	29	26	30	26	23	25	22	20
9	51	39	32	27	47	37	30	26	32	27	23	28	23	20	23	20	18
10	48	36	29	24	44	34	28	23	30	24	21	25	21	19	22	18	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2128	2128	2128
5°	2131	2095	2108
10°	2110	2054	2040
15°	2081	1986	1935
20°	2043	1893	1805
25°	2003	1789	1680
30°	1950	1681	1521
35°	1899	1566	1381
40°	1846	1447	1221
45°	1785	1314	1075
50°	1721	1181	933
55°	1655	1038	797
60°	1579	888	657
65°	1491	736	592
70°	1384	594	536
75°	1250	525	489
80°	1056	441	426
85°	735	297	325

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1785 cd/sqm

TEST NUMBER: P917695

CATALOG NUMBER: DFN2DIP-SQ4F0-090D080US930-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	284.2	2.2
10°-20°	780.3	6.1
20°-30°	1095.5	8.6
30°-40°	1194.1	9.4
40°-50°	1097.5	8.6
50°-60°	861.9	6.8
60°-70°	561.0	4.4
70°-80°	288.8	2.3
80°-90°	77.6	0.6
90°-100°	72.6	0.6
100°-110°	270.6	2.1
110°-120°	717.6	5.7
120°-130°	1190.2	9.4
130°-140°	1264.3	10.0
140°-150°	1175.0	9.3
150°-160°	944.7	7.4
160°-170°	608.7	4.8
170°-180°	209.5	1.7
0°-30°	2159.9	17.0
0°-40°	3354.0	26.4
0°-60°	5313.5	41.9
0°-90°	6240.9	49.2
90°-120°	1060.8	8.4
90°-150°	4690.4	36.9
90°-180°	6453.0	50.8
0°-180°	12694.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3033	3033	3033	3033	3033	
5°	3033	3019	2983	3008	3000	288
15°	2884	2854	2761	2709	2682	813
25°	2618	2530	2349	2237	2196	1204
35°	2256	2116	1875	1702	1641	1412
45°	1844	1660	1372	1177	1111	1424
55°	1402	1188	892	727	675	1253
65°	947	724	478	384	376	939
75°	505	313	220	200	198	534
85°	118	60	52	52	52	135
90°	2	19	32	40	43	12
95°	104	51	62	70	68	123
105°	484	532	97	115	121	517
115°	916	943	983	245	131	902
125°	1295	1316	1346	1357	1362	1155
135°	1602	1628	1642	1658	1655	1238
145°	1859	1857	1884	1895	1887	1163
155°	2047	2032	2052	2061	2048	943
165°	2157	2147	2152	2163	2152	609
175°	2206	2195	2198	2209	2193	210
180°	2201	2201	2201	2201	2201	

TEST NUMBER: P917695

CATALOG NUMBER: DFN2DIP-SQ4F0-090D080US930-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3032.7	3032.7	3032.7	3032.7	3032.7
2.5°	3046.4	3032.7	3002.3	3030.1	3024.5
5°	3032.7	3019.0	2983.2	3007.9	2999.7
7.5°	3007.9	2991.6	2953.2	2963.9	2950.2
10°	2975.0	2955.8	2901.1	2892.6	2876.3
12.5°	2933.9	2909.2	2835.0	2818.6	2788.3
15°	2884.4	2854.2	2761.0	2708.8	2681.5
17.5°	2826.8	2782.9	2667.5	2607.2	2563.3
20°	2761.0	2706.0	2568.8	2500.4	2439.8
22.5°	2689.7	2626.5	2467.2	2374.0	2333.0
25°	2618.3	2530.4	2349.3	2236.9	2195.5
27.5°	2533.3	2439.8	2239.5	2110.5	2047.3
30°	2442.7	2338.2	2118.6	1978.9	1904.6
32.5°	2354.7	2228.4	2003.6	1838.8	1770.1
35°	2256.1	2116.0	1874.6	1701.7	1641.1
37.5°	2160.0	2008.9	1753.8	1564.2	1495.8
40°	2058.4	1893.9	1627.4	1432.6	1361.3
42.5°	1954.1	1778.6	1501.3	1298.1	1229.6
45°	1844.4	1660.4	1372.3	1177.2	1111.4
47.5°	1740.1	1545.3	1248.9	1053.8	993.5
50°	1624.8	1430.0	1128.0	938.5	881.1
52.5°	1512.1	1306.3	1012.8	831.6	779.5
55°	1402.3	1188.3	891.9	727.4	675.2
57.5°	1290.0	1070.4	785.1	631.3	587.3
60°	1174.6	955.0	672.4	532.6	488.6
62.5°	1062.3	842.7	576.3	444.7	422.8
65°	946.9	724.5	477.5	384.3	375.9
67.5°	837.1	614.7	384.3	337.5	329.3
70°	721.9	507.8	318.3	290.9	279.8
72.5°	612.0	408.8	266.1	244.3	238.8
75°	504.9	312.7	219.6	200.3	197.7
77.5°	398.0	222.2	172.9	161.9	156.4
80°	299.1	159.3	131.6	120.8	120.8
82.5°	208.5	107.1	90.6	85.0	85.0
85°	117.9	60.3	52.1	52.1	52.1
87.5°	43.9	21.8	21.8	19.2	19.2
90°	1.5	19.1	31.8	39.9	43.0
92.5°	39.9	33.5	38.2	41.4	43.0
95°	103.5	50.9	62.0	70.2	68.5
97.5°	186.3	55.8	81.1	86.1	87.6
100°	282.0	63.8	90.8	103.5	106.6
102.5°	387.0	383.9	94.0	111.4	116.3
105°	484.2	532.1	97.2	114.6	121.1
107.5°	597.3	637.0	100.4	117.8	124.3
110°	705.7	739.0	278.8	119.5	125.8

TEST NUMBER: P917695

CATALOG NUMBER: DFN2DIP-SQ4F0-090D080US930-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	807.6	836.2	809.2	122.5	127.5
115°	915.8	942.9	982.8	245.3	130.7
117.5°	1009.8	1041.6	1068.9	840.9	423.7
120°	1115.0	1138.8	1167.6	1186.7	971.6
122.5°	1204.0	1229.6	1261.6	1271.0	1272.8
125°	1294.9	1315.6	1345.9	1357.1	1361.8
127.5°	1377.7	1400.0	1424.1	1439.9	1441.4
130°	1455.8	1481.3	1498.8	1516.4	1514.8
132.5°	1535.5	1556.2	1573.7	1588.0	1586.5
135°	1602.4	1627.9	1642.1	1658.2	1655.0
137.5°	1672.4	1691.5	1707.6	1723.5	1718.7
140°	1740.8	1753.7	1771.2	1785.5	1777.5
142.5°	1798.4	1809.5	1830.1	1842.8	1834.8
145°	1858.9	1857.2	1884.2	1895.4	1887.4
147.5°	1911.3	1906.6	1933.6	1941.6	1935.3
150°	1962.3	1951.2	1976.7	1986.1	1978.2
152.5°	2005.3	1992.6	2016.4	2026.1	2014.9
155°	2046.7	2032.5	2051.6	2061.1	2048.4
157.5°	2080.2	2067.5	2081.9	2093.0	2080.2
160°	2108.9	2099.3	2108.9	2118.4	2107.2
162.5°	2134.3	2124.8	2132.7	2143.9	2129.6
165°	2156.6	2147.2	2151.9	2163.0	2151.9
167.5°	2174.2	2164.5	2169.4	2180.6	2166.2
170°	2188.6	2178.9	2182.1	2193.3	2178.9
172.5°	2198.0	2188.6	2191.8	2202.9	2188.6
175°	2206.0	2194.8	2198.0	2209.1	2193.3
177.5°	2209.1	2198.0	2199.7	2210.8	2196.5
180°	2201.2	2201.2	2201.2	2201.2	2201.2

TEST NUMBER: P917695

CATALOG NUMBER: DFN2DIP-SQ4F0-090D080US930-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.70	10.53	10.68	11.51	12.79	5.67	6.49	6.64	7.47	8.75
	3H	11.39	12.12	12.37	13.11	14.42	6.85	7.59	7.84	8.58	9.89
	4H	12.00	12.69	12.99	13.69	15.00	7.30	8.00	8.30	8.99	10.31
	6H	12.42	13.06	13.43	14.06	15.39	7.63	8.27	8.63	9.26	10.59
	8H	12.55	13.16	13.56	14.17	15.50	7.72	8.33	8.73	9.34	10.67
	12H	12.61	13.19	13.63	14.20	15.55	7.76	8.34	8.78	9.35	10.70
4H	2H	9.72	10.42	10.72	11.41	12.73	6.26	6.96	7.26	7.95	9.27
	3H	11.56	12.13	12.57	13.16	14.49	7.61	8.19	8.62	9.21	10.54
	4H	12.25	12.78	13.27	13.79	15.15	8.16	8.69	9.18	9.70	11.06
	6H	12.77	13.22	13.80	14.26	15.61	8.58	9.03	9.61	10.07	11.42
	8H	12.95	13.37	13.98	14.40	15.77	8.71	9.13	9.74	10.16	11.53
	12H	13.04	13.43	14.09	14.47	15.84	8.78	9.16	9.82	10.20	11.57
8H	4H	12.22	12.64	13.25	13.67	15.04	8.44	8.87	9.47	9.90	11.26
	6H	12.79	13.14	13.84	14.21	15.57	8.96	9.31	10.02	10.39	11.75
	8H	13.01	13.32	14.07	14.37	15.75	9.15	9.46	10.22	10.52	11.90
	12H	13.15	13.42	14.21	14.47	15.90	9.27	9.54	10.34	10.60	12.02
12H	4H	12.17	12.55	13.22	13.60	14.97	8.45	8.83	9.50	9.88	11.25
	6H	12.76	13.07	13.83	14.13	15.51	9.01	9.32	10.07	10.38	11.76
	8H	12.99	13.26	14.05	14.31	15.73	9.22	9.50	10.29	10.55	11.97

END OF REPORT