

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P917705

Luminaire Tested: DFN2DIP-SQ4F0-090D110US930-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P917705
REPORT IS A COMBINATION OF REPORTS P901675 AND P898471
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-090D110US930-FLLONL
Description: 4 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 16142.9 lumens
Efficiency: N/A
Efficacy: 97.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 165.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.983
Total Harmonic Distortion (THDi): 0.073
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P917705

CATALOG NUMBER: DFN2DIP-SQ4F0-090D110US930-FLLONL

Luminous Intensity Polar Plot

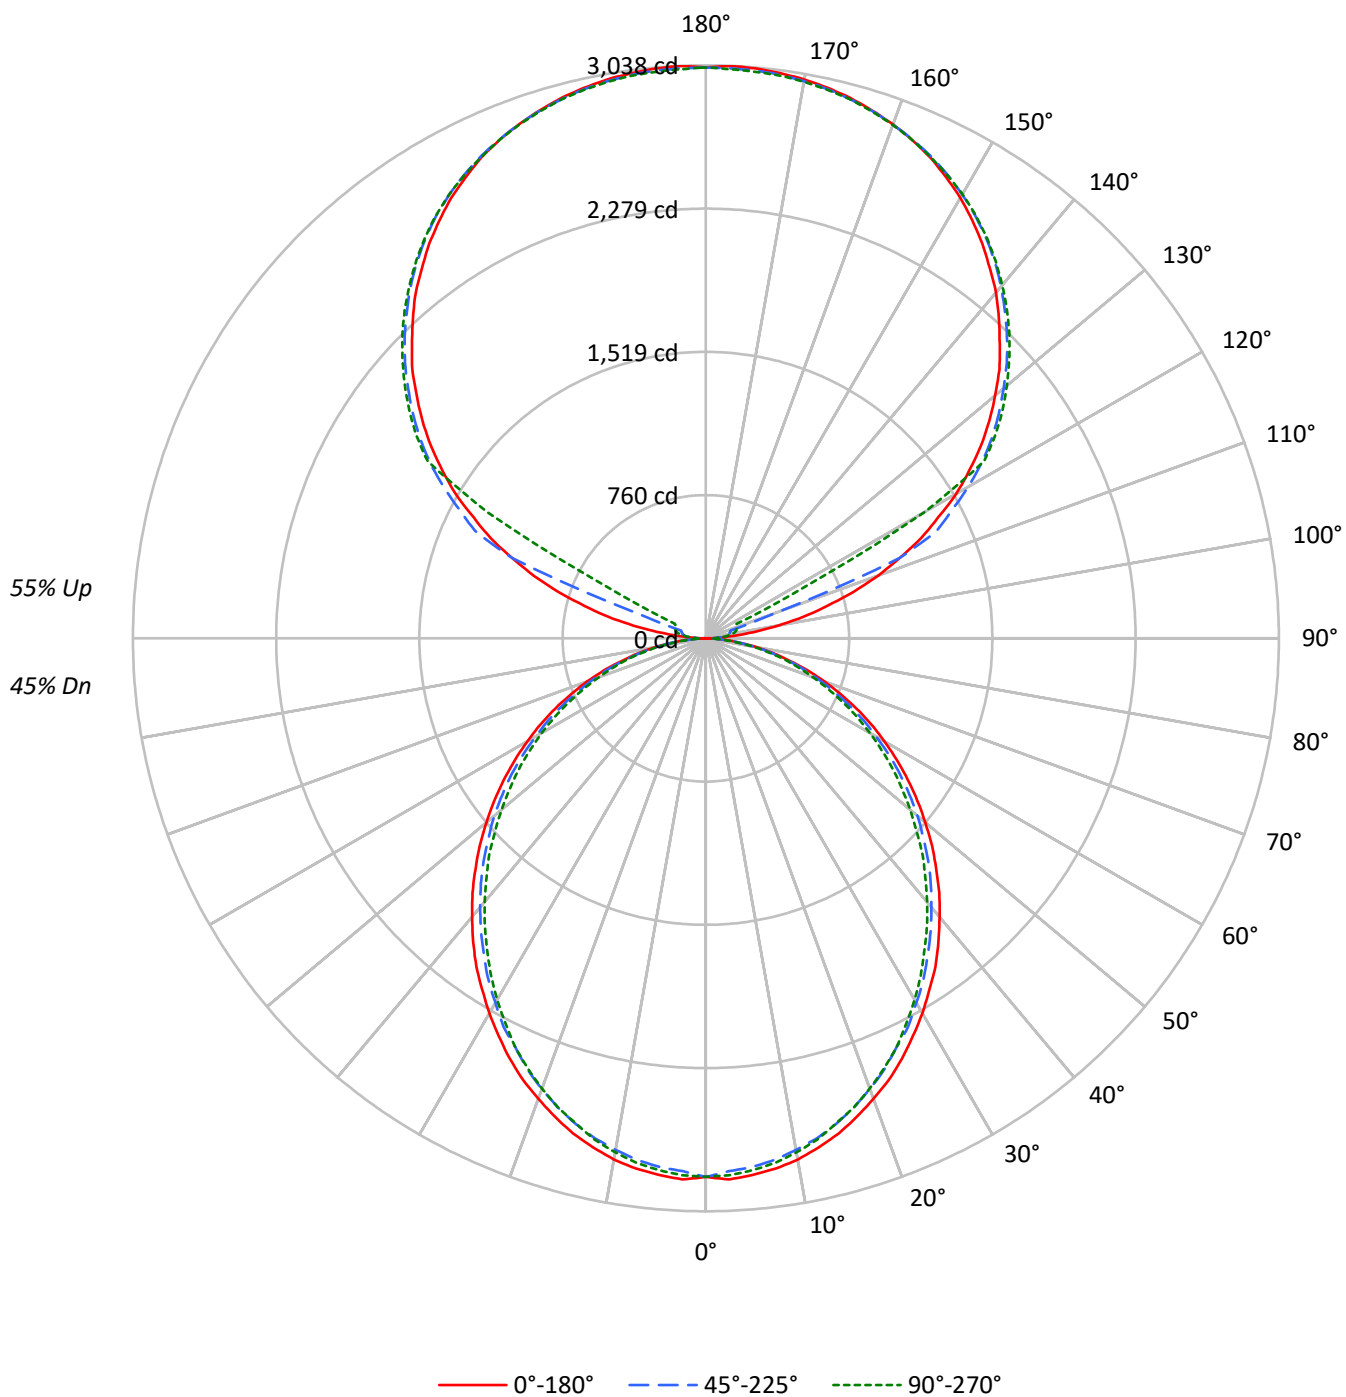

TEST NUMBER: P917705

CATALOG NUMBER: DFN2DIP-SQ4F0-090D110US930-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	97	97	97	97	81	81	81	65	65	65	52	52	52
1	97	92	89	85	88	85	82	79	71	68	66	58	56	54	46	45	44
2	88	81	75	69	80	74	69	64	62	58	55	51	48	45	40	38	37
3	80	71	64	58	73	65	59	54	55	50	46	45	41	38	36	33	31
4	73	63	55	49	67	58	51	46	48	43	39	40	36	33	32	29	27
5	67	56	48	42	61	52	44	39	43	38	34	36	32	29	29	26	23
6	62	50	42	36	57	46	39	34	39	34	29	32	28	25	26	23	21
7	57	45	37	32	52	42	35	30	35	30	26	29	25	22	24	21	18
8	53	41	33	28	49	38	31	26	32	27	23	27	23	20	22	19	16
9	50	37	30	25	45	35	28	23	30	24	21	25	21	18	20	17	15
10	46	34	27	22	42	32	25	21	27	22	18	23	19	16	19	16	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2003	2003	2003
5°	2007	1976	1989
10°	1990	1950	1963
15°	1961	1918	1921
20°	1921	1874	1879
25°	1882	1821	1830
30°	1833	1771	1767
35°	1786	1713	1700
40°	1728	1655	1637
45°	1671	1596	1573
50°	1608	1534	1498
55°	1543	1463	1429
60°	1468	1378	1351
65°	1387	1290	1258
70°	1284	1183	1158
75°	1141	1056	1067
80°	970	893	892
85°	700	611	599

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1671 cd/sqm

TEST NUMBER: P917705

CATALOG NUMBER: DFN2DIP-SQ4F0-090D110US930-FLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	268.7	1.7
10°-20°	756.1	4.7
20°-30°	1111.2	6.9
30°-40°	1290.5	8.0
40°-50°	1288.9	8.0
50°-60°	1123.9	7.0
60°-70°	830.8	5.1
70°-80°	470.1	2.9
80°-90°	129.4	0.8
90°-100°	99.8	0.6
100°-110°	372.1	2.3
110°-120°	986.7	6.1
120°-130°	1636.6	10.1
130°-140°	1738.4	10.8
140°-150°	1615.7	10.0
150°-160°	1298.9	8.0
160°-170°	837.0	5.2
170°-180°	288.1	1.8
0°-30°	2136.0	13.2
0°-40°	3426.5	21.2
0°-60°	5839.4	36.2
0°-90°	7269.6	45.0
90°-120°	1458.6	9.0
90°-150°	6449.2	40.0
90°-180°	8873.0	55.0
0°-180°	16142.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2855	2855	2855	2855	2855	
5°	2855	2844	2814	2836	2831	271
15°	2718	2702	2666	2677	2663	765
25°	2460	2438	2391	2397	2391	1132
35°	2122	2095	2051	2034	2021	1325
45°	1727	1708	1666	1636	1625	1333
55°	1307	1290	1257	1225	1211	1169
65°	881	865	837	813	799	871
75°	461	456	442	426	431	492
85°	112	110	107	99	96	125
90°	2	26	44	55	59	15
95°	142	70	85	96	94	169
105°	666	732	134	158	166	711
115°	1259	1296	1351	337	180	1240
125°	1780	1809	1851	1866	1872	1588
135°	2203	2238	2258	2280	2276	1702
145°	2556	2554	2591	2606	2595	1599
155°	2814	2795	2821	2834	2816	1297
165°	2965	2952	2959	2974	2959	838
175°	3033	3018	3022	3038	3016	289
180°	3027	3027	3027	3027	3027	

TEST NUMBER: P917705

CATALOG NUMBER: DFN2DIP-SQ4F0-090D110US930-FLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2855.1	2855.1	2855.1	2855.1	2855.1
2.5°	2871.7	2858.0	2827.8	2855.1	2849.9
5°	2855.1	2844.3	2814.1	2835.9	2830.6
7.5°	2835.9	2819.6	2789.3	2811.5	2805.9
10°	2805.9	2786.7	2753.8	2775.6	2767.4
12.5°	2764.5	2748.2	2715.4	2729.0	2723.5
15°	2718.0	2701.7	2665.8	2676.9	2663.2
17.5°	2660.2	2643.9	2608.1	2621.8	2608.1
20°	2597.1	2580.7	2542.3	2550.4	2539.7
22.5°	2534.1	2509.4	2473.5	2473.5	2468.0
25°	2459.8	2438.0	2391.4	2396.7	2391.4
27.5°	2377.4	2358.2	2322.7	2314.6	2300.9
30°	2295.3	2273.1	2232.0	2223.9	2212.9
32.5°	2207.3	2191.0	2147.0	2130.5	2119.4
35°	2122.3	2094.9	2050.9	2034.3	2020.6
37.5°	2026.2	2001.4	1957.4	1938.2	1924.5
40°	1927.4	1905.3	1861.2	1836.8	1825.8
42.5°	1831.2	1809.1	1765.4	1737.8	1721.5
45°	1727.0	1707.8	1666.4	1636.4	1625.4
47.5°	1625.4	1606.1	1562.1	1531.9	1515.6
50°	1518.2	1504.5	1466.0	1427.6	1413.9
52.5°	1413.9	1394.6	1359.1	1328.9	1309.6
55°	1307.0	1290.4	1257.4	1224.6	1210.9
57.5°	1199.8	1186.1	1150.3	1117.4	1106.3
60°	1092.6	1081.8	1043.3	1013.1	1004.9
62.5°	988.3	969.1	941.7	914.4	903.3
65°	881.4	864.8	837.4	812.7	799.0
67.5°	771.6	757.7	733.1	714.0	702.9
70°	669.9	658.8	634.1	614.9	604.1
72.5°	565.7	554.6	540.9	521.7	513.6
75°	461.1	455.8	441.9	425.6	431.1
77.5°	367.9	356.9	351.3	343.2	335.0
80°	274.7	271.7	266.2	258.0	252.6
82.5°	186.7	186.7	184.1	173.0	173.0
85°	112.4	109.8	107.2	98.7	96.1
87.5°	49.5	43.9	38.5	30.3	27.4
90°	2.1	26.3	43.7	54.9	59.0
92.5°	54.9	46.1	52.5	57.0	59.0
95°	142.3	70.0	85.3	96.4	94.2
97.5°	256.2	76.7	111.5	118.3	120.4
100°	387.8	87.6	124.8	142.3	146.7
102.5°	532.1	527.9	129.2	153.2	160.0
105°	665.8	731.6	133.7	157.6	166.5
107.5°	821.3	875.9	138.1	162.0	170.9
110°	970.3	1016.1	383.4	164.4	172.9

TEST NUMBER: P917705

CATALOG NUMBER: DFN2DIP-SQ4F0-090D110US930-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1110.5	1149.7	1112.6	168.5	175.3
115°	1259.2	1296.4	1351.4	337.3	179.7
117.5°	1388.5	1432.2	1469.7	1156.3	582.5
120°	1533.1	1565.9	1605.4	1631.7	1335.9
122.5°	1655.6	1690.7	1734.6	1747.7	1750.0
125°	1780.4	1809.1	1850.6	1866.0	1872.5
127.5°	1894.3	1925.0	1958.0	1979.9	1982.0
130°	2001.7	2036.9	2060.7	2085.0	2082.9
132.5°	2111.2	2139.8	2163.8	2183.5	2181.5
135°	2203.3	2238.4	2257.9	2280.1	2275.6
137.5°	2299.5	2325.8	2347.9	2369.7	2363.2
140°	2393.7	2411.3	2435.3	2455.0	2444.1
142.5°	2472.7	2488.0	2516.4	2533.9	2522.9
145°	2556.0	2553.6	2590.8	2606.2	2595.3
147.5°	2628.0	2621.5	2658.7	2669.6	2661.1
150°	2698.2	2682.9	2718.0	2731.0	2720.1
152.5°	2757.3	2739.8	2772.6	2785.9	2770.5
155°	2814.2	2794.7	2820.9	2834.0	2816.5
157.5°	2860.2	2842.8	2862.6	2877.9	2860.2
160°	2899.8	2886.5	2899.8	2912.7	2897.4
162.5°	2934.6	2921.6	2932.5	2947.9	2928.1
165°	2965.3	2952.3	2958.8	2974.1	2958.8
167.5°	2989.5	2976.2	2983.0	2998.3	2978.6
170°	3009.3	2996.0	3000.4	3015.8	2996.0
172.5°	3022.2	3009.3	3013.7	3029.0	3009.3
175°	3033.2	3017.8	3022.2	3037.6	3015.8
177.5°	3037.6	3022.2	3024.6	3039.9	3020.2
180°	3026.7	3026.7	3026.7	3026.7	3026.7

TEST NUMBER: P917705

CATALOG NUMBER: DFN2DIP-SQ4F0-090D110US930-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.22	10.04	10.22	11.05	12.39	8.78	9.60	9.78	10.61	11.95
	3H	10.88	11.62	11.89	12.64	14.00	10.39	11.13	11.40	12.14	13.51
	4H	11.47	12.17	12.49	13.19	14.56	10.98	11.67	12.00	12.69	14.06
	6H	11.87	12.51	12.90	13.54	14.92	11.37	12.01	12.40	13.04	14.42
	8H	11.98	12.59	13.02	13.63	15.01	11.48	12.09	12.51	13.13	14.51
	12H	12.03	12.61	13.07	13.64	15.04	11.52	12.10	12.56	13.13	14.53
4H	2H	9.68	10.37	10.71	11.39	12.76	9.32	10.02	10.35	11.04	12.41
	3H	11.54	12.12	12.58	13.17	14.56	11.14	11.72	12.17	12.77	14.15
	4H	12.26	12.79	13.30	13.83	15.24	11.84	12.37	12.88	13.41	14.81
	6H	12.78	13.23	13.83	14.30	15.70	12.35	12.80	13.40	13.87	15.27
	8H	12.93	13.35	13.98	14.41	15.83	12.49	12.92	13.55	13.98	15.39
	12H	13.00	13.39	14.07	14.46	15.88	12.55	12.94	13.62	14.01	15.43
8H	4H	12.45	12.88	13.51	13.94	15.35	12.08	12.50	13.13	13.56	14.98
	6H	13.09	13.44	14.17	14.54	15.95	12.70	13.06	13.78	14.16	15.57
	8H	13.31	13.62	14.40	14.70	16.14	12.92	13.23	14.00	14.31	15.74
	12H	13.44	13.72	14.53	14.79	16.27	13.03	13.31	14.12	14.38	15.86
12H	4H	12.44	12.82	13.51	13.90	15.32	12.07	12.46	13.14	13.53	14.95
	6H	13.12	13.43	14.20	14.51	15.94	12.75	13.06	13.83	14.14	15.57
	8H	13.36	13.63	14.45	14.71	16.18	12.98	13.25	14.07	14.33	15.80