

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P917712

Luminaire Tested: DFN2DIP-SQ4F0-090D140US930-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P917712
REPORT IS A COMBINATION OF REPORTS P900191 AND P896915
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-090D140US930-FLLFLL
Description: 4 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 17365.9 lumens
Efficiency: N/A
Efficacy: 92.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 188.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.983
Total Harmonic Distortion (THDi): 0.073
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P917712

CATALOG NUMBER: DFN2DIP-SQ4F0-090D140US930-FLLFLL

Luminous Intensity Polar Plot

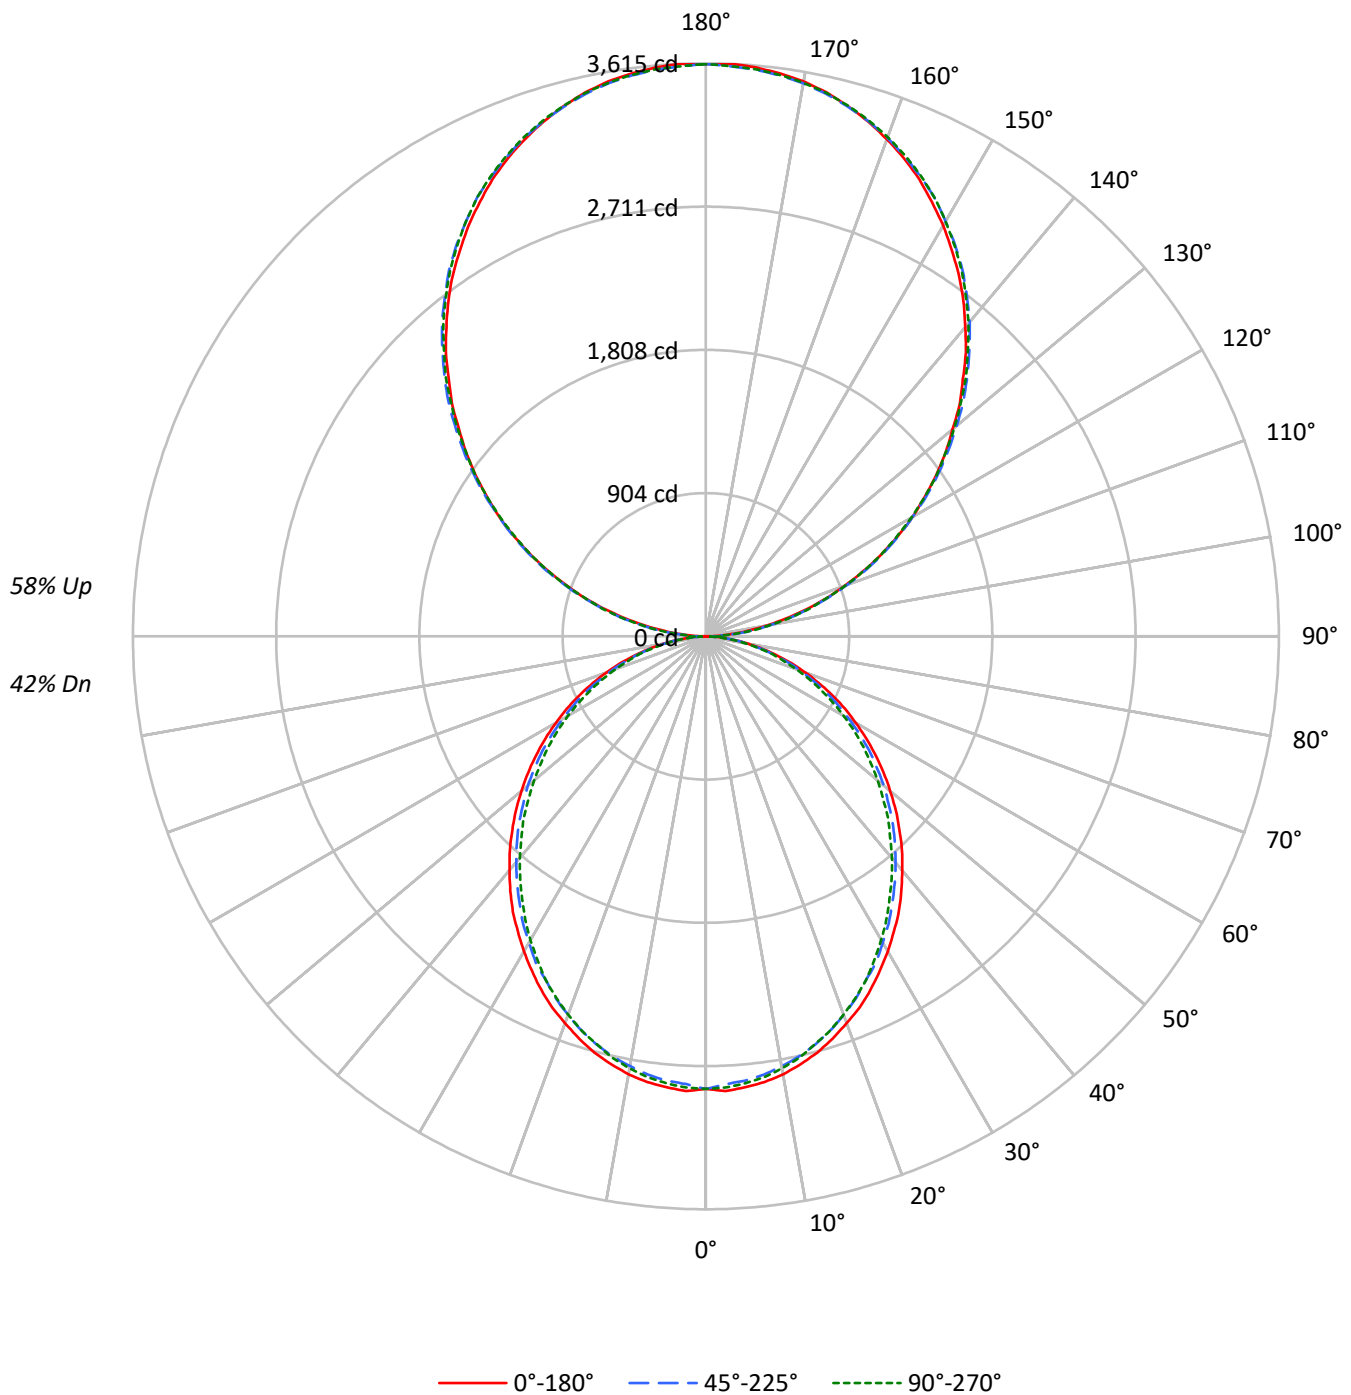

TEST NUMBER: P917712

CATALOG NUMBER: DFN2DIP-SQ4F0-090D140US930-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	96	96	96	96	79	79	79	63	63	63	49	49	49
1	96	92	88	84	87	84	81	78	69	67	65	55	54	52	43	42	41
2	87	80	74	69	79	73	68	64	60	57	53	49	46	44	38	36	35
3	80	70	63	57	72	64	58	53	53	49	45	43	40	37	34	31	29
4	73	62	54	48	66	57	50	45	47	42	38	38	35	32	30	27	25
5	67	55	47	41	61	51	44	39	42	37	33	34	31	27	27	24	22
6	62	50	42	36	56	46	39	33	38	33	29	31	27	24	24	22	19
7	57	45	37	31	52	41	34	29	35	29	25	28	24	21	22	19	17
8	53	41	33	28	48	37	31	26	31	26	22	26	22	19	21	18	15
9	49	37	30	25	45	34	28	23	29	24	20	24	20	17	19	16	14
10	46	34	27	22	42	31	25	21	26	21	18	22	18	15	18	15	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2003	2003	2003
5°	2007	1976	1989
10°	1990	1950	1963
15°	1961	1918	1921
20°	1921	1874	1879
25°	1882	1821	1830
30°	1833	1771	1767
35°	1786	1713	1700
40°	1728	1655	1637
45°	1671	1596	1573
50°	1608	1534	1498
55°	1543	1463	1429
60°	1468	1378	1351
65°	1387	1290	1258
70°	1284	1183	1158
75°	1141	1056	1067
80°	970	893	892
85°	700	611	599

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2842 cd/sqm

TEST NUMBER: P917712

CATALOG NUMBER: DFN2DIP-SQ4F0-090D140US930-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	268.7	1.5
10°-20°	756.1	4.4
20°-30°	1111.2	6.4
30°-40°	1290.5	7.4
40°-50°	1288.9	7.4
50°-60°	1123.9	6.5
60°-70°	830.8	4.8
70°-80°	470.1	2.7
80°-90°	134.3	0.8
90°-100°	223.4	1.3
100°-110°	709.8	4.1
110°-120°	1214.6	7.0
120°-130°	1597.4	9.2
130°-140°	1793.0	10.3
140°-150°	1758.2	10.1
150°-160°	1474.9	8.5
160°-170°	978.1	5.6
170°-180°	341.9	2.0
0°-30°	2136.0	12.3
0°-40°	3426.5	19.7
0°-60°	5839.4	33.6
0°-90°	7274.6	41.9
90°-120°	2147.7	12.4
90°-150°	7296.4	42.0
90°-180°	10091.0	58.1
0°-180°	17365.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2855	2855	2855	2855	2855	
5°	2855	2844	2814	2836	2831	271
15°	2718	2702	2666	2677	2663	765
25°	2460	2438	2391	2397	2391	1132
35°	2122	2095	2051	2034	2021	1325
45°	1727	1708	1666	1636	1625	1333
55°	1307	1290	1257	1225	1211	1169
65°	881	865	837	813	799	871
75°	461	456	442	426	431	492
85°	112	110	107	99	96	125
90°	3	39	107	100	103	17
95°	159	189	195	195	189	177
105°	655	664	670	676	676	691
115°	1219	1236	1231	1228	1219	1206
125°	1773	1800	1791	1782	1778	1584
135°	2293	2327	2333	2330	2321	1772
145°	2784	2806	2823	2826	2814	1739
155°	3183	3192	3202	3217	3207	1465
165°	3463	3460	3460	3482	3466	977
175°	3603	3595	3588	3610	3591	342
180°	3610	3610	3610	3610	3610	

TEST NUMBER: P917712

CATALOG NUMBER: DFN2DIP-SQ4F0-090D140US930-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2855.1	2855.1	2855.1	2855.1	2855.1
2.5°	2871.7	2858.0	2827.8	2855.1	2849.9
5°	2855.1	2844.3	2814.1	2835.9	2830.6
7.5°	2835.9	2819.6	2789.3	2811.5	2805.9
10°	2805.9	2786.7	2753.8	2775.6	2767.4
12.5°	2764.5	2748.2	2715.4	2729.0	2723.5
15°	2718.0	2701.7	2665.8	2676.9	2663.2
17.5°	2660.2	2643.9	2608.1	2621.8	2608.1
20°	2597.1	2580.7	2542.3	2550.4	2539.7
22.5°	2534.1	2509.4	2473.5	2473.5	2468.0
25°	2459.8	2438.0	2391.4	2396.7	2391.4
27.5°	2377.4	2358.2	2322.7	2314.6	2300.9
30°	2295.3	2273.1	2232.0	2223.9	2212.9
32.5°	2207.3	2191.0	2147.0	2130.5	2119.4
35°	2122.3	2094.9	2050.9	2034.3	2020.6
37.5°	2026.2	2001.4	1957.4	1938.2	1924.5
40°	1927.4	1905.3	1861.2	1836.8	1825.8
42.5°	1831.2	1809.1	1765.4	1737.8	1721.5
45°	1727.0	1707.8	1666.4	1636.4	1625.4
47.5°	1625.4	1606.1	1562.1	1531.9	1515.6
50°	1518.2	1504.5	1466.0	1427.6	1413.9
52.5°	1413.9	1394.6	1359.1	1328.9	1309.6
55°	1307.0	1290.4	1257.4	1224.6	1210.9
57.5°	1199.8	1186.1	1150.3	1117.4	1106.3
60°	1092.6	1081.8	1043.3	1013.1	1004.9
62.5°	988.3	969.1	941.7	914.4	903.3
65°	881.4	864.8	837.4	812.7	799.0
67.5°	771.6	757.7	733.1	714.0	702.9
70°	669.9	658.8	634.1	614.9	604.1
72.5°	565.7	554.6	540.9	521.7	513.6
75°	461.1	455.8	441.9	425.6	431.1
77.5°	367.9	356.9	351.3	343.2	335.0
80°	274.7	271.7	266.2	258.0	252.6
82.5°	186.7	186.7	184.1	173.0	173.0
85°	112.4	109.8	107.2	98.7	96.1
87.5°	49.5	43.9	38.5	30.3	27.4
90°	3.3	39.2	106.6	100.1	103.4
92.5°	67.5	91.4	94.7	97.9	97.9
95°	158.9	189.4	194.8	194.8	189.4
97.5°	264.5	292.8	304.8	304.8	304.8
100°	386.4	411.4	420.0	420.0	416.8
102.5°	514.8	533.3	545.3	548.5	545.3
105°	655.2	663.9	670.4	675.8	675.8
107.5°	794.4	807.6	807.6	809.7	794.4
110°	929.4	946.8	946.8	946.8	938.1

TEST NUMBER: P917712

CATALOG NUMBER: DFN2DIP-SQ4F0-090D140US930-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1075.2	1093.7	1090.5	1081.7	1075.2
115°	1218.9	1236.3	1230.9	1227.6	1218.9
117.5°	1361.5	1385.4	1370.2	1361.5	1352.7
120°	1505.1	1529.1	1505.1	1505.1	1495.3
122.5°	1635.7	1666.1	1651.0	1642.3	1635.7
125°	1772.9	1800.0	1791.3	1781.5	1778.2
127.5°	1906.7	1940.4	1928.4	1915.4	1906.7
130°	2031.8	2071.0	2065.6	2059.0	2047.1
132.5°	2172.2	2202.7	2204.9	2189.6	2180.9
135°	2293.0	2326.8	2333.3	2330.0	2321.3
137.5°	2428.0	2455.2	2460.7	2458.5	2445.4
140°	2546.6	2573.8	2589.1	2589.1	2577.1
142.5°	2668.5	2695.7	2704.4	2707.7	2695.7
145°	2783.8	2805.6	2823.1	2826.3	2814.3
147.5°	2887.2	2914.4	2927.5	2933.0	2921.0
150°	2993.9	3012.4	3024.3	3034.1	3024.3
152.5°	3088.6	3107.1	3122.3	3134.3	3122.3
155°	3183.3	3192.0	3201.8	3217.0	3207.2
157.5°	3264.9	3271.4	3276.8	3298.6	3283.4
160°	3337.8	3344.4	3347.6	3366.1	3353.0
162.5°	3405.3	3405.3	3408.5	3429.2	3414.0
165°	3463.0	3459.7	3459.7	3481.5	3466.2
167.5°	3515.2	3505.4	3505.4	3527.1	3511.9
170°	3554.4	3545.7	3542.4	3564.2	3545.7
172.5°	3581.6	3572.9	3569.6	3591.4	3572.9
175°	3603.4	3594.6	3588.1	3609.9	3591.4
177.5°	3615.3	3606.6	3600.1	3618.5	3600.1
180°	3609.9	3609.9	3609.9	3609.9	3609.9

TEST NUMBER: P917712

CATALOG NUMBER: DFN2DIP-SQ4F0-090D140US930-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.90	9.69	9.92	10.72	12.10	8.45	9.25	9.48	10.28	11.66
	3H	10.56	11.27	11.59	12.31	13.71	10.07	10.78	11.10	11.82	13.22
	4H	11.14	11.82	12.19	12.86	14.27	10.65	11.32	11.70	12.37	13.78
	6H	11.54	12.16	12.60	13.21	14.63	11.04	11.66	12.10	12.71	14.13
	8H	11.65	12.24	12.71	13.30	14.72	11.15	11.74	12.21	12.80	14.22
	12H	11.70	12.26	12.76	13.31	14.76	11.19	11.75	12.25	12.81	14.25
4H	2H	9.35	10.02	10.40	11.07	12.48	9.00	9.67	10.05	10.71	12.12
	3H	11.21	11.78	12.28	12.85	14.27	10.81	11.37	11.87	12.44	13.86
	4H	11.93	12.45	13.00	13.51	14.95	11.51	12.02	12.57	13.08	14.53
	6H	12.45	12.89	13.52	13.97	15.41	12.01	12.46	13.09	13.54	14.98
	8H	12.60	13.01	13.67	14.09	15.54	12.16	12.57	13.23	13.65	15.10
	12H	12.67	13.04	13.76	14.13	15.59	12.22	12.59	13.31	13.68	15.14
8H	4H	12.12	12.53	13.20	13.61	15.07	11.74	12.16	12.82	13.24	14.69
	6H	12.75	13.10	13.85	14.22	15.67	12.37	12.71	13.47	13.83	15.28
	8H	12.98	13.28	14.08	14.38	15.85	12.58	12.88	13.69	13.99	15.46
	12H	13.11	13.37	14.22	14.47	15.98	12.70	12.96	13.81	14.06	15.57
12H	4H	12.10	12.48	13.20	13.57	15.03	11.74	12.11	12.83	13.20	14.66
	6H	12.78	13.08	13.89	14.19	15.66	12.41	12.71	13.52	13.81	15.29
	8H	13.03	13.29	14.14	14.39	15.90	12.65	12.91	13.76	14.01	15.52

END OF REPORT