

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P917818

Luminaire Tested: DFN2DIP-SQ4F0-120D120US930-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P917818
REPORT IS A COMBINATION OF REPORTS P900180 AND P896915
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-120D120US930-RLLFLL
Description: 4 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 16974.5 lumens
Efficiency: N/A
Efficacy: 81.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 207.7
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9933
Total Harmonic Distortion (THDi): 0.066
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P917818

CATALOG NUMBER: DFN2DIP-SQ4F0-120D120US930-RLLFLL

Luminous Intensity Polar Plot

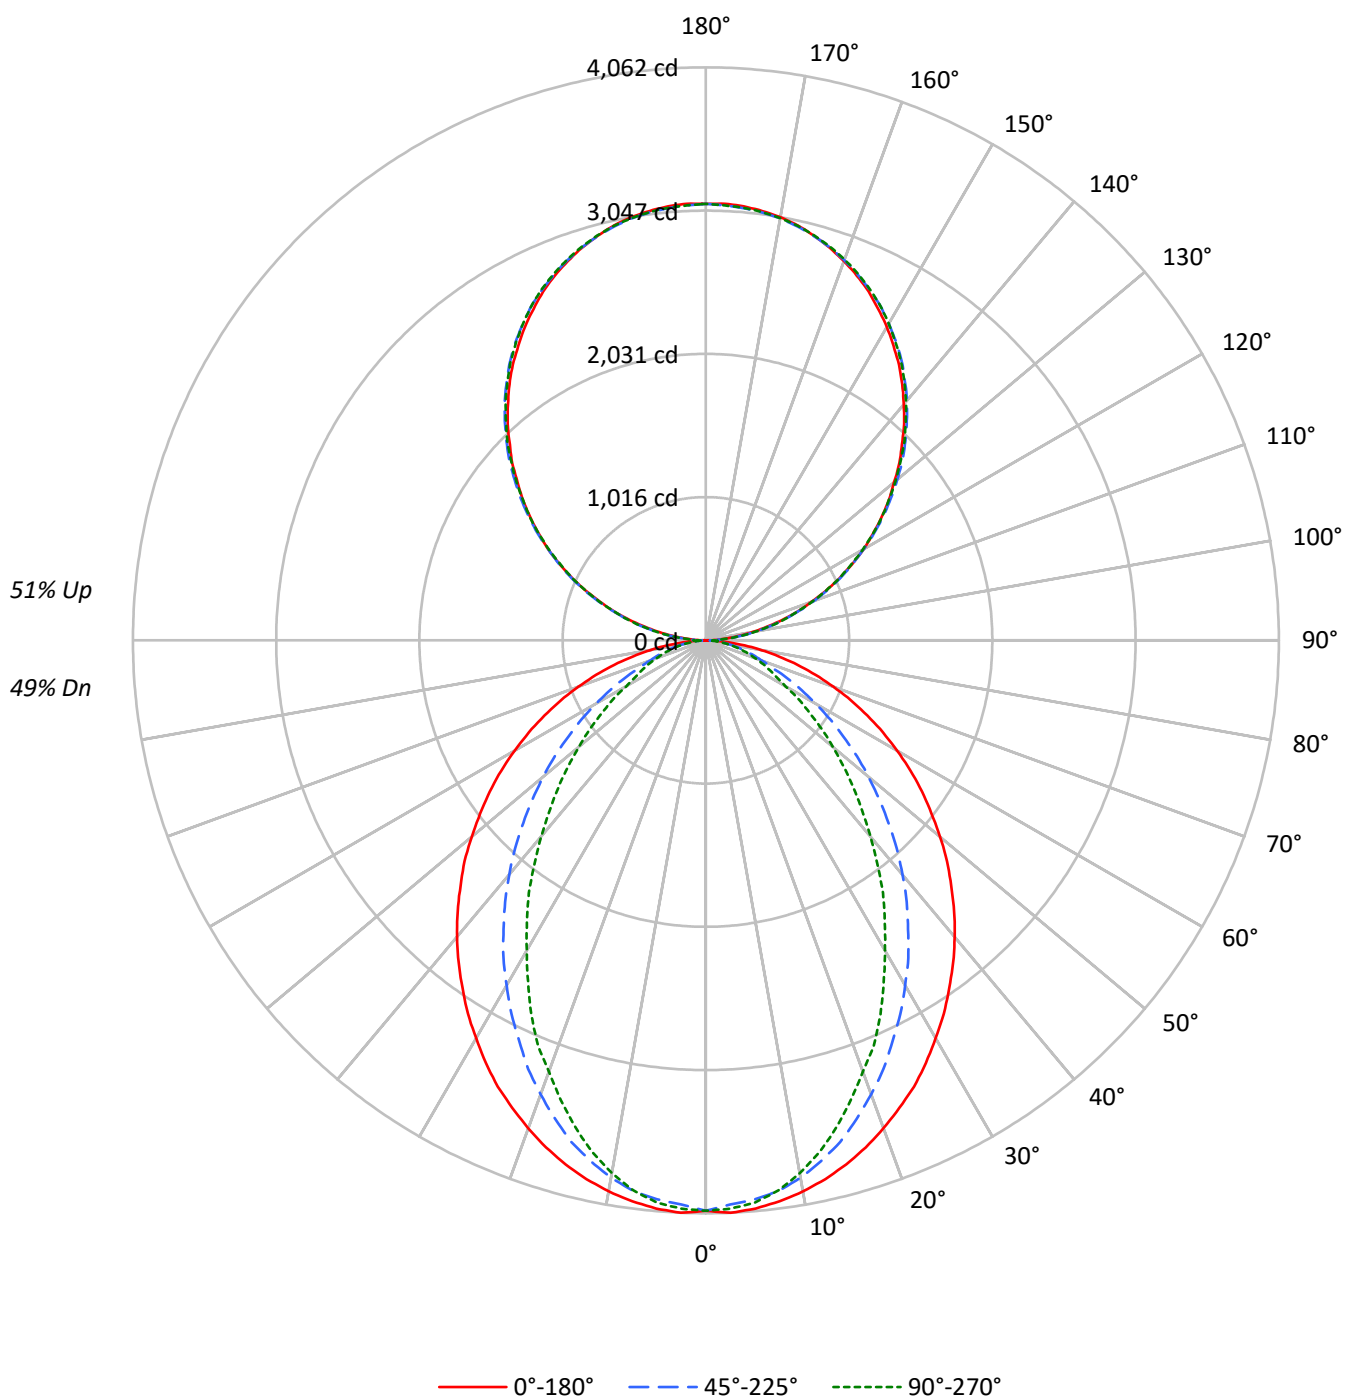

TEST NUMBER: P917818

CATALOG NUMBER: DFN2DIP-SQ4F0-120D120US930-RLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	68	68	68	55	55	55
1	98	94	90	87	90	87	84	81	73	71	69	61	59	58	50	49	48
2	90	83	77	72	82	76	71	67	65	61	58	54	51	49	44	42	41
3	82	73	66	60	75	68	61	57	58	53	49	48	45	42	40	37	35
4	75	65	57	51	69	60	54	48	51	46	42	43	40	36	36	33	31
5	69	58	50	44	64	54	47	42	46	41	37	39	35	32	32	29	27
6	64	52	44	39	59	49	42	37	42	36	32	35	31	28	30	26	24
7	59	47	40	34	55	44	37	32	38	33	29	32	28	25	27	24	22
8	55	43	36	30	51	40	33	29	35	29	26	30	26	23	25	22	20
9	51	39	32	27	47	37	30	26	32	27	23	27	23	20	23	20	18
10	48	36	29	24	44	34	28	23	30	24	21	25	21	19	22	18	16

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2837	2837	2837
5°	2842	2793	2811
10°	2814	2739	2720
15°	2775	2649	2580
20°	2724	2524	2407
25°	2671	2385	2240
30°	2601	2242	2028
35°	2531	2088	1841
40°	2461	1929	1628
45°	2379	1752	1434
50°	2295	1574	1245
55°	2207	1383	1063
60°	2105	1184	876
65°	1987	981	789
70°	1845	792	715
75°	1666	700	652
80°	1408	589	569
85°	980	396	433

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2435 cd/sqm

TEST NUMBER: P917818

CATALOG NUMBER: DFN2DIP-SQ4F0-120D120US930-RLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	379.0	2.2
10°-20°	1040.3	6.1
20°-30°	1460.6	8.6
30°-40°	1592.1	9.4
40°-50°	1463.4	8.6
50°-60°	1149.2	6.8
60°-70°	748.0	4.4
70°-80°	385.1	2.3
80°-90°	107.1	0.6
90°-100°	191.5	1.1
100°-110°	608.3	3.6
110°-120°	1041.1	6.1
120°-130°	1369.2	8.1
130°-140°	1536.9	9.1
140°-150°	1507.1	8.9
150°-160°	1264.2	7.4
160°-170°	838.4	4.9
170°-180°	293.0	1.7
0°-30°	2879.9	17.0
0°-40°	4472.0	26.3
0°-60°	7084.6	41.7
0°-90°	8324.8	49.0
90°-120°	1840.9	10.8
90°-150°	6254.0	36.8
90°-180°	8650.0	51.0
0°-180°	16974.5	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4044	4044	4044	4044	4044	
5°	4044	4025	3978	4010	4000	383
15°	3846	3806	3681	3612	3575	1084
25°	3491	3374	3132	2982	2927	1606
35°	3008	2821	2500	2269	2188	1883
45°	2459	2214	1830	1570	1482	1899
55°	1870	1584	1189	970	900	1671
65°	1263	966	637	512	501	1252
75°	673	417	293	267	264	712
85°	157	80	70	70	70	181
90°	3	34	91	86	89	17
95°	136	162	167	167	162	152
105°	562	569	575	579	579	593
115°	1045	1060	1055	1052	1045	1033
125°	1520	1543	1536	1527	1524	1358
135°	1965	1994	2000	1997	1990	1519
145°	2386	2405	2420	2423	2412	1491
155°	2728	2736	2744	2757	2749	1256
165°	2968	2966	2966	2984	2971	837
175°	3089	3081	3076	3094	3078	293
180°	3094	3094	3094	3094	3094	



TEST NUMBER: P917818

CATALOG NUMBER: DFN2DIP-SQ4F0-120D120US930-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4043.6	4043.6	4043.6	4043.6	4043.6
2.5°	4061.8	4043.6	4003.2	4040.0	4032.6
5°	4043.6	4025.3	3977.5	4010.5	3999.7
7.5°	4010.5	3988.8	3937.6	3951.9	3933.7
10°	3966.7	3941.1	3868.0	3856.8	3835.1
12.5°	3911.9	3878.9	3779.9	3758.2	3717.8
15°	3845.9	3805.6	3681.3	3611.8	3575.3
17.5°	3769.0	3710.4	3556.7	3476.4	3417.7
20°	3681.3	3607.9	3425.1	3333.8	3253.0
22.5°	3586.2	3502.0	3289.6	3165.3	3110.6
25°	3491.1	3373.8	3132.3	2982.4	2927.3
27.5°	3377.7	3253.0	2985.9	2814.0	2729.7
30°	3257.0	3117.6	2824.8	2638.5	2539.5
32.5°	3139.7	2971.2	2671.5	2451.8	2360.1
35°	3008.1	2821.3	2499.5	2268.9	2188.1
37.5°	2880.0	2678.5	2338.4	2085.6	1994.4
40°	2744.5	2525.1	2169.9	1910.2	1815.0
42.5°	2605.4	2371.4	2001.8	1730.8	1639.6
45°	2459.1	2213.8	1829.8	1569.7	1481.9
47.5°	2320.1	2060.4	1665.2	1405.1	1324.7
50°	2166.4	1906.7	1504.1	1251.3	1174.8
52.5°	2016.2	1741.6	1350.3	1108.8	1039.3
55°	1869.8	1584.5	1189.2	969.8	900.3
57.5°	1719.9	1427.2	1046.7	841.7	783.1
60°	1566.2	1273.4	896.4	710.1	651.5
62.5°	1416.3	1123.6	768.3	592.9	563.7
65°	1262.6	966.0	636.7	512.5	501.2
67.5°	1116.2	819.5	512.5	450.0	439.1
70°	962.5	677.1	424.4	387.8	373.1
72.5°	816.1	545.1	354.8	325.7	318.4
75°	673.2	416.9	292.8	267.1	263.6
77.5°	530.8	296.2	230.6	215.9	208.5
80°	398.8	212.4	175.5	161.1	161.1
82.5°	278.0	142.8	120.7	113.3	113.3
85°	157.3	80.4	69.5	69.5	69.5
87.5°	58.6	29.1	29.1	25.6	25.6
90°	2.8	33.6	91.4	85.9	88.6
92.5°	57.8	78.4	81.1	84.0	84.0
95°	136.2	162.3	167.0	167.0	162.3
97.5°	226.7	250.9	261.2	261.2	261.2
100°	331.2	352.6	360.0	360.0	357.3
102.5°	441.2	457.1	467.3	470.2	467.3
105°	561.6	569.0	574.6	579.3	579.3
107.5°	680.9	692.2	692.2	694.0	680.9
110°	796.6	811.5	811.5	811.5	804.1

TEST NUMBER: P917818

CATALOG NUMBER: DFN2DIP-SQ4F0-120D120US930-RLFL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	921.6	937.5	934.7	927.2	921.6
115°	1044.7	1059.7	1055.0	1052.2	1044.7
117.5°	1166.9	1187.5	1174.4	1166.9	1159.5
120°	1290.1	1310.6	1290.1	1290.1	1281.7
122.5°	1402.1	1428.2	1415.1	1407.6	1402.1
125°	1519.6	1542.9	1535.5	1527.1	1524.2
127.5°	1634.3	1663.2	1652.9	1641.8	1634.3
130°	1741.6	1775.1	1770.5	1764.9	1754.6
132.5°	1861.9	1888.1	1889.9	1876.8	1869.4
135°	1965.4	1994.4	2000.0	1997.2	1989.7
137.5°	2081.1	2104.4	2109.1	2107.2	2096.1
140°	2182.8	2206.1	2219.2	2219.2	2208.9
142.5°	2287.3	2310.6	2318.1	2320.8	2310.6
145°	2386.1	2404.8	2419.7	2422.6	2412.3
147.5°	2474.8	2498.1	2509.3	2514.0	2503.7
150°	2566.2	2582.0	2592.3	2600.7	2592.3
152.5°	2647.4	2663.2	2676.3	2686.6	2676.3
155°	2728.5	2736.0	2744.4	2757.4	2749.0
157.5°	2798.5	2804.1	2808.7	2827.4	2814.3
160°	2861.0	2866.6	2869.4	2885.3	2874.0
162.5°	2918.8	2918.8	2921.6	2939.3	2926.3
165°	2968.3	2965.5	2965.5	2984.1	2971.0
167.5°	3013.0	3004.6	3004.6	3023.3	3010.2
170°	3046.6	3039.1	3036.3	3055.0	3039.1
172.5°	3069.9	3062.4	3059.7	3078.3	3062.4
175°	3088.6	3081.1	3075.5	3094.1	3078.3
177.5°	3098.9	3091.4	3085.7	3101.6	3085.7
180°	3094.1	3094.1	3094.1	3094.1	3094.1

TEST NUMBER: P917818

CATALOG NUMBER: DFN2DIP-SQ4F0-120D120US930-RLFL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.69	11.51	11.66	12.49	13.78	6.65	7.47	7.62	8.46	9.74
	3H	12.37	13.11	13.36	14.10	15.41	7.84	8.58	8.82	9.57	10.88
	4H	12.98	13.68	13.98	14.67	15.99	8.29	8.99	9.29	9.98	11.30
	6H	13.41	14.05	14.42	15.05	16.38	8.61	9.25	9.62	10.25	11.58
	8H	13.54	14.15	14.55	15.16	16.49	8.70	9.31	9.72	10.33	11.65
	12H	13.60	14.18	14.62	15.19	16.54	8.75	9.32	9.76	10.33	11.68
4H	2H	10.71	11.40	11.71	12.40	13.72	7.25	7.94	8.25	8.94	10.26
	3H	12.54	13.12	13.55	14.14	15.47	8.60	9.18	9.61	10.20	11.53
	4H	13.24	13.76	14.26	14.78	16.14	9.15	9.68	10.17	10.69	12.05
	6H	13.76	14.21	14.79	15.25	16.60	9.57	10.02	10.60	11.06	12.41
	8H	13.93	14.36	14.96	15.39	16.75	9.70	10.12	10.73	11.15	12.52
	12H	14.03	14.41	15.08	15.46	16.83	9.76	10.14	10.81	11.19	12.56
8H	4H	13.20	13.63	14.23	14.66	16.03	9.43	9.85	10.46	10.88	12.25
	6H	13.77	14.12	14.83	15.20	16.56	9.95	10.30	11.00	11.37	12.74
	8H	13.99	14.30	15.06	15.36	16.74	10.14	10.45	11.20	11.51	12.89
	12H	14.14	14.41	15.20	15.46	16.88	10.26	10.53	11.32	11.58	13.01
12H	4H	13.16	13.54	14.20	14.58	15.96	9.43	9.82	10.48	10.86	12.23
	6H	13.75	14.06	14.81	15.12	16.50	10.00	10.31	11.06	11.37	12.75
	8H	13.97	14.24	15.04	15.30	16.72	10.21	10.48	11.27	11.53	12.96

END OF REPORT