

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P917866

Luminaire Tested: DFN2DIP-SQ4F0-160D060US930-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P917866
REPORT IS A COMBINATION OF REPORTS P900076 AND P896915
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-160D060US930-RLLFLL
Description: 4 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 15417.3 lumens
Efficiency: N/A
Efficacy: 72.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 211.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P917866

CATALOG NUMBER: DFN2DIP-SQ4F0-160D060US930-RLLFLL

Luminous Intensity Polar Plot

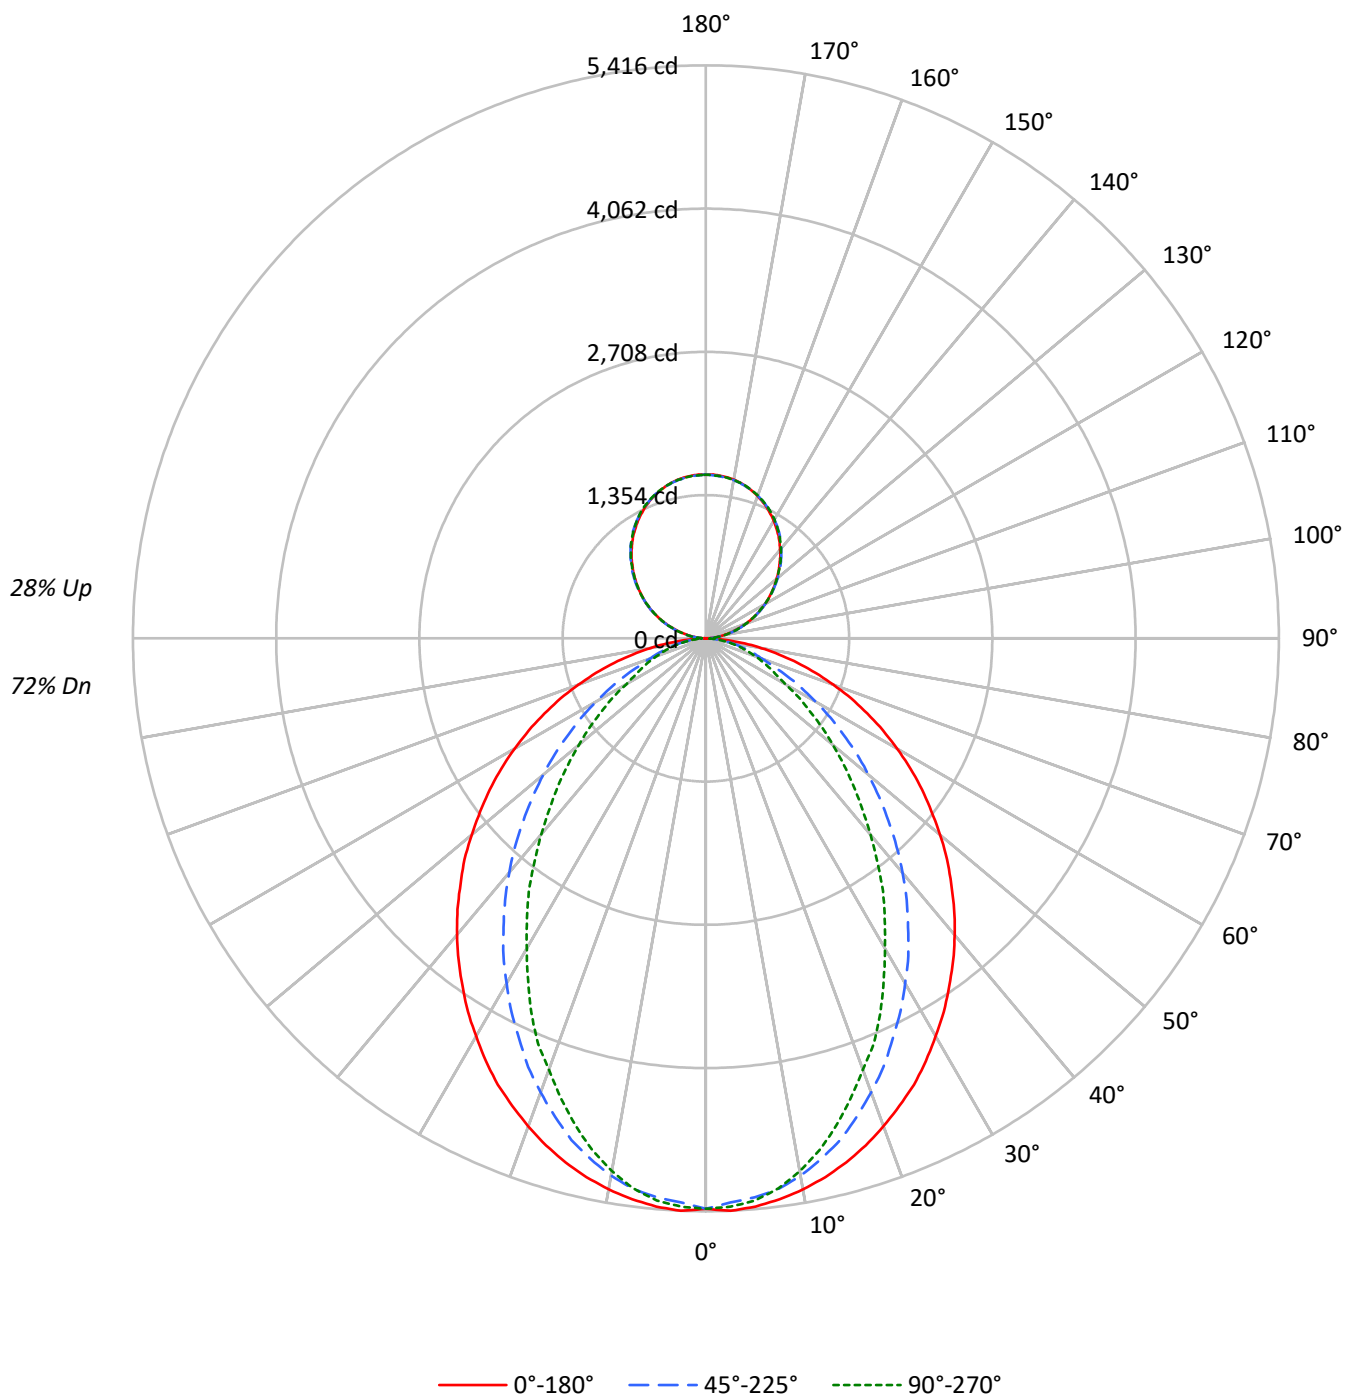

TEST NUMBER: P917866

CATALOG NUMBER: DFN2DIP-SQ4F0-160D060US930-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	112	112	112	112	106	106	106	106	96	96	96	85	85	85	76	76	76
1	103	99	95	92	98	94	91	88	85	82	80	76	75	73	69	67	66
2	95	87	81	76	90	83	78	73	75	71	67	68	65	62	61	59	57
3	87	78	70	65	82	74	67	62	67	62	58	61	57	53	55	52	49
4	80	69	61	55	76	66	59	53	60	54	50	55	50	46	50	46	43
5	74	62	54	48	70	59	52	47	54	48	44	49	45	41	45	41	38
6	68	56	48	42	65	54	46	41	49	43	39	45	40	36	41	37	34
7	63	51	43	38	60	49	42	36	45	39	34	41	36	32	38	33	30
8	59	47	39	34	56	45	38	33	41	35	31	38	33	29	35	31	27
9	55	43	35	30	52	41	34	30	38	32	28	35	30	26	32	28	25
10	52	40	32	28	49	38	31	27	35	29	25	33	28	24	30	26	23

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3783	3783	3783
5°	3789	3724	3748
10°	3751	3651	3627
15°	3700	3531	3439
20°	3631	3366	3209
25°	3561	3180	2986
30°	3467	2989	2704
35°	3375	2784	2455
40°	3282	2572	2170
45°	3173	2337	1912
50°	3060	2099	1659
55°	2942	1845	1417
60°	2806	1579	1167
65°	2650	1308	1052
70°	2460	1056	954
75°	2222	932	870
80°	1877	785	758
85°	1306	528	578

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3173 cd/sqm

TEST NUMBER: P917866

CATALOG NUMBER: DFN2DIP-SQ4F0-160D060US930-RLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	505.3	3.3
10°-20°	1387.1	9.0
20°-30°	1947.5	12.6
30°-40°	2122.9	13.8
40°-50°	1951.1	12.7
50°-60°	1532.3	9.9
60°-70°	997.4	6.5
70°-80°	513.4	3.3
80°-90°	135.5	0.9
90°-100°	95.7	0.6
100°-110°	304.2	2.0
110°-120°	520.6	3.4
120°-130°	684.6	4.4
130°-140°	768.4	5.0
140°-150°	753.5	4.9
150°-160°	632.1	4.1
160°-170°	419.2	2.7
170°-180°	146.5	1.0
0°-30°	3839.9	24.9
0°-40°	5962.7	38.7
0°-60°	9446.2	61.3
0°-90°	11092.4	71.9
90°-120°	920.5	6.0
90°-150°	3127.0	20.3
90°-180°	4325.0	28.1
0°-180°	15417.3	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	5391	5391	5391	5391	5391	
5°	5391	5367	5303	5347	5333	511
15°	5128	5074	4908	4816	4767	1445
25°	4655	4498	4176	3977	3903	2141
35°	4011	3762	3333	3025	2918	2510
45°	3279	2952	2440	2093	1976	2532
55°	2493	2112	1586	1293	1200	2228
65°	1683	1288	849	683	668	1669
75°	898	556	390	356	352	949
85°	210	107	93	93	93	241
90°	1	17	46	43	44	15
95°	68	81	84	84	81	76
105°	281	284	287	290	290	296
115°	522	530	528	526	522	517
125°	760	771	768	764	762	679
135°	983	997	1000	999	995	760
145°	1193	1202	1210	1211	1206	745
155°	1364	1368	1372	1379	1374	628
165°	1484	1483	1483	1492	1486	419
175°	1544	1541	1538	1547	1539	147
180°	1547	1547	1547	1547	1547	

TEST NUMBER: P917866

CATALOG NUMBER: DFN2DIP-SQ4F0-160D060US930-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	5391.4	5391.4	5391.4	5391.4	5391.4
2.5°	5415.7	5391.4	5337.5	5386.8	5376.9
5°	5391.4	5367.0	5303.4	5347.4	5332.9
7.5°	5347.4	5318.4	5250.0	5269.2	5244.9
10°	5288.9	5254.8	5157.4	5142.4	5113.4
12.5°	5215.9	5171.9	5039.9	5010.9	4957.1
15°	5127.9	5074.1	4908.4	4815.7	4767.0
17.5°	5025.4	4947.2	4742.3	4635.1	4556.9
20°	4908.4	4810.6	4566.7	4445.1	4337.5
22.5°	4781.6	4669.2	4386.1	4220.5	4147.4
25°	4654.8	4498.4	4176.4	3976.6	3903.2
27.5°	4503.6	4337.5	3981.3	3752.0	3639.7
30°	4342.6	4156.8	3766.4	3518.0	3386.0
32.5°	4186.3	3961.6	3562.0	3269.0	3146.8
35°	4010.8	3761.8	3332.7	3025.2	2917.5
37.5°	3840.0	3571.3	3117.9	2780.8	2659.2
40°	3659.3	3366.9	2893.2	2546.8	2420.0
42.5°	3474.0	3161.8	2669.0	2307.7	2186.1
45°	3278.8	2951.7	2439.7	2092.9	1975.9
47.5°	3093.5	2747.2	2220.2	1873.4	1766.3
50°	2888.5	2542.2	2005.4	1668.4	1566.4
52.5°	2688.2	2322.2	1800.4	1478.5	1385.8
55°	2493.0	2112.5	1585.6	1293.1	1200.4
57.5°	2293.2	1902.9	1395.6	1122.3	1044.1
60°	2088.2	1697.9	1195.2	946.8	868.6
62.5°	1888.4	1498.1	1024.4	790.4	751.6
65°	1683.4	1287.9	849.0	683.3	668.3
67.5°	1488.2	1092.7	683.3	600.0	585.5
70°	1283.3	902.8	565.8	517.1	497.5
72.5°	1088.1	726.8	473.1	434.3	424.4
75°	897.6	556.0	390.3	356.1	351.5
77.5°	707.6	394.9	307.4	287.8	278.0
80°	531.7	283.2	234.0	214.8	214.8
82.5°	370.6	190.5	161.0	151.2	151.2
85°	209.6	107.1	92.7	92.7	92.7
87.5°	78.2	38.8	38.8	34.2	34.2
90°	1.4	16.8	45.7	42.9	44.3
92.5°	28.9	39.2	40.6	42.0	42.0
95°	68.1	81.1	83.5	83.5	81.1
97.5°	113.3	125.5	130.6	130.6	130.6
100°	165.6	176.3	180.0	180.0	178.6
102.5°	220.6	228.5	233.7	235.1	233.7
105°	280.8	284.5	287.3	289.7	289.7
107.5°	340.5	346.1	346.1	347.0	340.5
110°	398.4	405.8	405.8	405.8	402.0



TEST NUMBER: P917866

CATALOG NUMBER: DFN2DIP-SQ4F0-160D060US930-RLFL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	460.8	468.7	467.3	463.6	460.8
115°	522.4	529.9	527.5	526.1	522.4
117.5°	583.5	593.8	587.2	583.5	579.8
120°	645.1	655.3	645.1	645.1	640.8
122.5°	701.0	714.0	707.5	703.8	701.0
125°	759.8	771.4	767.7	763.5	762.1
127.5°	817.2	831.6	826.5	820.9	817.2
130°	870.8	887.6	885.3	882.5	877.3
132.5°	931.0	944.0	944.9	938.4	934.7
135°	982.8	997.2	1000.0	998.6	994.8
137.5°	1040.6	1052.2	1054.6	1053.6	1048.1
140°	1091.4	1103.1	1109.6	1109.6	1104.5
142.5°	1143.6	1155.3	1159.0	1160.4	1155.3
145°	1193.1	1202.4	1209.9	1211.3	1206.2
147.5°	1237.4	1249.0	1254.7	1256.9	1251.8
150°	1283.1	1291.0	1296.2	1300.3	1296.2
152.5°	1323.6	1331.6	1338.1	1343.3	1338.1
155°	1364.2	1368.0	1372.1	1378.8	1374.5
157.5°	1399.2	1402.1	1404.4	1413.7	1407.2
160°	1430.5	1433.3	1434.7	1442.6	1437.0
162.5°	1459.4	1459.4	1460.8	1469.7	1463.1
165°	1484.1	1482.7	1482.7	1492.1	1485.6
167.5°	1506.5	1502.4	1502.4	1511.6	1505.1
170°	1523.3	1519.6	1518.2	1527.5	1519.6
172.5°	1535.0	1531.2	1529.8	1539.1	1531.2
175°	1544.3	1540.6	1537.7	1547.1	1539.1
177.5°	1549.4	1545.7	1542.9	1550.8	1542.9
180°	1547.1	1547.1	1547.1	1547.1	1547.1

TEST NUMBER: P917866

CATALOG NUMBER: DFN2DIP-SQ4F0-160D060US930-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.63	14.67	14.38	15.44	16.36	9.59	10.63	10.34	11.40	12.32
	3H	15.32	16.26	16.09	17.04	17.99	10.79	11.73	11.56	12.51	13.46
	4H	15.95	16.83	16.73	17.61	18.58	11.25	12.14	12.03	12.92	13.89
	6H	16.38	17.20	17.18	17.99	18.97	11.58	12.40	12.38	13.19	14.17
	8H	16.52	17.29	17.32	18.10	19.08	11.68	12.46	12.49	13.27	14.25
	12H	16.59	17.32	17.40	18.13	19.14	11.73	12.47	12.54	13.28	14.28
4H	2H	13.67	14.55	14.46	15.34	16.30	10.21	11.09	11.00	11.88	12.84
	3H	15.52	16.26	16.32	17.08	18.06	11.58	12.31	12.38	13.13	14.12
	4H	16.23	16.89	17.04	17.71	18.72	12.14	12.80	12.95	13.62	14.63
	6H	16.76	17.33	17.59	18.18	19.19	12.57	13.14	13.40	13.99	15.00
	8H	16.94	17.48	17.77	18.32	19.34	12.70	13.24	13.54	14.08	15.11
	12H	17.05	17.53	17.90	18.39	19.42	12.78	13.26	13.63	14.12	15.15
8H	4H	16.21	16.75	17.04	17.59	18.61	12.44	12.97	13.27	13.81	14.84
	6H	16.79	17.23	17.65	18.11	19.14	12.96	13.41	13.82	14.29	15.32
	8H	17.01	17.40	17.88	18.28	19.33	13.16	13.55	14.03	14.43	15.47
	12H	17.16	17.51	18.03	18.38	19.48	13.29	13.63	14.16	14.50	15.60
12H	4H	16.17	16.66	17.02	17.52	18.55	12.45	12.93	13.30	13.79	14.83
	6H	16.77	17.16	17.64	18.04	19.08	13.01	13.41	13.89	14.29	15.33
	8H	17.00	17.35	17.87	18.21	19.31	13.24	13.58	14.11	14.45	15.55

END OF REPORT