

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P920309

Luminaire Tested: DFN2DIP-SQ4F0-060D070US935-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P920309
REPORT IS A COMBINATION OF REPORTS P901597 AND P898471
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-060D070US935-FLLONL
Description: 4 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 11081.1 lumens
Efficiency: N/A
Efficacy: 108.4 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 102.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.946
Total Harmonic Distortion (THDi): 0.132
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P920309

CATALOG NUMBER: DFN2DIP-SQ4F0-060D070US935-FLLONL

Luminous Intensity Polar Plot

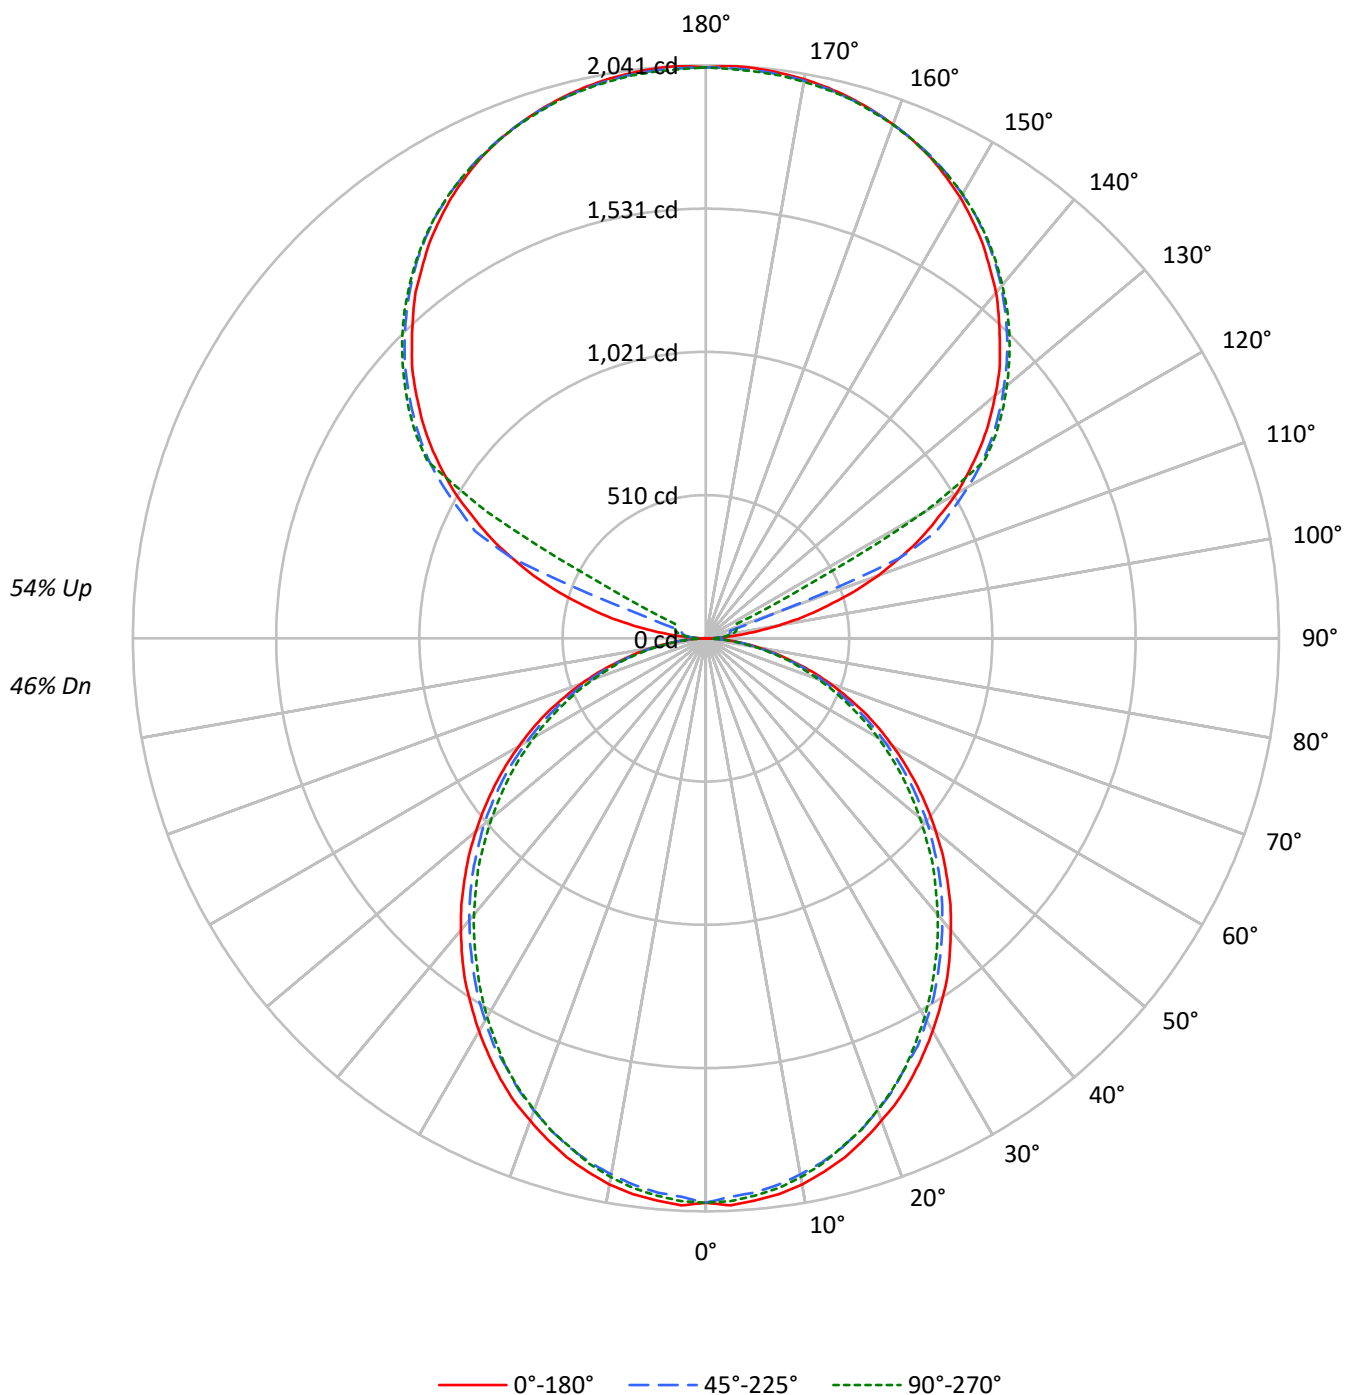

TEST NUMBER: P920309

CATALOG NUMBER: DFN2DIP-SQ4F0-060D070US935-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	98	98	98	98	81	81	81	66	66	66	53	53	53
1	97	93	89	85	89	85	82	79	71	69	67	58	57	55	46	45	44
2	88	81	75	70	81	74	69	65	62	59	55	51	48	46	41	39	37
3	81	71	64	58	74	66	59	54	55	50	46	45	42	39	36	34	32
4	74	63	55	49	67	58	51	46	49	44	40	40	37	33	32	30	27
5	68	56	48	42	62	52	45	39	44	38	34	36	32	29	29	26	24
6	62	50	42	36	57	46	39	34	39	34	30	33	29	25	26	23	21
7	58	45	37	32	53	42	35	30	36	30	26	30	26	22	24	21	19
8	53	41	33	28	49	38	31	26	33	27	23	27	23	20	22	19	17
9	50	38	30	25	46	35	28	24	30	24	21	25	21	18	21	17	15
10	46	34	27	22	43	32	26	21	27	22	19	23	19	16	19	16	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1410	1410	1410
5°	1413	1391	1401
10°	1401	1373	1382
15°	1381	1350	1353
20°	1353	1319	1323
25°	1325	1282	1288
30°	1290	1247	1244
35°	1257	1206	1197
40°	1217	1165	1153
45°	1177	1124	1107
50°	1132	1080	1055
55°	1086	1030	1006
60°	1034	970	951
65°	977	909	885
70°	904	833	815
75°	803	743	751
80°	683	629	628
85°	493	430	422

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1177 cd/sqm

TEST NUMBER: P920309

CATALOG NUMBER: DFN2DIP-SQ4F0-060D070US935-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	189.2	1.7
10°-20°	532.3	4.8
20°-30°	782.3	7.1
30°-40°	908.6	8.2
40°-50°	907.5	8.2
50°-60°	791.3	7.1
60°-70°	584.9	5.3
70°-80°	330.9	3.0
80°-90°	90.9	0.8
90°-100°	67.1	0.6
100°-110°	250.0	2.3
110°-120°	663.1	6.0
120°-130°	1099.8	9.9
130°-140°	1168.3	10.5
140°-150°	1085.8	9.8
150°-160°	872.9	7.9
160°-170°	562.5	5.1
170°-180°	193.6	1.7
0°-30°	1503.8	13.6
0°-40°	2412.4	21.8
0°-60°	4111.1	37.1
0°-90°	5117.9	46.2
90°-120°	980.2	8.8
90°-150°	4334.1	39.1
90°-180°	5963.0	53.8
0°-180°	11081.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2010	2010	2010	2010	2010	
5°	2010	2002	1981	1997	1993	191
15°	1914	1902	1877	1885	1875	539
25°	1732	1716	1684	1687	1684	797
35°	1494	1475	1444	1432	1422	933
45°	1216	1202	1173	1152	1144	938
55°	920	908	885	862	852	823
65°	620	609	590	572	562	614
75°	325	321	311	300	304	347
85°	79	77	75	70	68	88
90°	1	18	29	37	40	10
95°	96	47	57	65	63	113
105°	448	492	90	106	112	478
115°	846	871	908	227	121	833
125°	1196	1216	1244	1254	1258	1067
135°	1481	1504	1517	1532	1529	1144
145°	1718	1716	1741	1751	1744	1074
155°	1891	1878	1896	1904	1893	872
165°	1993	1984	1988	1999	1988	563
175°	2038	2028	2031	2041	2027	194
180°	2034	2034	2034	2034	2034	

TEST NUMBER: P920309

CATALOG NUMBER: DFN2DIP-SQ4F0-060D070US935-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2010.1	2010.1	2010.1	2010.1	2010.1
2.5°	2021.8	2012.2	1990.8	2010.1	2006.4
5°	2010.1	2002.5	1981.2	1996.6	1992.9
7.5°	1996.6	1985.1	1963.8	1979.3	1975.5
10°	1975.5	1962.0	1938.7	1954.1	1948.4
12.5°	1946.4	1934.8	1911.7	1921.3	1917.4
15°	1913.5	1902.0	1876.8	1884.6	1875.0
17.5°	1872.9	1861.5	1836.3	1845.8	1836.3
20°	1828.4	1817.0	1789.8	1795.6	1788.0
22.5°	1784.2	1766.7	1741.5	1741.5	1737.6
25°	1731.8	1716.5	1683.6	1687.3	1683.6
27.5°	1673.8	1660.3	1635.2	1629.5	1619.9
30°	1616.0	1600.3	1571.5	1565.7	1557.9
32.5°	1554.0	1542.6	1511.6	1499.9	1492.1
35°	1494.2	1474.9	1443.9	1432.2	1422.5
37.5°	1426.5	1409.0	1378.1	1364.5	1354.9
40°	1356.9	1341.3	1310.4	1293.2	1285.4
42.5°	1289.3	1273.7	1242.9	1223.5	1211.9
45°	1215.9	1202.3	1173.2	1152.1	1144.3
47.5°	1144.3	1130.7	1099.8	1078.5	1066.9
50°	1068.8	1059.2	1032.2	1005.0	995.4
52.5°	995.4	981.9	956.8	935.6	922.0
55°	920.1	908.4	885.3	862.1	852.5
57.5°	844.7	835.1	809.9	786.7	778.9
60°	769.2	761.6	734.6	713.3	707.5
62.5°	695.8	682.3	663.0	643.7	635.9
65°	620.5	608.9	589.6	572.1	562.5
67.5°	543.2	533.4	516.2	502.7	494.8
70°	471.7	463.9	446.4	432.9	425.3
72.5°	398.2	390.5	380.8	367.3	361.5
75°	324.6	321.0	311.1	299.6	303.5
77.5°	259.0	251.2	247.3	241.6	235.8
80°	193.4	191.3	187.4	181.7	177.8
82.5°	131.5	131.5	129.6	121.8	121.8
85°	79.1	77.3	75.4	69.5	67.7
87.5°	34.9	31.0	27.0	21.4	19.3
90°	1.4	17.7	29.4	36.9	39.7
92.5°	36.9	30.9	35.3	38.3	39.7
95°	95.6	47.0	57.3	64.8	63.3
97.5°	172.1	51.6	75.0	79.6	80.9
100°	260.6	58.9	83.9	95.6	98.6
102.5°	357.6	354.8	86.9	103.0	107.5
105°	447.5	491.6	89.8	105.9	111.8
107.5°	551.9	588.7	92.8	108.9	114.9
110°	652.1	682.9	257.6	110.5	116.2

TEST NUMBER: P920309

CATALOG NUMBER: DFN2DIP-SQ4F0-060D070US935-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	746.3	772.7	747.7	113.2	117.8
115°	846.3	871.2	908.1	226.7	120.8
117.5°	933.1	962.5	987.7	777.1	391.5
120°	1030.3	1052.3	1078.9	1096.6	897.8
122.5°	1112.6	1136.2	1165.8	1174.5	1176.0
125°	1196.5	1215.7	1243.7	1254.0	1258.3
127.5°	1273.1	1293.6	1315.9	1330.6	1332.0
130°	1345.2	1368.8	1384.9	1401.2	1399.8
132.5°	1418.8	1438.0	1454.1	1467.4	1466.0
135°	1480.7	1504.2	1517.4	1532.2	1529.3
137.5°	1545.3	1563.1	1577.9	1592.6	1588.2
140°	1608.6	1620.5	1636.6	1649.8	1642.5
142.5°	1661.7	1672.1	1691.1	1702.8	1695.5
145°	1717.7	1716.1	1741.1	1751.4	1744.1
147.5°	1766.1	1761.8	1786.7	1794.1	1788.3
150°	1813.3	1803.0	1826.6	1835.3	1828.0
152.5°	1853.0	1841.2	1863.3	1872.2	1861.9
155°	1891.3	1878.1	1895.7	1904.5	1892.8
157.5°	1922.2	1910.5	1923.7	1934.1	1922.2
160°	1948.8	1939.8	1948.8	1957.5	1947.1
162.5°	1972.2	1963.4	1970.7	1981.1	1967.8
165°	1992.8	1984.1	1988.4	1998.7	1988.4
167.5°	2009.1	2000.1	2004.7	2015.0	2001.7
170°	2022.3	2013.4	2016.4	2026.7	2013.4
172.5°	2031.1	2022.3	2025.3	2035.6	2022.3
175°	2038.4	2028.1	2031.1	2041.3	2026.7
177.5°	2041.3	2031.1	2032.6	2043.0	2029.6
180°	2034.0	2034.0	2034.0	2034.0	2034.0

TEST NUMBER: P920309

CATALOG NUMBER: DFN2DIP-SQ4F0-060D070US935-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.12	8.94	9.11	9.95	11.27	7.67	8.50	8.66	9.50	10.83
	3H	9.78	10.52	10.78	11.53	12.88	9.29	10.03	10.29	11.04	12.39
	4H	10.37	11.07	11.38	12.08	13.44	9.87	10.58	10.89	11.59	12.94
	6H	10.77	11.42	11.79	12.43	13.80	10.27	10.92	11.29	11.93	13.30
	8H	10.87	11.49	11.90	12.53	13.89	10.37	10.99	11.40	12.02	13.39
	12H	10.92	11.51	11.96	12.54	13.92	10.41	11.00	11.45	12.03	13.42
4H	2H	8.57	9.28	9.59	10.29	11.64	8.22	8.92	9.24	9.94	11.29
	3H	10.44	11.03	11.47	12.07	13.44	10.03	10.62	11.06	11.66	13.03
	4H	11.16	11.70	12.19	12.73	14.12	10.73	11.27	11.77	12.30	13.69
	6H	11.68	12.14	12.72	13.19	14.58	11.24	11.70	12.29	12.76	14.15
	8H	11.83	12.26	12.87	13.31	14.71	11.39	11.82	12.43	12.87	14.27
	12H	11.90	12.29	12.96	13.35	14.76	11.45	11.84	12.51	12.91	14.31
8H	4H	11.35	11.78	12.40	12.83	14.23	10.98	11.41	12.02	12.46	13.86
	6H	11.99	12.34	13.06	13.44	14.83	11.60	11.96	12.67	13.05	14.45
	8H	12.21	12.52	13.29	13.60	15.02	11.82	12.13	12.89	13.21	14.62
	12H	12.34	12.62	13.42	13.69	15.15	11.93	12.21	13.01	13.28	14.74
12H	4H	11.34	11.73	12.40	12.79	14.20	10.97	11.36	12.03	12.42	13.83
	6H	12.02	12.33	13.09	13.41	14.82	11.64	11.96	12.72	13.03	14.45
	8H	12.26	12.54	13.34	13.61	15.07	11.88	12.16	12.96	13.23	14.69

END OF REPORT