

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P920334

Luminaire Tested: DFN2DIP-SQ4F0-060D140US935-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P920334
REPORT IS A COMBINATION OF REPORTS P900186 AND P896915
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-060D140US935-RLLFLL
Description: 4 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 15058.8 lumens
Efficiency: N/A
Efficacy: 96.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 155.8
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.946
Total Harmonic Distortion (THDi): 0.132
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P920334

CATALOG NUMBER: DFN2DIP-SQ4F0-060D140US935-RLFL

Luminous Intensity Polar Plot

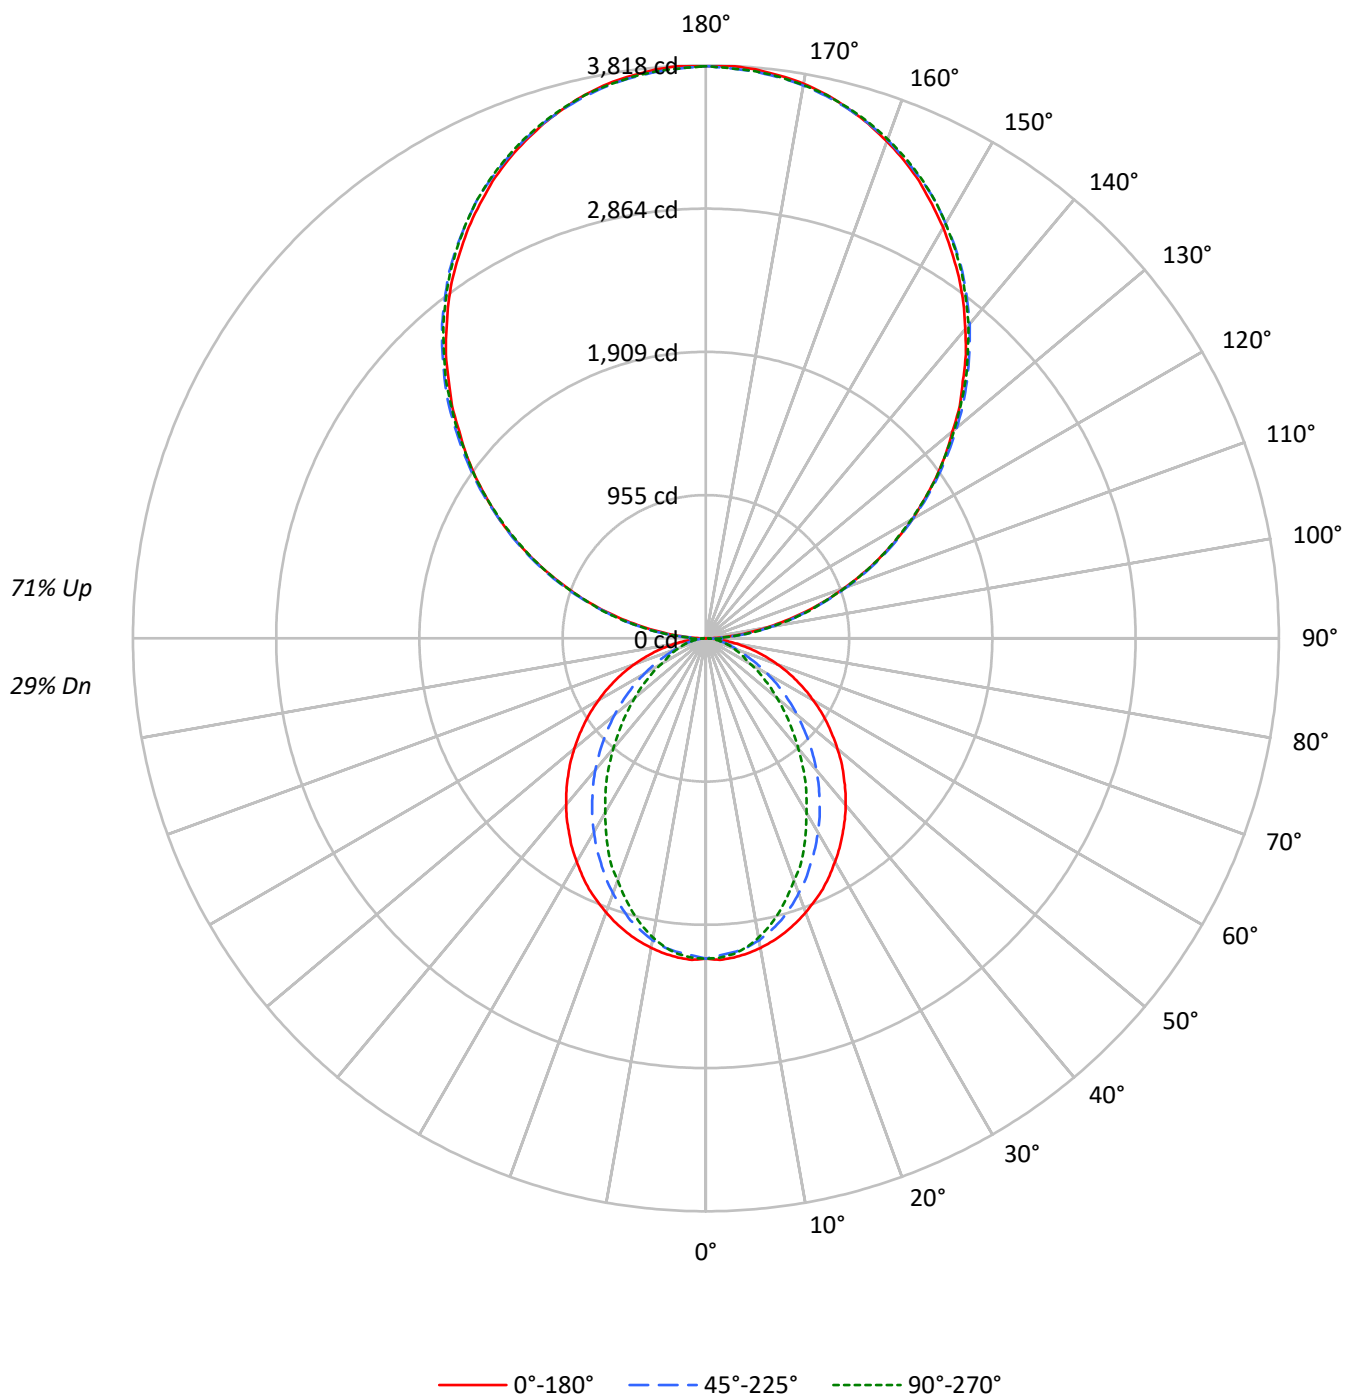

TEST NUMBER: P920334

CATALOG NUMBER: DFN2DIP-SQ4F0-060D140US935-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	102	102	102	102	92	92	92	92	72	72	72	54	54	54	37	37	37
1	93	89	86	82	84	80	77	74	63	61	59	48	46	45	33	32	32
2	85	78	72	68	76	70	66	61	56	52	49	42	40	38	29	28	27
3	78	69	62	57	70	62	56	52	49	45	42	37	35	32	26	25	23
4	71	61	54	48	64	55	49	44	44	39	36	33	30	28	24	22	20
5	65	54	47	41	59	49	43	38	39	35	31	30	27	24	21	19	18
6	60	49	41	36	54	44	38	33	35	31	27	27	24	21	20	17	16
7	56	44	36	31	50	40	33	29	32	27	24	25	21	19	18	16	14
8	52	40	33	27	46	36	30	25	29	24	21	23	19	17	16	14	13
9	48	36	29	24	43	33	27	23	27	22	19	21	18	15	15	13	12
10	45	33	26	22	40	30	24	20	25	20	17	19	16	14	14	12	11

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1498	1498	1498
5°	1501	1475	1484
10°	1486	1446	1436
15°	1465	1399	1362
20°	1438	1333	1271
25°	1410	1259	1183
30°	1373	1184	1071
35°	1337	1103	972
40°	1299	1019	859
45°	1256	925	757
50°	1212	831	657
55°	1165	730	561
60°	1111	625	462
65°	1049	518	417
70°	974	418	378
75°	880	369	345
80°	743	311	300
85°	517	209	229

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 3001 cd/sqm

TEST NUMBER: P920334

CATALOG NUMBER: DFN2DIP-SQ4F0-060D140US935-RLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	200.1	1.3
10°-20°	549.3	3.6
20°-30°	771.2	5.1
30°-40°	840.7	5.6
40°-50°	772.7	5.1
50°-60°	606.8	4.0
60°-70°	395.0	2.6
70°-80°	203.3	1.4
80°-90°	62.7	0.4
90°-100°	235.9	1.6
100°-110°	749.5	5.0
110°-120°	1282.7	8.5
120°-130°	1686.9	11.2
130°-140°	1893.5	12.6
140°-150°	1856.8	12.3
150°-160°	1557.6	10.3
160°-170°	1033.0	6.9
170°-180°	361.0	2.4
0°-30°	1520.7	10.1
0°-40°	2361.4	15.7
0°-60°	3740.9	24.8
0°-90°	4401.9	29.2
90°-120°	2268.1	15.1
90°-150°	7705.3	51.2
90°-180°	10657.0	70.8
0°-180°	15058.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2135	2135	2135	2135	2135	
5°	2135	2126	2100	2118	2112	202
15°	2031	2009	1944	1907	1888	572
25°	1843	1782	1654	1575	1546	848
35°	1588	1490	1320	1198	1155	994
45°	1298	1169	966	829	782	1003
55°	987	837	628	512	475	882
65°	667	510	336	271	265	661
75°	356	220	154	141	139	376
85°	83	42	37	37	37	95
90°	3	41	113	106	109	15
95°	168	200	206	206	200	187
105°	692	701	708	714	714	730
115°	1287	1306	1300	1296	1287	1273
125°	1872	1901	1892	1881	1878	1673
135°	2422	2457	2464	2461	2451	1872
145°	2940	2963	2981	2985	2972	1837
155°	3362	3371	3381	3397	3387	1547
165°	3657	3654	3654	3677	3660	1032
175°	3805	3796	3789	3812	3793	362
180°	3812	3812	3812	3812	3812	

TEST NUMBER: P920334

CATALOG NUMBER: DFN2DIP-SQ4F0-060D140US935-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2135.1	2135.1	2135.1	2135.1	2135.1
2.5°	2144.7	2135.1	2113.7	2133.2	2129.3
5°	2135.1	2125.5	2100.2	2117.7	2111.9
7.5°	2117.7	2106.2	2079.1	2086.7	2077.1
10°	2094.5	2080.9	2042.5	2036.5	2025.0
12.5°	2065.6	2048.1	1995.9	1984.4	1963.1
15°	2030.7	2009.4	1943.8	1907.1	1887.8
17.5°	1990.2	1959.2	1878.0	1835.6	1804.7
20°	1943.8	1905.0	1808.5	1760.3	1717.7
22.5°	1893.6	1849.1	1737.0	1671.4	1642.4
25°	1843.4	1781.5	1654.0	1574.9	1545.7
27.5°	1783.6	1717.7	1576.7	1485.8	1441.4
30°	1719.8	1646.1	1491.6	1393.2	1340.9
32.5°	1657.9	1568.9	1410.7	1294.6	1246.2
35°	1588.4	1489.8	1319.8	1198.0	1155.4
37.5°	1520.7	1414.3	1234.8	1101.3	1053.1
40°	1449.1	1333.3	1145.7	1008.6	958.4
42.5°	1375.8	1252.1	1057.0	913.9	865.7
45°	1298.5	1168.9	966.2	828.8	782.5
47.5°	1225.1	1088.0	879.3	741.9	699.5
50°	1143.9	1006.8	794.2	660.7	620.3
52.5°	1064.5	919.6	713.0	585.5	548.8
55°	987.3	836.6	627.9	512.1	475.4
57.5°	908.2	753.5	552.7	444.4	413.5
60°	827.0	672.4	473.4	375.0	344.0
62.5°	747.9	593.3	405.7	313.1	297.6
65°	666.7	510.1	336.2	270.6	264.7
67.5°	589.4	432.7	270.6	237.6	231.9
70°	508.2	357.5	224.0	204.8	197.0
72.5°	430.9	287.8	187.4	172.0	168.1
75°	355.5	220.2	154.5	141.0	139.2
77.5°	280.3	156.4	121.7	114.0	110.1
80°	210.5	112.1	92.6	85.1	85.1
82.5°	146.8	75.4	63.7	59.8	59.8
85°	83.0	42.4	36.7	36.7	36.7
87.5°	31.0	15.4	15.4	13.5	13.5
90°	3.4	41.4	112.6	105.7	109.2
92.5°	71.3	96.5	100.0	103.4	103.4
95°	167.8	200.0	205.7	205.7	200.0
97.5°	279.3	309.2	321.8	321.8	321.8
100°	408.0	434.5	443.6	443.6	440.1
102.5°	543.6	563.2	575.8	579.3	575.8
105°	691.9	701.1	708.0	713.7	713.7
107.5°	839.0	852.8	852.8	855.1	839.0
110°	981.5	999.9	999.9	999.9	990.7

TEST NUMBER: P920334

CATALOG NUMBER: DFN2DIP-SQ4F0-060D140US935-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1135.5	1155.0	1151.6	1142.4	1135.5
115°	1287.2	1305.6	1299.8	1296.4	1287.2
117.5°	1437.8	1463.1	1447.0	1437.8	1428.6
120°	1589.5	1614.8	1589.5	1589.5	1579.2
122.5°	1727.4	1759.5	1743.5	1734.3	1727.4
125°	1872.2	1900.9	1891.7	1881.4	1877.9
127.5°	2013.5	2049.2	2036.5	2022.7	2013.5
130°	2145.7	2187.1	2181.3	2174.5	2161.8
132.5°	2294.0	2326.2	2328.5	2312.4	2303.2
135°	2421.6	2457.2	2464.1	2460.6	2451.4
137.5°	2564.1	2592.8	2598.6	2596.3	2582.5
140°	2689.3	2718.1	2734.2	2734.2	2721.5
142.5°	2818.0	2846.8	2856.0	2859.5	2846.8
145°	2939.9	2962.9	2981.3	2984.7	2972.1
147.5°	3049.1	3077.8	3091.6	3097.4	3084.7
150°	3161.7	3181.2	3193.9	3204.2	3193.9
152.5°	3261.7	3281.3	3297.4	3309.9	3297.4
155°	3361.7	3370.9	3381.2	3397.3	3387.0
157.5°	3447.9	3454.8	3460.5	3483.5	3467.4
160°	3524.9	3531.8	3535.3	3554.8	3540.9
162.5°	3596.1	3596.1	3599.6	3621.4	3605.3
165°	3657.1	3653.6	3653.6	3676.6	3660.5
167.5°	3712.2	3701.9	3701.9	3724.8	3708.7
170°	3753.6	3744.4	3740.9	3763.9	3744.4
172.5°	3782.4	3773.2	3769.7	3792.7	3773.2
175°	3805.4	3796.1	3789.3	3812.2	3792.7
177.5°	3817.9	3808.8	3801.9	3821.4	3801.9
180°	3812.2	3812.2	3812.2	3812.2	3812.2

TEST NUMBER: P920334

CATALOG NUMBER: DFN2DIP-SQ4F0-060D140US935-RLFL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	6.22	6.91	7.34	8.02	9.56	2.18	2.87	3.30	3.98	5.52
	3H	7.89	8.50	9.02	9.63	11.18	3.36	3.97	4.49	5.09	6.65
	4H	8.50	9.08	9.64	10.20	11.76	3.80	4.39	4.94	5.51	7.07
	6H	8.91	9.45	10.06	10.57	12.15	4.12	4.65	5.27	5.78	7.35
	8H	9.04	9.55	10.19	10.69	12.25	4.21	4.71	5.36	5.85	7.42
	12H	9.10	9.58	10.25	10.71	12.30	4.24	4.73	5.40	5.86	7.45
4H	2H	6.22	6.80	7.37	7.92	9.49	2.76	3.34	3.91	4.46	6.03
	3H	8.04	8.53	9.19	9.67	11.25	4.10	4.58	5.25	5.73	7.31
	4H	8.73	9.18	9.89	10.31	11.91	4.64	5.09	5.80	6.22	7.82
	6H	9.24	9.62	10.40	10.78	12.37	5.06	5.44	6.22	6.59	8.18
	8H	9.42	9.77	10.58	10.92	12.53	5.18	5.54	6.34	6.69	8.29
	12H	9.51	9.83	10.68	10.99	12.60	5.24	5.56	6.42	6.72	8.33
8H	4H	8.69	9.04	9.85	10.19	11.80	4.91	5.27	6.07	6.42	8.02
	6H	9.25	9.55	10.43	10.74	12.34	5.43	5.72	6.61	6.91	8.51
	8H	9.47	9.73	10.66	10.90	12.52	5.62	5.88	6.80	7.05	8.67
	12H	9.61	9.83	10.80	11.00	12.65	5.73	5.96	6.92	7.13	8.78
12H	4H	8.63	8.96	9.81	10.12	11.72	4.91	5.24	6.09	6.40	8.00
	6H	9.23	9.49	10.41	10.66	12.28	5.48	5.73	6.66	6.91	8.52
	8H	9.45	9.67	10.63	10.84	12.49	5.68	5.91	6.87	7.08	8.73

END OF REPORT