

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P920343

Luminaire Tested: DFN2DIP-SQ4F0-070D060US935-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P920343
REPORT IS A COMBINATION OF REPORTS P901582 AND P898471
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-070D060US935-RLONL
Description: 4 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10237.2 lumens
Efficiency: N/A
Efficacy: 96.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 106.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9967
Total Harmonic Distortion (THDi): 0.063
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P920343

CATALOG NUMBER: DFN2DIP-SQ4F0-070D060US935-RLLONL

Luminous Intensity Polar Plot

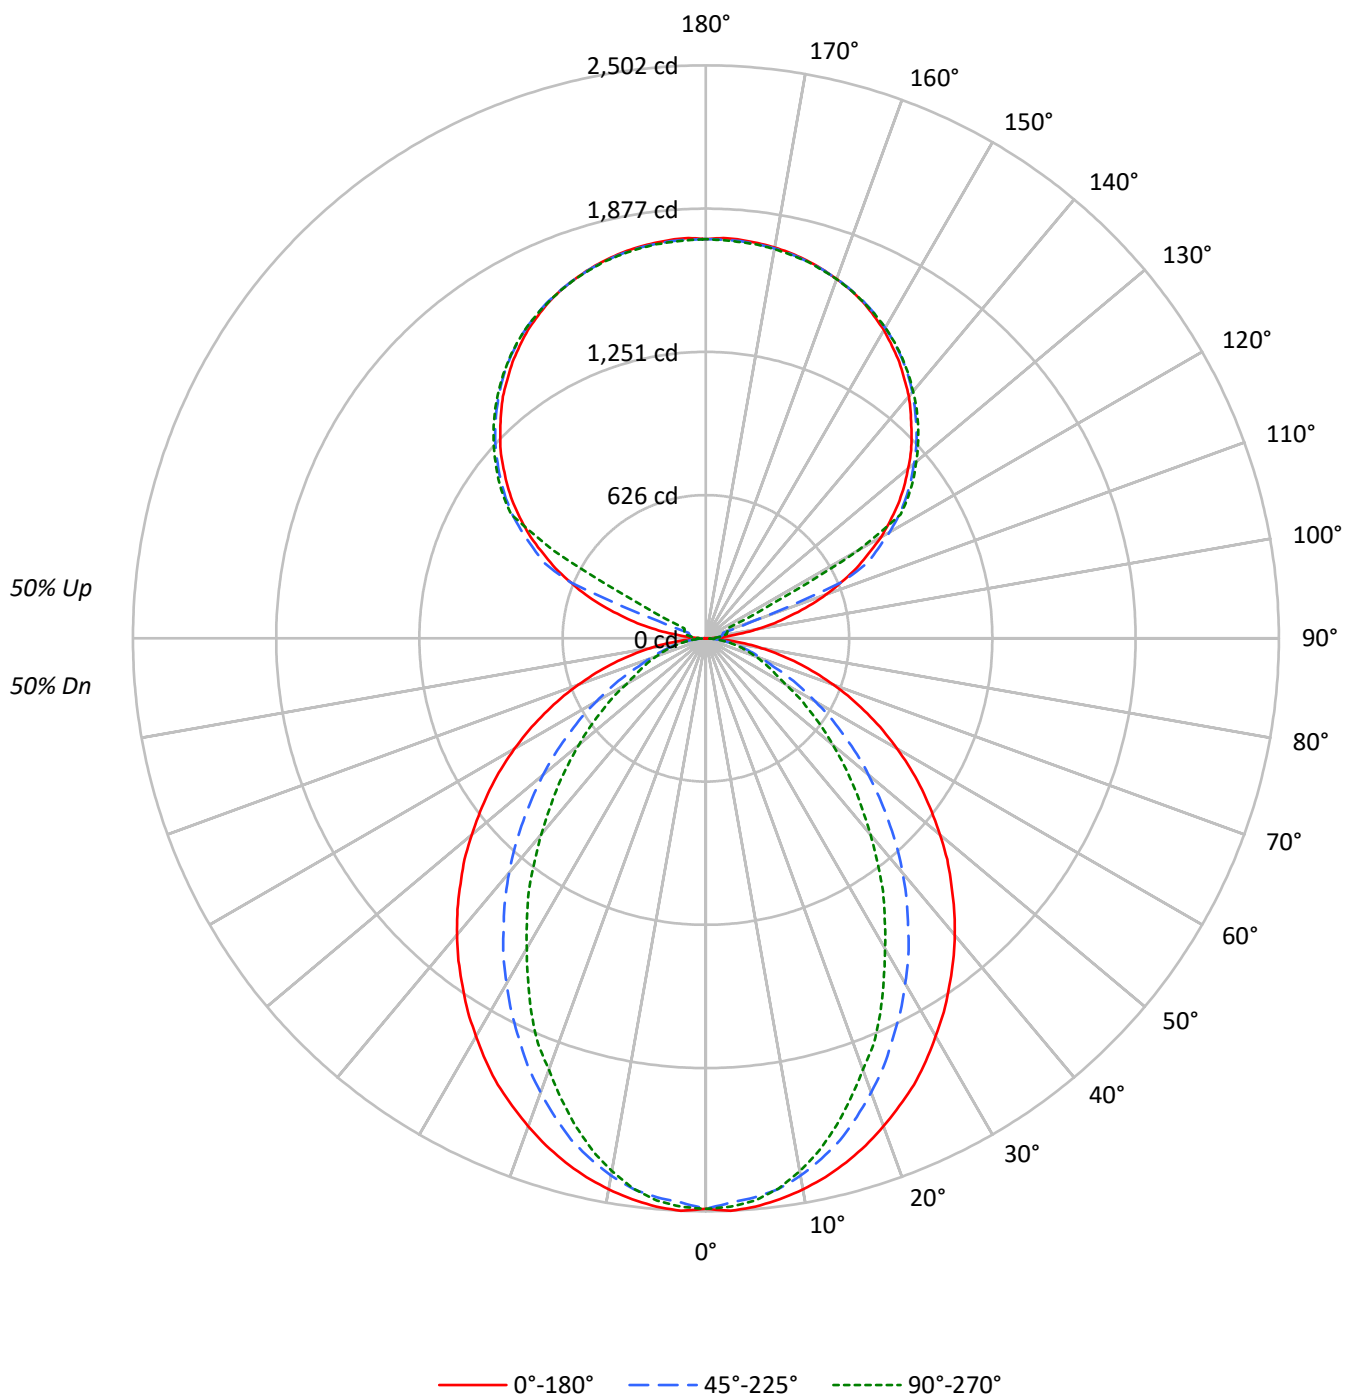

TEST NUMBER: P920343

CATALOG NUMBER: DFN2DIP-SQ4F0-070D060US935-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	69	69	69	56	56	56
1	98	94	90	87	91	87	84	81	74	72	69	62	60	59	50	49	48
2	90	83	77	72	83	77	72	67	65	62	58	55	52	50	45	43	41
3	82	73	66	60	76	68	62	57	58	53	50	49	45	43	40	38	36
4	76	65	57	52	70	60	54	49	52	47	43	44	40	37	36	34	31
5	70	58	50	45	64	54	47	42	47	41	37	40	35	32	33	30	28
6	64	52	45	39	59	49	42	37	42	37	33	36	32	29	30	27	25
7	59	47	40	34	55	44	37	32	38	33	29	33	29	25	28	24	22
8	55	43	36	30	51	40	34	29	35	30	26	30	26	23	25	22	20
9	52	40	32	27	48	37	30	26	32	27	23	28	24	21	24	20	18
10	48	36	29	25	45	34	28	23	30	25	21	26	22	19	22	19	17

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1748	1748	1748
5°	1751	1720	1732
10°	1733	1687	1676
15°	1709	1632	1589
20°	1678	1555	1483
25°	1645	1469	1380
30°	1602	1381	1249
35°	1559	1286	1134
40°	1516	1188	1003
45°	1466	1080	883
50°	1414	970	767
55°	1359	852	655
60°	1297	729	539
65°	1224	605	486
70°	1137	488	441
75°	1026	431	402
80°	867	363	350
85°	604	244	267

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1466 cd/sqm

TEST NUMBER: P920343

CATALOG NUMBER: DFN2DIP-SQ4F0-070D060US935-RLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	233.5	2.3
10°-20°	640.9	6.3
20°-30°	899.8	8.8
30°-40°	980.8	9.6
40°-50°	901.5	8.8
50°-60°	708.0	6.9
60°-70°	460.8	4.5
70°-80°	237.2	2.3
80°-90°	63.6	0.6
90°-100°	57.5	0.6
100°-110°	214.3	2.1
110°-120°	568.4	5.6
120°-130°	942.7	9.2
130°-140°	1001.4	9.8
140°-150°	930.7	9.1
150°-160°	748.2	7.3
160°-170°	482.1	4.7
170°-180°	165.9	1.6
0°-30°	1774.1	17.3
0°-40°	2754.9	26.9
0°-60°	4364.3	42.6
0°-90°	5126.0	50.1
90°-120°	840.2	8.2
90°-150°	3714.9	36.3
90°-180°	5111.0	49.9
0°-180°	10237.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2491	2491	2491	2491	2491	
5°	2491	2480	2450	2471	2464	236
15°	2369	2344	2268	2225	2202	668
25°	2151	2078	1930	1837	1803	989
35°	1853	1738	1540	1398	1348	1160
45°	1515	1364	1127	967	913	1170
55°	1152	976	732	597	555	1029
65°	778	595	392	316	309	771
75°	415	257	180	164	162	439
85°	97	50	43	43	43	111
90°	1	15	25	32	34	10
95°	82	40	49	56	54	97
105°	384	421	77	91	96	410
115°	725	747	778	194	104	714
125°	1026	1042	1066	1075	1079	915
135°	1269	1289	1301	1313	1311	980
145°	1472	1471	1492	1501	1495	921
155°	1621	1610	1625	1632	1622	747
165°	1708	1701	1704	1713	1704	483
175°	1747	1738	1741	1750	1737	166
180°	1743	1743	1743	1743	1743	

TEST NUMBER: P920343

CATALOG NUMBER: DFN2DIP-SQ4F0-070D060US935-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2491.0	2491.0	2491.0	2491.0	2491.0
2.5°	2502.1	2491.0	2466.1	2488.8	2484.2
5°	2491.0	2479.7	2450.3	2470.6	2463.9
7.5°	2470.6	2457.2	2425.7	2434.5	2423.3
10°	2443.6	2427.8	2382.8	2375.9	2362.5
12.5°	2409.8	2389.5	2328.6	2315.1	2290.3
15°	2369.2	2344.3	2267.8	2225.0	2202.5
17.5°	2321.9	2285.8	2191.1	2141.5	2105.4
20°	2267.8	2222.6	2110.0	2053.7	2004.0
22.5°	2209.2	2157.3	2026.4	1949.9	1916.2
25°	2150.6	2078.4	1929.6	1837.3	1803.4
27.5°	2080.8	2004.0	1839.4	1733.5	1681.6
30°	2006.4	1920.5	1740.2	1625.4	1564.4
32.5°	1934.1	1830.4	1645.7	1510.4	1453.9
35°	1853.0	1738.0	1539.8	1397.7	1348.0
37.5°	1774.2	1650.0	1440.5	1284.8	1228.6
40°	1690.7	1555.6	1336.7	1176.7	1118.1
42.5°	1605.1	1460.9	1233.1	1066.2	1010.0
45°	1514.9	1363.7	1127.2	967.0	912.9
47.5°	1429.3	1269.3	1025.8	865.6	816.1
50°	1334.5	1174.6	926.5	770.9	723.8
52.5°	1242.0	1072.9	831.8	683.0	640.2
55°	1151.8	976.0	732.5	597.4	554.7
57.5°	1059.5	879.2	644.8	518.5	482.4
60°	964.8	784.5	552.2	437.5	401.3
62.5°	872.4	692.2	473.3	365.2	347.2
65°	777.7	595.0	392.3	315.7	308.8
67.5°	687.6	504.9	315.7	277.2	270.5
70°	592.9	417.1	261.4	238.9	229.8
72.5°	502.7	335.8	218.6	200.7	196.1
75°	414.7	256.8	180.3	164.5	162.4
77.5°	326.9	182.4	142.1	132.9	128.5
80°	245.6	130.8	108.1	99.3	99.3
82.5°	171.3	88.0	74.4	69.8	69.8
85°	96.9	49.5	42.8	42.8	42.8
87.5°	36.1	17.9	17.9	15.8	15.8
90°	1.2	15.2	25.1	31.6	34.0
92.5°	31.6	26.5	30.2	32.8	34.0
95°	82.0	40.3	49.2	55.6	54.2
97.5°	147.6	44.2	64.2	68.2	69.4
100°	223.3	50.5	71.9	82.0	84.5
102.5°	306.5	304.1	74.5	88.3	92.1
105°	383.5	421.4	77.0	90.7	95.9
107.5°	473.1	504.5	79.6	93.3	98.4
110°	559.0	585.3	220.8	94.7	99.6

TEST NUMBER: P920343

CATALOG NUMBER: DFN2DIP-SQ4F0-070D060US935-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	639.6	662.3	640.8	97.0	101.0
115°	725.4	746.8	778.4	194.3	103.5
117.5°	799.8	825.0	846.5	666.1	335.5
120°	883.1	902.0	924.8	939.9	769.6
122.5°	953.6	973.9	999.2	1006.7	1008.1
125°	1025.6	1042.1	1066.0	1074.9	1078.6
127.5°	1091.2	1108.9	1127.9	1140.5	1141.7
130°	1153.0	1173.3	1187.1	1201.0	1199.8
132.5°	1216.2	1232.6	1246.4	1257.7	1256.5
135°	1269.2	1289.4	1300.6	1313.4	1310.8
137.5°	1324.6	1339.7	1352.5	1365.0	1361.3
140°	1378.8	1389.0	1402.8	1414.2	1407.9
142.5°	1424.3	1433.2	1449.6	1459.6	1453.3
145°	1472.3	1470.9	1492.4	1501.2	1495.0
147.5°	1513.8	1510.0	1531.5	1537.7	1532.8
150°	1554.3	1545.4	1565.6	1573.1	1566.8
152.5°	1588.3	1578.2	1597.1	1604.7	1595.9
155°	1621.1	1609.8	1625.0	1632.5	1622.4
157.5°	1647.6	1637.5	1648.9	1657.8	1647.6
160°	1670.3	1662.7	1670.3	1677.8	1669.0
162.5°	1690.4	1682.9	1689.2	1698.1	1686.7
165°	1708.1	1700.6	1704.3	1713.2	1704.3
167.5°	1722.0	1714.4	1718.3	1727.2	1715.7
170°	1733.4	1725.8	1728.4	1737.1	1725.8
172.5°	1740.9	1733.4	1735.9	1744.8	1733.4
175°	1747.2	1738.4	1740.9	1749.7	1737.1
177.5°	1749.7	1740.9	1742.2	1751.1	1739.7
180°	1743.4	1743.4	1743.4	1743.4	1743.4

TEST NUMBER: P920343

CATALOG NUMBER: DFN2DIP-SQ4F0-070D060US935-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.11	9.94	10.07	10.91	12.18	5.07	5.90	6.03	6.87	8.14
	3H	10.79	11.53	11.76	12.51	13.81	6.26	7.00	7.23	7.98	9.28
	4H	11.40	12.10	12.39	13.09	14.39	6.71	7.41	7.70	8.40	9.70
	6H	11.83	12.47	12.82	13.46	14.78	7.03	7.68	8.03	8.67	9.98
	8H	11.95	12.57	12.96	13.58	14.89	7.12	7.73	8.12	8.74	10.06
	12H	12.02	12.60	13.03	13.60	14.94	7.16	7.75	8.17	8.75	10.09
4H	2H	9.12	9.83	10.12	10.81	12.12	5.67	6.37	6.66	7.35	8.66
	3H	10.96	11.54	11.96	12.56	13.88	7.02	7.60	8.02	8.62	9.93
	4H	11.65	12.19	12.67	13.20	14.54	7.56	8.10	8.58	9.11	10.45
	6H	12.17	12.63	13.20	13.66	15.00	7.99	8.44	9.01	9.47	10.81
	8H	12.35	12.78	13.37	13.80	15.16	8.11	8.54	9.14	9.57	10.92
	12H	12.45	12.83	13.49	13.87	15.23	8.18	8.57	9.22	9.61	10.96
8H	4H	11.62	12.05	12.65	13.07	14.43	7.85	8.28	8.87	9.30	10.65
	6H	12.19	12.55	13.24	13.61	14.96	8.37	8.72	9.41	9.79	11.14
	8H	12.41	12.72	13.47	13.78	15.14	8.56	8.87	9.61	9.92	11.29
	12H	12.55	12.83	13.61	13.87	15.29	8.68	8.95	9.74	10.00	11.41
12H	4H	11.57	11.96	12.62	13.00	14.36	7.85	8.24	8.89	9.28	10.64
	6H	12.17	12.48	13.22	13.53	14.90	8.42	8.73	9.47	9.78	11.15
	8H	12.39	12.67	13.45	13.71	15.12	8.63	8.90	9.69	9.95	11.36

END OF REPORT