

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P920353

Luminaire Tested: DFN2DIP-SQ4F0-070D090US935-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P920353
REPORT IS A COMBINATION OF REPORTS P901635 AND P898471
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-070D090US935-FLLONL
Description: 4 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 13638.2 lumens
Efficiency: N/A
Efficacy: 106.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 128
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9967
Total Harmonic Distortion (THDi): 0.063
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P920353

CATALOG NUMBER: DFN2DIP-SQ4F0-070D090US935-FLLONL

Luminous Intensity Polar Plot

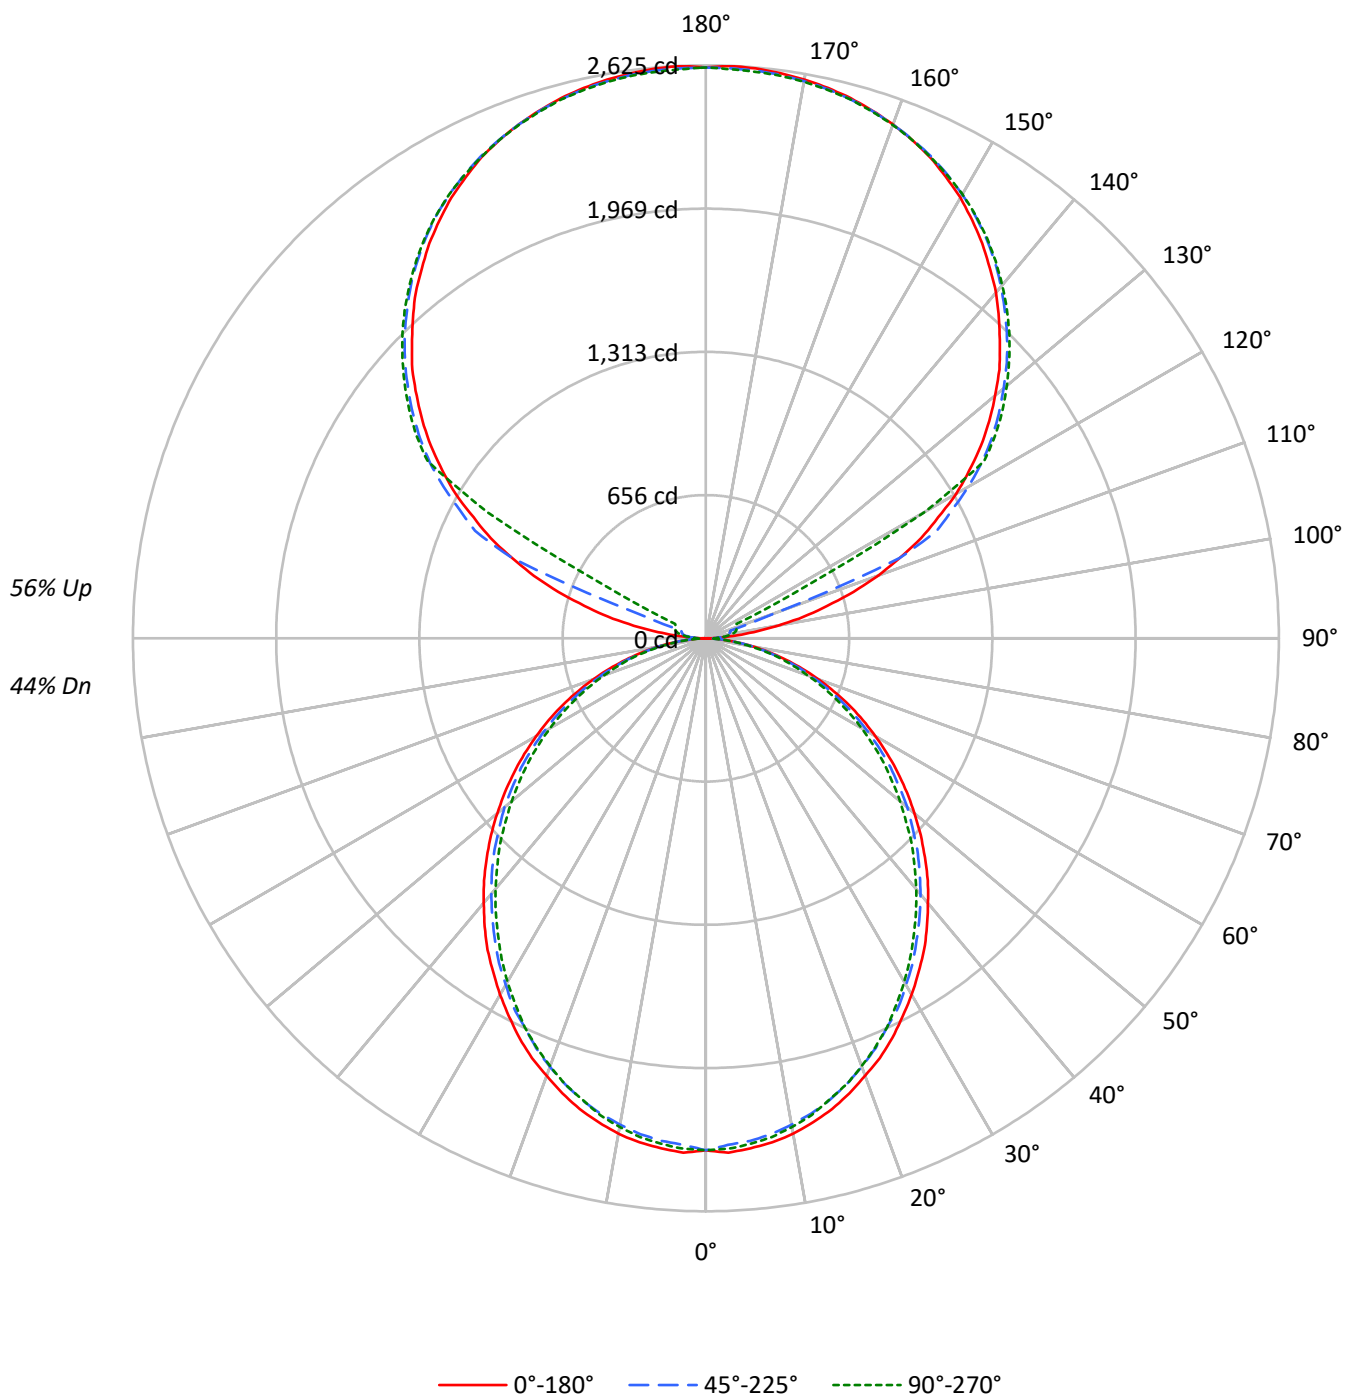

TEST NUMBER: P920353

CATALOG NUMBER: DFN2DIP-SQ4F0-070D090US935-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	97	97	97	97	80	80	80	65	65	65	50	50	50
1	96	92	88	85	88	84	81	78	70	68	66	57	55	54	45	44	43
2	88	80	74	69	80	74	69	64	61	58	54	50	47	45	39	37	36
3	80	71	63	58	73	65	59	54	54	49	46	44	41	38	35	32	31
4	73	63	55	49	67	58	51	45	48	43	39	39	35	32	31	28	26
5	67	56	48	42	61	51	44	39	43	38	33	35	31	28	28	25	23
6	62	50	42	36	56	46	39	34	39	33	29	32	28	25	25	22	20
7	57	45	37	32	52	42	35	30	35	30	26	29	25	22	23	20	18
8	53	41	33	28	48	38	31	26	32	27	23	26	22	19	21	18	16
9	49	37	30	25	45	34	28	23	29	24	20	24	20	17	20	17	14
10	46	34	27	22	42	32	25	21	27	22	18	22	18	16	18	15	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1646	1646	1646
5°	1648	1623	1634
10°	1635	1601	1612
15°	1611	1575	1578
20°	1578	1539	1543
25°	1546	1496	1503
30°	1505	1455	1451
35°	1467	1407	1397
40°	1420	1359	1345
45°	1373	1311	1292
50°	1321	1260	1230
55°	1267	1202	1174
60°	1206	1132	1109
65°	1140	1060	1033
70°	1055	972	951
75°	938	867	876
80°	796	734	732
85°	576	502	492

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1402 cd/sqm

TEST NUMBER: P920353

CATALOG NUMBER: DFN2DIP-SQ4F0-070D090US935-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	220.7	1.6
10°-20°	621.0	4.6
20°-30°	912.7	6.7
30°-40°	1060.0	7.8
40°-50°	1058.7	7.8
50°-60°	923.2	6.8
60°-70°	682.4	5.0
70°-80°	386.1	2.8
80°-90°	106.5	0.8
90°-100°	86.2	0.6
100°-110°	321.5	2.4
110°-120°	852.6	6.3
120°-130°	1414.1	10.4
130°-140°	1502.1	11.0
140°-150°	1396.0	10.2
150°-160°	1122.4	8.2
160°-170°	723.2	5.3
170°-180°	248.9	1.8
0°-30°	1754.4	12.9
0°-40°	2814.4	20.6
0°-60°	4796.3	35.2
0°-90°	5971.3	43.8
90°-120°	1260.3	9.2
90°-150°	5572.4	40.9
90°-180°	7667.0	56.2
0°-180°	13638.2	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2345	2345	2345	2345	2345	
5°	2345	2336	2311	2329	2325	223
15°	2232	2219	2190	2199	2188	629
25°	2020	2002	1964	1969	1964	930
35°	1743	1721	1684	1671	1660	1089
45°	1418	1403	1369	1344	1335	1095
55°	1074	1060	1033	1006	994	960
65°	724	710	688	668	656	716
75°	379	374	363	350	354	404
85°	92	90	88	81	79	103
90°	2	23	38	47	51	13
95°	123	60	74	83	81	146
105°	575	632	116	136	144	615
115°	1088	1120	1168	291	155	1071
125°	1538	1563	1599	1612	1618	1372
135°	1904	1934	1951	1970	1966	1471
145°	2208	2206	2239	2252	2242	1381
155°	2432	2415	2437	2449	2434	1121
165°	2562	2551	2557	2570	2557	724
175°	2621	2608	2611	2625	2606	249
180°	2615	2615	2615	2615	2615	

TEST NUMBER: P920353

CATALOG NUMBER: DFN2DIP-SQ4F0-070D090US935-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2345.1	2345.1	2345.1	2345.1	2345.1
2.5°	2358.8	2347.5	2322.6	2345.1	2340.8
5°	2345.1	2336.3	2311.4	2329.3	2325.0
7.5°	2329.3	2315.9	2291.0	2309.3	2304.7
10°	2304.7	2288.9	2261.8	2279.8	2273.1
12.5°	2270.7	2257.4	2230.3	2241.5	2237.0
15°	2232.5	2219.0	2189.6	2198.7	2187.5
17.5°	2185.0	2171.7	2142.2	2153.5	2142.2
20°	2133.1	2119.8	2088.2	2094.9	2086.0
22.5°	2081.5	2061.1	2031.7	2031.7	2027.1
25°	2020.5	2002.5	1964.3	1968.6	1964.3
27.5°	1952.7	1937.0	1907.8	1901.1	1889.8
30°	1885.3	1867.1	1833.4	1826.7	1817.6
32.5°	1813.0	1799.7	1763.5	1749.9	1740.8
35°	1743.2	1720.7	1684.5	1670.9	1659.7
37.5°	1664.2	1643.9	1607.7	1592.0	1580.7
40°	1583.1	1564.9	1528.8	1508.7	1499.6
42.5°	1504.2	1486.0	1450.1	1427.4	1413.9
45°	1418.5	1402.7	1368.7	1344.1	1335.0
47.5°	1335.0	1319.2	1283.1	1258.2	1244.8
50°	1247.0	1235.7	1204.1	1172.6	1161.3
52.5°	1161.3	1145.6	1116.4	1091.5	1075.6
55°	1073.5	1059.9	1032.9	1005.8	994.5
57.5°	985.5	974.2	944.8	917.7	908.7
60°	897.4	888.5	857.0	832.2	825.4
62.5°	811.7	796.0	773.5	751.0	741.9
65°	724.0	710.3	687.9	667.5	656.3
67.5°	633.8	622.3	602.2	586.4	577.3
70°	550.3	541.2	520.8	505.1	496.2
72.5°	464.6	455.6	444.3	428.5	421.8
75°	378.8	374.4	362.9	349.6	354.1
77.5°	302.2	293.1	288.5	281.8	275.2
80°	225.6	223.3	218.7	212.0	207.4
82.5°	153.3	153.3	151.2	142.2	142.2
85°	92.4	90.2	88.1	81.1	79.0
87.5°	40.6	36.2	31.6	24.9	22.5
90°	1.8	22.7	37.7	47.4	51.0
92.5°	47.4	39.8	45.4	49.2	51.0
95°	123.0	60.4	73.7	83.3	81.4
97.5°	221.4	66.3	96.4	102.2	104.0
100°	335.0	75.8	107.9	123.0	126.7
102.5°	459.8	456.2	111.7	132.3	138.2
105°	575.2	632.1	115.5	136.2	143.8
107.5°	709.6	756.8	119.3	140.0	147.7
110°	838.4	878.0	331.2	142.0	149.5

TEST NUMBER: P920353

CATALOG NUMBER: DFN2DIP-SQ4F0-070D090US935-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	959.5	993.4	961.3	145.6	151.4
115°	1088.0	1120.2	1167.6	291.4	155.2
117.5°	1199.7	1237.5	1269.8	999.1	503.3
120°	1324.6	1353.0	1387.2	1409.8	1154.3
122.5°	1430.5	1460.9	1498.8	1510.0	1512.1
125°	1538.3	1563.1	1599.0	1612.3	1617.9
127.5°	1636.8	1663.3	1691.9	1710.7	1712.5
130°	1729.6	1760.0	1780.6	1801.5	1799.7
132.5°	1824.2	1848.9	1869.6	1886.7	1884.9
135°	1903.8	1934.1	1950.9	1970.0	1966.3
137.5°	1986.9	2009.6	2028.7	2047.5	2041.9
140°	2068.2	2083.5	2104.2	2121.2	2111.9
142.5°	2136.6	2149.8	2174.3	2189.3	2180.0
145°	2208.5	2206.4	2238.6	2251.9	2242.4
147.5°	2270.7	2265.1	2297.2	2306.7	2299.2
150°	2331.4	2318.2	2348.5	2359.7	2350.3
152.5°	2382.4	2367.3	2395.6	2407.1	2393.8
155°	2431.6	2414.8	2437.4	2448.7	2433.6
157.5°	2471.4	2456.3	2473.4	2486.6	2471.4
160°	2505.5	2494.1	2505.5	2516.8	2503.5
162.5°	2535.6	2524.4	2533.8	2547.1	2530.0
165°	2562.2	2550.9	2556.6	2569.8	2556.6
167.5°	2583.1	2571.6	2577.4	2590.7	2573.6
170°	2600.1	2588.7	2592.5	2605.7	2588.7
172.5°	2611.4	2600.1	2603.9	2617.2	2600.1
175°	2620.8	2607.5	2611.4	2624.6	2605.7
177.5°	2624.6	2611.4	2613.4	2626.6	2609.6
180°	2615.2	2615.2	2615.2	2615.2	2615.2

TEST NUMBER: P920353

CATALOG NUMBER: DFN2DIP-SQ4F0-070D090US935-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.41	9.22	9.42	10.24	11.60	7.97	8.78	8.98	9.79	11.15
	3H	10.07	10.80	11.09	11.82	13.20	9.58	10.31	10.60	11.33	12.71
	4H	10.66	11.35	11.69	12.38	13.76	10.17	10.85	11.20	11.88	13.27
	6H	11.06	11.69	12.10	12.73	14.13	10.56	11.19	11.60	12.23	13.62
	8H	11.17	11.77	12.21	12.82	14.21	10.66	11.27	11.71	12.32	13.71
	12H	11.21	11.79	12.27	12.83	14.25	10.70	11.28	11.76	12.32	13.74
4H	2H	8.87	9.55	9.90	10.58	11.97	8.51	9.20	9.55	10.23	11.61
	3H	10.73	11.31	11.78	12.36	13.76	10.32	10.90	11.37	11.96	13.35
	4H	11.45	11.97	12.50	13.02	14.44	11.02	11.55	12.08	12.60	14.02
	6H	11.96	12.42	13.03	13.49	14.90	11.53	11.98	12.59	13.06	14.47
	8H	12.12	12.54	13.18	13.60	15.03	11.68	12.10	12.74	13.16	14.60
	12H	12.19	12.57	13.27	13.65	15.09	11.74	12.12	12.82	13.20	14.64
8H	4H	11.64	12.06	12.70	13.13	14.56	11.26	11.69	12.33	12.75	14.18
	6H	12.27	12.62	13.36	13.73	15.16	11.89	12.24	12.98	13.35	14.78
	8H	12.50	12.80	13.59	13.89	15.34	12.11	12.41	13.20	13.50	14.95
	12H	12.63	12.90	13.73	13.99	15.47	12.22	12.49	13.32	13.57	15.06
12H	4H	11.62	12.00	12.71	13.08	14.52	11.26	11.64	12.34	12.72	14.15
	6H	12.30	12.61	13.40	13.70	15.15	11.93	12.24	13.03	13.33	14.78
	8H	12.55	12.82	13.64	13.90	15.39	12.17	12.44	13.26	13.52	15.01

END OF REPORT