

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P920413

Luminaire Tested: DFN2DIP-SQ4F0-090D060US935-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P920413
REPORT IS A COMBINATION OF REPORTS P901585 AND P898471
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-090D060US935-FLLONL
Description: 4 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 12785.8 lumens
Efficiency: N/A
Efficacy: 100.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 127.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.983
Total Harmonic Distortion (THDi): 0.073
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P920413

CATALOG NUMBER: DFN2DIP-SQ4F0-090D060US935-FLLONL

Luminous Intensity Polar Plot

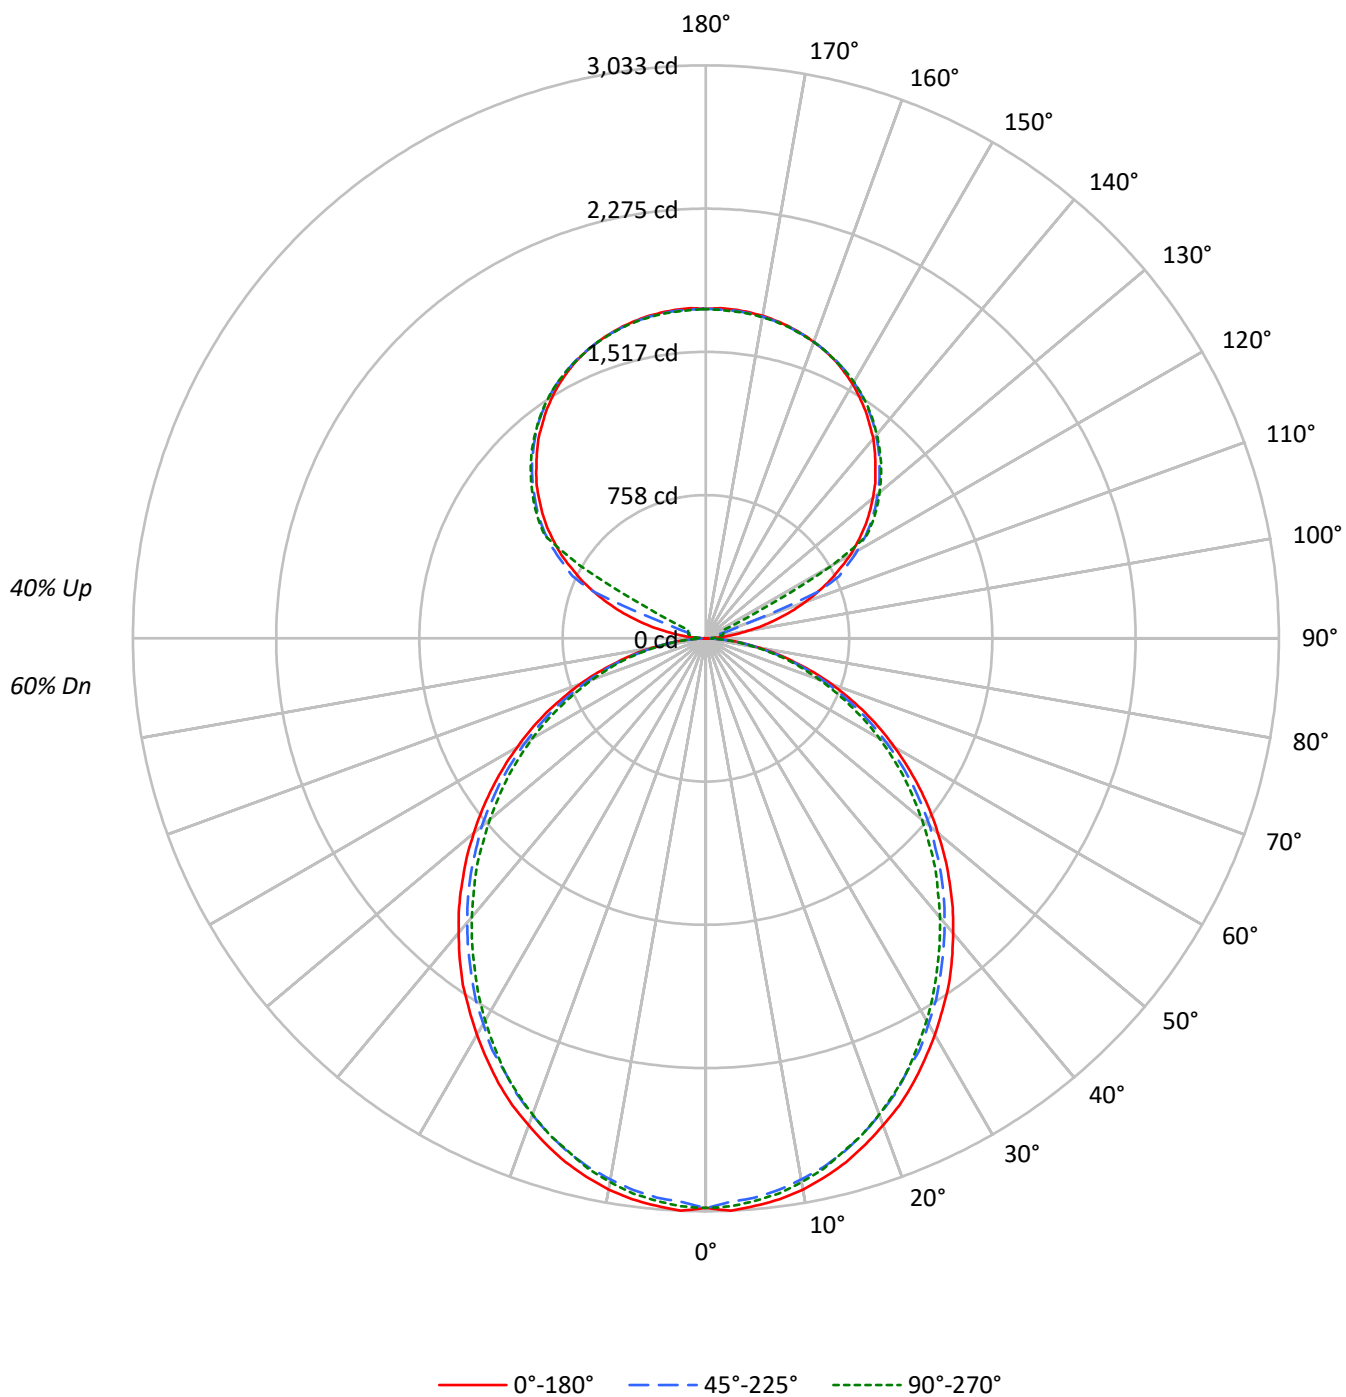

TEST NUMBER: P920413

CATALOG NUMBER: DFN2DIP-SQ4F0-090D060US935-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50
RCR																	
0	110	110	110	110	102	102	102	102	89	89	89		77	77	77		65
1	100	96	92	88	93	90	86	83	78	75	73		67	66	64		58
2	91	84	77	72	85	78	73	68	68	64	61		59	56	53		51
3	83	73	66	60	77	69	62	57	60	55	51		52	48	45		45
4	76	65	57	51	71	61	54	48	54	48	44		47	42	39		40
5	70	58	50	44	65	55	47	42	48	42	38		42	37	34		36
6	64	52	44	38	60	49	42	36	43	37	33		38	33	30		33
7	60	47	39	33	56	44	37	32	39	33	29		35	30	26		30
8	55	43	35	30	52	40	33	28	36	30	26		32	27	23		28
9	52	39	32	26	48	37	30	25	33	27	23		29	24	21		26
10	48	36	29	24	45	34	27	23	30	25	21		27	22	19		24

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2116	2116	2116
5°	2119	2087	2101
10°	2102	2059	2073
15°	2071	2025	2029
20°	2029	1979	1984
25°	1988	1923	1932
30°	1935	1871	1866
35°	1886	1809	1796
40°	1825	1747	1729
45°	1765	1685	1661
50°	1699	1620	1582
55°	1629	1545	1509
60°	1551	1455	1426
65°	1465	1363	1328
70°	1356	1250	1223
75°	1205	1115	1127
80°	1024	943	941
85°	740	645	633

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
Vertical Angle: 45°
Luminance: 1765 cd/sqm

TEST NUMBER: P920413

CATALOG NUMBER: DFN2DIP-SQ4F0-090D060US935-FLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	283.8	2.2
10°-20°	798.5	6.2
20°-30°	1173.4	9.2
30°-40°	1362.9	10.7
40°-50°	1361.2	10.6
50°-60°	1186.9	9.3
60°-70°	877.4	6.9
70°-80°	496.4	3.9
80°-90°	134.1	1.0
90°-100°	57.5	0.4
100°-110°	214.3	1.7
110°-120°	568.4	4.4
120°-130°	942.7	7.4
130°-140°	1001.4	7.8
140°-150°	930.7	7.3
150°-160°	748.2	5.9
160°-170°	482.1	3.8
170°-180°	165.9	1.3
0°-30°	2255.7	17.6
0°-40°	3618.6	28.3
0°-60°	6166.7	48.2
0°-90°	7674.6	60.0
90°-120°	840.2	6.6
90°-150°	3714.9	29.1
90°-180°	5111.0	40.0
0°-180°	12785.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3015	3015	3015	3015	3015	
5°	3015	3004	2972	2995	2989	286
15°	2870	2853	2815	2827	2812	808
25°	2598	2575	2526	2531	2526	1195
35°	2241	2212	2166	2148	2134	1400
45°	1824	1804	1760	1728	1716	1408
55°	1380	1363	1328	1293	1279	1234
65°	931	913	884	858	844	920
75°	487	481	467	449	455	520
85°	119	116	113	104	102	132
90°	1	15	25	32	34	12
95°	82	40	49	56	54	97
105°	384	421	77	91	96	410
115°	725	747	778	194	104	714
125°	1026	1042	1066	1075	1079	915
135°	1269	1289	1301	1313	1311	980
145°	1472	1471	1492	1501	1495	921
155°	1621	1610	1625	1632	1622	747
165°	1708	1701	1704	1713	1704	483
175°	1747	1738	1741	1750	1737	166
180°	1743	1743	1743	1743	1743	

TEST NUMBER: P920413

CATALOG NUMBER: DFN2DIP-SQ4F0-090D060US935-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3015.1	3015.1	3015.1	3015.1	3015.1
2.5°	3032.7	3018.2	2986.3	3015.1	3009.6
5°	3015.1	3003.8	2971.8	2994.9	2989.3
7.5°	2994.9	2977.7	2945.6	2969.1	2963.2
10°	2963.2	2942.9	2908.1	2931.2	2922.6
12.5°	2919.5	2902.3	2867.6	2881.9	2876.2
15°	2870.3	2853.1	2815.2	2826.9	2812.4
17.5°	2809.3	2792.1	2754.3	2768.8	2754.3
20°	2742.6	2725.4	2684.8	2693.4	2682.0
22.5°	2676.2	2650.1	2612.2	2612.2	2606.3
25°	2597.7	2574.6	2525.5	2531.0	2525.5
27.5°	2510.7	2490.4	2452.9	2444.3	2429.8
30°	2424.0	2400.5	2357.2	2348.5	2336.9
32.5°	2331.1	2313.8	2267.4	2249.9	2238.2
35°	2241.3	2212.3	2165.8	2148.4	2133.9
37.5°	2139.8	2113.6	2067.1	2046.9	2032.4
40°	2035.4	2012.1	1965.6	1939.7	1928.1
42.5°	1933.9	1910.6	1864.4	1835.2	1818.0
45°	1823.8	1803.5	1759.8	1728.1	1716.5
47.5°	1716.5	1696.2	1649.7	1617.7	1600.5
50°	1603.3	1588.8	1548.2	1507.6	1493.1
52.5°	1493.1	1472.8	1435.3	1403.3	1383.0
55°	1380.3	1362.7	1327.9	1293.2	1278.8
57.5°	1267.0	1252.6	1214.8	1180.0	1168.3
60°	1153.8	1142.5	1101.8	1069.9	1061.3
62.5°	1043.7	1023.4	994.5	965.6	953.9
65°	930.8	913.3	884.3	858.2	843.8
67.5°	814.8	800.1	774.2	754.0	742.3
70°	707.5	695.8	669.7	649.4	638.0
72.5°	597.4	585.7	571.2	551.0	542.3
75°	487.0	481.4	466.7	449.4	455.3
77.5°	388.5	376.9	371.0	362.4	353.8
80°	290.1	287.0	281.1	272.5	266.7
82.5°	197.2	197.2	194.4	182.7	182.7
85°	118.7	116.0	113.2	104.3	101.5
87.5°	52.3	46.4	40.6	32.0	28.9
90°	1.2	15.2	25.1	31.6	34.0
92.5°	31.6	26.5	30.2	32.8	34.0
95°	82.0	40.3	49.2	55.6	54.2
97.5°	147.6	44.2	64.2	68.2	69.4
100°	223.3	50.5	71.9	82.0	84.5
102.5°	306.5	304.1	74.5	88.3	92.1
105°	383.5	421.4	77.0	90.7	95.9
107.5°	473.1	504.5	79.6	93.3	98.4
110°	559.0	585.3	220.8	94.7	99.6

TEST NUMBER: P920413

CATALOG NUMBER: DFN2DIP-SQ4F0-090D060US935-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	639.6	662.3	640.8	97.0	101.0
115°	725.4	746.8	778.4	194.3	103.5
117.5°	799.8	825.0	846.5	666.1	335.5
120°	883.1	902.0	924.8	939.9	769.6
122.5°	953.6	973.9	999.2	1006.7	1008.1
125°	1025.6	1042.1	1066.0	1074.9	1078.6
127.5°	1091.2	1108.9	1127.9	1140.5	1141.7
130°	1153.0	1173.3	1187.1	1201.0	1199.8
132.5°	1216.2	1232.6	1246.4	1257.7	1256.5
135°	1269.2	1289.4	1300.6	1313.4	1310.8
137.5°	1324.6	1339.7	1352.5	1365.0	1361.3
140°	1378.8	1389.0	1402.8	1414.2	1407.9
142.5°	1424.3	1433.2	1449.6	1459.6	1453.3
145°	1472.3	1470.9	1492.4	1501.2	1495.0
147.5°	1513.8	1510.0	1531.5	1537.7	1532.8
150°	1554.3	1545.4	1565.6	1573.1	1566.8
152.5°	1588.3	1578.2	1597.1	1604.7	1595.9
155°	1621.1	1609.8	1625.0	1632.5	1622.4
157.5°	1647.6	1637.5	1648.9	1657.8	1647.6
160°	1670.3	1662.7	1670.3	1677.8	1669.0
162.5°	1690.4	1682.9	1689.2	1698.1	1686.7
165°	1708.1	1700.6	1704.3	1713.2	1704.3
167.5°	1722.0	1714.4	1718.3	1727.2	1715.7
170°	1733.4	1725.8	1728.4	1737.1	1725.8
172.5°	1740.9	1733.4	1735.9	1744.8	1733.4
175°	1747.2	1738.4	1740.9	1749.7	1737.1
177.5°	1749.7	1740.9	1742.2	1751.1	1739.7
180°	1743.4	1743.4	1743.4	1743.4	1743.4

TEST NUMBER: P920413

CATALOG NUMBER: DFN2DIP-SQ4F0-090D060US935-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.76	11.72	11.63	12.61	13.73	10.32	11.28	11.19	12.17	13.29
	3H	12.44	13.30	13.32	14.19	15.34	11.95	12.81	12.82	13.70	14.85
	4H	13.03	13.85	13.93	14.75	15.91	12.54	13.35	13.43	14.25	15.41
	6H	13.44	14.19	14.35	15.10	16.27	12.94	13.69	13.85	14.60	15.77
	8H	13.55	14.26	14.46	15.19	16.36	13.05	13.76	13.96	14.69	15.86
	12H	13.60	14.28	14.52	15.21	16.40	13.09	13.77	14.01	14.70	15.89
4H	2H	11.24	12.05	12.14	12.95	14.11	10.88	11.70	11.78	12.60	13.76
	3H	13.12	13.80	14.03	14.73	15.90	12.71	13.39	13.62	14.32	15.50
	4H	13.84	14.46	14.76	15.39	16.59	13.42	14.04	14.34	14.97	16.16
	6H	14.36	14.90	15.30	15.85	17.05	13.93	14.47	14.87	15.42	16.62
	8H	14.52	15.02	15.46	15.97	17.18	14.08	14.58	15.02	15.53	16.74
	12H	14.60	15.05	15.56	16.02	17.23	14.15	14.60	15.11	15.57	16.78
8H	4H	14.04	14.54	14.98	15.49	16.70	13.67	14.17	14.61	15.12	16.33
	6H	14.68	15.10	15.65	16.09	17.30	14.30	14.72	15.26	15.70	16.91
	8H	14.91	15.28	15.88	16.25	17.48	14.52	14.88	15.49	15.86	17.09
	12H	15.05	15.37	16.02	16.34	17.62	14.64	14.96	15.61	15.93	17.21
12H	4H	14.03	14.49	14.99	15.45	16.67	13.67	14.12	14.62	15.08	16.30
	6H	14.72	15.08	15.69	16.06	17.29	14.34	14.71	15.32	15.69	16.92
	8H	14.97	15.29	15.94	16.26	17.54	14.59	14.91	15.56	15.88	17.16

END OF REPORT