

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P920428

Luminaire Tested: DFN2DIP-SQ4F0-090D100US935-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P920428
REPORT IS A COMBINATION OF REPORTS P900137 AND P896915
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-090D100US935-FLLFLL
Description: 4 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 15291.4 lumens
Efficiency: N/A
Efficacy: 97.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 157.4
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.983
Total Harmonic Distortion (THDi): 0.073
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P920428

CATALOG NUMBER: DFN2DIP-SQ4F0-090D100US935-FLLFLL

Luminous Intensity Polar Plot

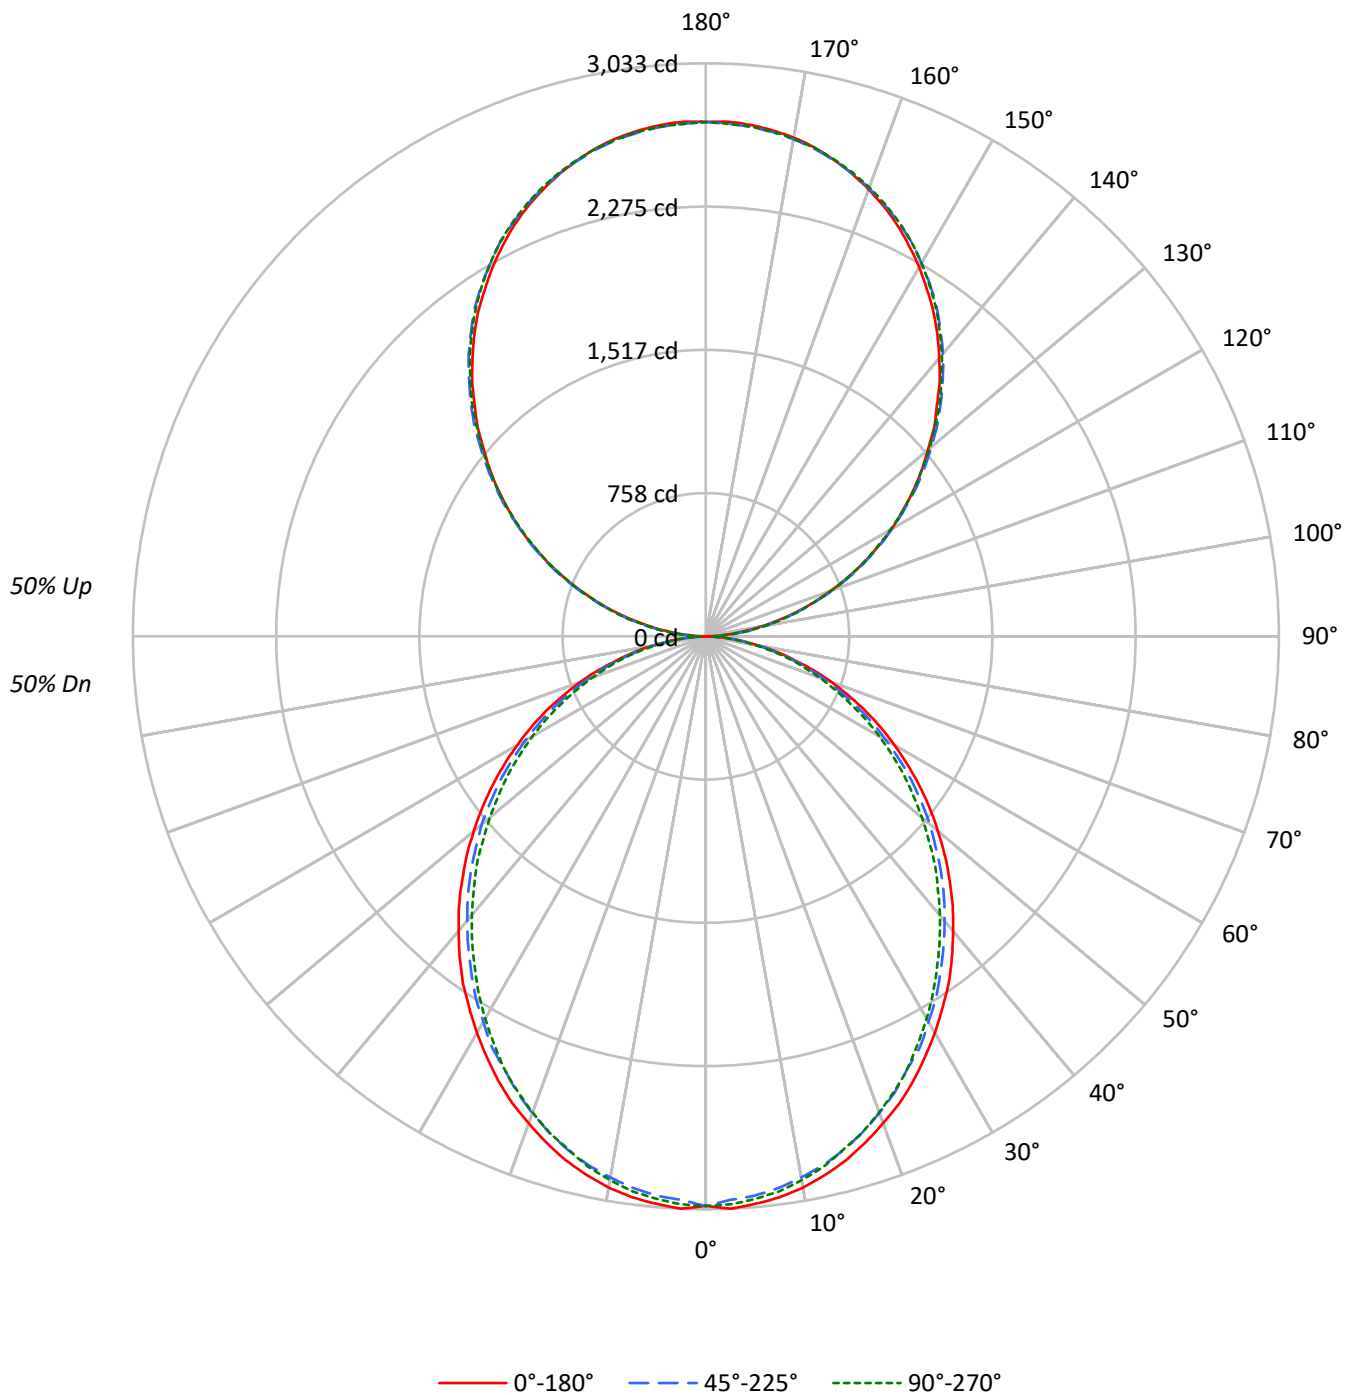

TEST NUMBER: P920428

CATALOG NUMBER: DFN2DIP-SQ4F0-090D100US935-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	83	83	83	69	69	69	56	56	56
1	98	93	90	86	90	86	83	80	73	71	69	61	59	58	50	49	48
2	89	82	76	70	82	76	70	66	64	60	57	54	51	48	44	42	40
3	81	72	64	59	75	67	60	55	57	52	48	47	44	41	39	36	34
4	74	64	56	50	68	59	52	47	50	45	41	42	38	35	35	32	29
5	68	57	48	42	63	53	45	40	45	39	35	38	34	30	31	28	26
6	63	51	43	37	58	47	40	35	41	35	31	34	30	27	28	25	23
7	58	46	38	32	54	43	36	31	37	31	27	31	27	23	26	23	20
8	54	42	34	29	50	39	32	27	34	28	24	29	24	21	24	20	18
9	50	38	31	25	46	36	29	24	31	25	21	26	22	19	22	19	16
10	47	35	28	23	43	33	26	22	28	23	19	24	20	17	20	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2116	2116	2116
5°	2119	2087	2101
10°	2102	2059	2073
15°	2071	2025	2029
20°	2029	1979	1984
25°	1988	1923	1932
30°	1935	1871	1866
35°	1886	1809	1796
40°	1825	1747	1729
45°	1765	1685	1661
50°	1699	1620	1582
55°	1629	1545	1509
60°	1551	1455	1426
65°	1465	1363	1328
70°	1356	1250	1223
75°	1205	1115	1127
80°	1024	943	941
85°	740	645	633

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2144 cd/sqm

TEST NUMBER: P920428

CATALOG NUMBER: DFN2DIP-SQ4F0-090D100US935-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	283.8	1.9
10°-20°	798.5	5.2
20°-30°	1173.4	7.7
30°-40°	1362.9	8.9
40°-50°	1361.2	8.9
50°-60°	1186.9	7.8
60°-70°	877.4	5.7
70°-80°	496.4	3.2
80°-90°	138.7	0.9
90°-100°	168.5	1.1
100°-110°	535.4	3.5
110°-120°	916.2	6.0
120°-130°	1204.9	7.9
130°-140°	1352.5	8.8
140°-150°	1326.3	8.7
150°-160°	1112.6	7.3
160°-170°	737.8	4.8
170°-180°	257.9	1.7
0°-30°	2255.7	14.8
0°-40°	3618.6	23.7
0°-60°	6166.7	40.3
0°-90°	7679.3	50.2
90°-120°	1620.1	10.6
90°-150°	5503.8	36.0
90°-180°	7612.0	49.8
0°-180°	15291.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3015	3015	3015	3015	3015	
5°	3015	3004	2972	2995	2989	286
15°	2870	2853	2815	2827	2812	808
25°	2598	2575	2526	2531	2526	1195
35°	2241	2212	2166	2148	2134	1400
45°	1824	1804	1760	1728	1716	1408
55°	1380	1363	1328	1293	1279	1234
65°	931	913	884	858	844	920
75°	487	481	467	449	455	520
85°	119	116	113	104	102	132
90°	2	30	80	76	78	15
95°	120	143	147	147	143	133
105°	494	501	506	510	510	522
115°	920	932	928	926	920	909
125°	1337	1358	1351	1344	1341	1195
135°	1730	1755	1760	1758	1751	1337
145°	2100	2116	2130	2132	2123	1312
155°	2401	2408	2415	2427	2419	1105
165°	2612	2610	2610	2626	2615	737
175°	2718	2712	2707	2723	2709	258
180°	2723	2723	2723	2723	2723	

TEST NUMBER: P920428

CATALOG NUMBER: DFN2DIP-SQ4F0-090D100US935-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3015.1	3015.1	3015.1	3015.1	3015.1
2.5°	3032.7	3018.2	2986.3	3015.1	3009.6
5°	3015.1	3003.8	2971.8	2994.9	2989.3
7.5°	2994.9	2977.7	2945.6	2969.1	2963.2
10°	2963.2	2942.9	2908.1	2931.2	2922.6
12.5°	2919.5	2902.3	2867.6	2881.9	2876.2
15°	2870.3	2853.1	2815.2	2826.9	2812.4
17.5°	2809.3	2792.1	2754.3	2768.8	2754.3
20°	2742.6	2725.4	2684.8	2693.4	2682.0
22.5°	2676.2	2650.1	2612.2	2612.2	2606.3
25°	2597.7	2574.6	2525.5	2531.0	2525.5
27.5°	2510.7	2490.4	2452.9	2444.3	2429.8
30°	2424.0	2400.5	2357.2	2348.5	2336.9
32.5°	2331.1	2313.8	2267.4	2249.9	2238.2
35°	2241.3	2212.3	2165.8	2148.4	2133.9
37.5°	2139.8	2113.6	2067.1	2046.9	2032.4
40°	2035.4	2012.1	1965.6	1939.7	1928.1
42.5°	1933.9	1910.6	1864.4	1835.2	1818.0
45°	1823.8	1803.5	1759.8	1728.1	1716.5
47.5°	1716.5	1696.2	1649.7	1617.7	1600.5
50°	1603.3	1588.8	1548.2	1507.6	1493.1
52.5°	1493.1	1472.8	1435.3	1403.3	1383.0
55°	1380.3	1362.7	1327.9	1293.2	1278.8
57.5°	1267.0	1252.6	1214.8	1180.0	1168.3
60°	1153.8	1142.5	1101.8	1069.9	1061.3
62.5°	1043.7	1023.4	994.5	965.6	953.9
65°	930.8	913.3	884.3	858.2	843.8
67.5°	814.8	800.1	774.2	754.0	742.3
70°	707.5	695.8	669.7	649.4	638.0
72.5°	597.4	585.7	571.2	551.0	542.3
75°	487.0	481.4	466.7	449.4	455.3
77.5°	388.5	376.9	371.0	362.4	353.8
80°	290.1	287.0	281.1	272.5	266.7
82.5°	197.2	197.2	194.4	182.7	182.7
85°	118.7	116.0	113.2	104.3	101.5
87.5°	52.3	46.4	40.6	32.0	28.9
90°	2.5	29.5	80.4	75.5	78.0
92.5°	50.9	69.0	71.5	73.9	73.9
95°	119.9	142.8	147.0	147.0	142.8
97.5°	199.5	220.8	229.9	229.9	229.9
100°	291.4	310.3	316.8	316.8	314.4
102.5°	388.3	402.3	411.3	413.7	411.3
105°	494.2	500.8	505.7	509.8	509.8
107.5°	599.3	609.2	609.2	610.8	599.3
110°	701.1	714.2	714.2	714.2	707.7

TEST NUMBER: P920428

CATALOG NUMBER: DFN2DIP-SQ4F0-090D100US935-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	811.1	825.0	822.6	816.0	811.1
115°	919.5	932.5	928.5	926.0	919.5
117.5°	1027.0	1045.1	1033.5	1027.0	1020.4
120°	1135.3	1153.4	1135.3	1135.3	1128.0
122.5°	1233.8	1256.8	1245.3	1238.8	1233.8
125°	1337.3	1357.8	1351.3	1343.8	1341.4
127.5°	1438.3	1463.7	1454.7	1444.8	1438.3
130°	1532.7	1562.2	1558.1	1553.2	1544.2
132.5°	1638.6	1661.6	1663.2	1651.7	1645.1
135°	1729.7	1755.1	1760.1	1757.6	1751.0
137.5°	1831.5	1852.0	1856.1	1854.5	1844.6
140°	1921.0	1941.5	1953.0	1953.0	1944.0
142.5°	2012.9	2033.4	2040.0	2042.5	2033.4
145°	2099.9	2116.3	2129.5	2131.9	2122.9
147.5°	2177.9	2198.5	2208.3	2212.4	2203.4
150°	2258.4	2272.3	2281.4	2288.7	2281.4
152.5°	2329.8	2343.7	2355.3	2364.3	2355.3
155°	2401.2	2407.8	2415.2	2426.6	2419.2
157.5°	2462.8	2467.7	2471.8	2488.2	2476.7
160°	2517.8	2522.7	2525.1	2539.1	2529.3
162.5°	2568.7	2568.7	2571.1	2586.7	2575.2
165°	2612.2	2609.7	2609.7	2626.1	2614.7
167.5°	2651.6	2644.2	2644.2	2660.7	2649.1
170°	2681.1	2674.6	2672.1	2688.6	2674.6
172.5°	2701.6	2695.1	2692.6	2709.0	2695.1
175°	2718.1	2711.5	2706.6	2723.0	2709.0
177.5°	2727.1	2720.6	2715.6	2729.5	2715.6
180°	2723.0	2723.0	2723.0	2723.0	2723.0

TEST NUMBER: P920428

CATALOG NUMBER: DFN2DIP-SQ4F0-090D100US935-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.91	10.77	10.86	11.74	13.01	9.46	10.33	10.42	11.30	12.56
	3H	11.57	12.35	12.54	13.33	14.62	11.08	11.86	12.05	12.84	14.13
	4H	12.16	12.90	13.14	13.88	15.18	11.67	12.40	12.65	13.39	14.68
	6H	12.57	13.24	13.56	14.23	15.54	12.07	12.74	13.06	13.73	15.04
	8H	12.67	13.32	13.67	14.32	15.63	12.17	12.81	13.17	13.82	15.13
	12H	12.72	13.33	13.73	14.33	15.67	12.21	12.82	13.22	13.82	15.16
4H	2H	10.37	11.10	11.35	12.09	13.38	10.01	10.75	11.00	11.73	13.03
	3H	12.24	12.85	13.23	13.86	15.18	11.83	12.44	12.83	13.46	14.77
	4H	12.96	13.52	13.96	14.52	15.86	12.53	13.09	13.54	14.10	15.44
	6H	13.48	13.96	14.49	14.99	16.32	13.04	13.53	14.06	14.56	15.89
	8H	13.63	14.08	14.65	15.10	16.45	13.19	13.64	14.21	14.66	16.01
	12H	13.70	14.11	14.74	15.15	16.50	13.25	13.66	14.29	14.70	16.05
8H	4H	13.15	13.60	14.17	14.63	15.98	12.78	13.23	13.79	14.25	15.60
	6H	13.79	14.16	14.83	15.23	16.57	13.41	13.78	14.45	14.84	16.19
	8H	14.01	14.34	15.06	15.39	16.76	13.62	13.95	14.67	15.00	16.36
	12H	14.15	14.44	15.20	15.48	16.89	13.74	14.03	14.79	15.07	16.48
12H	4H	13.14	13.55	14.18	14.58	15.94	12.77	13.18	13.81	14.22	15.57
	6H	13.82	14.15	14.87	15.20	16.56	13.45	13.78	14.50	14.83	16.19
	8H	14.07	14.35	15.12	15.40	16.81	13.69	13.97	14.74	15.02	16.43

END OF REPORT