

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P920430

Luminaire Tested: DFN2DIP-SQ4F0-090D100US935-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P920430
REPORT IS A COMBINATION OF REPORTS P900138 AND P896915
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-090D100US935-RLLFLL
Description: 4 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 14206.5 lumens
Efficiency: N/A
Efficacy: 90.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 157.4
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.983
Total Harmonic Distortion (THDi): 0.073
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P920430

CATALOG NUMBER: DFN2DIP-SQ4F0-090D100US935-RLLFLL

Luminous Intensity Polar Plot

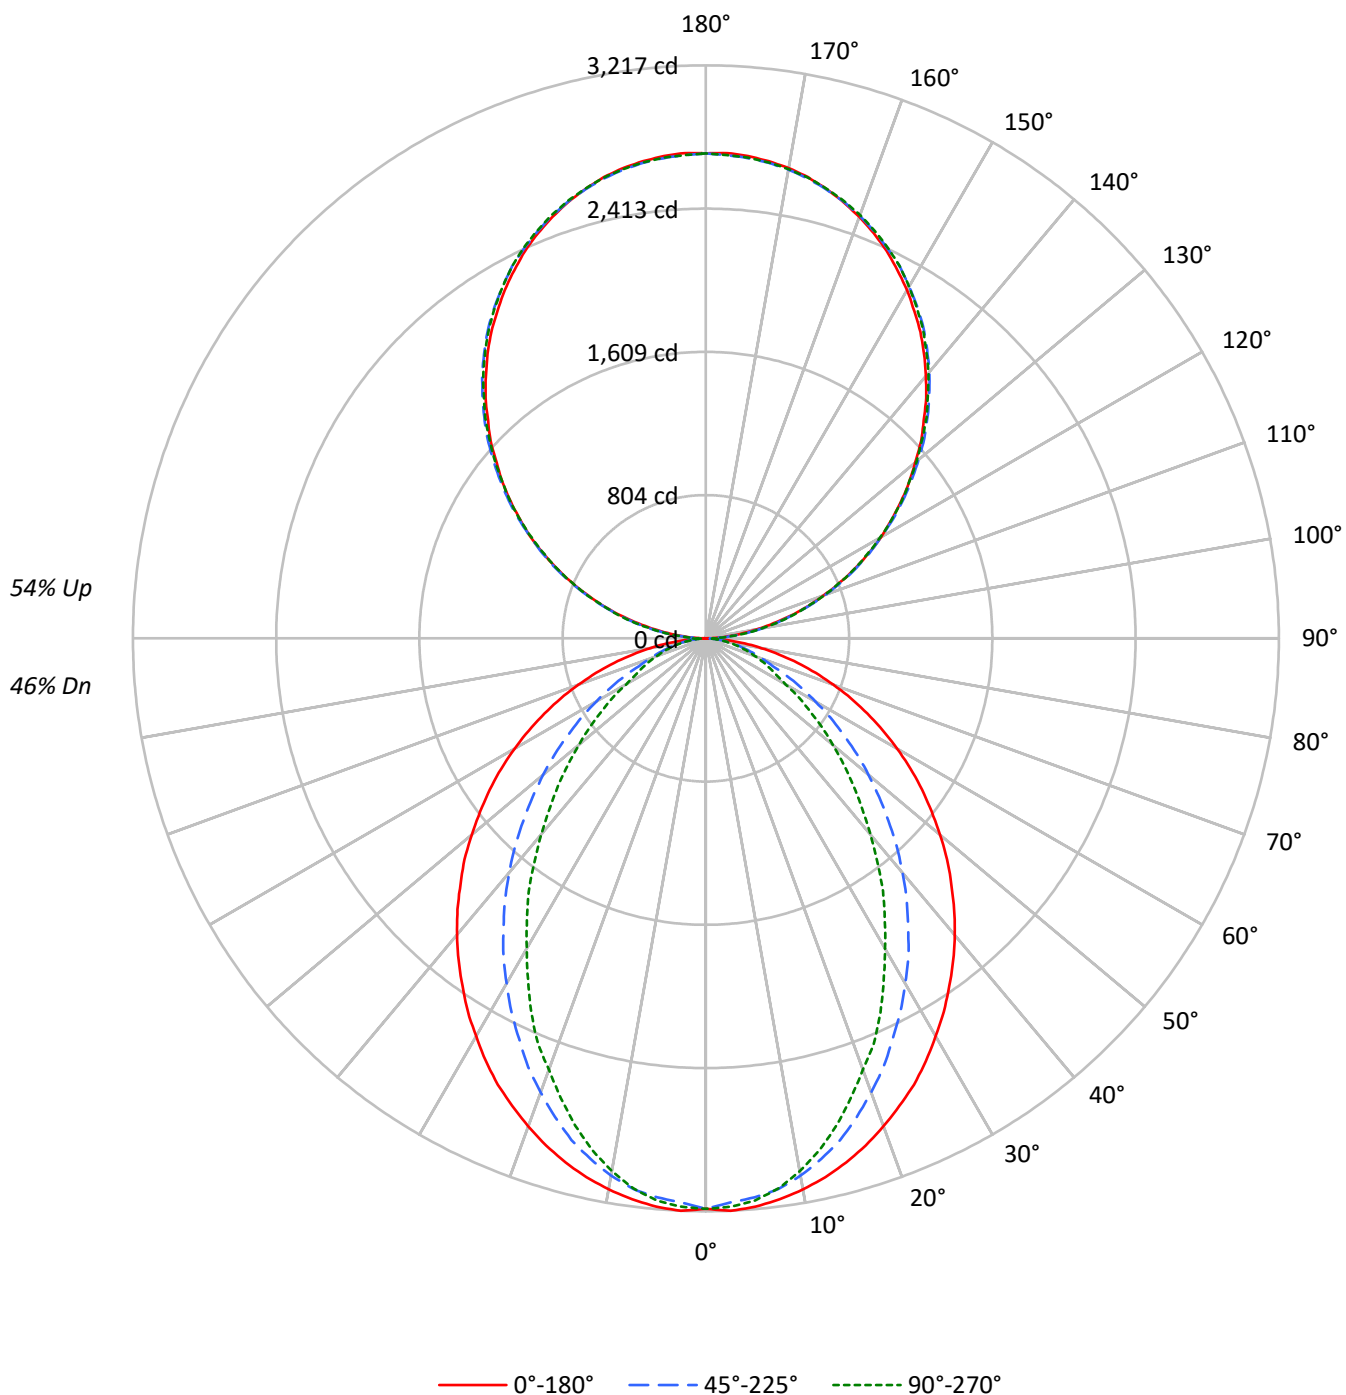

TEST NUMBER: P920430

CATALOG NUMBER: DFN2DIP-SQ4F0-090D100US935-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	106	106	106	106	98	98	98	98	81	81	81	66	66	66	53	53	53
1	97	93	90	86	89	86	83	80	72	70	68	59	58	56	47	46	45
2	89	82	76	71	82	76	71	66	64	60	57	52	50	48	42	41	39
3	82	72	65	60	75	67	61	56	56	52	48	47	44	41	38	36	34
4	75	64	57	51	69	60	53	48	50	45	41	42	38	35	34	32	29
5	69	58	50	44	63	53	46	41	45	40	36	38	34	31	31	28	26
6	63	52	44	38	58	48	41	36	41	36	32	34	30	27	28	25	23
7	59	47	39	34	54	44	37	32	37	32	28	31	27	24	26	23	21
8	55	43	35	30	50	40	33	28	34	29	25	29	25	22	24	21	19
9	51	39	32	27	47	36	30	25	31	26	23	27	23	20	22	19	17
10	48	36	29	24	44	33	27	23	29	24	20	25	21	18	21	18	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2247	2247	2247
5°	2251	2212	2226
10°	2229	2169	2155
15°	2198	2098	2043
20°	2157	1999	1906
25°	2116	1889	1774
30°	2060	1776	1606
35°	2005	1654	1458
40°	1949	1528	1289
45°	1885	1388	1136
50°	1818	1247	986
55°	1748	1096	842
60°	1667	938	693
65°	1574	777	625
70°	1461	627	566
75°	1320	554	517
80°	1115	466	450
85°	776	313	343

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2144 cd/sqm

TEST NUMBER: P920430

CATALOG NUMBER: DFN2DIP-SQ4F0-090D100US935-RLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	300.2	2.1
10°-20°	824.0	5.8
20°-30°	1156.9	8.1
30°-40°	1261.0	8.9
40°-50°	1159.0	8.2
50°-60°	910.3	6.4
60°-70°	592.5	4.2
70°-80°	305.0	2.1
80°-90°	85.6	0.6
90°-100°	168.5	1.2
100°-110°	535.4	3.8
110°-120°	916.2	6.4
120°-130°	1204.9	8.5
130°-140°	1352.5	9.5
140°-150°	1326.3	9.3
150°-160°	1112.6	7.8
160°-170°	737.8	5.2
170°-180°	257.9	1.8
0°-30°	2281.0	16.1
0°-40°	3542.0	24.9
0°-60°	5611.3	39.5
0°-90°	6594.4	46.4
90°-120°	1620.1	11.4
90°-150°	5503.8	38.7
90°-180°	7612.0	53.6
0°-180°	14206.5	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3203	3203	3203	3203	3203	
5°	3203	3188	3150	3176	3168	304
15°	3046	3014	2916	2861	2832	858
25°	2765	2672	2481	2362	2319	1272
35°	2383	2235	1980	1797	1733	1491
45°	1948	1753	1449	1243	1174	1504
55°	1481	1255	942	768	713	1323
65°	1000	765	504	406	397	991
75°	533	330	232	212	209	564
85°	124	64	55	55	55	143
90°	2	30	80	76	78	14
95°	120	143	147	147	143	133
105°	494	501	506	510	510	522
115°	920	932	928	926	920	909
125°	1337	1358	1351	1344	1341	1195
135°	1730	1755	1760	1758	1751	1337
145°	2100	2116	2130	2132	2123	1312
155°	2401	2408	2415	2427	2419	1105
165°	2612	2610	2610	2626	2615	737
175°	2718	2712	2707	2723	2709	258
180°	2723	2723	2723	2723	2723	

TEST NUMBER: P920430

CATALOG NUMBER: DFN2DIP-SQ4F0-090D100US935-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3202.7	3202.7	3202.7	3202.7	3202.7
2.5°	3217.1	3202.7	3170.6	3199.9	3194.0
5°	3202.7	3188.2	3150.4	3176.5	3167.9
7.5°	3176.5	3159.3	3118.7	3130.1	3115.6
10°	3141.8	3121.5	3063.7	3054.7	3037.5
12.5°	3098.4	3072.3	2993.9	2976.6	2944.6
15°	3046.1	3014.2	2915.8	2860.7	2831.8
17.5°	2985.3	2938.8	2817.0	2753.4	2707.0
20°	2915.8	2857.7	2712.7	2640.5	2576.5
22.5°	2840.4	2773.7	2605.5	2507.1	2463.7
25°	2765.1	2672.2	2481.0	2362.2	2318.6
27.5°	2675.3	2576.5	2365.0	2228.8	2162.1
30°	2579.6	2469.3	2237.4	2089.8	2011.4
32.5°	2486.7	2353.3	2115.9	1941.9	1869.3
35°	2382.6	2234.6	1979.7	1797.1	1733.1
37.5°	2281.0	2121.5	1852.1	1651.9	1579.7
40°	2173.8	2000.0	1718.6	1512.9	1437.6
42.5°	2063.6	1878.3	1585.4	1370.9	1298.6
45°	1947.7	1753.4	1449.2	1243.2	1173.7
47.5°	1837.6	1631.9	1318.9	1112.8	1049.2
50°	1715.9	1510.1	1191.3	991.1	930.5
52.5°	1596.9	1379.5	1069.5	878.2	823.2
55°	1480.9	1254.9	941.8	768.2	713.1
57.5°	1362.3	1130.4	829.1	666.7	620.3
60°	1240.4	1008.6	710.1	562.4	516.0
62.5°	1121.8	889.9	608.6	469.6	446.5
65°	1000.0	765.1	504.3	405.9	397.0
67.5°	884.1	649.1	405.9	356.4	347.8
70°	762.3	536.3	336.1	307.2	295.5
72.5°	646.4	431.7	281.0	258.0	252.2
75°	533.2	330.3	231.9	211.5	208.8
77.5°	420.3	234.6	182.6	171.0	165.1
80°	315.8	168.2	139.0	127.6	127.6
82.5°	220.2	113.1	95.7	89.8	89.8
85°	124.5	63.6	55.0	55.0	55.0
87.5°	46.4	23.1	23.1	20.3	20.3
90°	2.5	29.5	80.4	75.5	78.0
92.5°	50.9	69.0	71.5	73.9	73.9
95°	119.9	142.8	147.0	147.0	142.8
97.5°	199.5	220.8	229.9	229.9	229.9
100°	291.4	310.3	316.8	316.8	314.4
102.5°	388.3	402.3	411.3	413.7	411.3
105°	494.2	500.8	505.7	509.8	509.8
107.5°	599.3	609.2	609.2	610.8	599.3
110°	701.1	714.2	714.2	714.2	707.7

TEST NUMBER: P920430

CATALOG NUMBER: DFN2DIP-SQ4F0-090D100US935-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	811.1	825.0	822.6	816.0	811.1
115°	919.5	932.5	928.5	926.0	919.5
117.5°	1027.0	1045.1	1033.5	1027.0	1020.4
120°	1135.3	1153.4	1135.3	1135.3	1128.0
122.5°	1233.8	1256.8	1245.3	1238.8	1233.8
125°	1337.3	1357.8	1351.3	1343.8	1341.4
127.5°	1438.3	1463.7	1454.7	1444.8	1438.3
130°	1532.7	1562.2	1558.1	1553.2	1544.2
132.5°	1638.6	1661.6	1663.2	1651.7	1645.1
135°	1729.7	1755.1	1760.1	1757.6	1751.0
137.5°	1831.5	1852.0	1856.1	1854.5	1844.6
140°	1921.0	1941.5	1953.0	1953.0	1944.0
142.5°	2012.9	2033.4	2040.0	2042.5	2033.4
145°	2099.9	2116.3	2129.5	2131.9	2122.9
147.5°	2177.9	2198.5	2208.3	2212.4	2203.4
150°	2258.4	2272.3	2281.4	2288.7	2281.4
152.5°	2329.8	2343.7	2355.3	2364.3	2355.3
155°	2401.2	2407.8	2415.2	2426.6	2419.2
157.5°	2462.8	2467.7	2471.8	2488.2	2476.7
160°	2517.8	2522.7	2525.1	2539.1	2529.3
162.5°	2568.7	2568.7	2571.1	2586.7	2575.2
165°	2612.2	2609.7	2609.7	2626.1	2614.7
167.5°	2651.6	2644.2	2644.2	2660.7	2649.1
170°	2681.1	2674.6	2672.1	2688.6	2674.6
172.5°	2701.6	2695.1	2692.6	2709.0	2695.1
175°	2718.1	2711.5	2706.6	2723.0	2709.0
177.5°	2727.1	2720.6	2715.6	2729.5	2715.6
180°	2723.0	2723.0	2723.0	2723.0	2723.0

TEST NUMBER: P920430

CATALOG NUMBER: DFN2DIP-SQ4F0-090D100US935-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.63	10.43	10.62	11.43	12.75	5.59	6.39	6.58	7.39	8.71
	3H	11.31	12.02	12.31	13.03	14.38	6.77	7.49	7.78	8.50	9.85
	4H	11.92	12.59	12.93	13.61	14.96	7.22	7.90	8.24	8.92	10.27
	6H	12.34	12.96	13.37	13.98	15.35	7.54	8.17	8.57	9.19	10.55
	8H	12.47	13.06	13.50	14.10	15.46	7.63	8.23	8.67	9.26	10.62
	12H	12.53	13.10	13.57	14.12	15.51	7.68	8.24	8.71	9.27	10.65
4H	2H	9.64	10.32	10.67	11.33	12.69	6.18	6.86	7.21	7.87	9.23
	3H	11.47	12.04	12.50	13.08	14.44	7.53	8.09	8.56	9.14	10.50
	4H	12.17	12.68	13.21	13.72	15.11	8.08	8.59	9.12	9.63	11.02
	6H	12.68	13.13	13.73	14.18	15.57	8.50	8.94	9.55	10.00	11.38
	8H	12.86	13.28	13.91	14.33	15.72	8.63	9.04	9.67	10.09	11.49
	12H	12.96	13.33	14.03	14.40	15.80	8.69	9.06	9.76	10.13	11.53
8H	4H	12.13	12.55	13.18	13.60	15.00	8.36	8.77	9.41	9.82	11.22
	6H	12.70	13.04	13.78	14.14	15.53	8.88	9.22	9.95	10.31	11.71
	8H	12.92	13.22	14.00	14.30	15.71	9.07	9.37	10.15	10.44	11.86
	12H	13.06	13.33	14.15	14.40	15.85	9.19	9.45	10.27	10.52	11.98
12H	4H	12.08	12.46	13.15	13.52	14.93	8.36	8.74	9.43	9.80	11.20
	6H	12.68	12.98	13.76	14.05	15.47	8.93	9.23	10.01	10.30	11.72
	8H	12.90	13.16	13.98	14.23	15.69	9.14	9.40	10.22	10.47	11.93

END OF REPORT