

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P920448

Luminaire Tested: DFN2DIP-SQ4F0-100D060US935-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P920448
REPORT IS A COMBINATION OF REPORTS P900067 AND P896915
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-100D060US935-FLLFLL
Description: 4 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 13095.8 lumens
Efficiency: N/A
Efficacy: 95.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 137.9
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9968
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P920448

CATALOG NUMBER: DFN2DIP-SQ4F0-100D060US935-FLLFLL

Luminous Intensity Polar Plot

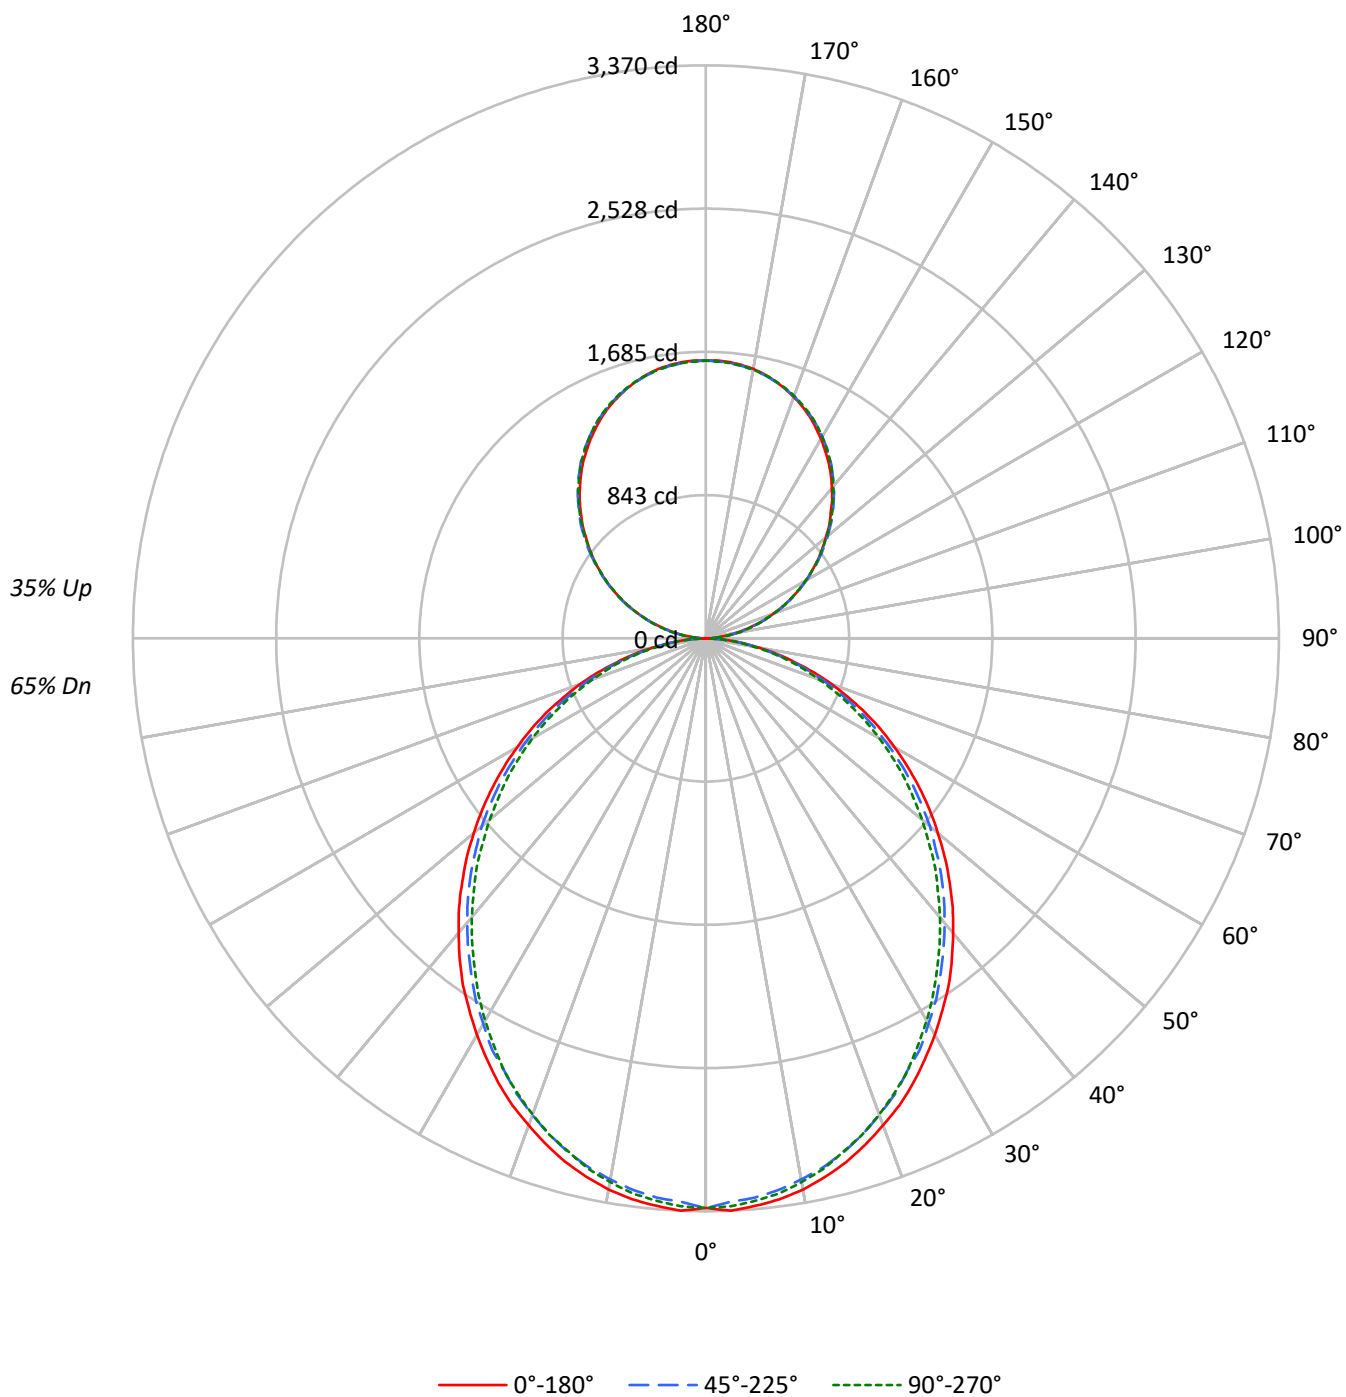

TEST NUMBER: P920448

CATALOG NUMBER: DFN2DIP-SQ4F0-100D060US935-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	111	111	111	111	104	104	104	104	92	92	92	80	80	80	70	70	70
1	101	97	93	89	95	91	88	84	81	78	75	71	69	67	62	60	59
2	92	85	78	73	86	80	74	69	71	66	63	62	59	56	55	52	50
3	84	74	67	61	79	70	63	58	62	57	53	55	51	47	48	45	42
4	77	66	58	52	72	62	55	49	55	50	45	49	44	41	43	40	37
5	71	59	50	44	66	56	48	42	50	44	39	44	39	35	39	35	32
6	65	53	45	39	61	50	43	37	45	39	34	40	35	31	35	31	28
7	60	48	40	34	57	45	38	33	41	35	30	36	31	28	32	28	25
8	56	44	36	30	53	41	34	29	37	31	27	33	28	25	30	26	22
9	52	40	32	27	49	38	31	26	34	28	24	31	26	22	27	23	20
10	49	37	29	24	46	35	28	23	32	26	22	28	24	20	25	21	19

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2351	2351	2351
5°	2354	2318	2334
10°	2335	2288	2303
15°	2301	2250	2255
20°	2254	2199	2205
25°	2208	2137	2147
30°	2150	2079	2073
35°	2096	2011	1995
40°	2028	1942	1921
45°	1961	1873	1845
50°	1887	1800	1758
55°	1810	1717	1677
60°	1723	1617	1585
65°	1628	1514	1476
70°	1507	1389	1359
75°	1339	1239	1252
80°	1138	1048	1046
85°	822	717	703

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1961 cd/sqm

TEST NUMBER: P920448

CATALOG NUMBER: DFN2DIP-SQ4F0-100D060US935-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	315.3	2.4
10°-20°	887.2	6.8
20°-30°	1303.8	10.0
30°-40°	1514.3	11.6
40°-50°	1512.4	11.5
50°-60°	1318.8	10.1
60°-70°	974.9	7.4
70°-80°	551.6	4.2
80°-90°	150.2	1.1
90°-100°	101.1	0.8
100°-110°	321.2	2.5
110°-120°	549.7	4.2
120°-130°	723.0	5.5
130°-140°	811.5	6.2
140°-150°	795.8	6.1
150°-160°	667.5	5.1
160°-170°	442.7	3.4
170°-180°	154.7	1.2
0°-30°	2506.3	19.1
0°-40°	4020.6	30.7
0°-60°	6851.8	52.3
0°-90°	8528.5	65.1
90°-120°	972.0	7.4
90°-150°	3302.3	25.2
90°-180°	4567.0	34.9
0°-180°	13095.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3350	3350	3350	3350	3350	
5°	3350	3338	3302	3328	3322	318
15°	3189	3170	3128	3141	3125	898
25°	2886	2861	2806	2812	2806	1328
35°	2490	2458	2406	2387	2371	1555
45°	2026	2004	1955	1920	1907	1564
55°	1534	1514	1476	1437	1421	1371
65°	1034	1015	983	954	938	1023
75°	541	535	518	499	506	578
85°	132	129	126	116	113	147
90°	2	18	48	45	47	13
95°	72	86	88	88	86	80
105°	296	300	303	306	306	313
115°	552	560	557	556	552	546
125°	802	815	811	806	805	717
135°	1038	1053	1056	1055	1051	802
145°	1260	1270	1278	1279	1274	787
155°	1441	1445	1449	1456	1452	663
165°	1567	1566	1566	1576	1569	442
175°	1631	1627	1624	1634	1625	155
180°	1634	1634	1634	1634	1634	

TEST NUMBER: P920448

CATALOG NUMBER: DFN2DIP-SQ4F0-100D060US935-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3350.2	3350.2	3350.2	3350.2	3350.2
2.5°	3369.7	3353.6	3318.0	3350.2	3344.0
5°	3350.2	3337.6	3302.0	3327.7	3321.5
7.5°	3327.7	3308.5	3272.9	3298.9	3292.5
10°	3292.5	3269.9	3231.2	3256.9	3247.3
12.5°	3243.9	3224.8	3186.1	3202.2	3195.7
15°	3189.2	3170.1	3128.0	3141.0	3125.0
17.5°	3121.5	3102.4	3060.3	3076.4	3060.3
20°	3047.3	3028.2	2983.1	2992.7	2980.0
22.5°	2973.5	2944.5	2902.4	2902.4	2896.0
25°	2886.4	2860.8	2806.1	2812.2	2806.1
27.5°	2789.6	2767.1	2725.4	2715.8	2699.7
30°	2693.3	2667.3	2619.1	2609.5	2596.5
32.5°	2590.1	2570.9	2519.3	2499.8	2486.8
35°	2490.3	2458.1	2406.5	2387.0	2370.9
37.5°	2377.5	2348.4	2296.8	2274.2	2258.1
40°	2261.6	2235.6	2184.0	2155.3	2142.3
42.5°	2148.8	2122.8	2071.6	2039.1	2020.0
45°	2026.4	2003.9	1955.3	1920.1	1907.2
47.5°	1907.2	1884.6	1833.0	1797.4	1778.3
50°	1781.4	1765.3	1720.2	1675.1	1659.1
52.5°	1659.1	1636.5	1594.7	1559.3	1536.7
55°	1533.6	1514.2	1475.5	1436.8	1420.8
57.5°	1407.8	1391.7	1349.7	1311.1	1298.1
60°	1282.0	1269.4	1224.3	1188.7	1179.1
62.5°	1159.7	1137.1	1105.0	1072.9	1059.9
65°	1034.2	1014.8	982.7	953.6	937.5
67.5°	905.4	889.0	860.3	837.8	824.7
70°	786.1	773.1	744.1	721.5	708.9
72.5°	663.7	650.7	634.7	612.2	602.5
75°	541.1	534.9	518.5	499.4	505.8
77.5°	431.7	418.7	412.2	402.6	393.0
80°	322.3	318.9	312.4	302.8	296.4
82.5°	219.1	219.1	216.0	203.0	203.0
85°	131.9	128.9	125.8	115.9	112.8
87.5°	58.1	51.6	45.1	35.6	32.1
90°	1.5	17.7	48.3	45.3	46.8
92.5°	30.6	41.4	42.9	44.3	44.3
95°	71.9	85.7	88.2	88.2	85.7
97.5°	119.7	132.5	137.9	137.9	137.9
100°	174.9	186.1	190.1	190.1	188.6
102.5°	233.0	241.3	246.8	248.2	246.8
105°	296.5	300.5	303.4	305.9	305.9
107.5°	359.6	365.5	365.5	366.4	359.6
110°	420.7	428.5	428.5	428.5	424.6

TEST NUMBER: P920448

CATALOG NUMBER: DFN2DIP-SQ4F0-100D060US935-FLLFL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	486.6	495.0	493.5	489.6	486.6
115°	551.6	559.6	557.1	555.6	551.6
117.5°	616.2	627.1	620.1	616.2	612.3
120°	681.2	692.1	681.2	681.2	676.7
122.5°	740.3	754.1	747.2	743.3	740.3
125°	802.4	814.7	810.7	806.3	804.9
127.5°	863.0	878.2	872.8	866.9	863.0
130°	919.6	937.4	934.9	931.9	926.5
132.5°	983.2	996.9	997.9	991.0	987.0
135°	1037.8	1053.1	1056.0	1054.6	1050.6
137.5°	1098.9	1111.2	1113.7	1112.7	1106.8
140°	1152.6	1164.9	1171.8	1171.8	1166.4
142.5°	1207.7	1220.0	1224.0	1225.5	1220.0
145°	1260.0	1269.8	1277.7	1279.2	1273.8
147.5°	1306.7	1319.0	1325.0	1327.4	1322.0
150°	1355.0	1363.4	1368.8	1373.2	1368.8
152.5°	1397.8	1406.3	1413.2	1418.6	1413.2
155°	1440.7	1444.7	1449.1	1456.0	1451.6
157.5°	1477.6	1480.7	1483.1	1493.0	1486.1
160°	1510.7	1513.6	1515.1	1523.4	1517.6
162.5°	1541.2	1541.2	1542.6	1552.0	1545.1
165°	1567.3	1565.8	1565.8	1575.7	1568.8
167.5°	1591.0	1586.6	1586.6	1596.4	1589.5
170°	1608.7	1604.7	1603.3	1613.1	1604.7
172.5°	1621.0	1617.0	1615.6	1625.4	1617.0
175°	1630.8	1626.9	1623.9	1633.8	1625.4
177.5°	1636.2	1632.4	1629.4	1637.7	1629.4
180°	1633.8	1633.8	1633.8	1633.8	1633.8

TEST NUMBER: P920448

CATALOG NUMBER: DFN2DIP-SQ4F0-100D060US935-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.54	12.56	12.36	13.40	14.43	11.10	12.11	11.91	12.95	13.99
	3H	13.22	14.13	14.05	14.98	16.04	12.73	13.64	13.56	14.49	15.55
	4H	13.82	14.68	14.66	15.53	16.61	13.32	14.18	14.17	15.04	16.12
	6H	14.23	15.02	15.09	15.89	16.98	13.73	14.52	14.58	15.39	16.47
	8H	14.34	15.10	15.21	15.98	17.07	13.84	14.59	14.70	15.48	16.57
	12H	14.39	15.12	15.27	15.99	17.11	13.88	14.61	14.76	15.48	16.60
4H	2H	12.02	12.88	12.87	13.74	14.82	11.67	12.53	12.52	13.39	14.46
	3H	13.91	14.63	14.77	15.51	16.61	13.50	14.22	14.36	15.11	16.20
	4H	14.63	15.29	15.51	16.17	17.29	14.21	14.86	15.08	15.75	16.87
	6H	15.16	15.73	16.05	16.64	17.76	14.73	15.29	15.62	16.20	17.32
	8H	15.32	15.85	16.21	16.75	17.88	14.88	15.41	15.77	16.31	17.45
	12H	15.40	15.88	16.31	16.80	17.94	14.95	15.43	15.86	16.35	17.49
8H	4H	14.84	15.37	15.73	16.27	17.41	14.46	14.99	15.36	15.90	17.03
	6H	15.48	15.92	16.40	16.87	18.00	15.10	15.54	16.02	16.48	17.62
	8H	15.71	16.10	16.64	17.03	18.19	15.32	15.70	16.25	16.64	17.79
	12H	15.85	16.19	16.78	17.12	18.33	15.44	15.78	16.37	16.71	17.91
12H	4H	14.83	15.31	15.75	16.23	17.37	14.47	14.94	15.38	15.87	17.01
	6H	15.51	15.90	16.44	16.84	17.99	15.14	15.53	16.07	16.47	17.62
	8H	15.77	16.11	16.70	17.04	18.24	15.39	15.73	16.32	16.66	17.86

END OF REPORT