

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P920469

Luminaire Tested: DFN2DIP-SQ4F0-100D110US935-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P920469
REPORT IS A COMBINATION OF REPORTS P901677 AND P898471
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-100D110US935-FLLONL
Description: 4 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 17900.1 lumens
Efficiency: N/A
Efficacy: 102.0 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 175.5
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9968
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P920469

CATALOG NUMBER: DFN2DIP-SQ4F0-100D110US935-FLLONL

Luminous Intensity Polar Plot

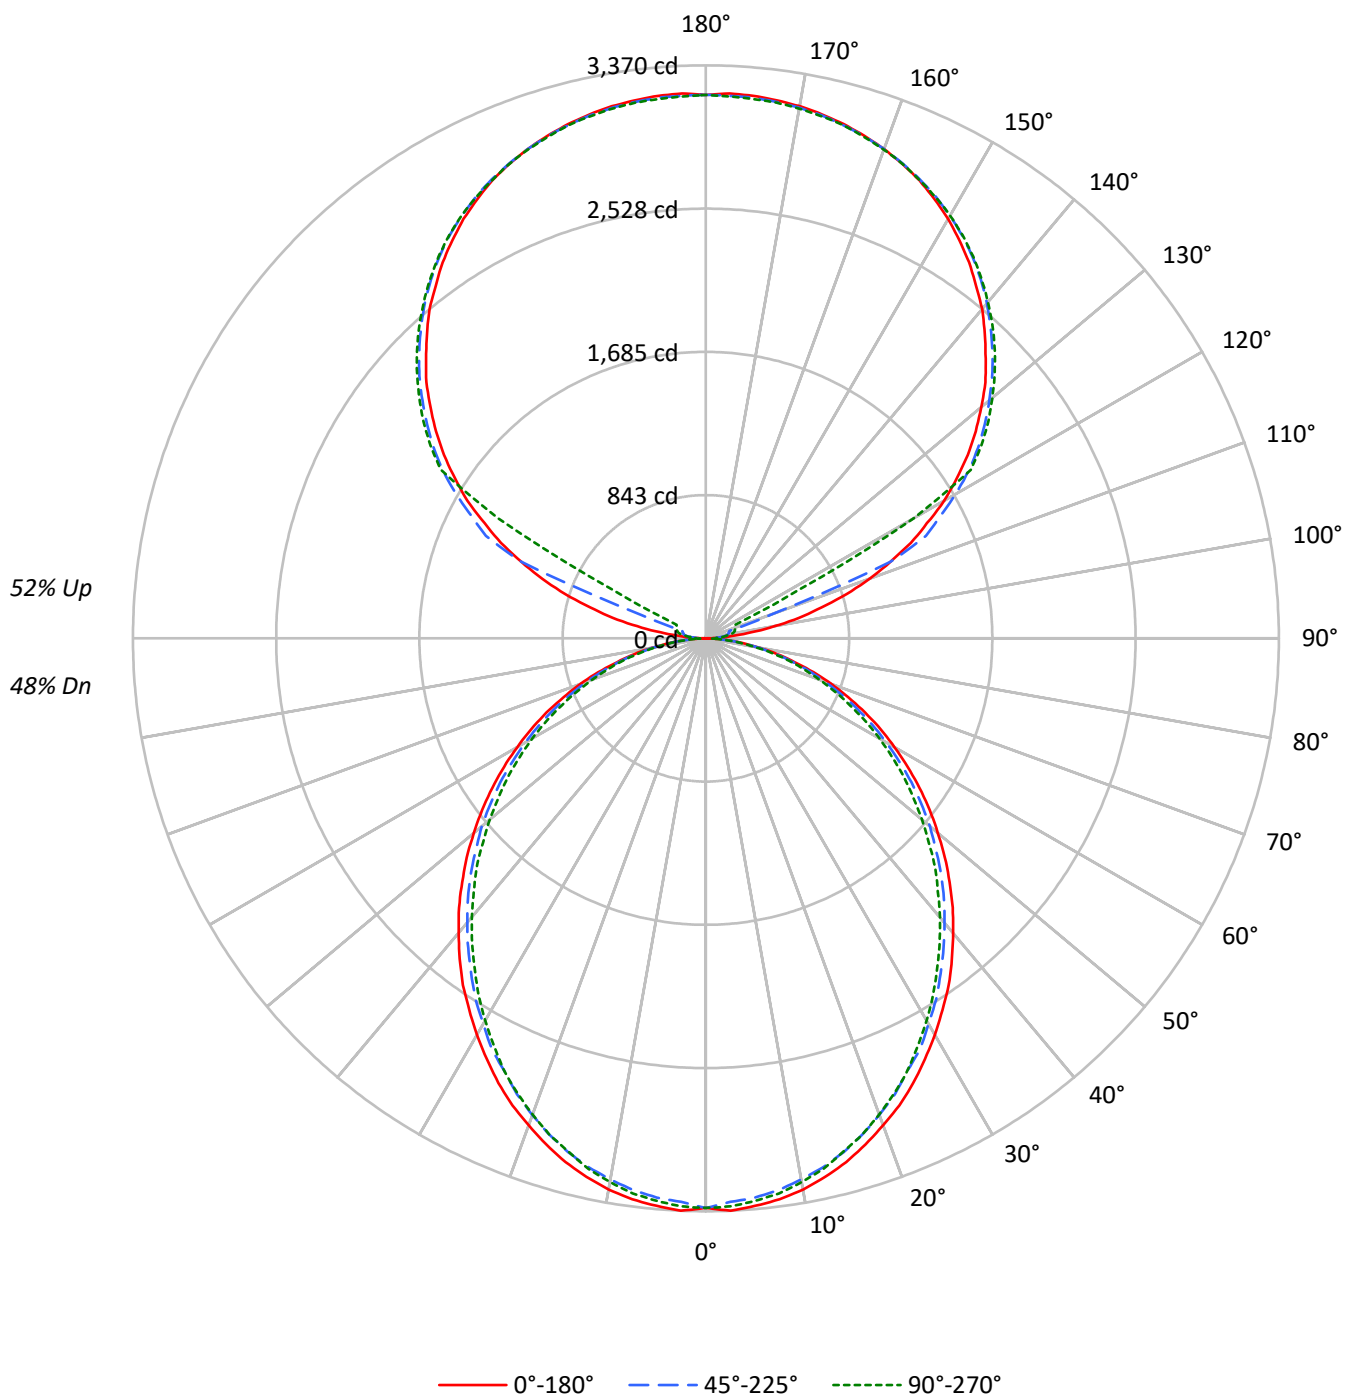

TEST NUMBER: P920469

CATALOG NUMBER: DFN2DIP-SQ4F0-100D110US935-FLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	98	98	98	98	82	82	82	67	67	67	54	54	54
1	97	93	89	86	89	86	82	79	72	70	67	59	58	56	48	47	46
2	89	81	75	70	81	75	70	65	63	59	56	52	49	47	42	40	38
3	81	71	64	58	74	66	60	54	56	51	47	46	43	40	37	35	33
4	74	63	55	49	68	58	51	46	49	44	40	41	37	34	33	30	28
5	68	56	48	42	62	52	45	40	44	39	34	37	33	29	30	27	25
6	62	50	42	37	57	47	40	34	40	34	30	33	29	26	27	24	22
7	58	46	38	32	53	42	35	30	36	30	26	30	26	23	25	22	19
8	54	41	34	28	49	38	31	27	33	27	23	28	23	20	23	20	17
9	50	38	30	25	46	35	28	24	30	25	21	25	21	18	21	18	16
10	47	35	27	23	43	32	26	21	28	23	19	24	19	17	20	16	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2351	2351	2351
5°	2354	2318	2334
10°	2335	2288	2303
15°	2301	2250	2255
20°	2254	2199	2205
25°	2208	2137	2147
30°	2150	2079	2073
35°	2096	2011	1995
40°	2028	1942	1921
45°	1961	1873	1845
50°	1887	1800	1758
55°	1810	1717	1677
60°	1723	1617	1585
65°	1628	1514	1476
70°	1507	1389	1359
75°	1339	1239	1252
80°	1138	1048	1046
85°	822	717	703

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 1961 cd/sqm

TEST NUMBER: P920469

CATALOG NUMBER: DFN2DIP-SQ4F0-100D110US935-FLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	315.3	1.8
10°-20°	887.2	5.0
20°-30°	1303.8	7.3
30°-40°	1514.3	8.5
40°-50°	1512.4	8.4
50°-60°	1318.8	7.4
60°-70°	974.9	5.4
70°-80°	551.6	3.1
80°-90°	151.2	0.8
90°-100°	105.4	0.6
100°-110°	392.9	2.2
110°-120°	1042.0	5.8
120°-130°	1728.3	9.7
130°-140°	1835.9	10.3
140°-150°	1706.2	9.5
150°-160°	1371.8	7.7
160°-170°	883.9	4.9
170°-180°	304.2	1.7
0°-30°	2506.3	14.0
0°-40°	4020.6	22.5
0°-60°	6851.8	38.3
0°-90°	8529.5	47.7
90°-120°	1540.3	8.6
90°-150°	6810.7	38.0
90°-180°	9371.0	52.4
0°-180°	17900.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3350	3350	3350	3350	3350	
5°	3350	3338	3302	3328	3322	318
15°	3189	3170	3128	3141	3125	898
25°	2886	2861	2806	2812	2806	1328
35°	2490	2458	2406	2387	2371	1555
45°	2026	2004	1955	1920	1907	1564
55°	1534	1514	1476	1437	1421	1371
65°	1034	1015	983	954	938	1023
75°	541	535	518	499	506	578
85°	132	129	126	116	113	147
90°	2	28	46	58	62	16
95°	150	74	90	102	99	178
105°	703	773	141	166	176	751
115°	1330	1369	1427	356	190	1309
125°	1880	1910	1954	1971	1978	1677
135°	2327	2364	2384	2408	2403	1797
145°	2699	2697	2736	2752	2741	1688
155°	2972	2951	2979	2993	2974	1370
165°	3132	3118	3125	3141	3125	885
175°	3203	3187	3192	3208	3185	305
180°	3196	3196	3196	3196	3196	

TEST NUMBER: P920469

CATALOG NUMBER: DFN2DIP-SQ4F0-100D110US935-FLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3350.2	3350.2	3350.2	3350.2	3350.2
2.5°	3369.7	3353.6	3318.0	3350.2	3344.0
5°	3350.2	3337.6	3302.0	3327.7	3321.5
7.5°	3327.7	3308.5	3272.9	3298.9	3292.5
10°	3292.5	3269.9	3231.2	3256.9	3247.3
12.5°	3243.9	3224.8	3186.1	3202.2	3195.7
15°	3189.2	3170.1	3128.0	3141.0	3125.0
17.5°	3121.5	3102.4	3060.3	3076.4	3060.3
20°	3047.3	3028.2	2983.1	2992.7	2980.0
22.5°	2973.5	2944.5	2902.4	2902.4	2896.0
25°	2886.4	2860.8	2806.1	2812.2	2806.1
27.5°	2789.6	2767.1	2725.4	2715.8	2699.7
30°	2693.3	2667.3	2619.1	2609.5	2596.5
32.5°	2590.1	2570.9	2519.3	2499.8	2486.8
35°	2490.3	2458.1	2406.5	2387.0	2370.9
37.5°	2377.5	2348.4	2296.8	2274.2	2258.1
40°	2261.6	2235.6	2184.0	2155.3	2142.3
42.5°	2148.8	2122.8	2071.6	2039.1	2020.0
45°	2026.4	2003.9	1955.3	1920.1	1907.2
47.5°	1907.2	1884.6	1833.0	1797.4	1778.3
50°	1781.4	1765.3	1720.2	1675.1	1659.1
52.5°	1659.1	1636.5	1594.7	1559.3	1536.7
55°	1533.6	1514.2	1475.5	1436.8	1420.8
57.5°	1407.8	1391.7	1349.7	1311.1	1298.1
60°	1282.0	1269.4	1224.3	1188.7	1179.1
62.5°	1159.7	1137.1	1105.0	1072.9	1059.9
65°	1034.2	1014.8	982.7	953.6	937.5
67.5°	905.4	889.0	860.3	837.8	824.7
70°	786.1	773.1	744.1	721.5	708.9
72.5°	663.7	650.7	634.7	612.2	602.5
75°	541.1	534.9	518.5	499.4	505.8
77.5°	431.7	418.7	412.2	402.6	393.0
80°	322.3	318.9	312.4	302.8	296.4
82.5°	219.1	219.1	216.0	203.0	203.0
85°	131.9	128.9	125.8	115.9	112.8
87.5°	58.1	51.6	45.1	35.6	32.1
90°	2.2	27.7	46.1	57.9	62.3
92.5°	57.9	48.6	55.4	60.2	62.3
95°	150.2	73.9	90.1	101.9	99.4
97.5°	270.5	81.0	117.8	124.9	127.2
100°	409.5	92.6	131.8	150.2	154.9
102.5°	561.9	557.5	136.5	161.8	168.9
105°	703.1	772.6	141.2	166.4	175.8
107.5°	867.4	925.0	145.9	171.1	180.5
110°	1024.7	1073.1	404.8	173.6	182.6

TEST NUMBER: P920469

CATALOG NUMBER: DFN2DIP-SQ4F0-100D110US935-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1172.8	1214.2	1174.9	178.0	185.1
115°	1329.8	1369.1	1427.1	356.2	189.8
117.5°	1466.4	1512.5	1552.0	1221.1	615.2
120°	1619.0	1653.6	1695.4	1723.1	1410.8
122.5°	1748.4	1785.5	1831.9	1845.6	1848.1
125°	1880.2	1910.5	1954.4	1970.6	1977.5
127.5°	2000.5	2032.9	2067.8	2090.8	2093.1
130°	2113.9	2151.0	2176.3	2201.8	2199.7
132.5°	2229.6	2259.8	2285.1	2305.9	2303.8
135°	2326.8	2363.9	2384.4	2407.9	2403.1
137.5°	2428.4	2456.2	2479.5	2502.6	2495.7
140°	2527.9	2546.5	2571.8	2592.6	2581.1
142.5°	2611.3	2627.5	2657.5	2675.9	2664.4
145°	2699.2	2696.7	2736.0	2752.3	2740.7
147.5°	2775.3	2768.5	2807.7	2819.3	2810.2
150°	2849.5	2833.3	2870.3	2884.1	2872.5
152.5°	2911.8	2893.4	2928.0	2942.0	2925.8
155°	2972.0	2951.3	2979.1	2992.8	2974.4
157.5°	3020.6	3002.1	3023.0	3039.2	3020.6
160°	3062.3	3048.3	3062.3	3076.0	3059.8
162.5°	3099.1	3085.4	3096.9	3113.1	3092.3
165°	3131.5	3117.8	3124.6	3140.8	3124.6
167.5°	3157.0	3143.1	3150.2	3166.4	3145.6
170°	3177.9	3163.9	3168.6	3184.8	3163.9
172.5°	3191.6	3177.9	3182.6	3198.8	3177.9
175°	3203.2	3187.0	3191.6	3207.9	3184.8
177.5°	3207.9	3191.6	3194.1	3210.3	3189.5
180°	3196.4	3196.4	3196.4	3196.4	3196.4

TEST NUMBER: P920469

CATALOG NUMBER: DFN2DIP-SQ4F0-100D110US935-FLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.03	10.87	11.01	11.86	13.17	9.59	10.43	10.57	11.42	12.72
	3H	11.70	12.45	12.68	13.45	14.77	11.21	11.96	12.19	12.96	14.28
	4H	12.29	13.00	13.29	14.00	15.34	11.79	12.50	12.79	13.51	14.84
	6H	12.69	13.35	13.70	14.35	15.70	12.19	12.84	13.20	13.85	15.20
	8H	12.79	13.42	13.81	14.44	15.79	12.29	12.92	13.31	13.94	15.29
	12H	12.84	13.44	13.87	14.46	15.82	12.33	12.93	13.36	13.95	15.31
4H	2H	10.49	11.21	11.50	12.21	13.54	10.14	10.85	11.14	11.85	13.19
	3H	12.36	12.96	13.38	13.99	15.34	11.95	12.55	12.97	13.58	14.93
	4H	13.08	13.62	14.10	14.65	16.02	12.65	13.20	13.68	14.22	15.59
	6H	13.60	14.06	14.63	15.11	16.48	13.16	13.63	14.20	14.68	16.05
	8H	13.75	14.19	14.78	15.23	16.61	13.31	13.75	14.35	14.79	16.17
	12H	13.82	14.22	14.88	15.27	16.66	13.37	13.77	14.43	14.82	16.21
8H	4H	13.27	13.71	14.31	14.75	16.13	12.90	13.33	13.93	14.37	15.76
	6H	13.91	14.27	14.97	15.35	16.73	13.52	13.89	14.58	14.97	16.35
	8H	14.13	14.45	15.20	15.52	16.92	13.74	14.06	14.81	15.12	16.52
	12H	14.27	14.55	15.34	15.61	17.05	13.85	14.13	14.92	15.20	16.64
12H	4H	13.26	13.65	14.31	14.71	16.10	12.89	13.29	13.94	14.34	15.73
	6H	13.94	14.26	15.00	15.32	16.72	13.57	13.89	14.63	14.95	16.35
	8H	14.18	14.46	15.25	15.52	16.96	13.80	14.08	14.87	15.14	16.58

END OF REPORT