

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P920578

Luminaire Tested: DFN2DIP-SQ4F0-140D110US935-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P920578
REPORT IS A COMBINATION OF REPORTS P900164 AND P896915
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-140D110US935-RLLFLL
Description: 4 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 18627.7 lumens
Efficiency: N/A
Efficacy: 82.2 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 226.6
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9789
Total Harmonic Distortion (THDi): 0.074
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P920578

CATALOG NUMBER: DFN2DIP-SQ4F0-140D110US935-RLLFLL

Luminous Intensity Polar Plot

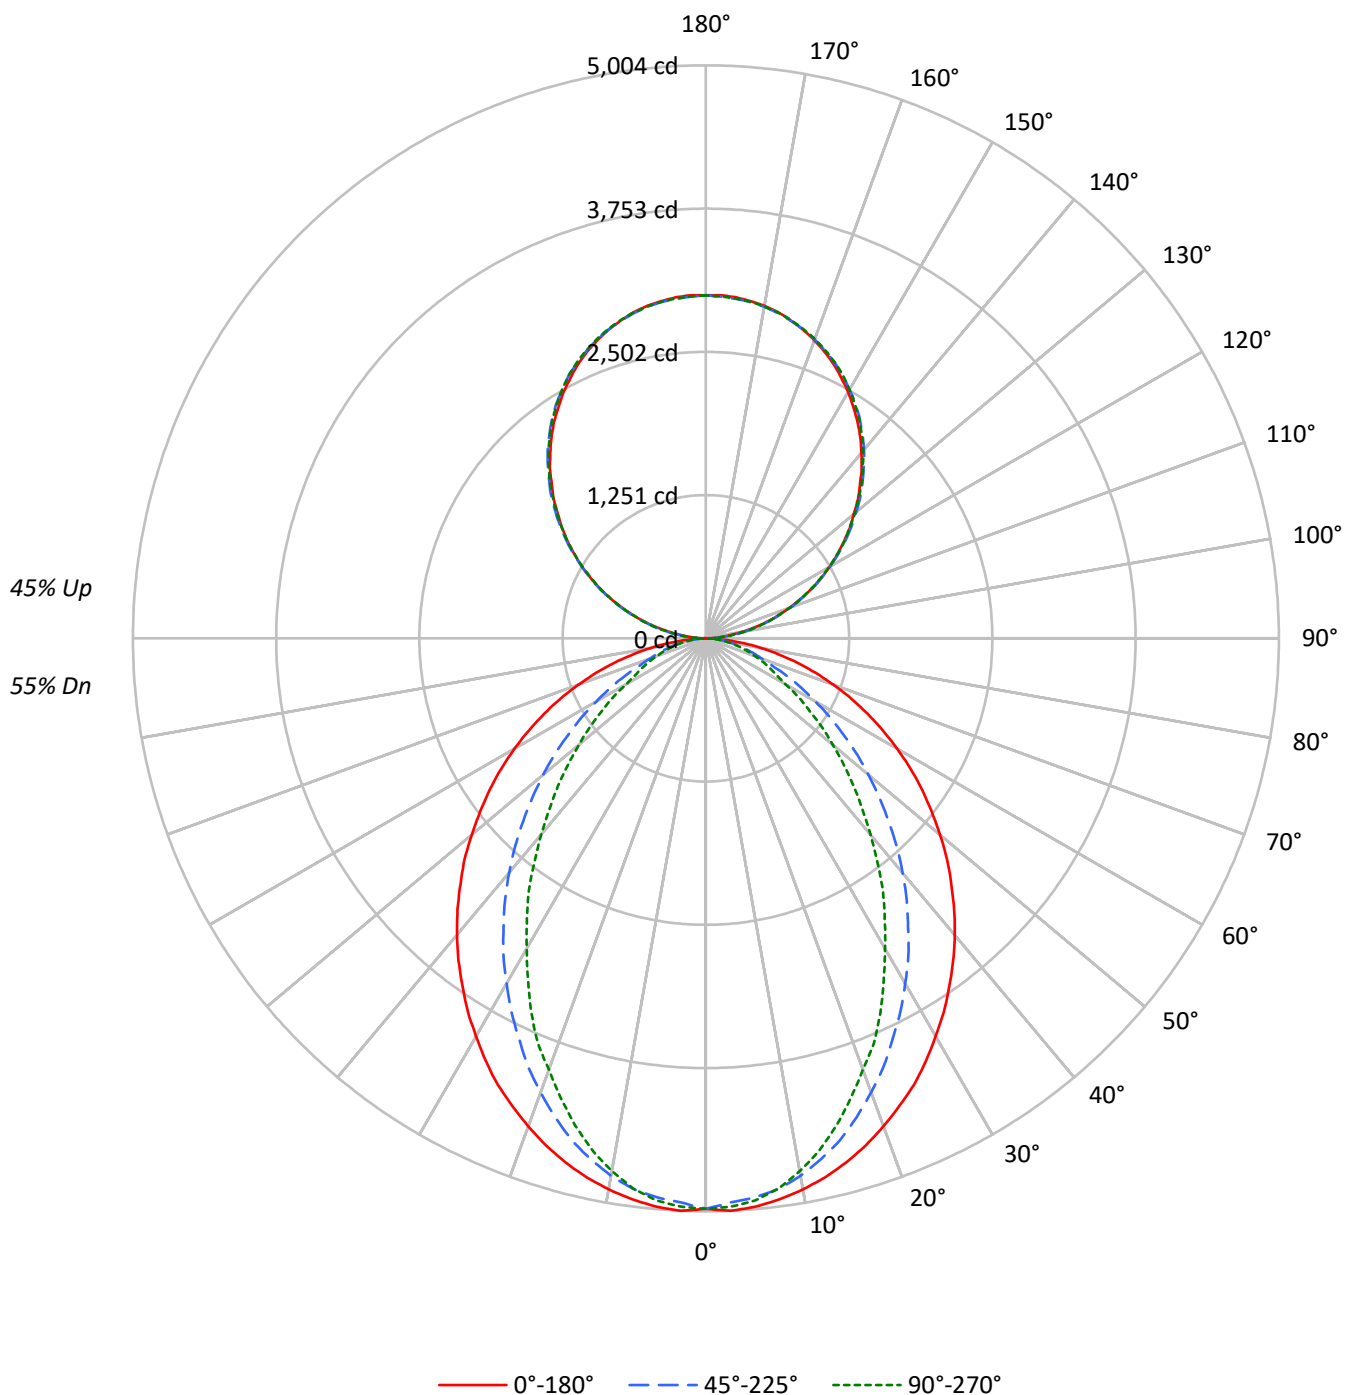

TEST NUMBER: P920578

CATALOG NUMBER: DFN2DIP-SQ4F0-140D110US935-RLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	108	108	108	108	101	101	101	101	86	86	86	73	73	73	61	61	61
1	99	95	92	88	92	89	85	83	76	74	72	65	63	62	55	53	52
2	91	84	78	73	84	78	73	69	68	64	60	58	55	52	49	47	45
3	83	74	67	61	77	69	63	58	60	55	51	51	48	45	44	41	39
4	77	66	58	52	71	62	55	50	54	48	44	46	42	39	39	36	34
5	70	59	51	45	65	55	48	43	48	43	39	42	38	34	36	32	30
6	65	53	45	40	60	50	43	38	44	38	34	38	34	30	33	29	27
7	60	48	40	35	56	45	38	33	40	34	30	35	30	27	30	26	24
8	56	44	36	31	52	41	35	30	37	31	27	32	27	24	28	24	22
9	52	40	33	28	49	38	31	27	34	28	24	29	25	22	26	22	20
10	49	37	30	25	46	35	29	24	31	26	22	27	23	20	24	20	18

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3496	3496	3496
5°	3501	3441	3463
10°	3467	3374	3351
15°	3419	3263	3178
20°	3356	3110	2965
25°	3291	2938	2759
30°	3204	2762	2498
35°	3119	2573	2269
40°	3032	2377	2005
45°	2932	2159	1767
50°	2828	1939	1533
55°	2719	1705	1309
60°	2593	1459	1079
65°	2449	1209	972
70°	2273	976	881
75°	2053	862	804
80°	1734	725	701
85°	1207	488	533

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 2932 cd/sqm

TEST NUMBER: P920578

CATALOG NUMBER: DFN2DIP-SQ4F0-140D110US935-RLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	466.9	2.5
10°-20°	1281.8	6.9
20°-30°	1799.5	9.7
30°-40°	1961.6	10.5
40°-50°	1802.9	9.7
50°-60°	1415.9	7.6
60°-70°	921.6	4.9
70°-80°	474.4	2.5
80°-90°	129.6	0.7
90°-100°	185.3	1.0
100°-110°	588.9	3.2
110°-120°	1007.8	5.4
120°-130°	1325.4	7.1
130°-140°	1487.7	8.0
140°-150°	1458.9	7.8
150°-160°	1223.8	6.6
160°-170°	811.6	4.4
170°-180°	283.7	1.5
0°-30°	3548.2	19.0
0°-40°	5509.8	29.6
0°-60°	8728.7	46.9
0°-90°	10254.4	55.0
90°-120°	1782.1	9.6
90°-150°	6054.2	32.5
90°-180°	8373.0	44.9
0°-180°	18627.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	4982	4982	4982	4982	4982	
5°	4982	4959	4900	4941	4928	472
15°	4738	4689	4536	4450	4405	1335
25°	4301	4157	3859	3675	3607	1978
35°	3706	3476	3080	2795	2696	2320
45°	3030	2728	2254	1934	1826	2340
55°	2304	1952	1465	1195	1109	2059
65°	1556	1190	784	631	618	1542
75°	829	514	361	329	325	877
85°	194	99	86	86	86	222
90°	3	32	88	83	86	18
95°	132	157	162	162	157	147
105°	544	551	556	561	561	574
115°	1011	1026	1021	1019	1011	1000
125°	1471	1494	1486	1478	1476	1315
135°	1903	1931	1936	1933	1926	1471
145°	2310	2328	2342	2345	2335	1443
155°	2641	2648	2657	2669	2661	1216
165°	2873	2871	2871	2889	2876	811
175°	2990	2983	2977	2995	2980	284
180°	2995	2995	2995	2995	2995	



TEST NUMBER: P920578

CATALOG NUMBER: DFN2DIP-SQ4F0-140D110US935-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	4981.9	4981.9	4981.9	4981.9	4981.9
2.5°	5004.4	4981.9	4932.1	4977.6	4968.5
5°	4981.9	4959.4	4900.5	4941.3	4927.8
7.5°	4941.3	4914.4	4851.3	4869.0	4846.6
10°	4887.2	4855.6	4765.7	4751.8	4725.0
12.5°	4819.7	4779.1	4657.1	4630.3	4580.6
15°	4738.4	4688.6	4535.6	4450.0	4405.0
17.5°	4643.7	4571.5	4382.0	4283.0	4210.8
20°	4535.6	4445.2	4219.9	4107.5	4008.0
22.5°	4418.4	4314.6	4053.0	3899.9	3832.5
25°	4301.2	4156.7	3859.3	3674.6	3606.6
27.5°	4161.5	4008.0	3678.9	3467.0	3363.2
30°	4012.8	3841.1	3480.4	3250.8	3128.8
32.5°	3868.3	3660.7	3291.4	3020.7	2907.8
35°	3706.2	3476.1	3079.5	2795.4	2695.9
37.5°	3548.3	3300.0	2881.0	2569.6	2457.2
40°	3381.4	3111.1	2673.4	2353.5	2236.3
42.5°	3210.1	2921.7	2466.3	2132.4	2020.0
45°	3029.8	2727.5	2254.4	1933.9	1825.8
47.5°	2858.5	2538.6	2051.6	1731.1	1632.1
50°	2669.1	2349.1	1853.0	1541.7	1447.4
52.5°	2484.0	2145.8	1663.6	1366.1	1280.5
55°	2303.7	1952.1	1465.2	1194.9	1109.2
57.5°	2119.0	1758.3	1289.6	1037.1	964.8
60°	1929.6	1568.9	1104.5	874.9	802.6
62.5°	1745.0	1384.3	946.7	730.4	694.6
65°	1555.6	1190.1	784.5	631.4	617.5
67.5°	1375.2	1009.8	631.4	554.4	541.0
70°	1185.8	834.2	522.8	477.9	459.7
72.5°	1005.5	671.6	437.2	401.3	392.3
75°	829.4	513.8	360.7	329.1	324.8
77.5°	653.9	365.0	284.1	266.0	256.8
80°	491.3	261.7	216.2	198.5	198.5
82.5°	342.5	176.0	148.8	139.7	139.7
85°	193.7	99.0	85.6	85.6	85.6
87.5°	72.2	35.9	35.9	31.6	31.6
90°	2.7	32.5	88.5	83.1	85.8
92.5°	56.0	75.9	78.5	81.3	81.3
95°	131.8	157.1	161.6	161.6	157.1
97.5°	219.5	242.9	252.9	252.9	252.9
100°	320.5	341.3	348.5	348.5	345.9
102.5°	427.1	442.5	452.5	455.1	452.5
105°	543.6	550.9	556.3	560.8	560.8
107.5°	659.2	670.0	670.0	671.8	659.2
110°	771.2	785.7	785.7	785.7	778.4



TEST NUMBER: P920578

CATALOG NUMBER: DFN2DIP-SQ4F0-140D110US935-RLFL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	892.2	907.5	904.8	897.6	892.2
115°	1011.4	1025.8	1021.3	1018.6	1011.4
117.5°	1129.7	1149.5	1136.9	1129.7	1122.5
120°	1248.9	1268.8	1248.9	1248.9	1240.8
122.5°	1357.3	1382.5	1369.8	1362.6	1357.3
125°	1471.0	1493.6	1486.3	1478.2	1475.5
127.5°	1582.1	1610.1	1600.2	1589.3	1582.1
130°	1685.9	1718.5	1713.9	1708.5	1698.6
132.5°	1802.4	1827.7	1829.5	1816.9	1809.6
135°	1902.6	1930.6	1936.0	1933.4	1926.1
137.5°	2014.6	2037.2	2041.7	2039.9	2029.1
140°	2113.1	2135.6	2148.3	2148.3	2138.4
142.5°	2214.2	2236.8	2244.0	2246.7	2236.8
145°	2309.9	2328.0	2342.4	2345.1	2335.2
147.5°	2395.7	2418.3	2429.1	2433.6	2423.7
150°	2484.2	2499.6	2509.5	2517.6	2509.5
152.5°	2562.8	2578.1	2590.7	2600.7	2590.7
155°	2641.4	2648.5	2656.7	2669.4	2661.2
157.5°	2709.0	2714.5	2718.9	2737.0	2724.4
160°	2769.6	2775.0	2777.7	2793.1	2782.2
162.5°	2825.5	2825.5	2828.3	2845.4	2832.8
165°	2873.4	2870.7	2870.7	2888.7	2876.1
167.5°	2916.7	2908.6	2908.6	2926.7	2914.0
170°	2949.3	2942.0	2939.4	2957.4	2942.0
172.5°	2971.8	2964.6	2961.9	2980.0	2964.6
175°	2989.9	2982.7	2977.2	2995.3	2980.0
177.5°	2999.8	2992.6	2987.1	3002.6	2987.1
180°	2995.3	2995.3	2995.3	2995.3	2995.3

TEST NUMBER: P920578

CATALOG NUMBER: DFN2DIP-SQ4F0-140D110US935-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.97	12.84	12.89	13.77	14.97	7.93	8.80	8.85	9.73	10.93
	3H	13.65	14.43	14.58	15.37	16.60	9.12	9.90	10.05	10.84	12.07
	4H	14.26	15.00	15.21	15.95	17.18	9.57	10.31	10.52	11.26	12.49
	6H	14.69	15.37	15.65	16.32	17.57	9.90	10.57	10.85	11.53	12.77
	8H	14.82	15.47	15.79	16.44	17.68	9.99	10.63	10.95	11.60	12.85
	12H	14.89	15.50	15.86	16.46	17.73	10.03	10.65	11.00	11.61	12.88
4H	2H	11.99	12.73	12.94	13.67	14.91	8.53	9.27	9.48	10.21	11.45
	3H	13.83	14.44	14.79	15.42	16.67	9.89	10.50	10.85	11.48	12.72
	4H	14.52	15.08	15.50	16.06	17.33	10.44	10.99	11.41	11.97	13.24
	6H	15.05	15.53	16.03	16.52	17.79	10.86	11.34	11.84	12.33	13.60
	8H	15.22	15.67	16.21	16.66	17.95	10.99	11.44	11.97	12.43	13.71
	12H	15.32	15.73	16.33	16.73	18.02	11.06	11.46	12.06	12.47	13.75
8H	4H	14.50	14.94	15.48	15.93	17.22	10.72	11.17	11.71	12.16	13.44
	6H	15.07	15.44	16.08	16.47	17.75	11.24	11.61	12.25	12.64	13.93
	8H	15.29	15.61	16.31	16.63	17.93	11.43	11.76	12.45	12.78	14.08
	12H	15.43	15.72	16.45	16.73	18.08	11.56	11.84	12.58	12.86	14.20
12H	4H	14.45	14.85	15.45	15.86	17.15	10.73	11.13	11.73	12.14	13.43
	6H	15.04	15.37	16.06	16.39	17.69	11.29	11.62	12.31	12.64	13.94
	8H	15.27	15.56	16.29	16.57	17.92	11.51	11.79	12.53	12.81	14.15

END OF REPORT