

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P920602

Luminaire Tested: DFN2DIP-SQ4F0-160D080US935-RLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P920602
REPORT IS A COMBINATION OF REPORTS P900112 AND P896915
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-160D080US935-RLLFLL
Description: 4 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 17805.5 lumens
Efficiency: N/A
Efficacy: 78.7 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: Semi-Direct

Input Watts (W): 226.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P920602

CATALOG NUMBER: DFN2DIP-SQ4F0-160D080US935-RLLFLL

Luminous Intensity Polar Plot

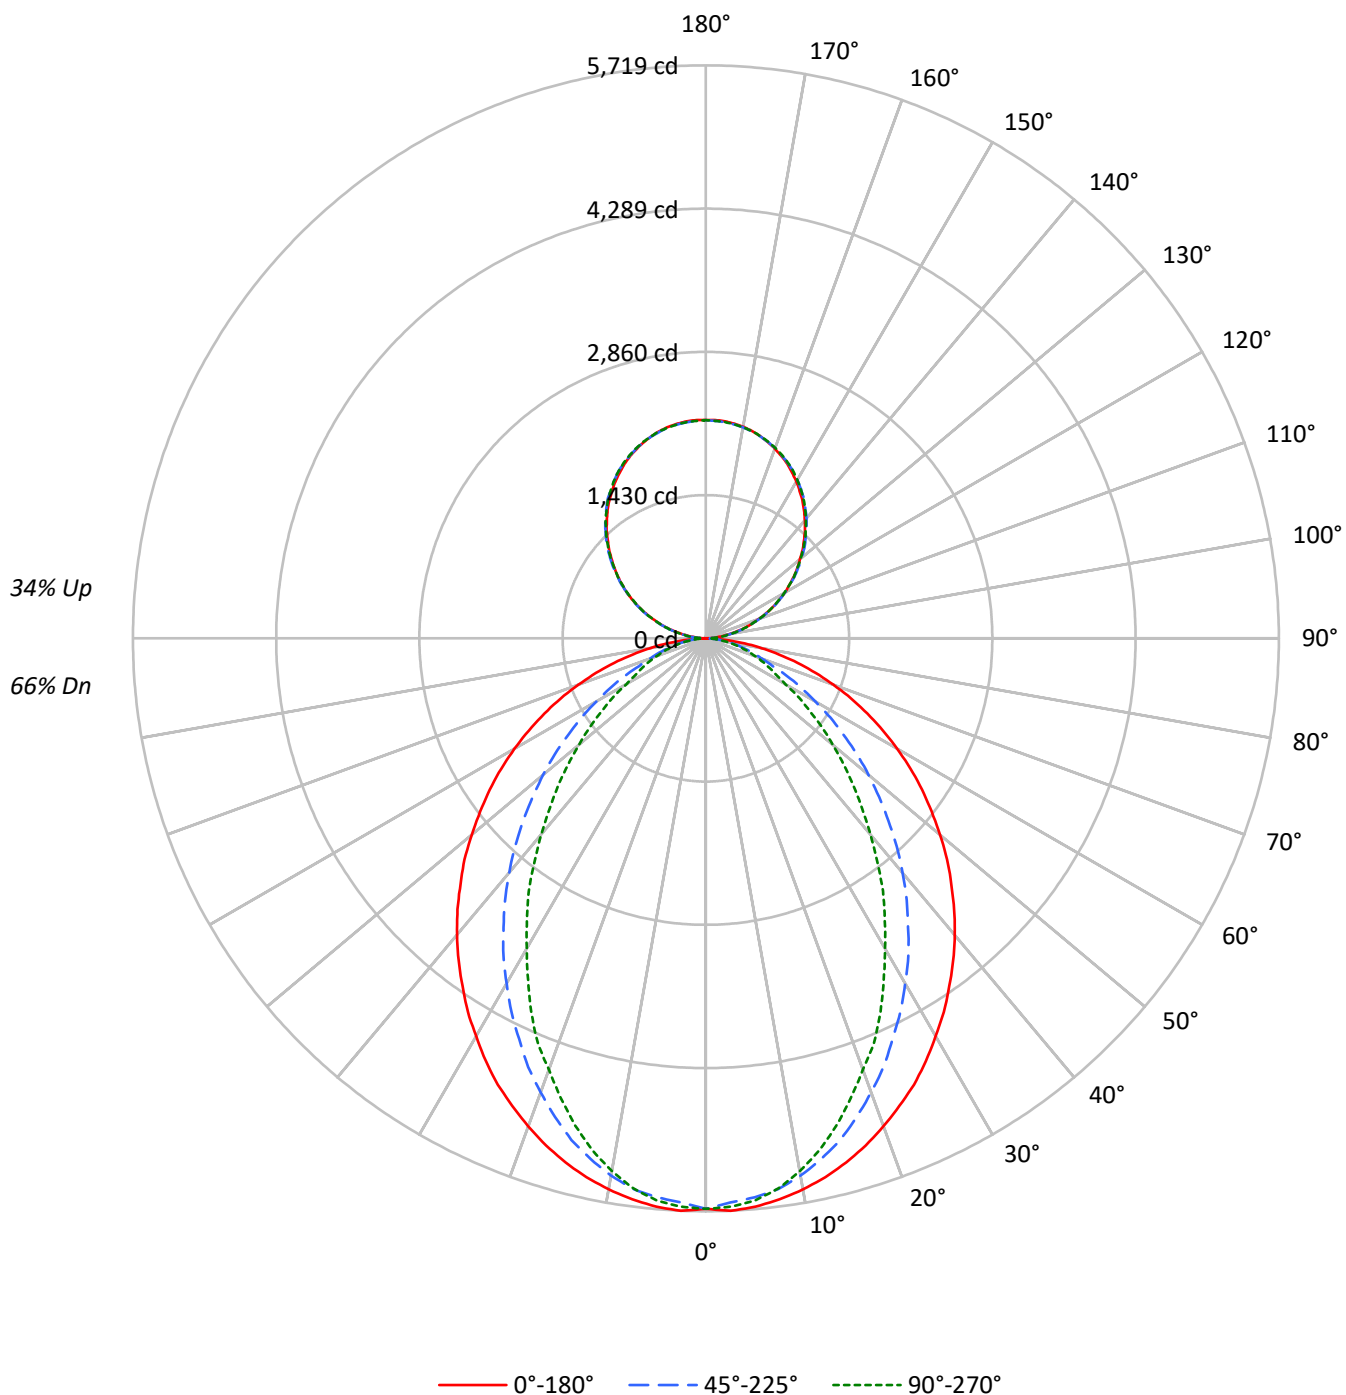

TEST NUMBER: P920602

CATALOG NUMBER: DFN2DIP-SQ4F0-160D080US935-RLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	111	111	111	111	104	104	104	104	92	92	92	81	81	81	71	71	71
1	102	98	94	91	96	92	89	86	82	79	77	72	70	69	63	62	61
2	93	86	80	75	88	81	76	72	72	68	65	64	61	58	57	54	52
3	86	76	69	63	80	72	66	61	65	59	55	57	53	50	51	48	45
4	79	68	60	54	74	65	58	52	58	52	48	52	47	44	46	42	40
5	73	61	53	47	68	58	51	45	52	46	42	47	42	38	42	38	35
6	67	55	47	41	63	52	45	40	47	41	37	42	38	34	38	34	31
7	62	50	42	37	59	48	40	35	43	37	33	39	34	30	35	31	28
8	58	46	38	33	55	44	37	32	40	34	29	36	31	27	32	28	25
9	54	42	35	29	51	40	33	29	36	31	27	33	28	25	30	26	23
10	51	39	31	27	48	37	30	26	34	28	24	31	26	23	28	24	21

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3995	3995	3995
5°	4001	3932	3958
10°	3962	3856	3830
15°	3907	3729	3632
20°	3835	3554	3389
25°	3761	3358	3154
30°	3662	3157	2855
35°	3564	2940	2593
40°	3465	2716	2292
45°	3350	2468	2019
50°	3232	2216	1752
55°	3107	1948	1496
60°	2964	1667	1233
65°	2798	1382	1111
70°	2598	1115	1007
75°	2347	985	919
80°	1982	829	801
85°	1380	558	610

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3350 cd/sqm

TEST NUMBER: P920602

CATALOG NUMBER: DFN2DIP-SQ4F0-160D080US935-RLFL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	533.6	3.0
10°-20°	1464.9	8.2
20°-30°	2056.6	11.6
30°-40°	2241.8	12.6
40°-50°	2060.5	11.6
50°-60°	1618.2	9.1
60°-70°	1053.3	5.9
70°-80°	542.2	3.0
80°-90°	144.6	0.8
90°-100°	134.8	0.8
100°-110°	428.3	2.4
110°-120°	733.0	4.1
120°-130°	964.0	5.4
130°-140°	1082.0	6.1
140°-150°	1061.0	6.0
150°-160°	890.1	5.0
160°-170°	590.3	3.3
170°-180°	206.3	1.2
0°-30°	4055.1	22.8
0°-40°	6296.9	35.4
0°-60°	9975.6	56.0
0°-90°	11715.8	65.8
90°-120°	1296.1	7.3
90°-150°	4403.1	24.7
90°-180°	6090.0	34.2
0°-180°	17805.5	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	5694	5694	5694	5694	5694	
5°	5694	5668	5601	5647	5632	540
15°	5415	5358	5184	5086	5034	1526
25°	4916	4751	4410	4200	4122	2261
35°	4236	3973	3520	3195	3081	2651
45°	3463	3117	2576	2210	2087	2674
55°	2633	2231	1674	1366	1268	2353
65°	1778	1360	897	722	706	1762
75°	948	587	412	376	371	1003
85°	221	113	98	98	98	254
90°	2	24	64	60	62	17
95°	96	114	118	118	114	107
105°	395	401	405	408	408	417
115°	736	746	743	741	736	728
125°	1070	1086	1081	1075	1073	956
135°	1384	1404	1408	1406	1401	1070
145°	1680	1693	1704	1706	1698	1050
155°	1921	1926	1932	1941	1935	884
165°	2090	2088	2088	2101	2092	590
175°	2174	2169	2165	2178	2167	207
180°	2178	2178	2178	2178	2178	

TEST NUMBER: P920602

CATALOG NUMBER: DFN2DIP-SQ4F0-160D080US935-RLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	5693.6	5693.6	5693.6	5693.6	5693.6
2.5°	5719.3	5693.6	5636.7	5688.7	5678.3
5°	5693.6	5667.9	5600.6	5647.1	5631.8
7.5°	5647.1	5616.5	5544.3	5564.5	5538.9
10°	5585.4	5549.3	5446.5	5430.7	5400.0
12.5°	5508.2	5461.8	5322.4	5291.8	5235.0
15°	5415.3	5358.5	5183.6	5085.7	5034.3
17.5°	5307.1	5224.5	5008.1	4894.9	4812.4
20°	5183.6	5080.2	4822.7	4694.2	4580.6
22.5°	5049.6	4930.9	4631.9	4457.0	4379.9
25°	4915.7	4750.6	4410.5	4199.5	4121.9
27.5°	4756.1	4580.6	4204.4	3962.3	3843.7
30°	4586.0	4389.8	3977.6	3715.2	3575.8
32.5°	4421.0	4183.7	3761.6	3452.3	3323.2
35°	4235.6	3972.6	3519.5	3194.7	3081.1
37.5°	4055.2	3771.5	3292.6	2936.7	2808.2
40°	3864.4	3555.6	3055.3	2689.6	2555.7
42.5°	3668.7	3339.0	2818.6	2437.1	2308.6
45°	3462.6	3117.2	2576.4	2210.2	2086.6
47.5°	3266.9	2901.2	2344.7	1978.4	1865.3
50°	3050.4	2684.7	2117.8	1761.9	1654.2
52.5°	2838.9	2452.4	1901.3	1561.3	1463.4
55°	2632.8	2230.9	1674.5	1365.5	1267.7
57.5°	2421.7	2009.6	1473.9	1185.2	1102.6
60°	2205.3	1793.1	1262.2	999.9	917.3
62.5°	1994.2	1582.1	1081.8	834.7	793.8
65°	1777.8	1360.1	896.6	721.6	705.8
67.5°	1571.7	1154.0	721.6	633.6	618.3
70°	1355.2	953.4	597.5	546.1	525.4
72.5°	1149.1	767.5	499.6	458.7	448.2
75°	948.0	587.1	412.2	376.1	371.2
77.5°	747.3	417.1	324.7	303.9	293.6
80°	561.5	299.0	247.1	226.9	226.9
82.5°	391.4	201.2	170.0	159.6	159.6
85°	221.4	113.1	97.9	97.9	97.9
87.5°	82.6	41.0	41.0	36.1	36.1
90°	2.0	23.7	64.4	60.4	62.4
92.5°	40.7	55.2	57.2	59.1	59.1
95°	95.9	114.3	117.5	117.5	114.3
97.5°	159.6	176.7	183.9	183.9	183.9
100°	233.2	248.2	253.5	253.5	251.5
102.5°	310.6	321.8	329.0	331.0	329.0
105°	395.4	400.6	404.6	407.9	407.9
107.5°	479.4	487.3	487.3	488.6	479.4
110°	560.9	571.4	571.4	571.4	566.1

TEST NUMBER: P920602

CATALOG NUMBER: DFN2DIP-SQ4F0-160D080US935-RLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	648.8	660.0	658.1	652.8	648.8
115°	735.6	746.1	742.8	740.8	735.6
117.5°	821.6	836.0	826.8	821.6	816.3
120°	908.3	922.7	908.3	908.3	902.3
122.5°	987.0	1005.5	996.3	991.0	987.0
125°	1069.8	1086.2	1081.0	1075.0	1073.1
127.5°	1150.6	1171.0	1163.7	1155.9	1150.6
130°	1226.1	1249.7	1246.5	1242.6	1235.4
132.5°	1310.9	1329.2	1330.6	1321.4	1316.1
135°	1383.7	1404.1	1408.1	1406.1	1400.8
137.5°	1465.2	1481.6	1484.9	1483.6	1475.7
140°	1536.8	1553.2	1562.4	1562.4	1555.1
142.5°	1610.3	1626.8	1632.0	1634.0	1626.8
145°	1680.0	1693.1	1703.6	1705.6	1698.3
147.5°	1742.3	1758.8	1766.6	1770.0	1762.7
150°	1806.7	1817.8	1825.1	1831.0	1825.1
152.5°	1863.8	1875.0	1884.2	1891.4	1884.2
155°	1921.0	1926.2	1932.2	1941.3	1935.4
157.5°	1970.2	1974.2	1977.5	1990.5	1981.4
160°	2014.2	2018.2	2020.2	2031.3	2023.4
162.5°	2054.9	2054.9	2056.9	2069.4	2060.2
165°	2089.7	2087.7	2087.7	2100.9	2091.7
167.5°	2121.2	2115.4	2115.4	2128.5	2119.3
170°	2144.9	2139.7	2137.7	2150.9	2139.7
172.5°	2161.4	2156.1	2154.1	2167.2	2156.1
175°	2174.5	2169.2	2165.2	2178.4	2167.2
177.5°	2181.7	2176.4	2172.5	2183.7	2172.5
180°	2178.4	2178.4	2178.4	2178.4	2178.4

TEST NUMBER: P920602

CATALOG NUMBER: DFN2DIP-SQ4F0-160D080US935-RLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.33	14.31	14.15	15.14	16.17	9.29	10.27	10.11	11.10	12.13
	3H	15.03	15.90	15.85	16.74	17.80	10.49	11.37	11.32	12.21	13.27
	4H	15.64	16.47	16.49	17.32	18.39	10.95	11.78	11.80	12.63	13.69
	6H	16.08	16.84	16.93	17.69	18.78	11.28	12.04	12.14	12.90	13.98
	8H	16.21	16.93	17.08	17.81	18.89	11.37	12.10	12.24	12.97	14.06
	12H	16.28	16.97	17.15	17.84	18.94	11.42	12.11	12.30	12.98	14.09
4H	2H	13.37	14.19	14.22	15.04	16.11	9.91	10.73	10.76	11.58	12.65
	3H	15.22	15.90	16.08	16.78	17.87	11.27	11.96	12.13	12.84	13.93
	4H	15.92	16.54	16.79	17.42	18.53	11.83	12.45	12.70	13.33	14.44
	6H	16.44	16.98	17.33	17.89	19.00	12.26	12.79	13.14	13.70	14.81
	8H	16.62	17.13	17.52	18.03	19.15	12.39	12.89	13.28	13.79	14.91
	12H	16.73	17.18	17.64	18.10	19.23	12.46	12.91	13.37	13.83	14.96
8H	4H	15.90	16.40	16.79	17.30	18.42	12.12	12.62	13.01	13.52	14.65
	6H	16.47	16.89	17.39	17.83	18.95	12.65	13.06	13.56	14.00	15.13
	8H	16.69	17.06	17.62	17.99	19.14	12.84	13.21	13.77	14.14	15.28
	12H	16.84	17.16	17.77	18.09	19.28	12.96	13.29	13.90	14.21	15.41
12H	4H	15.85	16.31	16.77	17.22	18.36	12.13	12.58	13.04	13.50	14.63
	6H	16.45	16.82	17.38	17.75	18.89	12.70	13.06	13.63	14.00	15.14
	8H	16.68	17.00	17.61	17.93	19.12	12.92	13.24	13.85	14.16	15.36

END OF REPORT