

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P920611

Luminaire Tested: DFN2DIP-SQ4F0-160D100US935-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P920611
REPORT IS A COMBINATION OF REPORTS P901668 AND P898471
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-160D100US935-RLLONL
Description: 4 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 20233.5 lumens
Efficiency: N/A
Efficacy: 83.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 241.4
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9971
Total Harmonic Distortion (THDi): 0.049
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P920611

CATALOG NUMBER: DFN2DIP-SQ4F0-160D100US935-RLLONL

Luminous Intensity Polar Plot

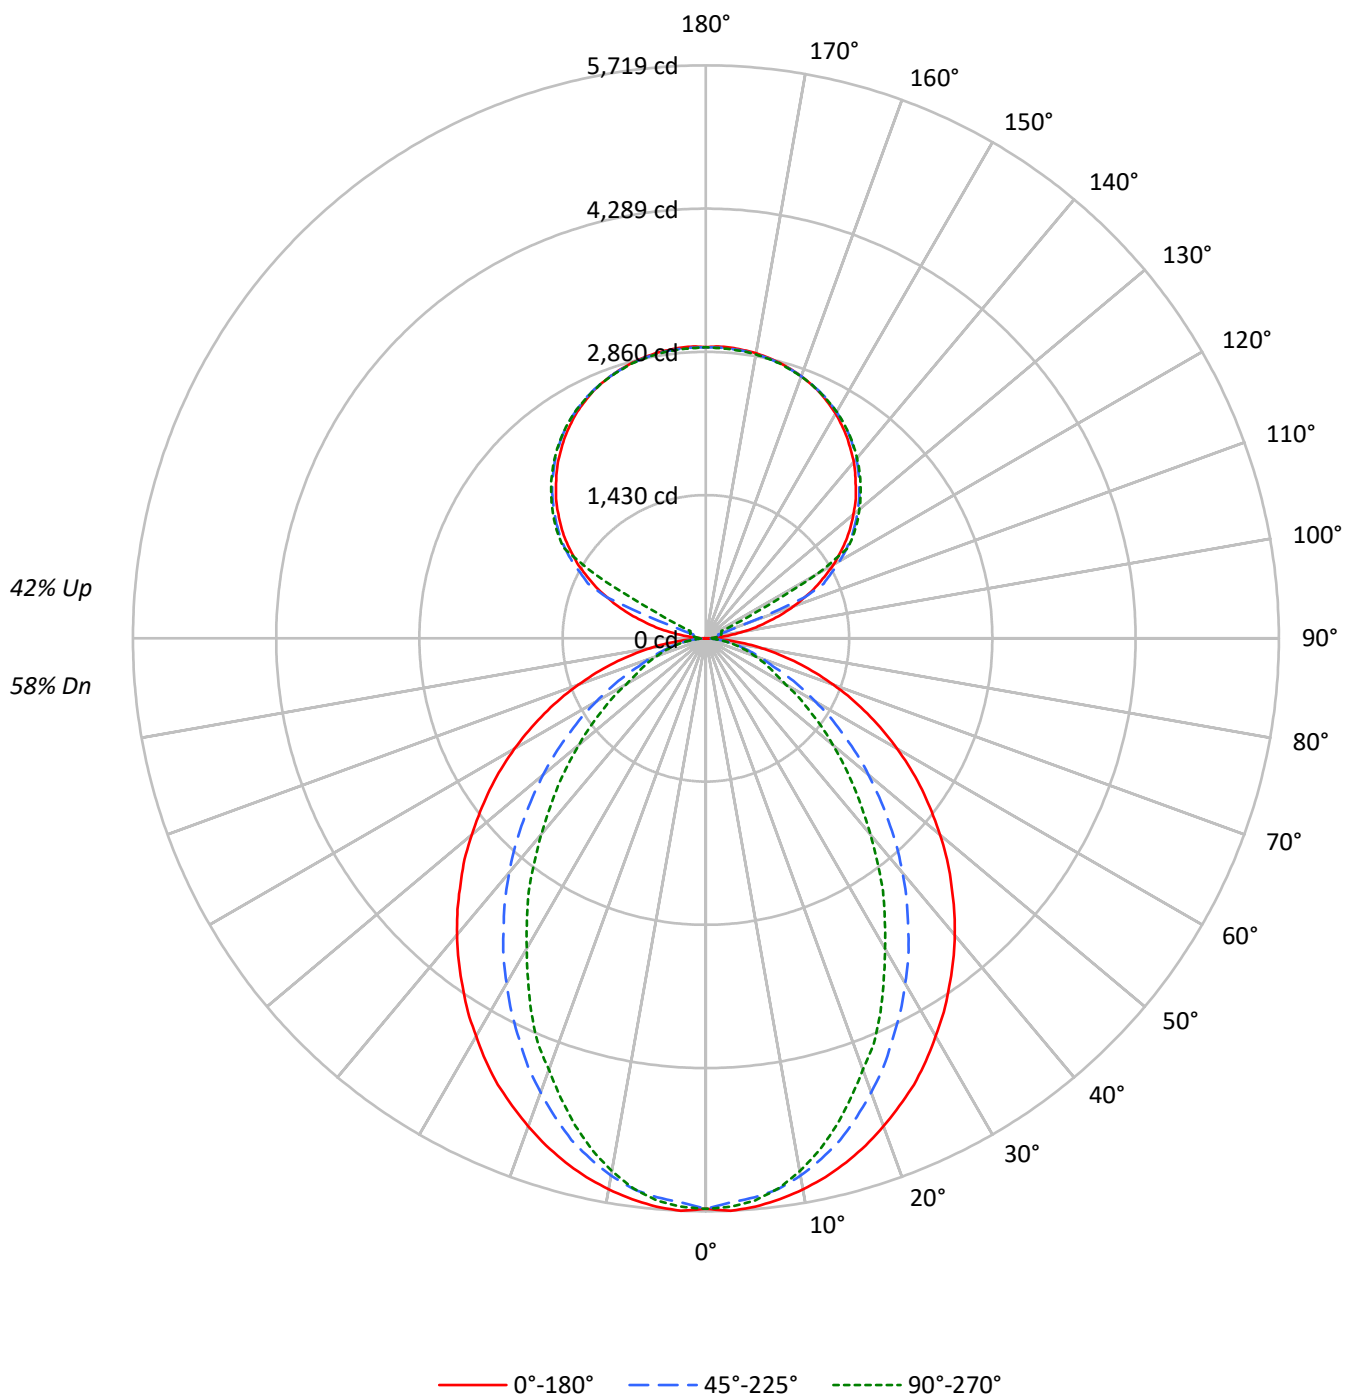

TEST NUMBER: P920611

CATALOG NUMBER: DFN2DIP-SQ4F0-160D100US935-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	109	109	109	109	102	102	102	102	88	88	88	75	75	75	63	63	63
1	100	96	92	89	93	90	86	83	78	75	73	67	65	64	57	56	55
2	92	84	79	74	85	79	74	69	69	65	62	59	57	54	51	49	47
3	84	75	68	62	78	70	64	59	61	56	52	53	49	46	45	43	41
4	77	67	59	53	72	62	56	50	55	49	45	48	44	40	41	38	35
5	71	60	52	46	66	56	49	44	49	44	39	43	39	35	37	34	31
6	66	54	46	40	61	51	43	38	45	39	35	39	35	31	34	31	28
7	61	49	41	35	57	46	39	34	41	35	31	36	31	28	31	28	25
8	57	44	37	32	53	42	35	30	37	32	28	33	28	25	29	25	23
9	53	41	33	28	49	39	32	27	34	29	25	30	26	23	27	23	20
10	49	38	30	26	46	36	29	25	32	26	23	28	24	21	25	21	19

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	3995	3995	3995
5°	4001	3932	3958
10°	3962	3856	3830
15°	3907	3729	3632
20°	3835	3554	3389
25°	3761	3358	3154
30°	3662	3157	2855
35°	3564	2940	2593
40°	3465	2716	2292
45°	3350	2468	2019
50°	3232	2216	1752
55°	3107	1948	1496
60°	2964	1667	1233
65°	2798	1382	1111
70°	2598	1115	1007
75°	2347	985	919
80°	1982	829	801
85°	1380	558	610

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°

Vertical Angle: 45°

Luminance: 3350 cd/sqm

TEST NUMBER: P920611

CATALOG NUMBER: DFN2DIP-SQ4F0-160D100US935-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	533.6	2.6
10°-20°	1464.9	7.2
20°-30°	2056.6	10.2
30°-40°	2241.8	11.1
40°-50°	2060.5	10.2
50°-60°	1618.2	8.0
60°-70°	1053.3	5.2
70°-80°	542.2	2.7
80°-90°	143.5	0.7
90°-100°	95.8	0.5
100°-110°	357.2	1.8
110°-120°	947.3	4.7
120°-130°	1571.2	7.8
130°-140°	1669.0	8.2
140°-150°	1551.1	7.7
150°-160°	1247.1	6.2
160°-170°	803.6	4.0
170°-180°	276.6	1.4
0°-30°	4055.1	20.0
0°-40°	6296.9	31.1
0°-60°	9975.6	49.3
0°-90°	11714.7	57.9
90°-120°	1400.3	6.9
90°-150°	6191.6	30.6
90°-180°	8519.0	42.1
0°-180°	20233.5	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	5694	5694	5694	5694	5694	
5°	5694	5668	5601	5647	5632	540
15°	5415	5358	5184	5086	5034	1526
25°	4916	4751	4410	4200	4122	2261
35°	4236	3973	3520	3195	3081	2651
45°	3463	3117	2576	2210	2087	2674
55°	2633	2231	1674	1366	1268	2353
65°	1778	1360	897	722	706	1762
75°	948	587	412	376	371	1003
85°	221	113	98	98	98	254
90°	2	25	42	53	57	19
95°	137	67	82	93	90	162
105°	639	702	128	151	160	683
115°	1209	1245	1297	324	172	1190
125°	1709	1737	1777	1792	1798	1524
135°	2115	2149	2168	2189	2185	1634
145°	2454	2452	2487	2502	2492	1535
155°	2702	2683	2708	2721	2704	1245
165°	2847	2834	2841	2855	2841	804
175°	2912	2897	2902	2916	2895	277
180°	2906	2906	2906	2906	2906	

TEST NUMBER: P920611

CATALOG NUMBER: DFN2DIP-SQ4F0-160D100US935-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	5693.6	5693.6	5693.6	5693.6	5693.6
2.5°	5719.3	5693.6	5636.7	5688.7	5678.3
5°	5693.6	5667.9	5600.6	5647.1	5631.8
7.5°	5647.1	5616.5	5544.3	5564.5	5538.9
10°	5585.4	5549.3	5446.5	5430.7	5400.0
12.5°	5508.2	5461.8	5322.4	5291.8	5235.0
15°	5415.3	5358.5	5183.6	5085.7	5034.3
17.5°	5307.1	5224.5	5008.1	4894.9	4812.4
20°	5183.6	5080.2	4822.7	4694.2	4580.6
22.5°	5049.6	4930.9	4631.9	4457.0	4379.9
25°	4915.7	4750.6	4410.5	4199.5	4121.9
27.5°	4756.1	4580.6	4204.4	3962.3	3843.7
30°	4586.0	4389.8	3977.6	3715.2	3575.8
32.5°	4421.0	4183.7	3761.6	3452.3	3323.2
35°	4235.6	3972.6	3519.5	3194.7	3081.1
37.5°	4055.2	3771.5	3292.6	2936.7	2808.2
40°	3864.4	3555.6	3055.3	2689.6	2555.7
42.5°	3668.7	3339.0	2818.6	2437.1	2308.6
45°	3462.6	3117.2	2576.4	2210.2	2086.6
47.5°	3266.9	2901.2	2344.7	1978.4	1865.3
50°	3050.4	2684.7	2117.8	1761.9	1654.2
52.5°	2838.9	2452.4	1901.3	1561.3	1463.4
55°	2632.8	2230.9	1674.5	1365.5	1267.7
57.5°	2421.7	2009.6	1473.9	1185.2	1102.6
60°	2205.3	1793.1	1262.2	999.9	917.3
62.5°	1994.2	1582.1	1081.8	834.7	793.8
65°	1777.8	1360.1	896.6	721.6	705.8
67.5°	1571.7	1154.0	721.6	633.6	618.3
70°	1355.2	953.4	597.5	546.1	525.4
72.5°	1149.1	767.5	499.6	458.7	448.2
75°	948.0	587.1	412.2	376.1	371.2
77.5°	747.3	417.1	324.7	303.9	293.6
80°	561.5	299.0	247.1	226.9	226.9
82.5°	391.4	201.2	170.0	159.6	159.6
85°	221.4	113.1	97.9	97.9	97.9
87.5°	82.6	41.0	41.0	36.1	36.1
90°	2.0	25.2	41.9	52.7	56.7
92.5°	52.7	44.2	50.5	54.7	56.7
95°	136.6	67.2	81.9	92.6	90.4
97.5°	245.9	73.6	107.1	113.6	115.6
100°	372.3	84.1	119.9	136.6	140.9
102.5°	510.8	506.9	124.1	147.1	153.5
105°	639.2	702.3	128.4	151.3	159.8
107.5°	788.5	840.9	132.6	155.6	164.0
110°	931.5	975.5	368.0	157.8	166.0



TEST NUMBER: P920611

CATALOG NUMBER: DFN2DIP-SQ4F0-160D100US935-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1066.1	1103.8	1068.2	161.8	168.3
115°	1208.9	1244.7	1297.4	323.8	172.5
117.5°	1333.0	1375.0	1410.9	1110.1	559.3
120°	1471.9	1503.3	1541.3	1566.5	1282.6
122.5°	1589.5	1623.2	1665.3	1677.8	1680.1
125°	1709.3	1736.8	1776.8	1791.5	1797.7
127.5°	1818.7	1848.1	1879.8	1900.8	1902.8
130°	1921.7	1955.5	1978.5	2001.6	1999.7
132.5°	2026.9	2054.3	2077.3	2096.3	2094.3
135°	2115.3	2149.0	2167.7	2188.9	2184.7
137.5°	2207.7	2232.9	2254.1	2275.1	2268.8
140°	2298.0	2315.1	2338.0	2357.0	2346.5
142.5°	2373.9	2388.7	2415.9	2432.6	2422.2
145°	2453.8	2451.6	2487.3	2502.1	2491.6
147.5°	2523.0	2516.8	2552.4	2562.9	2554.8
150°	2590.4	2575.7	2609.4	2621.9	2611.4
152.5°	2647.1	2630.3	2661.9	2674.5	2659.8
155°	2701.8	2683.0	2708.3	2720.8	2704.0
157.5°	2746.0	2729.3	2748.2	2762.9	2746.0
160°	2784.0	2771.2	2784.0	2796.4	2781.7
162.5°	2817.4	2804.9	2815.4	2830.1	2811.2
165°	2846.8	2834.3	2840.6	2855.3	2840.6
167.5°	2870.1	2857.3	2863.9	2878.6	2859.5
170°	2889.0	2876.3	2880.6	2895.3	2876.3
172.5°	2901.5	2889.0	2893.3	2908.0	2889.0
175°	2912.0	2897.3	2901.5	2916.3	2895.3
177.5°	2916.3	2901.5	2903.8	2918.5	2899.5
180°	2905.8	2905.8	2905.8	2905.8	2905.8

TEST NUMBER: P920611

CATALOG NUMBER: DFN2DIP-SQ4F0-160D100US935-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.68	13.58	13.57	14.49	15.64	8.64	9.54	9.53	10.45	11.60
	3H	14.37	15.17	15.27	16.09	17.27	9.83	10.64	10.74	11.56	12.74
	4H	14.98	15.74	15.90	16.66	17.86	10.29	11.05	11.21	11.97	13.16
	6H	15.41	16.11	16.34	17.04	18.24	10.61	11.31	11.55	12.24	13.45
	8H	15.54	16.21	16.48	17.15	18.35	10.71	11.37	11.65	12.32	13.52
	12H	15.61	16.24	16.55	17.18	18.41	10.75	11.38	11.70	12.32	13.55
4H	2H	12.71	13.46	13.63	14.39	15.58	9.25	10.01	10.17	10.93	12.12
	3H	14.55	15.18	15.48	16.13	17.34	10.60	11.23	11.54	12.19	13.39
	4H	15.24	15.82	16.19	16.77	18.00	11.15	11.73	12.10	12.68	13.91
	6H	15.77	16.26	16.73	17.23	18.47	11.58	12.07	12.54	13.05	14.28
	8H	15.95	16.41	16.91	17.37	18.62	11.71	12.17	12.67	13.14	14.38
	12H	16.05	16.46	17.03	17.45	18.70	11.78	12.19	12.76	13.18	14.43
8H	4H	15.22	15.68	16.18	16.65	17.89	11.44	11.90	12.40	12.87	14.12
	6H	15.79	16.17	16.78	17.18	18.42	11.96	12.35	12.95	13.35	14.60
	8H	16.01	16.35	17.01	17.34	18.61	12.16	12.49	13.15	13.49	14.75
	12H	16.16	16.45	17.15	17.44	18.75	12.28	12.58	13.28	13.57	14.88
12H	4H	15.17	15.59	16.15	16.57	17.82	11.45	11.87	12.43	12.85	14.10
	6H	15.77	16.10	16.76	17.10	18.36	12.02	12.35	13.01	13.35	14.61
	8H	15.99	16.29	16.99	17.28	18.59	12.23	12.53	13.23	13.52	14.83

END OF REPORT