

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P923036

Luminaire Tested: DFN2DIP-SQ4F0-060D070US940-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P923036
REPORT IS A COMBINATION OF REPORTS P900077 AND P896915
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-060D070US940-FLLFLL
Description: 4 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 10821.0 lumens
Efficiency: N/A
Efficacy: 105.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 102.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.946
Total Harmonic Distortion (THDi): 0.132
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P923036

CATALOG NUMBER: DFN2DIP-SQ4F0-060D070US940-FLLFLL

Luminous Intensity Polar Plot

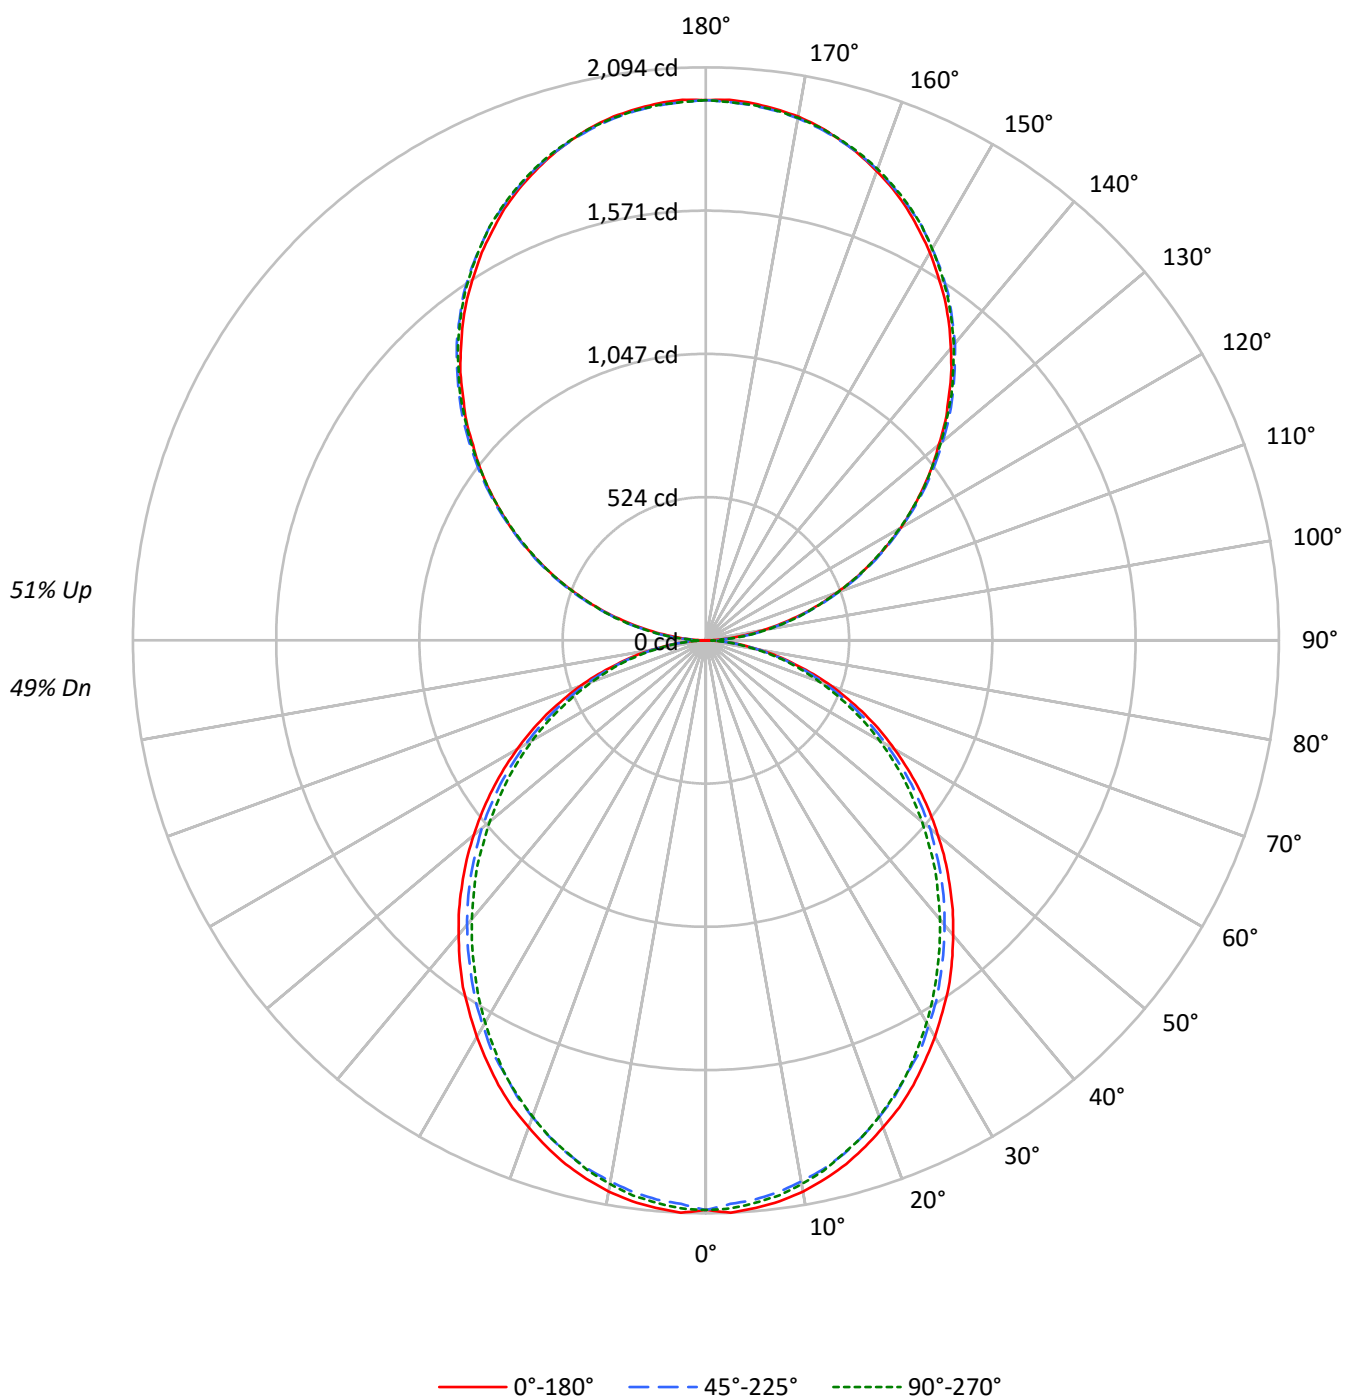

TEST NUMBER: P923036

CATALOG NUMBER: DFN2DIP-SQ4F0-060D070US940-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	98	98	98	98	83	83	83	68	68	68	55	55	55
1	98	93	89	86	90	86	83	80	73	70	68	60	59	57	49	48	47
2	89	81	75	70	82	75	70	65	64	60	56	53	50	48	43	41	39
3	81	72	64	58	74	66	60	55	56	51	47	47	43	40	38	36	33
4	74	63	55	49	68	59	52	46	50	45	40	42	38	34	34	31	29
5	68	56	48	42	62	52	45	40	45	39	35	37	33	30	31	28	25
6	63	51	43	37	58	47	40	35	40	35	30	34	29	26	28	25	22
7	58	46	38	32	53	42	35	30	36	31	27	31	26	23	25	22	20
8	54	41	34	28	49	39	32	27	33	28	24	28	24	21	23	20	18
9	50	38	30	25	46	35	29	24	30	25	21	26	22	19	22	18	16
10	47	35	28	23	43	32	26	22	28	23	19	24	20	17	20	17	14

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1461	1461	1461
5°	1463	1441	1451
10°	1451	1422	1431
15°	1430	1399	1401
20°	1401	1366	1370
25°	1372	1328	1334
30°	1336	1292	1288
35°	1302	1249	1240
40°	1260	1207	1194
45°	1219	1164	1147
50°	1173	1119	1092
55°	1125	1067	1042
60°	1071	1005	985
65°	1012	941	917
70°	936	863	844
75°	832	770	778
80°	707	651	650
85°	510	445	437

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 1553 cd/sqm

TEST NUMBER: P923036

CATALOG NUMBER: DFN2DIP-SQ4F0-060D070US940-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	195.9	1.8
10°-20°	551.3	5.1
20°-30°	810.2	7.5
30°-40°	941.0	8.7
40°-50°	939.8	8.7
50°-60°	819.5	7.6
60°-70°	605.8	5.6
70°-80°	342.7	3.2
80°-90°	96.1	0.9
90°-100°	122.2	1.1
100°-110°	388.1	3.6
110°-120°	664.2	6.1
120°-130°	873.6	8.1
130°-140°	980.5	9.1
140°-150°	961.5	8.9
150°-160°	806.6	7.5
160°-170°	534.9	4.9
170°-180°	187.0	1.7
0°-30°	1557.4	14.4
0°-40°	2498.4	23.1
0°-60°	4257.8	39.3
0°-90°	5302.4	49.0
90°-120°	1174.5	10.9
90°-150°	3990.1	36.9
90°-180°	5519.0	51.0
0°-180°	10821.0	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2082	2082	2082	2082	2082	
5°	2082	2074	2052	2068	2064	198
15°	1982	1970	1944	1952	1942	558
25°	1794	1778	1744	1748	1744	825
35°	1548	1528	1495	1483	1473	966
45°	1259	1245	1215	1193	1185	972
55°	953	941	917	893	883	852
65°	643	631	611	592	583	635
75°	336	332	322	310	314	359
85°	82	80	78	72	70	91
90°	2	21	58	55	56	10
95°	87	104	107	107	104	97
105°	358	363	367	370	370	378
115°	667	676	673	671	667	659
125°	970	984	980	974	972	866
135°	1254	1272	1276	1274	1269	969
145°	1522	1534	1544	1546	1539	951
155°	1741	1746	1751	1759	1754	801
165°	1894	1892	1892	1904	1896	534
175°	1970	1966	1962	1974	1964	187
180°	1974	1974	1974	1974	1974	

TEST NUMBER: P923036

CATALOG NUMBER: DFN2DIP-SQ4F0-060D070US940-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2081.8	2081.8	2081.8	2081.8	2081.8
2.5°	2093.9	2083.9	2061.8	2081.8	2078.0
5°	2081.8	2073.9	2051.8	2067.8	2064.0
7.5°	2067.8	2055.9	2033.8	2050.0	2045.9
10°	2045.9	2031.9	2007.9	2023.8	2017.9
12.5°	2015.8	2003.9	1979.9	1989.9	1985.8
15°	1981.7	1969.9	1943.8	1951.9	1941.9
17.5°	1939.7	1927.9	1901.8	1911.6	1901.8
20°	1893.6	1881.8	1853.7	1859.7	1851.8
22.5°	1847.8	1829.7	1803.6	1803.6	1799.6
25°	1793.6	1777.7	1743.7	1747.5	1743.7
27.5°	1733.5	1719.5	1693.5	1687.7	1677.7
30°	1673.7	1657.4	1627.5	1621.6	1613.5
32.5°	1609.4	1597.6	1565.5	1553.4	1545.3
35°	1547.5	1527.5	1495.4	1483.3	1473.3
37.5°	1477.4	1459.3	1427.3	1413.2	1403.2
40°	1405.3	1389.2	1357.2	1339.3	1331.2
42.5°	1335.2	1319.1	1287.3	1267.1	1255.2
45°	1259.3	1245.2	1215.0	1193.2	1185.1
47.5°	1185.1	1171.1	1139.1	1117.0	1105.0
50°	1107.0	1097.0	1069.0	1040.9	1030.9
52.5°	1030.9	1016.9	991.0	968.9	954.9
55°	953.0	940.8	916.9	892.9	882.9
57.5°	874.9	864.9	838.7	814.8	806.6
60°	796.7	788.8	760.8	738.7	732.7
62.5°	720.6	706.6	686.6	666.6	658.6
65°	642.7	630.6	610.6	592.5	582.6
67.5°	562.6	552.4	534.6	520.6	512.5
70°	488.5	480.5	462.4	448.4	440.5
72.5°	412.4	404.4	394.4	380.4	374.4
75°	336.2	332.4	322.2	310.3	314.3
77.5°	268.2	260.2	256.1	250.2	244.2
80°	200.3	198.1	194.1	188.2	184.1
82.5°	136.2	136.2	134.2	126.2	126.2
85°	81.9	80.1	78.1	72.0	70.1
87.5°	36.1	32.1	28.0	22.1	20.0
90°	1.8	21.4	58.3	54.8	56.5
92.5°	36.9	50.0	51.8	53.6	53.6
95°	86.9	103.5	106.6	106.6	103.5
97.5°	144.6	160.1	166.7	166.7	166.7
100°	211.2	225.0	229.7	229.7	227.9
102.5°	281.5	291.6	298.2	300.0	298.2
105°	358.3	363.0	366.6	369.6	369.6
107.5°	434.4	441.6	441.6	442.8	434.4
110°	508.3	517.8	517.8	517.8	513.0



TEST NUMBER: P923036

CATALOG NUMBER: DFN2DIP-SQ4F0-060D070US940-FLLFL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	588.0	598.2	596.4	591.6	588.0
115°	666.6	676.1	673.2	671.4	666.6
117.5°	744.5	757.6	749.3	744.5	739.8
120°	823.0	836.2	823.0	823.0	817.7
122.5°	894.5	911.1	902.9	898.0	894.5
125°	969.5	984.4	979.6	974.3	972.5
127.5°	1042.7	1061.1	1054.6	1047.5	1042.7
130°	1111.2	1132.6	1129.6	1126.1	1119.5
132.5°	1187.9	1204.6	1205.8	1197.5	1192.7
135°	1254.0	1272.4	1276.0	1274.2	1269.4
137.5°	1327.8	1342.6	1345.6	1344.4	1337.3
140°	1392.7	1407.6	1415.9	1415.9	1409.3
142.5°	1459.3	1474.2	1478.9	1480.7	1474.2
145°	1522.4	1534.3	1543.8	1545.6	1539.1
147.5°	1579.0	1593.8	1601.0	1603.9	1597.4
150°	1637.3	1647.3	1653.9	1659.3	1653.9
152.5°	1689.0	1699.2	1707.4	1714.0	1707.4
155°	1740.8	1745.5	1751.0	1759.3	1753.9
157.5°	1785.5	1789.0	1792.0	1803.9	1795.5
160°	1825.3	1828.9	1830.7	1840.8	1833.6
162.5°	1862.2	1862.2	1864.0	1875.3	1867.0
165°	1893.7	1891.9	1891.9	1903.9	1895.5
167.5°	1922.3	1917.0	1917.0	1928.9	1920.6
170°	1943.8	1939.0	1937.2	1949.1	1939.0
172.5°	1958.6	1953.8	1952.0	1964.0	1953.8
175°	1970.5	1965.8	1962.2	1974.1	1964.0
177.5°	1977.1	1972.3	1968.7	1978.9	1968.7
180°	1974.1	1974.1	1974.1	1974.1	1974.1

TEST NUMBER: P923036

CATALOG NUMBER: DFN2DIP-SQ4F0-060D070US940-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.51	9.36	9.47	10.34	11.62	8.06	8.91	9.03	9.90	11.18
	3H	10.17	10.94	11.15	11.92	13.23	9.68	10.44	10.66	11.43	12.74
	4H	10.76	11.48	11.75	12.48	13.79	10.27	10.99	11.26	11.98	13.30
	6H	11.16	11.83	12.16	12.83	14.16	10.66	11.33	11.66	12.33	13.66
	8H	11.27	11.90	12.28	12.92	14.24	10.77	11.40	11.77	12.42	13.74
	12H	11.32	11.92	12.33	12.93	14.28	10.81	11.41	11.82	12.42	13.77
4H	2H	8.97	9.69	9.96	10.68	12.00	8.61	9.34	9.61	10.33	11.64
	3H	10.84	11.44	11.84	12.46	13.79	10.43	11.03	11.43	12.06	13.38
	4H	11.55	12.11	12.57	13.12	14.47	11.13	11.68	12.14	12.70	14.05
	6H	12.07	12.55	13.10	13.59	14.94	11.64	12.12	12.66	13.15	14.50
	8H	12.22	12.67	13.25	13.70	15.06	11.79	12.23	12.81	13.26	14.63
	12H	12.30	12.70	13.34	13.75	15.12	11.85	12.25	12.89	13.30	14.67
8H	4H	11.75	12.19	12.78	13.23	14.59	11.37	11.82	12.40	12.85	14.21
	6H	12.39	12.75	13.44	13.83	15.19	12.00	12.37	13.05	13.44	14.80
	8H	12.61	12.93	13.67	13.99	15.37	12.22	12.54	13.27	13.60	14.98
	12H	12.74	13.03	13.81	14.08	15.50	12.33	12.62	13.39	13.67	15.09
12H	4H	11.74	12.14	12.78	13.18	14.55	11.37	11.77	12.41	12.82	14.19
	6H	12.42	12.74	13.47	13.80	15.18	12.04	12.37	13.10	13.43	14.81
	8H	12.66	12.95	13.72	14.00	15.42	12.28	12.57	13.34	13.62	15.04

END OF REPORT