

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P923063

Luminaire Tested: DFN2DIP-SQ4F0-060D140US940-RLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P923063
REPORT IS A COMBINATION OF REPORTS P901706 AND P898471
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-060D140US940-RLLONL
Description: 4 foot, Square Define Geo, with Direct 1in Regressed Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 16906.8 lumens
Efficiency: N/A
Efficacy: 108.5 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 0.99 / 1.16
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 155.8
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.946
Total Harmonic Distortion (THDi): 0.132
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P923063

CATALOG NUMBER: DFN2DIP-SQ4F0-060D140US940-RLLONL

Luminous Intensity Polar Plot

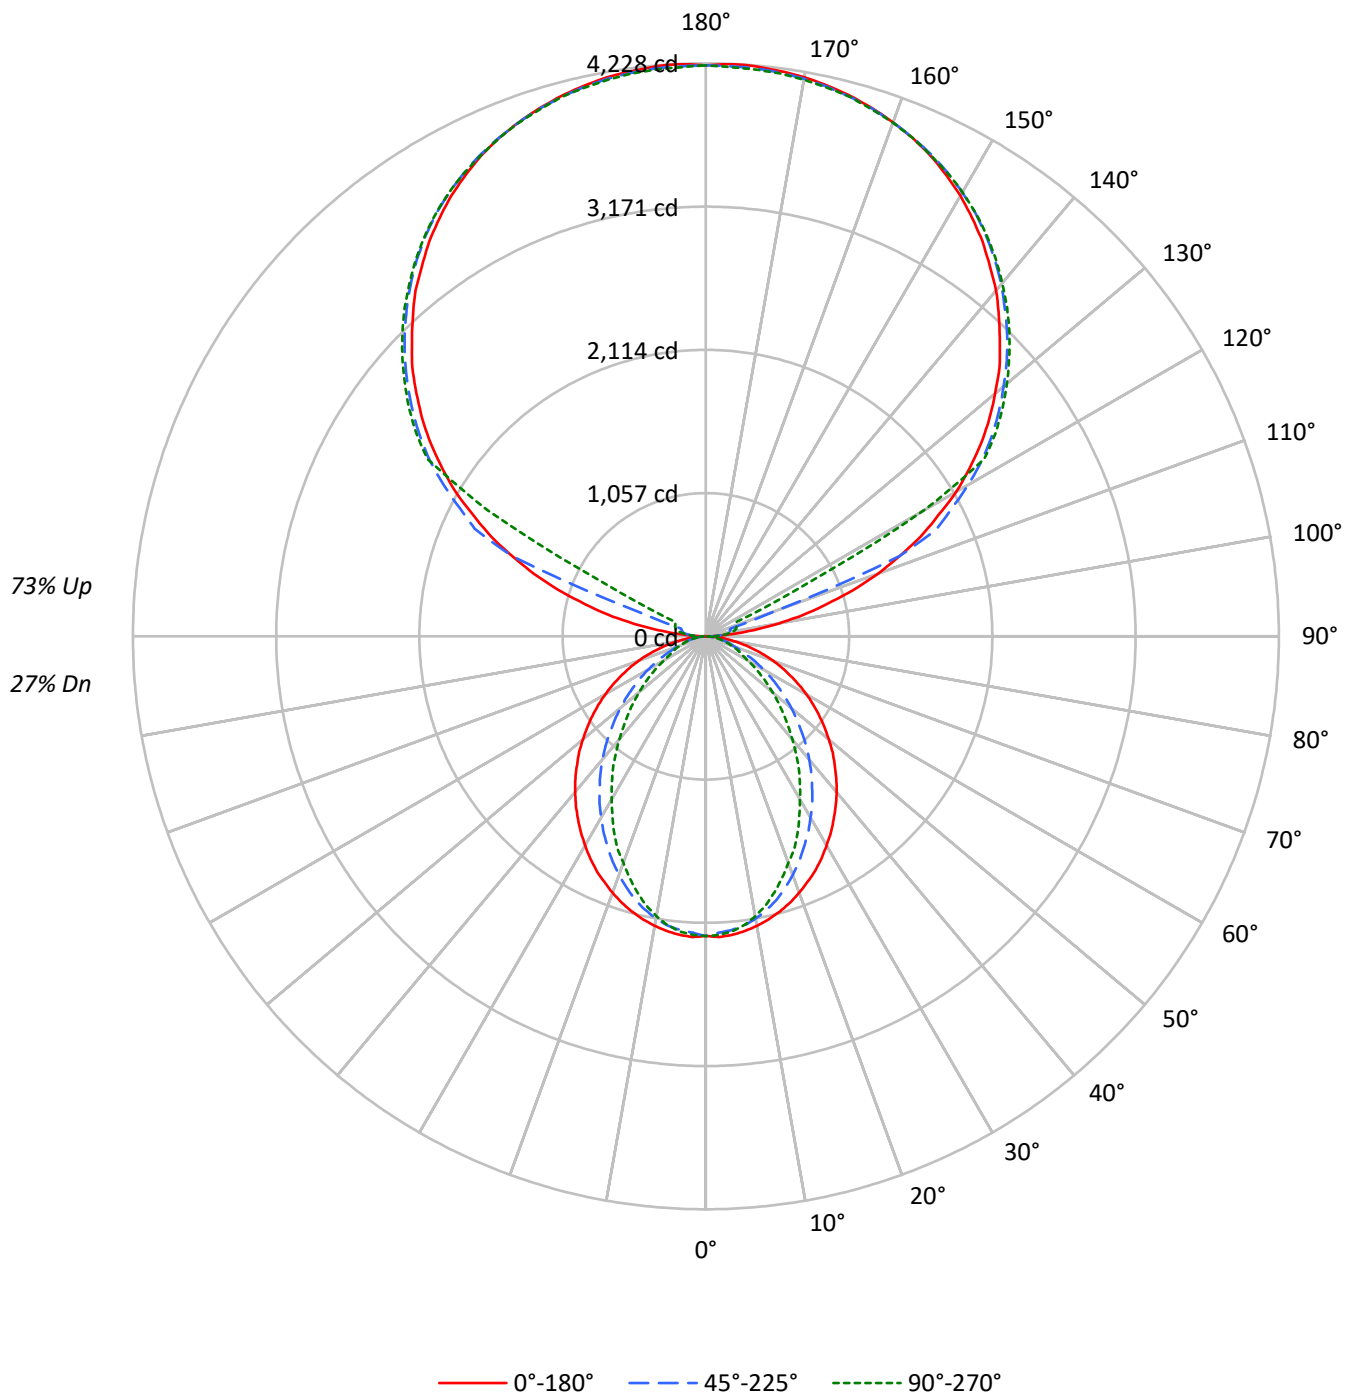

TEST NUMBER: P923063

CATALOG NUMBER: DFN2DIP-SQ4F0-060D140US940-RLLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	102	102	102	102	91	91	91	91	71	71	71	52	52	52	35	35	35
1	93	89	85	82	83	79	76	74	62	60	58	46	45	44	31	31	30
2	85	78	72	67	75	70	65	61	55	51	49	41	39	37	28	27	26
3	77	69	62	56	69	62	56	51	48	44	41	36	34	31	25	23	22
4	71	61	53	48	63	55	48	43	43	39	35	32	29	27	22	21	19
5	65	54	46	41	58	49	42	37	39	34	30	29	26	23	20	18	17
6	60	48	41	35	53	44	37	32	35	30	26	26	23	21	18	16	15
7	55	44	36	31	49	39	33	28	31	27	23	24	21	18	17	15	13
8	51	40	32	27	46	36	29	25	29	24	21	22	19	16	16	13	12
9	48	36	29	24	43	33	26	22	26	22	18	20	17	15	14	12	11
10	44	33	26	22	40	30	24	20	24	20	16	19	15	13	13	11	10

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1552	1552	1552
5°	1554	1527	1537
10°	1539	1498	1488
15°	1517	1448	1411
20°	1489	1380	1316
25°	1461	1304	1225
30°	1422	1226	1109
35°	1384	1142	1007
40°	1346	1055	890
45°	1301	958	784
50°	1255	861	681
55°	1207	757	581
60°	1151	648	479
65°	1087	537	431
70°	1009	433	391
75°	911	382	357
80°	769	322	311
85°	536	217	237

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2259 cd/sqm

TEST NUMBER: P923063

CATALOG NUMBER: DFN2DIP-SQ4F0-060D140US940-RLLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	207.2	1.2
10°-20°	568.9	3.4
20°-30°	798.7	4.7
30°-40°	870.7	5.1
40°-50°	800.3	4.7
50°-60°	628.5	3.7
60°-70°	409.1	2.4
70°-80°	210.6	1.2
80°-90°	61.2	0.4
90°-100°	138.9	0.8
100°-110°	517.9	3.1
110°-120°	1373.5	8.1
120°-130°	2278.1	13.5
130°-140°	2419.9	14.3
140°-150°	2249.0	13.3
150°-160°	1808.2	10.7
160°-170°	1165.1	6.9
170°-180°	401.0	2.4
0°-30°	1574.9	9.3
0°-40°	2445.6	14.5
0°-60°	3874.3	22.9
0°-90°	4555.1	26.9
90°-120°	2030.4	12.0
90°-150°	8977.4	53.1
90°-180°	12352.0	73.1
0°-180°	16906.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2211	2211	2211	2211	2211	
5°	2211	2201	2175	2193	2187	210
15°	2103	2081	2013	1975	1955	593
25°	1909	1845	1713	1631	1601	878
35°	1645	1543	1367	1241	1197	1030
45°	1345	1211	1001	858	810	1039
55°	1022	866	650	530	492	914
65°	690	528	348	280	274	685
75°	368	228	160	146	144	389
85°	86	44	38	38	38	99
90°	3	37	61	76	82	16
95°	198	97	119	134	131	235
105°	927	1018	186	219	232	990
115°	1753	1805	1881	470	250	1726
125°	2478	2518	2576	2598	2607	2210
135°	3067	3116	3143	3174	3168	2369
145°	3558	3555	3606	3628	3613	2225
155°	3917	3890	3927	3945	3921	1805
165°	4128	4110	4119	4140	4119	1166
175°	4222	4201	4207	4228	4198	402
180°	4213	4213	4213	4213	4213	

TEST NUMBER: P923063

CATALOG NUMBER: DFN2DIP-SQ4F0-060D140US940-RLLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2211.3	2211.3	2211.3	2211.3	2211.3
2.5°	2221.3	2211.3	2189.1	2209.3	2205.3
5°	2211.3	2201.3	2175.1	2193.3	2187.3
7.5°	2193.3	2181.3	2153.3	2161.1	2151.2
10°	2169.2	2155.2	2115.3	2109.2	2097.2
12.5°	2139.3	2121.2	2067.1	2055.2	2033.1
15°	2103.2	2081.1	2013.1	1975.1	1955.2
17.5°	2061.2	2029.1	1945.0	1901.0	1869.0
20°	2013.1	1973.0	1873.0	1823.1	1779.0
22.5°	1961.1	1915.0	1798.9	1731.0	1701.0
25°	1909.2	1845.0	1713.0	1631.0	1600.9
27.5°	1847.2	1779.0	1632.9	1538.8	1492.8
30°	1781.1	1704.9	1544.8	1442.9	1388.7
32.5°	1717.0	1624.9	1461.0	1340.8	1290.7
35°	1645.0	1542.9	1366.9	1240.7	1196.6
37.5°	1574.9	1464.7	1278.8	1140.6	1090.7
40°	1500.8	1380.9	1186.6	1044.5	992.6
42.5°	1424.9	1296.8	1094.7	946.5	896.6
45°	1344.8	1210.6	1000.7	858.4	810.4
47.5°	1268.8	1126.8	910.6	768.4	724.4
50°	1184.7	1042.7	822.5	684.3	642.5
52.5°	1102.5	952.4	738.4	606.4	568.4
55°	1022.5	866.5	650.3	530.4	492.3
57.5°	940.6	780.4	572.4	460.3	428.2
60°	856.5	696.4	490.3	388.3	356.2
62.5°	774.5	614.5	420.2	324.2	308.3
65°	690.5	528.2	348.2	280.3	274.1
67.5°	610.4	448.2	280.3	246.1	240.1
70°	526.3	370.2	232.0	212.1	204.0
72.5°	446.3	298.1	194.0	178.2	174.1
75°	368.2	228.0	160.1	146.1	144.2
77.5°	290.3	162.0	126.1	118.1	114.0
80°	218.0	116.1	95.9	88.1	88.1
82.5°	152.0	78.1	66.0	62.0	62.0
85°	86.0	44.0	38.0	38.0	38.0
87.5°	32.1	16.0	16.0	14.0	14.0
90°	2.9	36.6	60.8	76.4	82.2
92.5°	76.4	64.1	73.1	79.3	82.2
95°	198.0	97.4	118.8	134.3	131.1
97.5°	356.6	106.8	155.3	164.7	167.6
100°	539.8	122.0	173.8	198.0	204.2
102.5°	740.7	734.9	179.9	213.2	222.7
105°	926.8	1018.3	186.1	219.4	231.7
107.5°	1143.3	1219.2	192.3	225.5	237.8
110°	1350.7	1414.4	533.6	228.8	240.8

TEST NUMBER: P923063

CATALOG NUMBER: DFN2DIP-SQ4F0-060D140US940-RLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1545.8	1600.4	1548.7	234.6	244.0
115°	1752.9	1804.6	1881.1	469.6	250.1
117.5°	1932.8	1993.6	2045.8	1609.5	810.9
120°	2134.1	2179.7	2234.7	2271.3	1859.7
122.5°	2304.6	2353.5	2414.7	2432.8	2436.1
125°	2478.4	2518.2	2576.2	2597.5	2606.6
127.5°	2637.0	2679.7	2725.6	2756.0	2759.0
130°	2786.4	2835.4	2868.6	2902.3	2899.4
132.5°	2938.9	2978.7	3012.0	3039.5	3036.6
135°	3067.0	3115.9	3143.0	3173.8	3167.6
137.5°	3201.0	3237.5	3268.3	3298.7	3289.7
140°	3332.1	3356.7	3389.9	3417.5	3402.2
142.5°	3442.1	3463.4	3502.9	3527.2	3511.9
145°	3557.9	3554.6	3606.4	3627.8	3612.6
147.5°	3658.2	3649.1	3701.0	3716.1	3704.2
150°	3756.0	3734.6	3783.4	3801.5	3786.4
152.5°	3838.1	3813.8	3859.5	3878.0	3856.6
155°	3917.4	3890.3	3926.8	3944.9	3920.7
157.5°	3981.5	3957.2	3984.8	4006.1	3981.5
160°	4036.5	4018.0	4036.5	4054.6	4033.3
162.5°	4085.0	4066.9	4082.2	4103.5	4076.0
165°	4127.7	4109.6	4118.7	4140.0	4118.7
167.5°	4161.4	4143.0	4152.3	4173.7	4146.2
170°	4188.9	4170.4	4176.6	4198.0	4170.4
172.5°	4207.0	4188.9	4195.1	4216.5	4188.9
175°	4222.2	4200.8	4207.0	4228.4	4198.0
177.5°	4228.4	4207.0	4210.3	4231.6	4204.1
180°	4213.2	4213.2	4213.2	4213.2	4213.2

TEST NUMBER: P923063

CATALOG NUMBER: DFN2DIP-SQ4F0-060D140US940-RLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	6.01	6.69	7.15	7.81	9.38	1.98	2.65	3.11	3.77	5.34
	3H	7.68	8.28	8.83	9.42	11.00	3.15	3.75	4.30	4.89	6.47
	4H	8.29	8.86	9.44	9.99	11.58	3.60	4.17	4.75	5.30	6.89
	6H	8.71	9.23	9.87	10.37	11.97	3.91	4.43	5.07	5.57	7.17
	8H	8.83	9.33	9.99	10.48	12.07	4.00	4.49	5.16	5.65	7.24
	12H	8.89	9.36	10.06	10.51	12.12	4.03	4.51	5.20	5.65	7.27
4H	2H	6.01	6.58	7.18	7.72	9.31	2.55	3.12	3.72	4.26	5.85
	3H	7.83	8.31	9.00	9.47	11.07	3.89	4.37	5.06	5.52	7.12
	4H	8.52	8.96	9.69	10.11	11.73	4.43	4.87	5.60	6.02	7.64
	6H	9.03	9.41	10.21	10.58	12.19	4.84	5.22	6.02	6.39	8.00
	8H	9.21	9.56	10.38	10.72	12.34	4.97	5.32	6.14	6.48	8.11
	12H	9.30	9.61	10.49	10.79	12.42	5.03	5.35	6.22	6.52	8.15
8H	4H	8.48	8.83	9.65	9.99	11.62	4.70	5.05	5.88	6.21	7.84
	6H	9.04	9.33	10.24	10.53	12.16	5.22	5.51	6.41	6.71	8.33
	8H	9.26	9.51	10.46	10.69	12.34	5.41	5.66	6.61	6.84	8.48
	12H	9.40	9.62	10.60	10.80	12.47	5.52	5.74	6.72	6.92	8.60
12H	4H	8.42	8.74	9.61	9.91	11.54	4.70	5.02	5.89	6.19	7.82
	6H	9.02	9.27	10.22	10.45	12.09	5.27	5.52	6.46	6.70	8.34
	8H	9.23	9.45	10.44	10.63	12.31	5.47	5.69	6.67	6.87	8.55

END OF REPORT