

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P923088

Luminaire Tested: DFN2DIP-SQ4F0-070D110US940-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P923088
REPORT IS A COMBINATION OF REPORTS P900151 AND P896915
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-070D110US940-FLLFLL
Description: 4 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 14860.4 lumens
Efficiency: N/A
Efficacy: 103.1 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 144.1
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9967
Total Harmonic Distortion (THDi): 0.063
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P923088

CATALOG NUMBER: DFN2DIP-SQ4F0-070D110US940-FLLFLL

Luminous Intensity Polar Plot

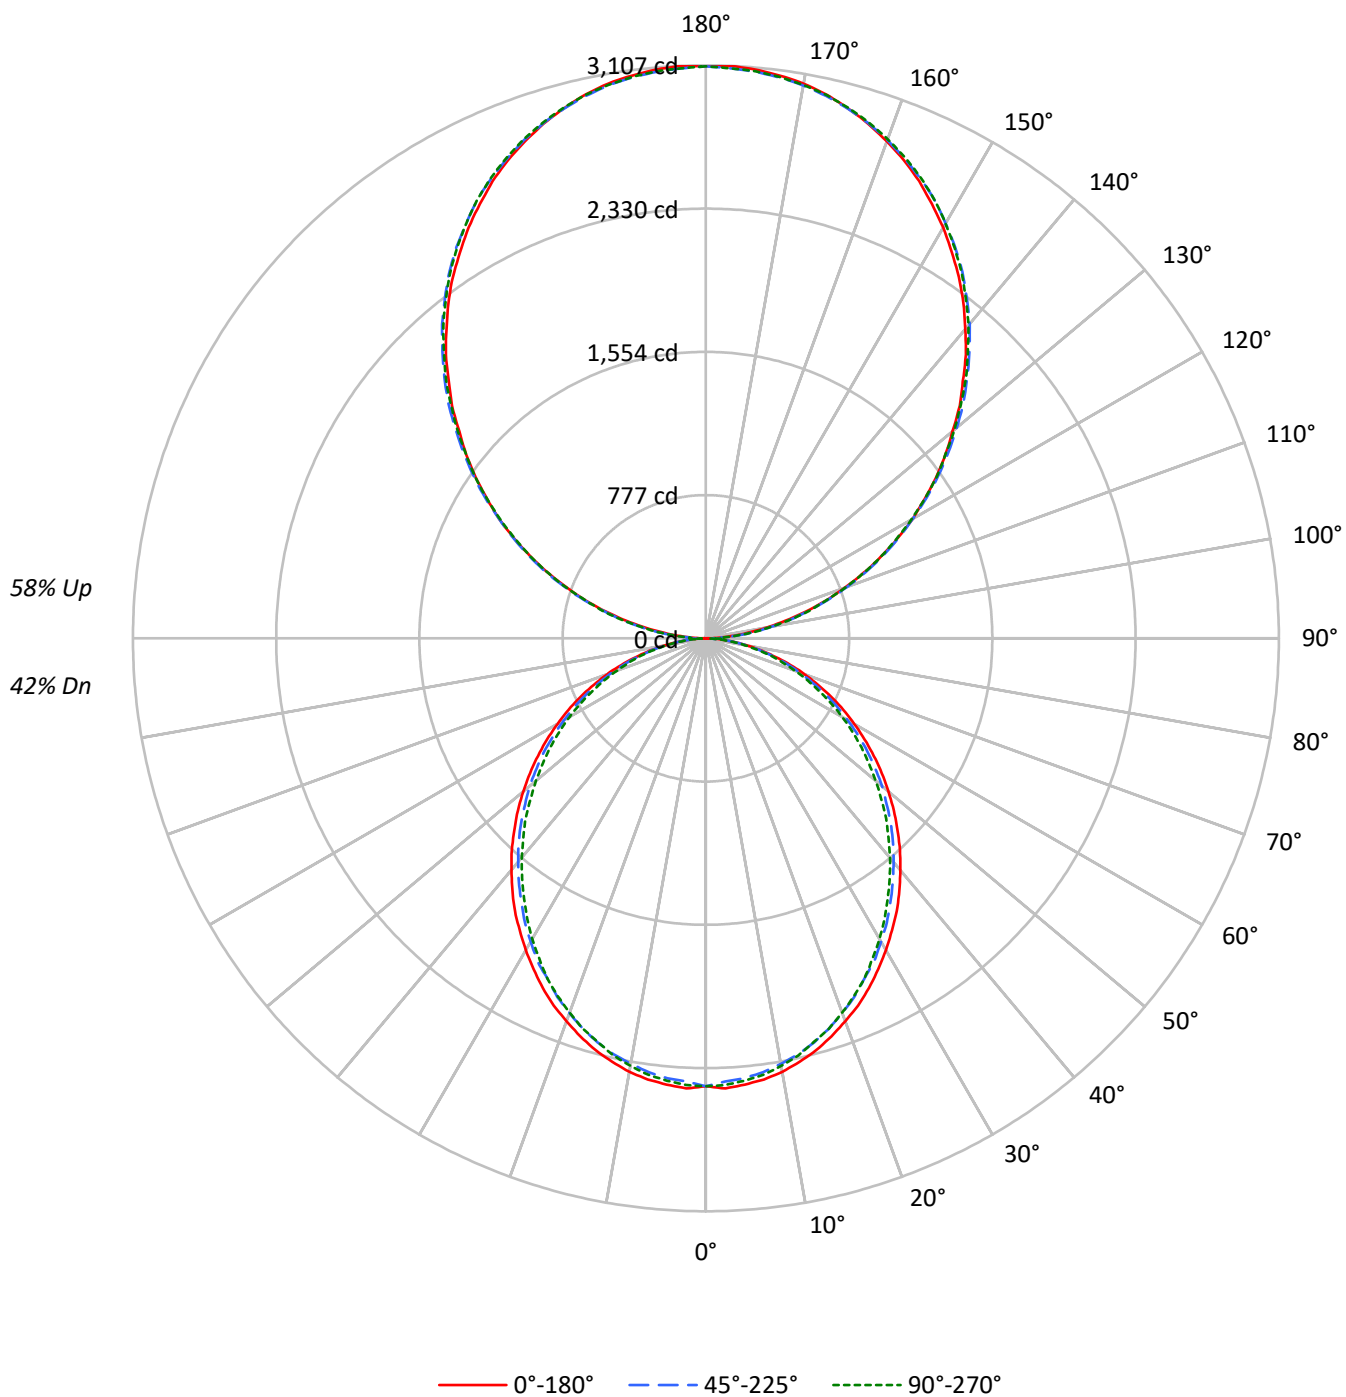

TEST NUMBER: P923088

CATALOG NUMBER: DFN2DIP-SQ4F0-070D110US940-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	105	105	105	105	96	96	96	96	79	79	79	63	63	63	48	48	48
1	96	92	88	84	87	84	80	78	69	67	65	55	54	52	43	42	41
2	87	80	74	69	79	73	68	64	60	57	53	49	46	44	38	36	34
3	80	70	63	57	72	64	58	53	53	49	45	43	40	37	33	31	29
4	73	62	54	48	66	57	50	45	47	42	38	38	35	32	30	27	25
5	67	55	47	41	61	51	44	39	42	37	33	34	30	27	27	24	22
6	61	50	42	36	56	46	39	33	38	33	29	31	27	24	24	22	19
7	57	45	37	31	52	41	34	29	34	29	25	28	24	21	22	19	17
8	53	41	33	28	48	37	31	26	31	26	22	26	22	19	20	18	15
9	49	37	30	25	45	34	28	23	29	24	20	24	20	17	19	16	14
10	46	34	27	22	42	31	25	21	26	21	18	22	18	15	17	15	13

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1704	1704	1704
5°	1707	1681	1692
10°	1693	1658	1670
15°	1668	1632	1635
20°	1634	1594	1598
25°	1601	1549	1556
30°	1559	1507	1503
35°	1519	1458	1447
40°	1470	1408	1393
45°	1422	1358	1338
50°	1368	1305	1274
55°	1312	1244	1216
60°	1249	1172	1149
65°	1180	1098	1070
70°	1093	1007	985
75°	971	898	908
80°	825	760	758
85°	596	520	510

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2440 cd/sqm

TEST NUMBER: P923088

CATALOG NUMBER: DFN2DIP-SQ4F0-070D110US940-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	228.6	1.5
10°-20°	643.2	4.3
20°-30°	945.2	6.4
30°-40°	1097.8	7.4
40°-50°	1096.5	7.4
50°-60°	956.1	6.4
60°-70°	706.8	4.8
70°-80°	399.9	2.7
80°-90°	114.4	0.8
90°-100°	192.0	1.3
100°-110°	609.9	4.1
110°-120°	1043.8	7.0
120°-130°	1372.7	9.2
130°-140°	1540.8	10.4
140°-150°	1511.0	10.2
150°-160°	1267.5	8.5
160°-170°	840.6	5.7
170°-180°	293.8	2.0
0°-30°	1817.0	12.2
0°-40°	2914.9	19.6
0°-60°	4967.4	33.4
0°-90°	6188.4	41.6
90°-120°	1845.7	12.4
90°-150°	6270.1	42.2
90°-180°	8672.0	58.4
0°-180°	14860.4	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2429	2429	2429	2429	2429	
5°	2429	2420	2394	2412	2408	231
15°	2312	2298	2268	2277	2266	651
25°	2093	2074	2034	2039	2034	963
35°	1805	1782	1745	1730	1719	1127
45°	1469	1453	1418	1392	1383	1134
55°	1112	1098	1070	1042	1030	994
65°	750	736	712	691	680	741
75°	392	388	376	362	367	419
85°	96	94	91	84	82	107
90°	3	34	92	86	89	14
95°	136	163	167	167	163	152
105°	563	570	576	581	581	594
115°	1048	1062	1058	1055	1048	1036
125°	1524	1547	1539	1531	1528	1361
135°	1970	2000	2005	2002	1995	1523
145°	2392	2411	2426	2429	2418	1495
155°	2736	2743	2752	2765	2756	1259
165°	2976	2973	2973	2992	2979	840
175°	3097	3089	3083	3102	3086	294
180°	3102	3102	3102	3102	3102	

TEST NUMBER: P923088

CATALOG NUMBER: DFN2DIP-SQ4F0-070D110US940-FLLFL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2428.8	2428.8	2428.8	2428.8	2428.8
2.5°	2442.9	2431.2	2405.5	2428.8	2424.3
5°	2428.8	2419.7	2393.9	2412.4	2408.0
7.5°	2412.4	2398.5	2372.8	2391.7	2386.9
10°	2386.9	2370.5	2342.5	2361.2	2354.2
12.5°	2351.7	2337.9	2309.9	2321.5	2316.8
15°	2312.1	2298.2	2267.7	2277.2	2265.5
17.5°	2263.0	2249.2	2218.7	2230.3	2218.7
20°	2209.2	2195.4	2162.7	2169.6	2160.4
22.5°	2155.7	2134.7	2104.2	2104.2	2099.4
25°	2092.6	2073.9	2034.3	2038.8	2034.3
27.5°	2022.4	2006.1	1975.9	1968.9	1957.2
30°	1952.6	1933.7	1898.8	1891.9	1882.4
32.5°	1877.7	1863.9	1826.4	1812.3	1802.9
35°	1805.4	1782.1	1744.6	1730.5	1718.9
37.5°	1723.6	1702.5	1665.1	1648.8	1637.1
40°	1639.6	1620.8	1583.3	1562.5	1553.1
42.5°	1557.8	1539.0	1501.8	1478.3	1464.4
45°	1469.1	1452.8	1417.6	1392.0	1382.6
47.5°	1382.6	1366.3	1328.8	1303.1	1289.2
50°	1291.5	1279.8	1247.1	1214.4	1202.7
52.5°	1202.7	1186.4	1156.2	1130.4	1114.0
55°	1111.8	1097.7	1069.7	1041.7	1030.0
57.5°	1020.7	1009.0	978.5	950.5	941.1
60°	929.4	920.2	887.6	861.8	854.9
62.5°	840.7	824.4	801.1	777.8	768.4
65°	749.8	735.7	712.4	691.3	679.7
67.5°	656.4	644.5	623.7	607.3	597.9
70°	569.9	560.5	539.4	523.1	513.9
72.5°	481.2	471.8	460.1	443.8	436.8
75°	392.3	387.8	375.9	362.0	366.8
77.5°	313.0	303.5	298.8	291.9	285.0
80°	233.6	231.2	226.5	219.5	214.8
82.5°	158.8	158.8	156.6	147.2	147.2
85°	95.7	93.5	91.2	84.0	81.8
87.5°	42.1	37.5	32.7	25.8	23.3
90°	2.8	33.7	91.7	86.1	88.8
92.5°	58.0	78.6	81.3	84.2	84.2
95°	136.5	162.7	167.4	167.4	162.7
97.5°	227.3	251.6	261.9	261.9	261.9
100°	332.0	353.5	361.0	361.0	358.2
102.5°	442.4	458.2	468.6	471.4	468.6
105°	563.0	570.5	576.1	580.8	580.8
107.5°	682.7	693.9	693.9	695.8	682.7
110°	798.7	813.7	813.7	813.7	806.2

TEST NUMBER: P923088

CATALOG NUMBER: DFN2DIP-SQ4F0-070D110US940-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	924.0	939.9	937.1	929.6	924.0
115°	1047.5	1062.4	1057.7	1055.0	1047.5
117.5°	1170.0	1190.5	1177.4	1170.0	1162.5
120°	1293.4	1314.0	1293.4	1293.4	1285.0
122.5°	1405.7	1431.8	1418.7	1411.2	1405.7
125°	1523.5	1546.8	1539.4	1531.0	1528.1
127.5°	1638.5	1667.5	1657.2	1646.0	1638.5
130°	1746.1	1779.8	1775.0	1769.4	1759.2
132.5°	1866.7	1892.9	1894.8	1881.7	1874.2
135°	1970.5	1999.5	2005.1	2002.3	1994.8
137.5°	2086.5	2109.9	2114.5	2112.6	2101.5
140°	2188.4	2211.8	2224.9	2224.9	2214.7
142.5°	2293.2	2316.6	2324.1	2326.8	2316.6
145°	2392.3	2411.0	2426.0	2428.8	2418.5
147.5°	2481.2	2504.5	2515.8	2520.4	2510.2
150°	2572.9	2588.7	2599.0	2607.5	2599.0
152.5°	2654.2	2670.0	2683.2	2693.5	2683.2
155°	2735.6	2743.0	2751.5	2764.6	2756.1
157.5°	2805.7	2811.3	2815.9	2834.7	2821.5
160°	2868.4	2874.0	2876.7	2892.7	2881.5
162.5°	2926.3	2926.3	2929.2	2946.9	2933.8
165°	2975.9	2973.1	2973.1	2991.8	2978.7
167.5°	3020.8	3012.4	3012.4	3031.1	3018.0
170°	3054.5	3047.0	3044.2	3062.8	3047.0
172.5°	3077.8	3070.3	3067.6	3086.3	3070.3
175°	3096.6	3089.1	3083.4	3102.2	3086.3
177.5°	3106.8	3099.3	3093.7	3109.7	3093.7
180°	3102.2	3102.2	3102.2	3102.2	3102.2

TEST NUMBER: P923088

CATALOG NUMBER: DFN2DIP-SQ4F0-070D110US940-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.31	9.10	9.34	10.13	11.52	7.87	8.66	8.89	9.69	11.08
	3H	9.97	10.68	11.00	11.72	13.13	9.48	10.19	10.51	11.23	12.64
	4H	10.56	11.23	11.60	12.27	13.69	10.06	10.73	11.11	11.78	13.19
	6H	10.96	11.57	12.01	12.62	14.05	10.46	11.07	11.51	12.12	13.55
	8H	11.06	11.65	12.12	12.71	14.13	10.56	11.15	11.62	12.21	13.63
	12H	11.11	11.67	12.18	12.73	14.17	10.60	11.16	11.67	12.22	13.66
4H	2H	8.76	9.43	9.82	10.48	11.89	8.41	9.08	9.46	10.12	11.54
	3H	10.63	11.19	11.69	12.26	13.69	10.22	10.78	11.28	11.85	13.28
	4H	11.34	11.86	12.41	12.92	14.37	10.92	11.43	11.99	12.50	13.94
	6H	11.86	12.30	12.93	13.39	14.83	11.42	11.87	12.50	12.95	14.39
	8H	12.01	12.42	13.08	13.50	14.96	11.57	11.98	12.65	13.06	14.52
	12H	12.08	12.45	13.17	13.55	15.01	11.63	12.00	12.72	13.10	14.56
8H	4H	11.53	11.95	12.61	13.02	14.48	11.16	11.57	12.23	12.65	14.11
	6H	12.17	12.51	13.27	13.63	15.08	11.78	12.12	12.88	13.24	14.70
	8H	12.39	12.69	13.50	13.79	15.27	12.00	12.30	13.10	13.40	14.87
	12H	12.52	12.78	13.63	13.88	15.40	12.11	12.37	13.22	13.47	14.98
12H	4H	11.51	11.89	12.61	12.98	14.44	11.15	11.52	12.24	12.61	14.08
	6H	12.20	12.49	13.30	13.60	15.07	11.82	12.12	12.93	13.23	14.70
	8H	12.44	12.70	13.55	13.80	15.31	12.06	12.32	13.17	13.42	14.93

END OF REPORT