

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P923097

Luminaire Tested: DFN2DIP-SQ4F0-070D140US940-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P923097
REPORT IS A COMBINATION OF REPORTS P901707 AND P898471
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-070D140US940-FLLONL
Description: 4 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 18538.7 lumens
Efficiency: N/A
Efficacy: 110.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 167.1
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9967
Total Harmonic Distortion (THDi): 0.063
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P923097

CATALOG NUMBER: DFN2DIP-SQ4F0-070D140US940-FLLONL

Luminous Intensity Polar Plot

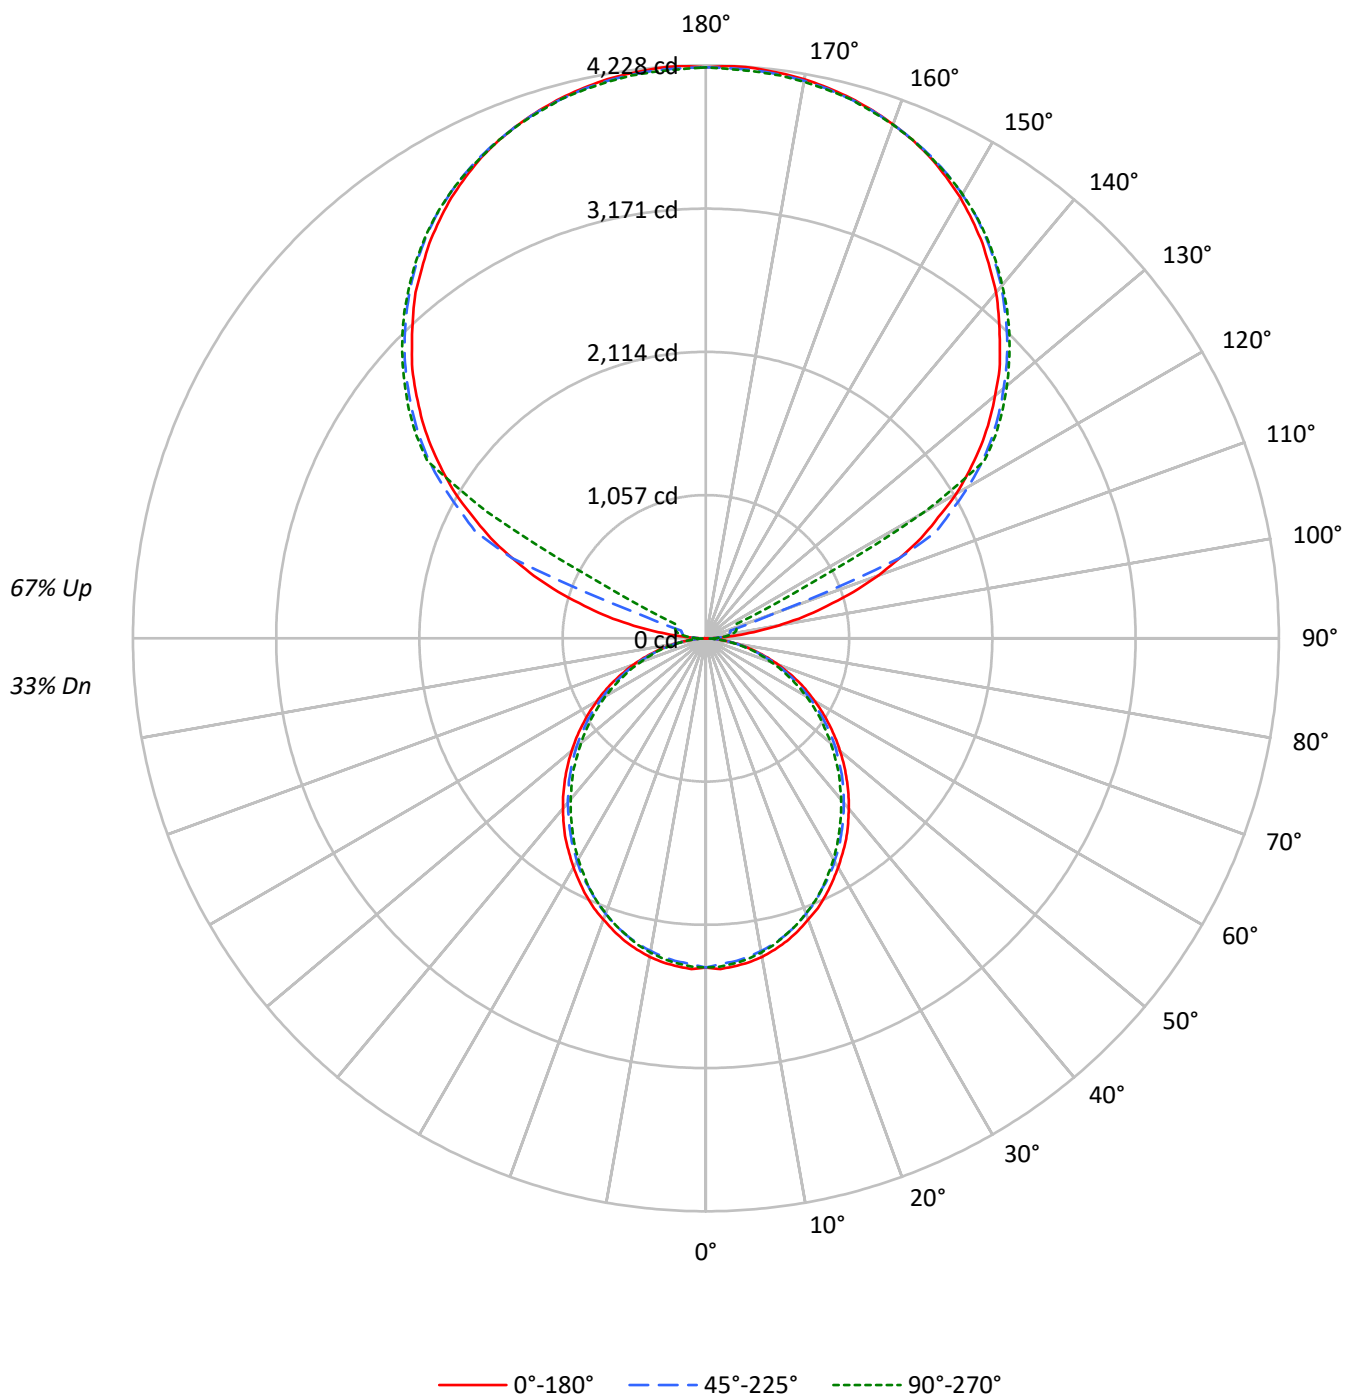

TEST NUMBER: P923097

CATALOG NUMBER: DFN2DIP-SQ4F0-070D140US940-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	103	103	103	103	93	93	93	93	74	74	74	57	57	57	41	41	41
1	94	90	86	83	85	81	78	75	65	63	61	50	48	47	36	35	34
2	86	78	72	67	77	71	66	62	57	53	50	44	41	39	32	30	29
3	78	69	62	56	70	62	56	51	50	46	42	39	36	33	28	26	25
4	71	61	53	47	64	55	49	43	44	40	36	34	31	28	25	23	21
5	65	54	46	40	59	49	42	37	40	35	31	31	27	25	23	20	18
6	60	48	41	35	54	44	37	32	36	31	27	28	24	21	20	18	16
7	56	44	36	30	50	40	33	28	32	27	23	25	22	19	19	16	14
8	51	39	32	27	46	36	29	25	29	24	21	23	19	17	17	15	13
9	48	36	29	24	43	33	26	22	27	22	19	21	18	15	16	13	12
10	45	33	26	21	40	30	24	20	25	20	17	19	16	14	15	12	11

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1704	1704	1704
5°	1707	1681	1692
10°	1693	1658	1670
15°	1668	1632	1635
20°	1634	1594	1598
25°	1601	1549	1556
30°	1559	1507	1503
35°	1519	1458	1447
40°	1470	1408	1393
45°	1422	1358	1338
50°	1368	1305	1274
55°	1312	1244	1216
60°	1249	1172	1149
65°	1180	1098	1070
70°	1093	1007	985
75°	971	898	908
80°	825	760	758
85°	596	520	510

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2259 cd/sqm

TEST NUMBER: P923097

CATALOG NUMBER: DFN2DIP-SQ4F0-070D140US940-FLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	228.6	1.2
10°-20°	643.2	3.5
20°-30°	945.2	5.1
30°-40°	1097.8	5.9
40°-50°	1096.5	5.9
50°-60°	956.1	5.2
60°-70°	706.8	3.8
70°-80°	399.9	2.2
80°-90°	113.0	0.6
90°-100°	138.9	0.7
100°-110°	517.9	2.8
110°-120°	1373.5	7.4
120°-130°	2278.1	12.3
130°-140°	2419.9	13.1
140°-150°	2249.0	12.1
150°-160°	1808.2	9.8
160°-170°	1165.1	6.3
170°-180°	401.0	2.2
0°-30°	1817.0	9.8
0°-40°	2914.9	15.7
0°-60°	4967.4	26.8
0°-90°	6187.0	33.4
90°-120°	2030.4	11.0
90°-150°	8977.4	48.4
90°-180°	12352.0	66.6
0°-180°	18538.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2429	2429	2429	2429	2429	
5°	2429	2420	2394	2412	2408	231
15°	2312	2298	2268	2277	2266	651
25°	2093	2074	2034	2039	2034	963
35°	1805	1782	1745	1730	1719	1127
45°	1469	1453	1418	1392	1383	1134
55°	1112	1098	1070	1042	1030	994
65°	750	736	712	691	680	741
75°	392	388	376	362	367	419
85°	96	94	91	84	82	107
90°	3	37	61	76	82	17
95°	198	97	119	134	131	235
105°	927	1018	186	219	232	990
115°	1753	1805	1881	470	250	1726
125°	2478	2518	2576	2598	2607	2210
135°	3067	3116	3143	3174	3168	2369
145°	3558	3555	3606	3628	3613	2225
155°	3917	3890	3927	3945	3921	1805
165°	4128	4110	4119	4140	4119	1166
175°	4222	4201	4207	4228	4198	402
180°	4213	4213	4213	4213	4213	

TEST NUMBER: P923097

CATALOG NUMBER: DFN2DIP-SQ4F0-070D140US940-FLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2428.8	2428.8	2428.8	2428.8	2428.8
2.5°	2442.9	2431.2	2405.5	2428.8	2424.3
5°	2428.8	2419.7	2393.9	2412.4	2408.0
7.5°	2412.4	2398.5	2372.8	2391.7	2386.9
10°	2386.9	2370.5	2342.5	2361.2	2354.2
12.5°	2351.7	2337.9	2309.9	2321.5	2316.8
15°	2312.1	2298.2	2267.7	2277.2	2265.5
17.5°	2263.0	2249.2	2218.7	2230.3	2218.7
20°	2209.2	2195.4	2162.7	2169.6	2160.4
22.5°	2155.7	2134.7	2104.2	2104.2	2099.4
25°	2092.6	2073.9	2034.3	2038.8	2034.3
27.5°	2022.4	2006.1	1975.9	1968.9	1957.2
30°	1952.6	1933.7	1898.8	1891.9	1882.4
32.5°	1877.7	1863.9	1826.4	1812.3	1802.9
35°	1805.4	1782.1	1744.6	1730.5	1718.9
37.5°	1723.6	1702.5	1665.1	1648.8	1637.1
40°	1639.6	1620.8	1583.3	1562.5	1553.1
42.5°	1557.8	1539.0	1501.8	1478.3	1464.4
45°	1469.1	1452.8	1417.6	1392.0	1382.6
47.5°	1382.6	1366.3	1328.8	1303.1	1289.2
50°	1291.5	1279.8	1247.1	1214.4	1202.7
52.5°	1202.7	1186.4	1156.2	1130.4	1114.0
55°	1111.8	1097.7	1069.7	1041.7	1030.0
57.5°	1020.7	1009.0	978.5	950.5	941.1
60°	929.4	920.2	887.6	861.8	854.9
62.5°	840.7	824.4	801.1	777.8	768.4
65°	749.8	735.7	712.4	691.3	679.7
67.5°	656.4	644.5	623.7	607.3	597.9
70°	569.9	560.5	539.4	523.1	513.9
72.5°	481.2	471.8	460.1	443.8	436.8
75°	392.3	387.8	375.9	362.0	366.8
77.5°	313.0	303.5	298.8	291.9	285.0
80°	233.6	231.2	226.5	219.5	214.8
82.5°	158.8	158.8	156.6	147.2	147.2
85°	95.7	93.5	91.2	84.0	81.8
87.5°	42.1	37.5	32.7	25.8	23.3
90°	2.9	36.6	60.8	76.4	82.2
92.5°	76.4	64.1	73.1	79.3	82.2
95°	198.0	97.4	118.8	134.3	131.1
97.5°	356.6	106.8	155.3	164.7	167.6
100°	539.8	122.0	173.8	198.0	204.2
102.5°	740.7	734.9	179.9	213.2	222.7
105°	926.8	1018.3	186.1	219.4	231.7
107.5°	1143.3	1219.2	192.3	225.5	237.8
110°	1350.7	1414.4	533.6	228.8	240.8

TEST NUMBER: P923097

CATALOG NUMBER: DFN2DIP-SQ4F0-070D140US940-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1545.8	1600.4	1548.7	234.6	244.0
115°	1752.9	1804.6	1881.1	469.6	250.1
117.5°	1932.8	1993.6	2045.8	1609.5	810.9
120°	2134.1	2179.7	2234.7	2271.3	1859.7
122.5°	2304.6	2353.5	2414.7	2432.8	2436.1
125°	2478.4	2518.2	2576.2	2597.5	2606.6
127.5°	2637.0	2679.7	2725.6	2756.0	2759.0
130°	2786.4	2835.4	2868.6	2902.3	2899.4
132.5°	2938.9	2978.7	3012.0	3039.5	3036.6
135°	3067.0	3115.9	3143.0	3173.8	3167.6
137.5°	3201.0	3237.5	3268.3	3298.7	3289.7
140°	3332.1	3356.7	3389.9	3417.5	3402.2
142.5°	3442.1	3463.4	3502.9	3527.2	3511.9
145°	3557.9	3554.6	3606.4	3627.8	3612.6
147.5°	3658.2	3649.1	3701.0	3716.1	3704.2
150°	3756.0	3734.6	3783.4	3801.5	3786.4
152.5°	3838.1	3813.8	3859.5	3878.0	3856.6
155°	3917.4	3890.3	3926.8	3944.9	3920.7
157.5°	3981.5	3957.2	3984.8	4006.1	3981.5
160°	4036.5	4018.0	4036.5	4054.6	4033.3
162.5°	4085.0	4066.9	4082.2	4103.5	4076.0
165°	4127.7	4109.6	4118.7	4140.0	4118.7
167.5°	4161.4	4143.0	4152.3	4173.7	4146.2
170°	4188.9	4170.4	4176.6	4198.0	4170.4
172.5°	4207.0	4188.9	4195.1	4216.5	4188.9
175°	4222.2	4200.8	4207.0	4228.4	4198.0
177.5°	4228.4	4207.0	4210.3	4231.6	4204.1
180°	4213.2	4213.2	4213.2	4213.2	4213.2

TEST NUMBER: P923097

CATALOG NUMBER: DFN2DIP-SQ4F0-070D140US940-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	7.36	8.09	8.45	9.18	10.67	6.92	7.65	8.01	8.74	10.23
	3H	9.02	9.67	10.12	10.77	12.28	8.53	9.18	9.62	10.28	11.78
	4H	9.60	10.22	10.71	11.32	12.83	9.11	9.73	10.22	10.83	12.34
	6H	10.00	10.57	11.12	11.67	13.20	9.50	10.07	10.62	11.17	12.69
	8H	10.10	10.65	11.22	11.76	13.28	9.60	10.14	10.72	11.26	12.78
	12H	10.15	10.66	11.27	11.77	13.31	9.64	10.15	10.76	11.26	12.80
4H	2H	7.81	8.43	8.92	9.53	11.04	7.45	8.07	8.57	9.17	10.68
	3H	9.67	10.19	10.79	11.31	12.83	9.26	9.78	10.38	10.90	12.43
	4H	10.38	10.86	11.50	11.97	13.51	9.96	10.43	11.08	11.54	13.09
	6H	10.89	11.30	12.02	12.44	13.97	10.46	10.87	11.59	12.00	13.54
	8H	11.04	11.42	12.17	12.55	14.10	10.60	10.98	11.73	12.11	13.67
	12H	11.11	11.45	12.26	12.59	14.15	10.66	11.00	11.81	12.14	13.70
8H	4H	10.57	10.95	11.70	12.07	13.63	10.19	10.57	11.32	11.70	13.25
	6H	11.20	11.51	12.35	12.68	14.23	10.81	11.13	11.97	12.30	13.85
	8H	11.42	11.69	12.58	12.84	14.41	11.03	11.30	12.18	12.45	14.02
	12H	11.55	11.79	12.71	12.93	14.54	11.14	11.38	12.30	12.52	14.13
12H	4H	10.55	10.89	11.69	12.03	13.59	10.18	10.52	11.33	11.66	13.22
	6H	11.23	11.50	12.38	12.65	14.22	10.85	11.13	12.01	12.28	13.85
	8H	11.46	11.71	12.63	12.85	14.46	11.08	11.33	12.25	12.47	14.08

END OF REPORT