

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P923164

Luminaire Tested: DFN2DIP-SQ4F0-090D120US940-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P923164
REPORT IS A COMBINATION OF REPORTS P900173 AND P896915
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-090D120US940-FLLFLL
Description: 4 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -


Summary

Lumens per Lamp: N/A
Luminaire Lumens: 17415.1 lumens
Efficiency: N/A
Efficacy: 100.8 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 172.8
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.983
Total Harmonic Distortion (THDi): 0.073
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P923164
CATALOG NUMBER: DFN2DIP-SQ4F0-090D120US940-FLLFLL

Luminous Intensity Polar Plot

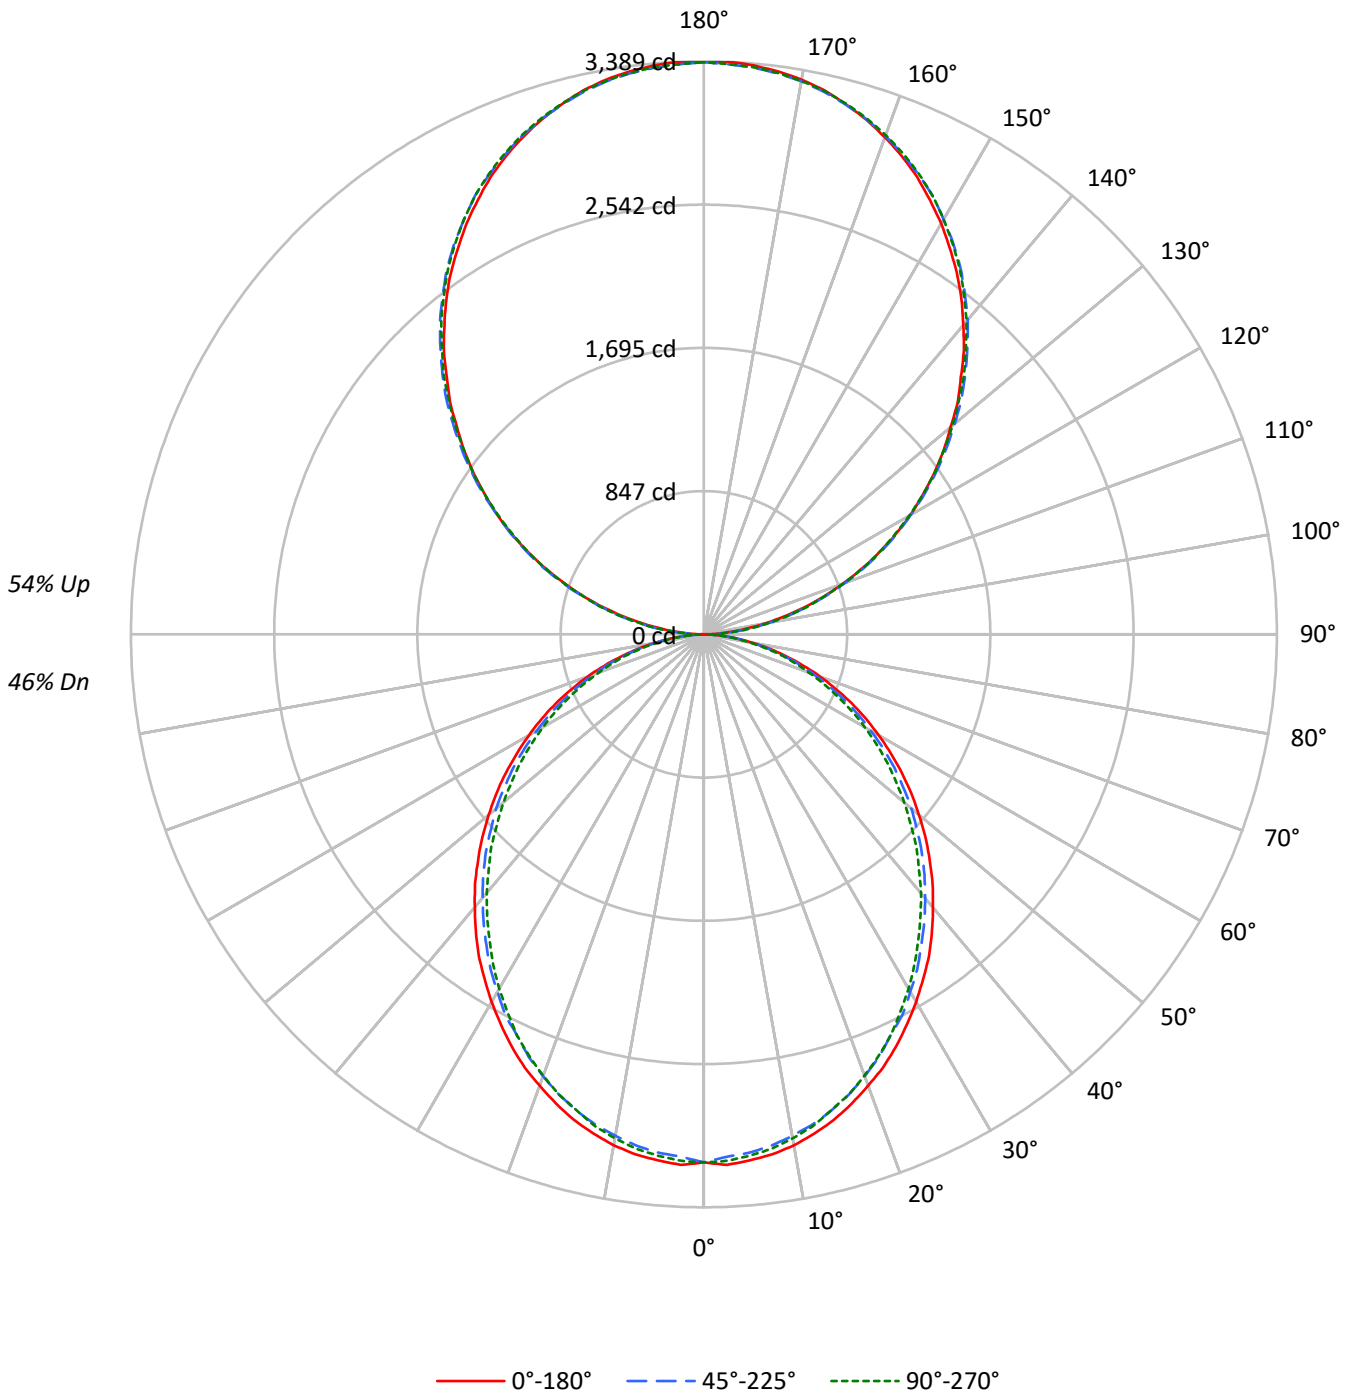



TEST NUMBER: P923164

CATALOG NUMBER: DFN2DIP-SQ4F0-090D120US940-FLLFLL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				20
RC	80				70				50				30				10				0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	106	106	106	106	97	97	97	97	81	81	81	66	66	66	52	52	52	46			46
1	97	93	89	85	89	85	82	79	71	69	66	58	56	55	46	45	44	38			38
2	88	81	75	70	81	74	69	65	62	58	55	51	48	46	41	39	37	32			32
3	80	71	64	58	73	65	59	54	55	50	46	45	42	39	36	34	32	27			27
4	74	63	55	49	67	58	51	46	49	43	39	40	36	33	32	29	27	23			23
5	67	56	48	42	62	52	45	39	44	38	34	36	32	29	29	26	24	20			20
6	62	50	42	36	57	46	39	34	39	34	30	33	28	25	26	23	21	18			18
7	57	45	37	32	53	42	35	30	36	30	26	30	25	22	24	21	19	16			16
8	53	41	33	28	49	38	31	26	32	27	23	27	23	20	22	19	17	14			14
9	50	37	30	25	45	35	28	24	30	24	21	25	21	18	20	17	15	13			13
10	46	34	27	22	42	32	25	21	27	22	19	23	19	16	19	16	14	12			12

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2191	2191	2191
5°	2195	2161	2176
10°	2177	2132	2147
15°	2145	2098	2102
20°	2101	2049	2055
25°	2058	1992	2001
30°	2004	1938	1933
35°	1953	1874	1860
40°	1890	1810	1791
45°	1828	1746	1720
50°	1759	1678	1638
55°	1687	1600	1563
60°	1606	1507	1477
65°	1517	1411	1376
70°	1405	1295	1267
75°	1248	1155	1167
80°	1060	976	975
85°	767	668	655

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°
 Vertical Angle: 90°
 Luminance: 2663 cd/sqm



TEST NUMBER: P923164

CATALOG NUMBER: DFN2DIP-SQ4F0-090D120US940-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	293.9	1.7
10°-20°	827.0	4.7
20°-30°	1215.3	7.0
30°-40°	1411.5	8.1
40°-50°	1409.7	8.1
50°-60°	1229.3	7.1
60°-70°	908.7	5.2
70°-80°	514.1	3.0
80°-90°	145.3	0.8
90°-100°	209.4	1.2
100°-110°	665.4	3.8
110°-120°	1138.7	6.5
120°-130°	1497.5	8.6
130°-140°	1680.9	9.7
140°-150°	1648.3	9.5
150°-160°	1382.7	7.9
160°-170°	917.0	5.3
170°-180°	320.5	1.8
0°-30°	2336.2	13.4
0°-40°	3747.7	21.5
0°-60°	6386.7	36.7
0°-90°	7954.8	45.7
90°-120°	2013.4	11.6
90°-150°	6840.1	39.3
90°-180°	9460.0	54.3
0°-180°	17415.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3123	3123	3123	3123	3123	
5°	3123	3111	3078	3102	3096	296
15°	2973	2955	2916	2928	2913	837
25°	2690	2666	2616	2621	2616	1238
35°	2321	2291	2243	2225	2210	1449
45°	1889	1868	1823	1790	1778	1458
55°	1430	1411	1375	1339	1324	1278
65°	964	946	916	889	874	953
75°	504	499	483	466	472	538
85°	123	120	117	108	105	137
90°	3	37	100	94	97	17
95°	149	178	183	183	178	166
105°	614	622	628	634	634	648
115°	1143	1159	1154	1151	1143	1130
125°	1662	1688	1679	1670	1667	1485
135°	2150	2181	2188	2184	2176	1662
145°	2610	2630	2646	2650	2638	1631
155°	2984	2992	3002	3016	3007	1374
165°	3246	3243	3243	3264	3250	916
175°	3378	3370	3364	3384	3367	321
180°	3384	3384	3384	3384	3384	



TEST NUMBER: P923164

CATALOG NUMBER: DFN2DIP-SQ4F0-090D120US940-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3122.7	3122.7	3122.7	3122.7	3122.7
2.5°	3140.9	3125.9	3092.8	3122.7	3117.0
5°	3122.7	3110.9	3077.8	3101.7	3095.9
7.5°	3101.7	3083.9	3050.7	3075.0	3068.9
10°	3068.9	3047.9	3011.8	3035.7	3026.8
12.5°	3023.6	3005.8	2969.8	2984.7	2978.8
15°	2972.7	2954.9	2915.6	2927.8	2912.8
17.5°	2909.6	2891.7	2852.6	2867.6	2852.6
20°	2840.5	2822.6	2780.5	2789.4	2777.7
22.5°	2771.6	2744.6	2705.4	2705.4	2699.3
25°	2690.4	2666.5	2615.6	2621.3	2615.6
27.5°	2600.2	2579.2	2540.4	2531.5	2516.5
30°	2510.4	2486.2	2441.2	2432.3	2420.3
32.5°	2414.2	2396.4	2348.2	2330.1	2318.0
35°	2321.2	2291.2	2243.1	2225.0	2210.0
37.5°	2216.1	2189.0	2140.8	2119.9	2104.9
40°	2108.0	2083.8	2035.7	2008.9	1996.9
42.5°	2002.9	1978.7	1930.9	1900.7	1882.8
45°	1888.8	1867.9	1822.6	1789.8	1777.7
47.5°	1777.7	1756.7	1708.5	1675.4	1657.6
50°	1660.5	1645.5	1603.4	1561.4	1546.4
52.5°	1546.4	1525.4	1486.5	1453.4	1432.4
55°	1429.5	1411.3	1375.3	1339.3	1324.4
57.5°	1312.2	1297.3	1258.1	1222.1	1210.0
60°	1195.0	1183.2	1141.1	1108.0	1099.1
62.5°	1080.9	1059.9	1029.9	1000.1	987.9
65°	964.0	945.8	915.9	888.9	873.9
67.5°	843.9	828.7	801.8	780.9	768.7
70°	732.7	720.6	693.6	672.5	660.8
72.5°	618.7	606.5	591.6	570.6	561.7
75°	504.4	498.6	483.3	465.5	471.5
77.5°	402.3	390.3	384.2	375.3	366.4
80°	300.4	297.2	291.1	282.2	276.3
82.5°	204.2	204.2	201.3	189.2	189.2
85°	123.0	120.1	117.3	108.0	105.1
87.5°	54.1	48.1	42.1	33.2	30.0
90°	3.0	36.7	100.0	93.9	96.9
92.5°	63.2	85.7	88.7	91.8	91.8
95°	148.9	177.5	182.6	182.6	177.5
97.5°	247.9	274.5	285.7	285.7	285.7
100°	362.2	385.7	393.8	393.8	390.7
102.5°	482.6	499.9	511.1	514.2	511.1
105°	614.2	622.3	628.5	633.6	633.6
107.5°	744.8	757.1	757.1	759.0	744.8
110°	871.3	887.6	887.6	887.6	879.5



TEST NUMBER: P923164

CATALOG NUMBER: DFN2DIP-SQ4F0-090D120US940-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1008.0	1025.4	1022.3	1014.1	1008.0
115°	1142.6	1159.0	1153.9	1150.8	1142.6
117.5°	1276.3	1298.8	1284.5	1276.3	1268.2
120°	1411.0	1433.4	1411.0	1411.0	1401.9
122.5°	1533.5	1562.0	1547.7	1539.5	1533.5
125°	1662.0	1687.5	1679.4	1670.2	1667.1
127.5°	1787.5	1819.1	1807.9	1795.6	1787.5
130°	1904.8	1941.5	1936.4	1930.3	1919.0
132.5°	2036.4	2065.0	2067.0	2052.7	2044.6
135°	2149.6	2181.3	2187.5	2184.3	2176.2
137.5°	2276.2	2301.7	2306.8	2304.7	2292.5
140°	2387.4	2412.9	2427.1	2427.1	2415.9
142.5°	2501.7	2527.2	2535.3	2538.3	2527.2
145°	2609.8	2630.2	2646.5	2649.6	2638.4
147.5°	2706.7	2732.2	2744.5	2749.6	2738.4
150°	2806.7	2824.0	2835.3	2844.5	2835.3
152.5°	2895.5	2912.8	2927.1	2938.4	2927.1
155°	2984.2	2992.4	3001.6	3015.9	3006.7
157.5°	3060.8	3066.9	3071.9	3092.4	3078.1
160°	3129.1	3135.3	3138.3	3155.7	3143.4
162.5°	3192.3	3192.3	3195.4	3214.8	3200.5
165°	3246.4	3243.4	3243.4	3263.7	3249.5
167.5°	3295.4	3286.2	3286.2	3306.6	3292.4
170°	3332.1	3323.9	3320.9	3341.3	3323.9
172.5°	3357.6	3349.4	3346.4	3366.8	3349.4
175°	3378.1	3369.9	3363.8	3384.1	3366.8
177.5°	3389.3	3381.1	3374.9	3392.3	3374.9
180°	3384.1	3384.1	3384.1	3384.1	3384.1



TEST NUMBER: P923164
 CATALOG NUMBER: DFN2DIP-SQ4F0-090D120US940-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.59	10.42	10.59	11.42	12.76	9.15	9.97	10.14	10.98	12.31
	3H	11.26	12.00	12.26	13.01	14.36	10.77	11.50	11.77	12.52	13.87
	4H	11.85	12.55	12.86	13.56	14.92	11.35	12.05	12.37	13.07	14.43
	6H	12.25	12.89	13.27	13.91	15.29	11.75	12.39	12.77	13.41	14.79
	8H	12.35	12.97	13.38	14.00	15.37	11.85	12.46	12.88	13.50	14.87
	12H	12.40	12.98	13.44	14.02	15.41	11.89	12.47	12.93	13.51	14.90
4H	2H	10.05	10.75	11.07	11.77	13.13	9.70	10.40	10.72	11.41	12.77
	3H	11.92	12.50	12.95	13.55	14.92	11.51	12.10	12.54	13.14	14.51
	4H	12.64	13.17	13.67	14.21	15.60	12.21	12.75	13.25	13.78	15.18
	6H	13.15	13.61	14.20	14.67	16.06	12.72	13.18	13.77	14.24	15.63
	8H	13.30	13.73	14.35	14.79	16.19	12.87	13.30	13.92	14.35	15.76
	12H	13.38	13.77	14.44	14.83	16.25	12.93	13.32	14.00	14.38	15.80
8H	4H	12.83	13.26	13.88	14.31	15.72	12.45	12.88	13.50	13.94	15.34
	6H	13.46	13.82	14.54	14.91	16.32	13.08	13.44	14.15	14.53	15.94
	8H	13.69	14.00	14.77	15.08	16.50	13.29	13.61	14.37	14.69	16.11
	12H	13.82	14.09	14.90	15.17	16.63	13.41	13.68	14.49	14.76	16.22
12H	4H	12.81	13.20	13.88	14.27	15.68	12.44	12.83	13.51	13.90	15.31
	6H	13.49	13.81	14.57	14.88	16.31	13.12	13.43	14.20	14.51	15.94
	8H	13.74	14.01	14.82	15.09	16.55	13.36	13.63	14.44	14.71	16.17