

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P923209

Luminaire Tested: DFN2DIP-SQ4F0-100D160US940-FLLONL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P923209
REPORT IS A COMBINATION OF REPORTS P901731 AND P898471
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-100D160US940-FLLONL
Description: 4 foot, Square Define Geo, with Direct Frosted Lens, Indirect Open No Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 22952.6 lumens
Efficiency: N/A
Efficacy: 106.9 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: Semi-Indirect

Input Watts (W): 214.8
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9968
Total Harmonic Distortion (THDi): 0.064
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P923209

CATALOG NUMBER: DFN2DIP-SQ4F0-100D160US940-FLLONL

Luminous Intensity Polar Plot

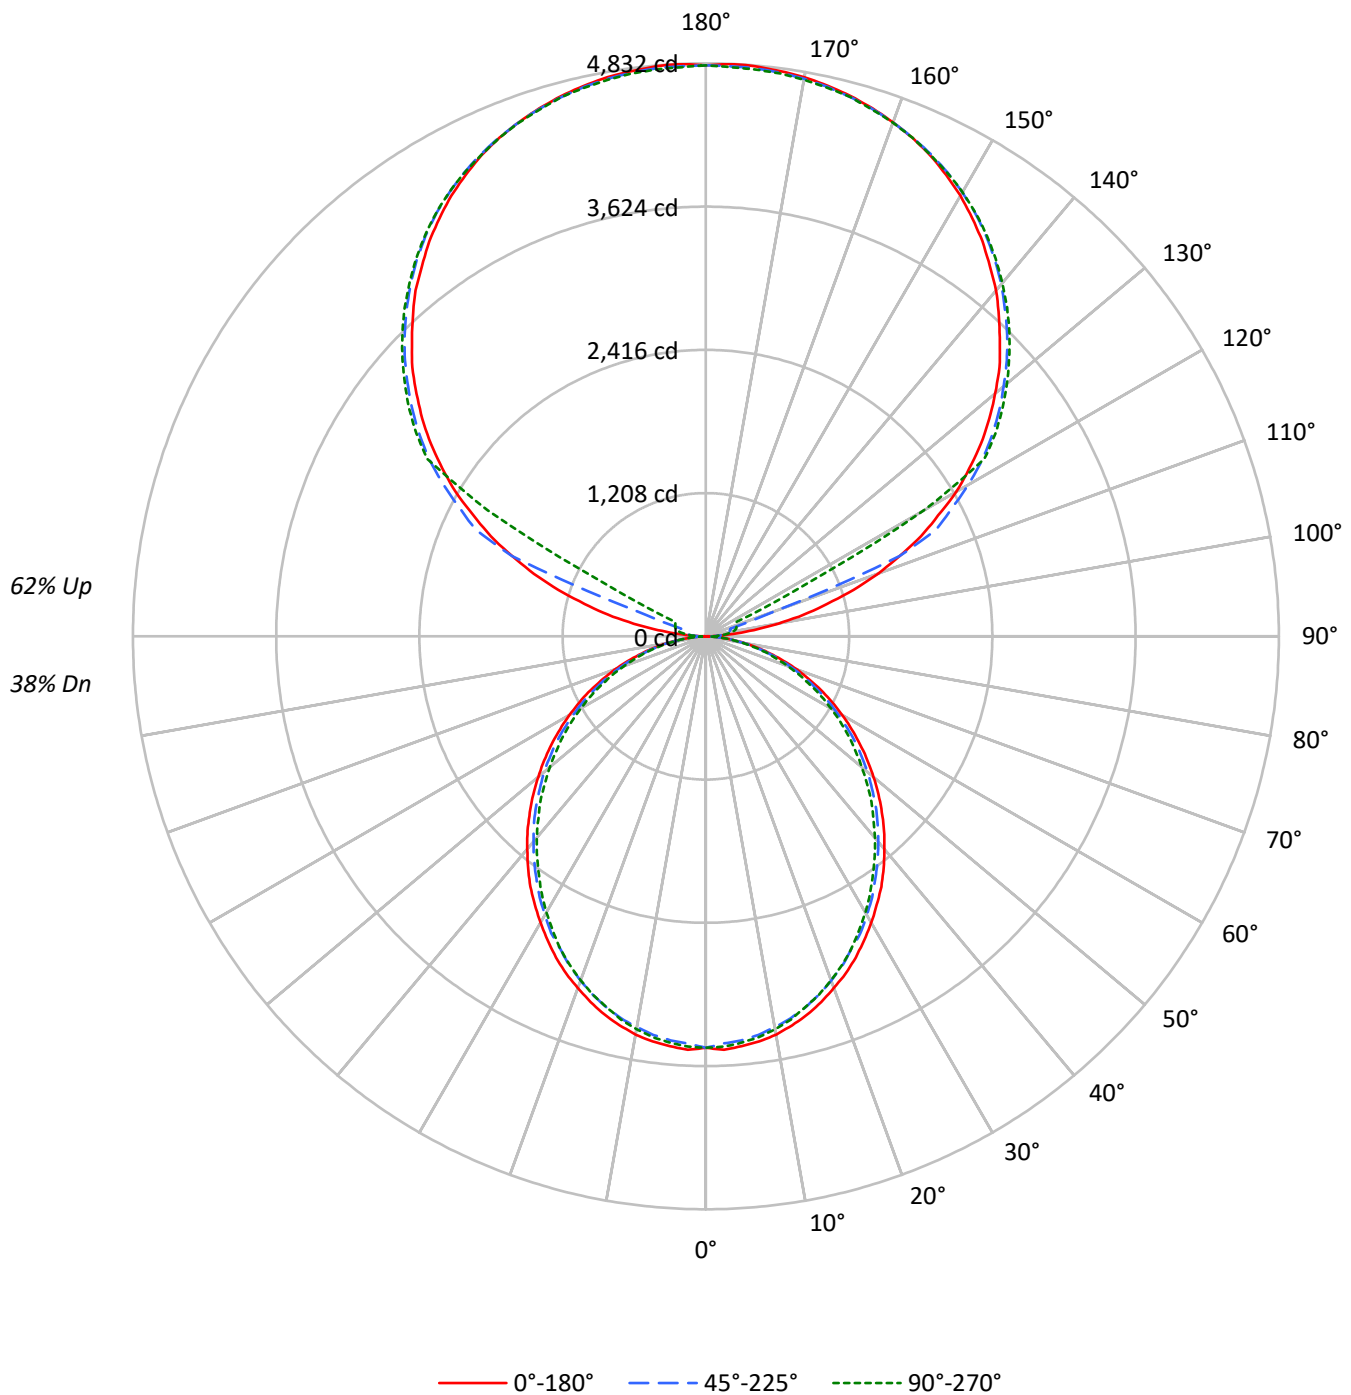

TEST NUMBER: P923209

CATALOG NUMBER: DFN2DIP-SQ4F0-100D160US940-FLONL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	104	104	104	104	95	95	95	95	77	77	77	61	61	61	46	46	46
1	95	91	87	84	86	83	80	77	67	65	63	53	52	50	40	39	38
2	87	79	73	68	78	72	67	63	59	55	52	47	44	42	35	34	32
3	79	70	63	57	71	64	57	52	52	48	44	41	38	36	31	29	28
4	72	62	54	48	65	56	50	44	46	41	37	37	33	30	28	26	24
5	66	55	47	41	60	50	43	38	41	36	32	33	29	26	25	23	21
6	61	49	41	36	55	45	38	33	37	32	28	30	26	23	23	20	18
7	56	44	36	31	51	41	34	29	34	28	25	27	23	20	21	18	16
8	52	40	33	27	47	37	30	25	31	25	22	25	21	18	19	16	14
9	49	37	29	24	44	34	27	23	28	23	19	23	19	16	18	15	13
10	45	33	26	22	41	31	25	20	26	21	17	21	17	15	16	14	12

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2435	2435	2435
5°	2438	2401	2418
10°	2419	2369	2386
15°	2383	2331	2335
20°	2335	2277	2283
25°	2287	2213	2224
30°	2227	2153	2147
35°	2170	2082	2066
40°	2100	2011	1990
45°	2031	1940	1911
50°	1954	1864	1820
55°	1875	1778	1737
60°	1784	1675	1641
65°	1686	1568	1528
70°	1561	1438	1407
75°	1387	1283	1297
80°	1178	1085	1083
85°	851	743	728

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2581 cd/sqm

TEST NUMBER: P923209

CATALOG NUMBER: DFN2DIP-SQ4F0-100D160US940-FLONL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	326.6	1.4
10°-20°	918.8	4.0
20°-30°	1350.3	5.9
30°-40°	1568.3	6.8
40°-50°	1566.4	6.8
50°-60°	1365.8	6.0
60°-70°	1009.7	4.4
70°-80°	571.3	2.5
80°-90°	159.2	0.7
90°-100°	158.8	0.7
100°-110°	591.9	2.6
110°-120°	1569.8	6.8
120°-130°	2603.6	11.3
130°-140°	2765.6	12.0
140°-150°	2570.3	11.2
150°-160°	2066.5	9.0
160°-170°	1331.6	5.8
170°-180°	458.3	2.0
0°-30°	2595.7	11.3
0°-40°	4164.0	18.1
0°-60°	7096.2	30.9
0°-90°	8836.4	38.5
90°-120°	2320.4	10.1
90°-150°	10259.9	44.7
90°-180°	14116.0	61.5
0°-180°	22952.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3470	3470	3470	3470	3470	
5°	3470	3457	3420	3446	3440	329
15°	3303	3283	3240	3253	3236	930
25°	2989	2963	2906	2912	2906	1376
35°	2579	2546	2492	2472	2456	1611
45°	2099	2075	2025	1989	1975	1620
55°	1588	1568	1528	1488	1472	1420
65°	1071	1051	1018	988	971	1059
75°	560	554	537	517	524	598
85°	137	134	130	120	117	152
90°	3	42	70	87	94	21
95°	226	111	136	154	150	268
105°	1059	1164	213	251	265	1132
115°	2003	2062	2150	537	286	1972
125°	2832	2878	2944	2969	2979	2526
135°	3505	3561	3592	3627	3620	2708
145°	4066	4062	4122	4146	4129	2543
155°	4477	4446	4488	4508	4481	2063
165°	4717	4697	4707	4732	4707	1333
175°	4825	4801	4808	4832	4798	459
180°	4815	4815	4815	4815	4815	

TEST NUMBER: P923209

CATALOG NUMBER: DFN2DIP-SQ4F0-100D160US940-FLONL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3469.7	3469.7	3469.7	3469.7	3469.7
2.5°	3489.9	3473.2	3436.4	3469.7	3463.3
5°	3469.7	3456.6	3419.8	3446.4	3440.0
7.5°	3446.4	3426.5	3389.7	3416.6	3409.9
10°	3409.9	3386.5	3346.5	3373.1	3363.2
12.5°	3359.6	3339.8	3299.8	3316.4	3309.7
15°	3303.0	3283.2	3239.6	3253.0	3236.5
17.5°	3232.9	3213.1	3169.5	3186.2	3169.5
20°	3156.0	3136.2	3089.5	3099.4	3086.3
22.5°	3079.6	3049.6	3006.0	3006.0	2999.3
25°	2989.4	2962.8	2906.2	2912.5	2906.2
27.5°	2889.1	2865.8	2822.6	2812.7	2796.0
30°	2789.4	2762.4	2712.5	2702.6	2689.1
32.5°	2682.4	2662.6	2609.1	2589.0	2575.5
35°	2579.1	2545.8	2492.3	2472.2	2455.5
37.5°	2462.3	2432.1	2378.7	2355.4	2338.7
40°	2342.3	2315.3	2261.9	2232.2	2218.8
42.5°	2225.4	2198.5	2145.5	2111.8	2092.0
45°	2098.7	2075.4	2025.1	1988.6	1975.2
47.5°	1975.2	1951.9	1898.4	1861.5	1841.7
50°	1844.9	1828.3	1781.5	1734.8	1718.2
52.5°	1718.2	1694.9	1651.6	1614.9	1591.5
55°	1588.3	1568.2	1528.1	1488.1	1471.5
57.5°	1458.0	1441.4	1397.8	1357.9	1344.4
60°	1327.8	1314.6	1267.9	1231.1	1221.2
62.5°	1201.0	1177.7	1144.4	1111.2	1097.7
65°	1071.1	1051.0	1017.7	987.6	971.0
67.5°	937.7	920.7	891.0	867.6	854.2
70°	814.1	800.7	770.6	747.3	734.1
72.5°	687.4	674.0	657.4	634.0	624.0
75°	560.4	554.0	537.0	517.2	523.9
77.5°	447.1	433.6	426.9	417.0	407.1
80°	333.8	330.3	323.5	313.6	306.9
82.5°	226.9	226.9	223.7	210.3	210.3
85°	136.6	133.5	130.3	120.0	116.8
87.5°	60.2	53.4	46.7	36.8	33.3
90°	3.3	41.8	69.5	87.3	93.9
92.5°	87.3	73.2	83.6	90.6	93.9
95°	226.3	111.3	135.7	153.5	149.8
97.5°	407.5	122.1	177.5	188.2	191.5
100°	616.9	139.5	198.6	226.3	233.4
102.5°	846.5	839.9	205.6	243.7	254.4
105°	1059.2	1163.9	212.7	250.7	264.7
107.5°	1306.5	1393.5	219.7	257.8	271.8
110°	1543.6	1616.5	609.8	261.4	275.1

TEST NUMBER: P923209

CATALOG NUMBER: DFN2DIP-SQ4F0-100D160US940-FLLONL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1766.7	1829.2	1770.0	268.1	278.8
115°	2003.3	2062.4	2149.7	536.6	285.9
117.5°	2208.9	2278.4	2338.1	1839.5	926.8
120°	2439.0	2491.1	2553.9	2595.8	2125.4
122.5°	2633.8	2689.7	2759.6	2780.3	2784.0
125°	2832.4	2877.9	2944.2	2968.6	2978.9
127.5°	3013.6	3062.5	3115.0	3149.8	3153.1
130°	3184.6	3240.4	3278.5	3316.9	3313.6
132.5°	3358.7	3404.2	3442.3	3473.7	3470.4
135°	3505.1	3561.0	3592.1	3627.2	3620.2
137.5°	3658.2	3700.1	3735.2	3770.0	3759.6
140°	3808.0	3836.1	3874.2	3905.7	3888.3
142.5°	3933.8	3958.2	4003.3	4031.1	4013.7
145°	4066.2	4062.5	4121.7	4146.0	4128.7
147.5°	4180.8	4170.4	4229.6	4247.0	4233.3
150°	4292.5	4268.1	4324.0	4344.7	4327.3
152.5°	4386.4	4358.7	4410.8	4432.0	4407.5
155°	4477.0	4446.0	4487.8	4508.5	4480.8
157.5°	4550.3	4522.6	4554.0	4578.4	4550.3
160°	4613.2	4592.0	4613.2	4633.9	4609.4
162.5°	4668.6	4648.0	4665.3	4689.7	4658.3
165°	4717.4	4696.7	4707.1	4731.5	4707.1
167.5°	4755.9	4734.8	4745.6	4769.9	4738.5
170°	4787.3	4766.3	4773.2	4797.7	4766.3
172.5°	4808.0	4787.3	4794.4	4818.8	4787.3
175°	4825.4	4801.0	4808.0	4832.4	4797.7
177.5°	4832.4	4808.0	4811.8	4836.2	4804.7
180°	4815.1	4815.1	4815.1	4815.1	4815.1

TEST NUMBER: P923209

CATALOG NUMBER: DFN2DIP-SQ4F0-100D160US940-FLLONL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.21	9.98	10.26	11.03	12.46	8.76	9.53	9.81	10.59	12.01
	3H	10.87	11.55	11.93	12.62	14.06	10.38	11.06	11.44	12.13	13.57
	4H	11.45	12.10	12.52	13.17	14.62	10.96	11.61	12.03	12.68	14.13
	6H	11.85	12.45	12.93	13.52	14.98	11.35	11.95	12.43	13.02	14.48
	8H	11.96	12.53	13.04	13.61	15.07	11.45	12.02	12.54	13.11	14.57
	12H	12.00	12.54	13.09	13.62	15.11	11.49	12.03	12.58	13.11	14.60
4H	2H	9.66	10.31	10.74	11.38	12.83	9.30	9.96	10.38	11.02	12.47
	3H	11.52	12.06	12.61	13.16	14.62	11.11	11.66	12.20	12.75	14.21
	4H	12.23	12.73	13.33	13.82	15.30	11.81	12.31	12.90	13.39	14.88
	6H	12.75	13.18	13.85	14.28	15.76	12.32	12.74	13.42	13.85	15.33
	8H	12.90	13.30	14.00	14.40	15.89	12.46	12.86	13.56	13.96	15.45
	12H	12.97	13.33	14.09	14.44	15.94	12.52	12.88	13.64	13.99	15.49
8H	4H	12.42	12.82	13.52	13.92	15.42	12.05	12.45	13.15	13.55	15.04
	6H	13.06	13.39	14.18	14.53	16.02	12.67	13.00	13.79	14.14	15.64
	8H	13.28	13.57	14.41	14.69	16.20	12.89	13.18	14.01	14.30	15.81
	12H	13.41	13.66	14.54	14.78	16.33	13.00	13.25	14.13	14.37	15.92
12H	4H	12.41	12.77	13.52	13.88	15.38	12.04	12.40	13.15	13.51	15.01
	6H	13.09	13.38	14.21	14.50	16.01	12.71	13.00	13.84	14.13	15.64
	8H	13.33	13.58	14.46	14.70	16.25	12.95	13.20	14.08	14.32	15.87

END OF REPORT