

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: NEO-RAY

Report Number: P923236

Luminaire Tested: DFN2DIP-SQ4F0-110D120US940-FLLFLL

Issue Date: 11/21/2024

Test Information

Test Method: LM-79-2019
Report Number: P923236
REPORT IS A COMBINATION OF REPORTS P900177 AND P896915
Test Lab: INNOVATION CENTER
Issue Date: 11/21/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: NEO-RAY
Catalog Number: DFN2DIP-SQ4F0-110D120US940-FLLFLL
Description: 4 foot, Square Define Geo, with Direct Frosted Lens, Indirect Frosted Lens
Light Source: -
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 19180.7 lumens
Efficiency: N/A
Efficacy: 98.3 lumens/watt
Spacing Criteria (0/90/45): 1.2 / 1.16 / 1.29
Luminous Opening: Rectangular w/ Sides (W: 3.92' x L: 3.92' x H: 0.1')
CIE Type: General Diffuse

Input Watts (W): 195.2
Input Voltage (V):
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: 0.9951
Total Harmonic Distortion (THDi): 0.07
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P923236

CATALOG NUMBER: DFN2DIP-SQ4F0-110D120US940-FLLFLL

Luminous Intensity Polar Plot

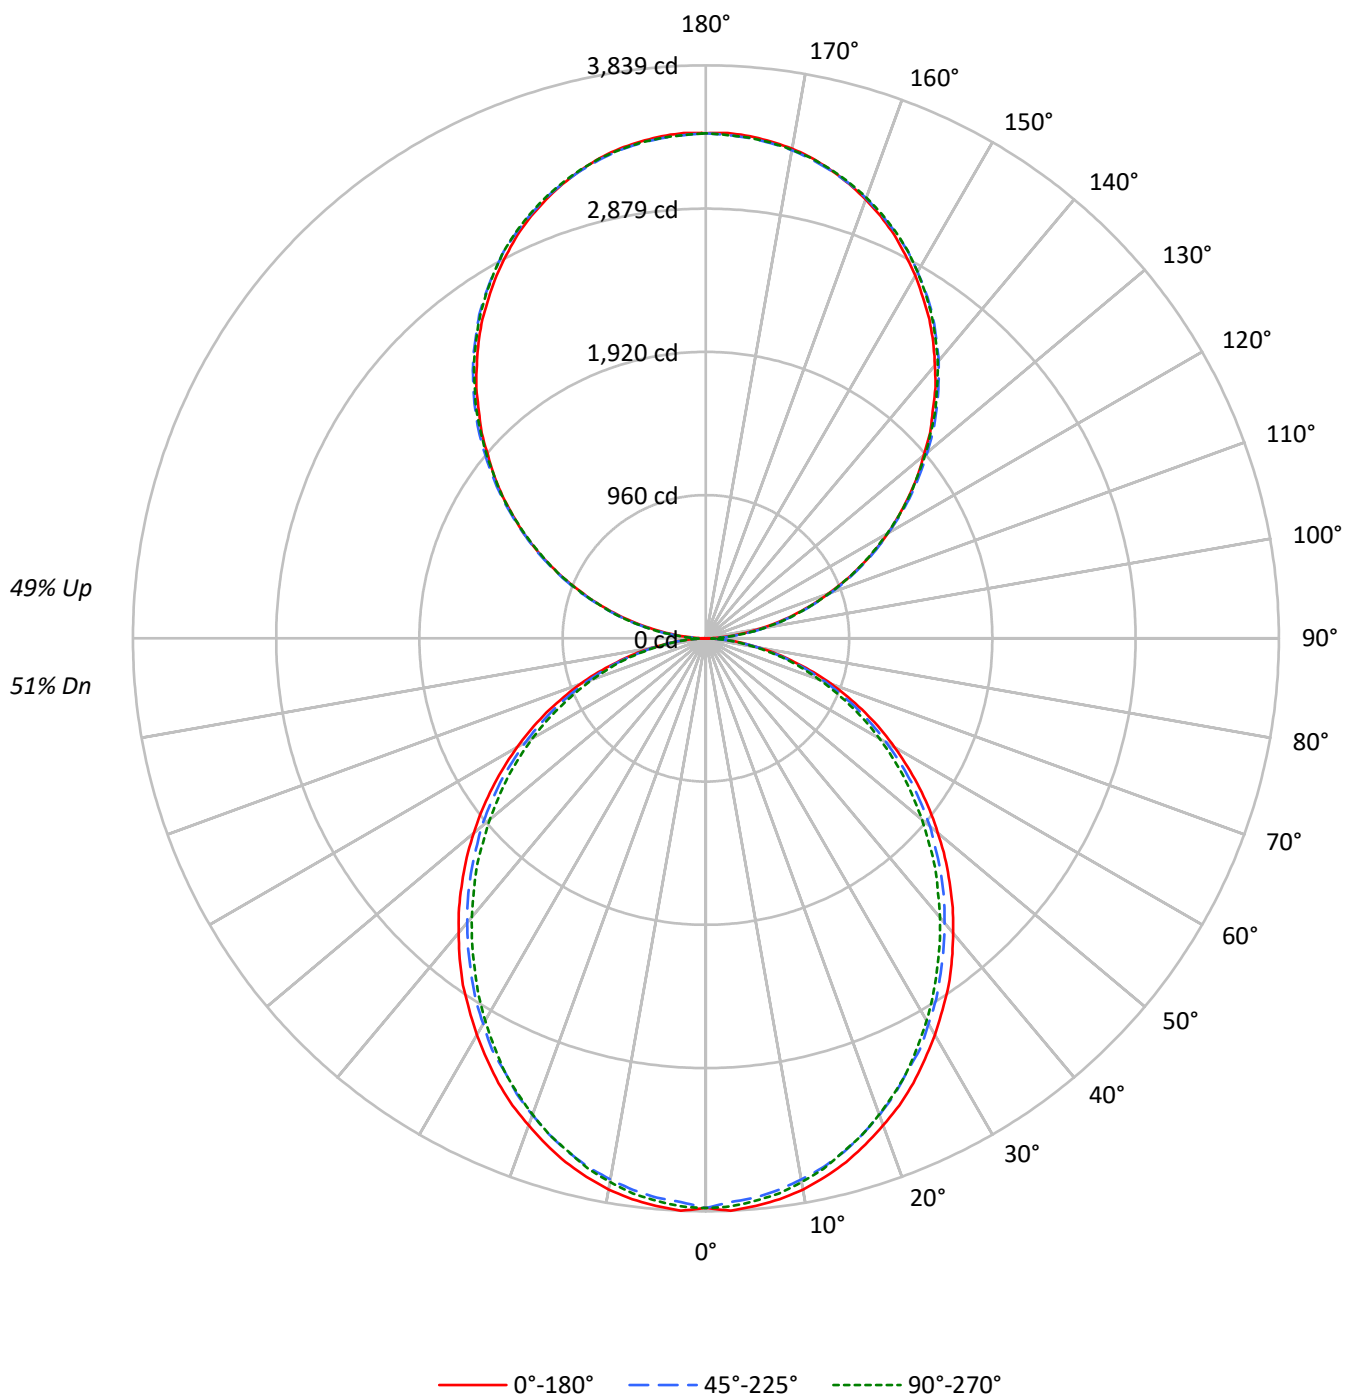

TEST NUMBER: P923236

CATALOG NUMBER: DFN2DIP-SQ4F0-110D120US940-FLLFL

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20
RC	80				70				50				30				10
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10
RCR																	
0	107	107	107	107	99	99	99	99	84	84	84	70	70	70	57	57	57
1	98	94	90	86	90	87	83	80	73	71	69	61	60	58	50	49	48
2	89	82	76	70	82	76	70	66	64	60	57	54	51	48	44	42	40
3	81	72	65	59	75	67	60	55	57	52	48	48	44	41	39	37	34
4	74	64	56	50	68	59	52	47	50	45	41	42	38	35	35	32	30
5	68	57	49	43	63	53	45	40	45	40	35	38	34	30	32	28	26
6	63	51	43	37	58	47	40	35	41	35	31	34	30	27	29	25	23
7	58	46	38	32	54	43	36	31	37	31	27	31	27	24	26	23	20
8	54	42	34	29	50	39	32	27	34	28	24	29	24	21	24	21	18
9	50	38	31	25	46	36	29	24	31	25	22	26	22	19	22	19	16
10	47	35	28	23	43	33	26	22	28	23	19	24	20	17	21	17	15

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	2678	2678	2678
5°	2682	2641	2659
10°	2661	2606	2624
15°	2621	2564	2569
20°	2568	2505	2512
25°	2516	2434	2446
30°	2450	2368	2362
35°	2387	2291	2273
40°	2311	2212	2189
45°	2234	2133	2102
50°	2150	2051	2002
55°	2062	1956	1910
60°	1963	1842	1805
65°	1855	1725	1681
70°	1717	1582	1548
75°	1526	1411	1426
80°	1296	1194	1192
85°	937	817	801

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 90°

Vertical Angle: 90°

Luminance: 2663 cd/sqm

TEST NUMBER: P923236

CATALOG NUMBER: DFN2DIP-SQ4F0-110D120US940-FLLFLL

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	359.2	1.9
10°-20°	1010.7	5.3
20°-30°	1485.4	7.7
30°-40°	1725.2	9.0
40°-50°	1723.0	9.0
50°-60°	1502.4	7.8
60°-70°	1110.6	5.8
70°-80°	628.4	3.3
80°-90°	175.5	0.9
90°-100°	209.4	1.1
100°-110°	665.4	3.5
110°-120°	1138.7	5.9
120°-130°	1497.5	7.8
130°-140°	1680.9	8.8
140°-150°	1648.3	8.6
150°-160°	1382.7	7.2
160°-170°	917.0	4.8
170°-180°	320.5	1.7
0°-30°	2855.3	14.9
0°-40°	4580.5	23.9
0°-60°	7805.9	40.7
0°-90°	9720.4	50.7
90°-120°	2013.4	10.5
90°-150°	6840.1	35.7
90°-180°	9460.0	49.3
0°-180°	19180.7	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	3817	3817	3817	3817	3817	
5°	3817	3802	3762	3791	3784	362
15°	3633	3611	3564	3578	3560	1023
25°	3288	3259	3197	3204	3197	1513
35°	2837	2800	2742	2719	2701	1772
45°	2309	2283	2228	2188	2173	1782
55°	1747	1725	1681	1637	1619	1562
65°	1178	1156	1120	1086	1068	1165
75°	616	609	591	569	576	658
85°	150	147	143	132	128	168
90°	3	37	100	94	97	19
95°	149	178	183	183	178	166
105°	614	622	628	634	634	648
115°	1143	1159	1154	1151	1143	1130
125°	1662	1688	1679	1670	1667	1485
135°	2150	2181	2188	2184	2176	1662
145°	2610	2630	2646	2650	2638	1631
155°	2984	2992	3002	3016	3007	1374
165°	3246	3243	3243	3264	3250	916
175°	3378	3370	3364	3384	3367	321
180°	3384	3384	3384	3384	3384	

TEST NUMBER: P923236

CATALOG NUMBER: DFN2DIP-SQ4F0-110D120US940-FLLFLL

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	3816.7	3816.7	3816.7	3816.7	3816.7
2.5°	3838.8	3820.5	3780.0	3816.7	3809.7
5°	3816.7	3802.3	3761.8	3790.9	3784.0
7.5°	3790.9	3769.2	3728.7	3758.3	3750.9
10°	3750.9	3725.1	3681.2	3710.3	3699.4
12.5°	3695.6	3673.8	3629.8	3648.1	3640.7
15°	3633.3	3611.4	3563.5	3578.3	3560.1
17.5°	3556.1	3534.4	3486.5	3504.8	3486.5
20°	3471.7	3449.8	3398.5	3409.4	3395.0
22.5°	3387.6	3354.4	3306.6	3306.6	3299.1
25°	3288.3	3259.1	3196.8	3203.8	3196.8
27.5°	3178.1	3152.4	3104.8	3094.0	3075.7
30°	3068.3	3038.7	2983.8	2972.9	2958.1
32.5°	2950.7	2928.9	2870.1	2847.9	2833.1
35°	2837.0	2800.4	2741.6	2719.4	2701.1
37.5°	2708.5	2675.4	2616.6	2590.9	2572.6
40°	2576.5	2546.9	2488.1	2455.4	2440.6
42.5°	2448.0	2418.4	2360.0	2323.0	2301.2
45°	2308.6	2282.9	2227.6	2187.5	2172.7
47.5°	2172.7	2147.1	2088.2	2047.7	2025.9
50°	2029.4	2011.2	1959.7	1908.3	1890.1
52.5°	1890.1	1864.3	1816.9	1776.3	1750.6
55°	1747.1	1724.9	1681.0	1636.9	1618.6
57.5°	1603.8	1585.6	1537.7	1493.6	1478.8
60°	1460.5	1446.2	1394.7	1354.2	1343.4
62.5°	1321.2	1295.5	1258.8	1222.3	1207.5
65°	1178.2	1156.0	1119.5	1086.4	1068.1
67.5°	1031.4	1012.8	980.1	954.4	939.6
70°	895.5	880.7	847.7	822.0	807.5
72.5°	756.2	741.4	723.1	697.4	686.4
75°	616.4	609.4	590.7	568.9	576.3
77.5°	491.8	477.0	469.6	458.7	447.8
80°	367.2	363.3	355.9	345.0	337.6
82.5°	249.6	249.6	246.1	231.3	231.3
85°	150.3	146.8	143.3	132.0	128.5
87.5°	66.2	58.8	51.4	40.5	36.6
90°	3.0	36.7	100.0	93.9	96.9
92.5°	63.2	85.7	88.7	91.8	91.8
95°	148.9	177.5	182.6	182.6	177.5
97.5°	247.9	274.5	285.7	285.7	285.7
100°	362.2	385.7	393.8	393.8	390.7
102.5°	482.6	499.9	511.1	514.2	511.1
105°	614.2	622.3	628.5	633.6	633.6
107.5°	744.8	757.1	757.1	759.0	744.8
110°	871.3	887.6	887.6	887.6	879.5

TEST NUMBER: P923236

CATALOG NUMBER: DFN2DIP-SQ4F0-110D120US940-FLLFLL

CANDELA DISTRIBUTION (continued):

	0°	22.5°	45°	67.5°	90°
112.5°	1008.0	1025.4	1022.3	1014.1	1008.0
115°	1142.6	1159.0	1153.9	1150.8	1142.6
117.5°	1276.3	1298.8	1284.5	1276.3	1268.2
120°	1411.0	1433.4	1411.0	1411.0	1401.9
122.5°	1533.5	1562.0	1547.7	1539.5	1533.5
125°	1662.0	1687.5	1679.4	1670.2	1667.1
127.5°	1787.5	1819.1	1807.9	1795.6	1787.5
130°	1904.8	1941.5	1936.4	1930.3	1919.0
132.5°	2036.4	2065.0	2067.0	2052.7	2044.6
135°	2149.6	2181.3	2187.5	2184.3	2176.2
137.5°	2276.2	2301.7	2306.8	2304.7	2292.5
140°	2387.4	2412.9	2427.1	2427.1	2415.9
142.5°	2501.7	2527.2	2535.3	2538.3	2527.2
145°	2609.8	2630.2	2646.5	2649.6	2638.4
147.5°	2706.7	2732.2	2744.5	2749.6	2738.4
150°	2806.7	2824.0	2835.3	2844.5	2835.3
152.5°	2895.5	2912.8	2927.1	2938.4	2927.1
155°	2984.2	2992.4	3001.6	3015.9	3006.7
157.5°	3060.8	3066.9	3071.9	3092.4	3078.1
160°	3129.1	3135.3	3138.3	3155.7	3143.4
162.5°	3192.3	3192.3	3195.4	3214.8	3200.5
165°	3246.4	3243.4	3243.4	3263.7	3249.5
167.5°	3295.4	3286.2	3286.2	3306.6	3292.4
170°	3332.1	3323.9	3320.9	3341.3	3323.9
172.5°	3357.6	3349.4	3346.4	3366.8	3349.4
175°	3378.1	3369.9	3363.8	3384.1	3366.8
177.5°	3389.3	3381.1	3374.9	3392.3	3374.9
180°	3384.1	3384.1	3384.1	3384.1	3384.1

TEST NUMBER: P923236

CATALOG NUMBER: DFN2DIP-SQ4F0-110D120US940-FLLFLL

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.77	11.64	11.72	12.60	13.86	10.32	11.19	11.27	12.16	13.42
	3H	12.43	13.21	13.40	14.19	15.47	11.94	12.72	12.91	13.70	14.98
	4H	13.02	13.76	14.00	14.74	16.03	12.53	13.27	13.51	14.25	15.54
	6H	13.43	14.11	14.42	15.09	16.40	12.93	13.61	13.91	14.59	15.90
	8H	13.53	14.18	14.53	15.18	16.49	13.03	13.68	14.03	14.68	15.98
	12H	13.59	14.20	14.58	15.20	16.52	13.08	13.69	14.07	14.69	16.01
4H	2H	11.23	11.97	12.21	12.95	14.24	10.88	11.61	11.86	12.59	13.89
	3H	13.10	13.72	14.09	14.73	16.03	12.69	13.31	13.69	14.32	15.63
	4H	13.82	14.38	14.82	15.38	16.71	13.40	13.96	14.40	14.96	16.29
	6H	14.34	14.82	15.35	15.85	17.18	13.91	14.39	14.92	15.42	16.74
	8H	14.49	14.94	15.50	15.96	17.31	14.05	14.51	15.07	15.53	16.87
	12H	14.57	14.98	15.60	16.01	17.36	14.12	14.53	15.15	15.56	16.91
8H	4H	14.02	14.47	15.03	15.49	16.83	13.64	14.09	14.65	15.11	16.45
	6H	14.65	15.03	15.69	16.09	17.43	14.27	14.64	15.31	15.71	17.05
	8H	14.88	15.21	15.92	16.25	17.61	14.48	14.81	15.53	15.86	17.22
	12H	15.01	15.30	16.06	16.34	17.75	14.60	14.89	15.65	15.93	17.33
12H	4H	14.00	14.41	15.03	15.45	16.79	13.64	14.04	14.67	15.08	16.43
	6H	14.68	15.01	15.73	16.06	17.42	14.31	14.64	15.36	15.69	17.05
	8H	14.93	15.22	15.98	16.26	17.66	14.55	14.84	15.60	15.88	17.28

END OF REPORT